



REFRIGERANT R410A  
INVERTER

AIR CONDITIONER

**Multi: 2, 3, 4 rooms type**

# DESIGN & TECHNICAL MANUAL

---

---

INDOOR



UIWH07AVFJ  
UIWH09AVFJ  
UIWH12AVFJ  
UIWH15AVFJ



UIWH18AVFJ  
UIWH24AVFJ

---

OUTDOOR



UOMH18AFXZJ  
UOMH24AFXZJ



UOMH36AFXZJ

---

**Notices:**

- Product specifications and design are subject to change without notice for future improvement.
- For further details, please check with our authorized dealer.

# CONTENTS

---

<b>Part 1. INDOOR UNIT</b> .....	<b>1</b>
<b>1. Model lineup</b> .....	<b>2</b>
1-1. Indoor unit connection patterns .....	3
<b>2. Specifications</b> .....	<b>5</b>
2-1. Wall mounted type .....	5
<b>3. Dimensions</b> .....	<b>7</b>
3-1. Wall mounted type .....	7
<b>4. Wiring diagrams</b> .....	<b>11</b>
4-1. Wall mounted type .....	11
<b>5. Air velocity and temperature distributions</b> .....	<b>13</b>
5-1. Wall mounted type .....	13
<b>6. Airflow</b> .....	<b>19</b>
6-1. Wall mounted type .....	19
<b>7. Noise level curve</b> .....	<b>21</b>
7-1. Wall mounted type .....	21
7-2. Sound level check point .....	24
<b>8. Electrical characteristics</b> .....	<b>25</b>
<b>9. Safety devices</b> .....	<b>26</b>
<b>10. External input and output</b> .....	<b>27</b>
10-1.External input.....	27
10-2.External output.....	29
<b>11. Remote controller</b> .....	<b>32</b>
11-1.Wireless remote controller (AR-RAH2U).....	32
11-2.Wireless remote controller (AR-REG1U).....	34
11-3.Wired remote controller (UXRNNUM: Optional part).....	36
11-4.Simple remote controller (UXRSNUM: Optional part) .....	40
<b>12. Function settings</b> .....	<b>45</b>
12-1.Indoor unit (setting by wireless remote controller).....	45
12-2.Indoor unit (setting by wired remote controller) .....	58
12-3.Indoor unit (setting by simple remote controller) .....	61
12-4.Function details.....	65
12-5.Wired remote controller.....	69
12-6.Simple remote controller .....	71
<b>13. Accessories</b> .....	<b>72</b>
13-1.Wall mounted type .....	72
<b>14. Optional parts</b> .....	<b>74</b>
14-1.Controllers .....	74
14-2.Others .....	75
<b>15. Indoor unit installation precautions</b> .....	<b>76</b>

## **CONTENTS (continued)**

15-1.Place where prohibited for use.....	76
15-2.Points to remember when installing .....	77

## CONTENTS (continued)

---

### Part 2. OUTDOOR UNIT (2 ROOMS TYPE) ..... 79

---

<b>1. Specifications</b> .....	<b>80</b>
1-1. Model: UOMH18AFXZJ .....	80
<b>2. Dimensions</b> .....	<b>81</b>
2-1. Model: UOMH18AFXZJ .....	81
<b>3. Installation space</b> .....	<b>82</b>
3-1. Model: UOMH18AFXZJ .....	82
<b>4. Refrigerant circuit</b> .....	<b>85</b>
4-1. Model: UOMH18AFXZJ .....	85
<b>5. Wiring diagram</b> .....	<b>86</b>
5-1. Model: UOMH18AFXZJ .....	86
<b>6. Capacity table</b> .....	<b>87</b>
6-1. Combinations .....	87
6-2. Cooling capacity.....	88
6-3. Heating capacity .....	93
<b>7. Capacity compensation rate for pipe length and height difference....</b>	<b>98</b>
7-1. Model: UOMH18AFXZJ .....	98
<b>8. Additional charge calculation</b> .....	<b>100</b>
8-1. Model: UOMH18AFXZJ .....	100
<b>9. Airflow</b> .....	<b>101</b>
9-1. Model: UOMH18AFXZJ .....	101
<b>10. Operation noise (sound pressure)</b> .....	<b>102</b>
10-1.Noise level curve.....	102
10-2.Sound level check point .....	102
<b>11. Electrical characteristics</b> .....	<b>103</b>
<b>12. Safety devices</b> .....	<b>104</b>
<b>13. Accessories</b> .....	<b>105</b>
<b>14. Outdoor unit installation precautions</b> .....	<b>106</b>
14-1.Place where prohibited for use.....	106
14-2.Points to remember when installing .....	106

## CONTENTS (continued)

---

### Part 3. OUTDOOR UNIT (3 ROOMS TYPE) ..... 107

---

<b>1. Specifications</b> .....	<b>108</b>
1-1. Model: UOMH24AFXZJ .....	108
<b>2. Dimensions</b> .....	<b>109</b>
2-1. Model: UOMH24AFXZJ .....	109
<b>3. Installation space</b> .....	<b>110</b>
3-1. Model: UOMH24AFXZJ .....	110
<b>4. Refrigerant circuit</b> .....	<b>113</b>
4-1. Model: UOMH24AFXZJ .....	113
<b>5. Wiring diagram</b> .....	<b>114</b>
5-1. Model: UOMH24AFXZJ .....	114
<b>6. Capacity table</b> .....	<b>115</b>
6-1. Combinations .....	115
6-2. Cooling capacity .....	117
6-3. Heating capacity .....	128
<b>7. Capacity compensation rate for pipe length and height difference.</b> ..	<b>139</b>
7-1. Model: UOMH24AFXZJ .....	139
<b>8. Additional charge calculation</b> .....	<b>142</b>
8-1. Model: UOMH24AFXZJ .....	142
<b>9. Airflow</b> .....	<b>143</b>
9-1. Model: UOMH24AFXZJ .....	143
<b>10. Operation noise (sound pressure)</b> .....	<b>144</b>
10-1.Noise level curve .....	144
10-2.Sound level check point .....	144
<b>11. Electrical characteristics</b> .....	<b>145</b>
<b>12. Safety devices</b> .....	<b>146</b>
<b>13. Accessories</b> .....	<b>147</b>
<b>14. Outdoor unit installation precautions</b> .....	<b>148</b>
14-1.Place where prohibited for use .....	148
14-2.Points to remember when installing .....	148

## CONTENTS (continued)

---

<b>Part 4. OUTDOOR UNIT (4 ROOMS TYPE)</b> .....	<b>149</b>
<b>1. Specifications</b> .....	<b>150</b>
1-1. Model: UOMH36AFXZJ .....	150
<b>2. Dimensions</b> .....	<b>151</b>
2-1. Model: UOMH36AFXZJ .....	151
<b>3. Installation space</b> .....	<b>152</b>
3-1. Model: UOMH36AFXZJ .....	152
<b>4. Refrigerant circuit</b> .....	<b>155</b>
4-1. Model: UOMH36AFXZJ .....	155
<b>5. Wiring diagram</b> .....	<b>156</b>
5-1. Model: UOMH36AFXZJ .....	156
<b>6. Capacity table</b> .....	<b>157</b>
6-1. Combinations .....	157
6-2. Cooling capacity .....	159
6-3. Heating capacity .....	178
<b>7. Capacity compensation rate for pipe length and height difference.</b> ..	<b>197</b>
7-1. Model: UOMH36AFXZJ .....	197
<b>8. Additional charge calculation</b> .....	<b>201</b>
8-1. Model: UOMH36AFXZJ .....	201
<b>9. Airflow</b> .....	<b>202</b>
9-1. Model: UOMH36AFXZJ .....	202
<b>10. Operation noise (sound pressure)</b> .....	<b>203</b>
10-1.Noise level curve .....	203
10-2.Sound level check point .....	203
<b>11. Electrical characteristics</b> .....	<b>204</b>
<b>12. Safety devices</b> .....	<b>205</b>
<b>13. Accessories</b> .....	<b>206</b>
<b>14. Optional parts</b> .....	<b>207</b>
14-1.2 rooms combination (with optional part RXK9FZ1818) .....	207
<b>15. Outdoor unit installation precautions</b> .....	<b>209</b>
15-1.Place where prohibited for use .....	209
15-2.Points to remember when installing .....	209





# **Part 1. INDOOR UNIT**

---

## **WALL MOUNTED TYPE:**

**UIWH07AVFJ**

**UIWH09AVFJ**



**UIWH12AVFJ**

**UIWH15AVFJ**

**UIWH18AVFJ**

**UIWH24AVFJ**

# 1. Model lineup

Indoor unit	
UIWH07AVFJ UIWH09AVFJ UIWH12AVFJ UIWH15AVFJ	UIWH18AVFJ UIWH24AVFJ
	

Outdoor unit		
UOMH18AFXZJ	UOMH24AFXZJ	UOMH36AFXZJ
		

## ● Indoor units that can be connected to each outdoor unit

●: Connectable / —: Not connectable

Outdoor unit		Wall mounted					
		UIWH07—15AVFJ				UIWH18, 24AVFJ	
	kBtu class	7	9	12	15	18	24
2 rooms	UOMH18AFXZJ	●	●	●	—	—	—
3 rooms	UOMH24AFXZJ	●	●	●	●	●	—
4 rooms	UOMH36AFXZJ	●	●	●	●	●	●

## 1-1. Indoor unit connection patterns

### ● 2 rooms

UOMH18AFXZJ			
No.	Room 1	Room 2	Total
1	7	7	14
2	7	9	16
3	7	12	19
4	9	9	18
5	9	12	21

7: 7,000Btu/h, 9: 9,000Btu/h, 12: 12,000Btu/h

### ● 3 rooms

UOMH24AFXZJ				
No.	Room 1	Room 2	Room 3	Total
1	7	7	—	14
2	7	9	—	16
3	7	12	—	19
4	7	15	—	22
5	7	18	—	25
6	9	9	—	18
7	9	12	—	21
8	9	15	—	24
9	9	18	—	27
10	12	12	—	24
11	12	15	—	27
12	7	7	7	21
13	7	7	9	23
14	7	7	12	26
15	7	9	9	25
16	9	9	9	27

7: 7,000Btu/h, 9: 9,000Btu/h, 12: 12,000Btu/h, 15: 14,000Btu/h, 18: 18,000Btu/h,

## ● 4 rooms

UOMH36AFXZJ					
No.	Room 1	Room 2	Room 3	Room 4	Total
1	18*1	18*1	—	—	36
2	7	7	15	—	29
3	7	7	18	—	32
4	7	7	24	—	38
5	7	9	12	—	28
6	7	9	15	—	31
7	7	9	18	—	34
8	7	12	12	—	31
9	7	12	15	—	34
10	7	12	18	—	37
11	9	9	9	—	27
12	9	9	12	—	30
13	9	9	15	—	33
14	9	9	18	—	37
15	9	12	12	—	33
16	9	12	15	—	36
17	9	12	18	—	39
18	12	12	12	—	36
19	12	12	15	—	39
20	7	7	7	7	28
21	7	7	7	9	30
22	7	7	7	12	33
23	7	7	7	15	36
24	7	7	7	18*2	39
25	7	7	9	9	32
26	7	7	9	12	35
27	7	7	9	15	38
28	7	7	12	12	38
29	7	9	9	9	34
30	7	9	9	12	37
31	9	9	9	9	36

7: 7,000Btu/h, 9: 9,000Btu/h, 12: 12,000Btu/h, 15: 14,000Btu/h, 18: 18,000Btu/h,  
24: 24,000Btu/h

\*1: Optional kit RXK9FZ1818 shall be necessary for the dual zone system "18 + 18".

\*2: Wall mounted type UIWH18AVFJ cannot be connected in this combination.

## 2. Specifications

### 2-1. Wall mounted type


Model name			UIWH07AVFJ	UIWH09AVFJ	UIWH12AVFJ	UIWH15AVFJ	
Power supply			208/230 V ~ 60 Hz				
Available voltage range			187—264 V				
Capacity		Btu/h class	7,000	9,000	12,000	14,000	
Input power		W	15	17	22	28	
Running current		A	0.13	0.15	0.19	0.25	
Fan	Airflow rate	Cooling	HIGH	330 (560)	353 (600)	388 (660)	430 (730)
			MED	294 (500)	306 (520)	330 (560)	353 (600)
			LOW	253 (430)	253 (430)	265 (450)	312 (530)
			QUIET	182 (310)	182 (310)	182 (310)	212 (360)
		Heating	HIGH	330 (560)	353 (600)	388 (660)	430 (730)
			MED	294 (500)	306 (520)	330 (560)	362 (615)
			LOW	253 (430)	253 (430)	277 (470)	330 (560)
			QUIET	194 (330)	194 (330)	194 (330)	221 (375)
	Type × Q'ty	Cross flow fan × 1					
	Motor output	W	30				
Sound pressure level *	Cooling	HIGH	36	37	40	42	
		MED	32	33	36	38	
		LOW	29	29	30	33	
		QUIET	21	21	21	25	
	Heating	HIGH	36	37	40	42	
		MED	32	33	36	38	
		LOW	29	29	31	35	
		QUIET	22	22	22	27	
Heat exchanger type	Dimensions (H × W × D)	in (mm)	Main: 12-5/8 × 24-13/16 × 13/16 (320 × 630 × 20) Sub: 3-5/16 × 24-13/16 × 1/2 (84 × 630 × 13.3)				
	Fin pitch	FPI	Main: 23, Sub: 18				
	Rows × Stages		Main: 2 × 20, Sub: 1 × 4				
	Pipe type		Copper tube				
	Fin type		Aluminum				
Enclosure	Material	Polystyrene					
	Color	White (Approximate color of MUNSELL N9.25 /)					
Dimensions (H × W × D)	Net	in (mm)	10-5/8 × 34-1/4 × 8-1/16 (270 × 870 × 204)				
	Gross		10-5/8 × 36-7/16 × 13-1/4 (270 × 925 × 336)				
Weight	Net	lb (kg)	19 (8.5)				
	Gross		24 (11)				
Connection pipe	Size	Liquid	Ø1/4 (Ø6.35)				
		Gas	Ø3/8 (Ø9.52)		Ø1/2 (Ø12.70)		
	Method	Flare					
Drain hose	Material	PP + LLDPE					
	Size	in (mm)	Ø 9/16(I.D.), Ø 5/8 to Ø 11/16(O.D.) [Ø 13.8(I.D.), Ø 15.8 to Ø 16.7(O.D.)]				
Operation range	Cooling	°F (°C)	64 to 90 (18 to 32)				
		%RH	80 or less				
Remote controller type	Heating	°F (°C)	60 to 88 (16 to 30)				
			Wireless (Wired [option])				
<b>NOTES:</b> <ul style="list-style-type: none"> <li>The protective function might work when using it outside the operation range.</li> <li>*Sound pressure level: <ul style="list-style-type: none"> <li>Measured values in manufacturer's anechoic chamber.</li> <li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li> </ul> </li> </ul>							

Model name				UIWH18AVFJ		UIWH24AVFJ	
Power supply				208/230 V ~ 60 Hz			
Available voltage range				187—264 V			
Capacity			Btu/h class	18,000	24,000		
Input power			W	41	69		
Running current			A	0.32	0.53		
Fan	Airflow rate	Cooling	HIGH	CFM (m <sup>3</sup> /h)	542 (920)		
			MED		659 (1,120)		
			LOW		530 (900)		
			QUIET		436 (740)		
		Heating	HIGH		647 (1,100)		
			MED		530 (900)		
			LOW		436 (740)		
			QUIET		365 (620)		
	Type × Qty	Cross flow fan × 1					
	Motor output			W	42		
Sound pressure level *	Cooling	HIGH	dB (A)	43			
		MED		49			
		LOW		42			
		QUIET		37			
	Heating	HIGH		33			
		MED		31			
		LOW		44			
		QUIET		48			
Heat exchanger type	Dimensions (H × W × D)		in (mm)	Main: 15-7/8 × 33-3/4 × 1-1/16 (378 × 832 × 26.6) Sub: 3-5/16 × 33-3/4 × 1/2 (84 × 832 × 13.3)			
	Fin pitch		FPI	Main: 21, Sub: 18			
	Rows × Stages			Main: 2 × 18, Sub: 1 × 4			
	Pipe type			Copper tube			
	Fin type			Aluminum			
Enclosure	Material			Polystyrene			
	Color			White (Approximate color of MUNSELL N9.25 I)			
Dimensions (H × W × D)	Net		in (mm)	12-5/8 × 39-5/16 × 9-3/8 (320 × 998 × 238)			
	Gross			12-15/16 × 42-15/16 × 16-9/16 (329 × 1,090 × 420)			
Weight	Net		lb (kg)	31 (14)			
	Gross			40 (18)			
Connection pipe	Size	Liquid	mm (in)	Ø1/4 (Ø6.35)			
		Gas		Ø1/2 (Ø12.70)		Ø5/8 (Ø15.88)	
Drain hose	Method			Flare			
	Material			PVC			
Operation range	Size		in (mm)	Ø 1/2(I.D.), Ø 5/8(O.D.) [Ø 12(I.D.), Ø 16(O.D.)]			
	Cooling	°F (°C)		64 to 90 (18 to 32)			
%RH		80 or less					
Remote controller type	Heating		°F (°C)		60 to 88 (16 to 30)		
							Wireless (Wired [option])
<b>NOTES:</b>							
<ul style="list-style-type: none"> <li>• The protective function might work when using it outside the operation range.</li> <li>• *Sound pressure level: <ul style="list-style-type: none"> <li>– Measured values in manufacturer's anechoic chamber.</li> <li>– Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li> </ul> </li> </ul>							

### 3. Dimensions

#### 3-1. Wall mounted type

■ Models: UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ

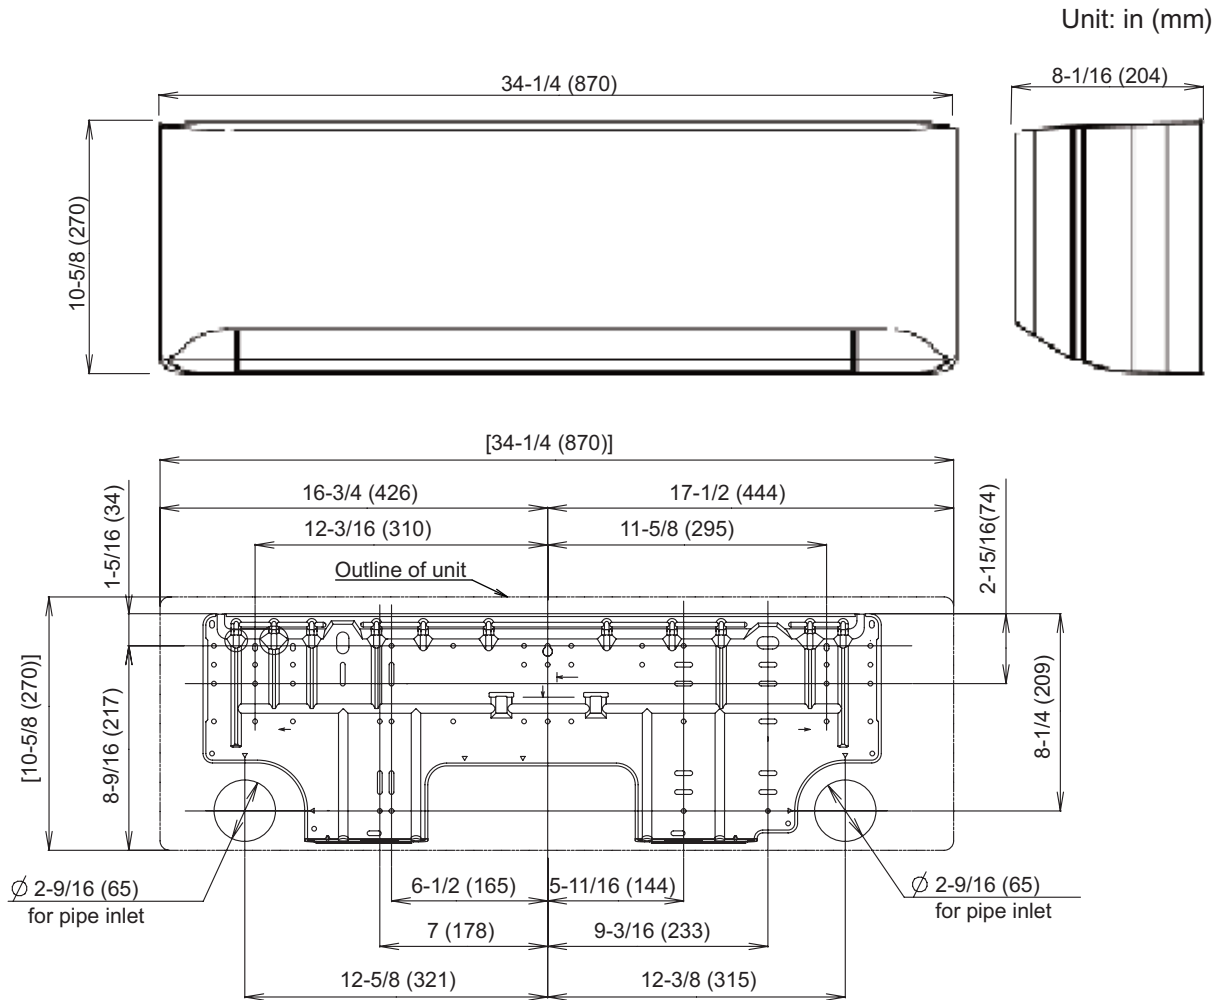



## ● Installation space requirement

Provide sufficient installation space for product safety.

### ⚠ CAUTION

Do not place any other electrical products or household belongings under the product. Condensation dripping from the product might get them wet, and may cause damage or malfunction to the property.



Unit: in (mm)

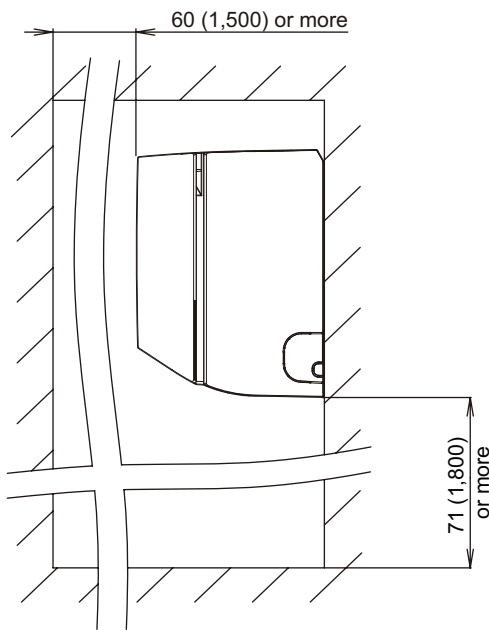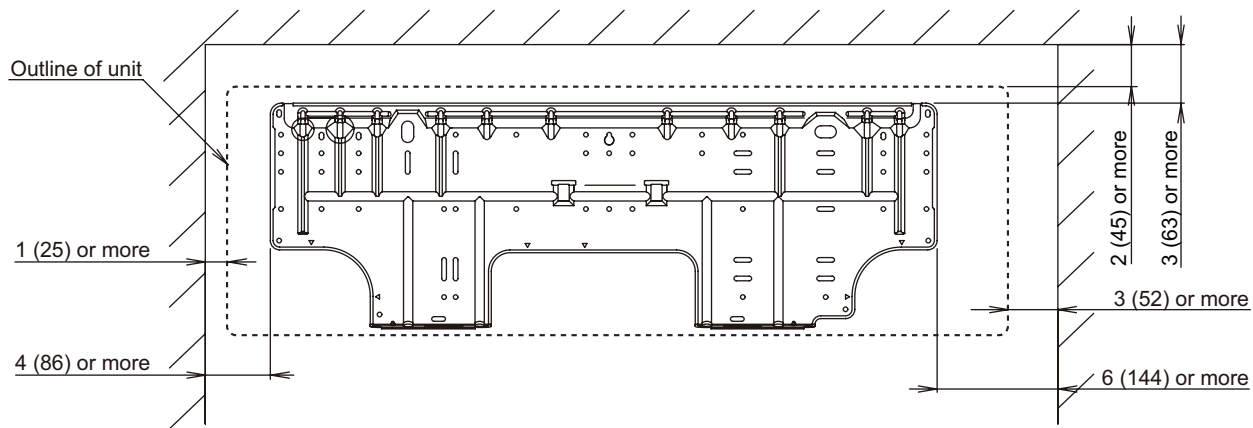



■ Models: UIWH18AVFJ and UIWH24AVFJ

Unit: in (mm)

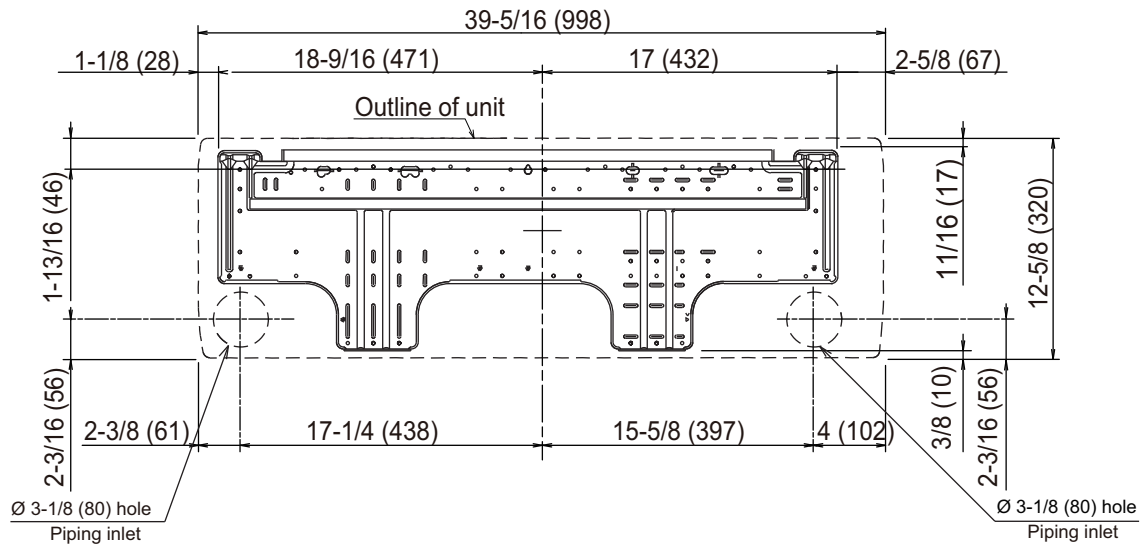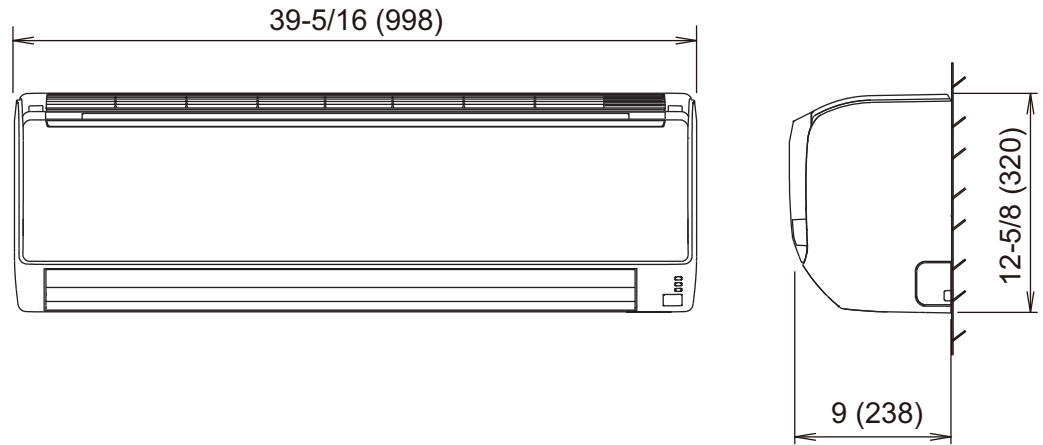



MULTI TYPE  
2, 3, 4 ROOMS TYPE

## ● Installation space requirement

Provide sufficient installation space for product safety.

### ⚠ CAUTION


Do not place any other electrical products or household belongings under the product. Condensation dripping from the product might get them wet, and may cause damage or malfunction to the property.

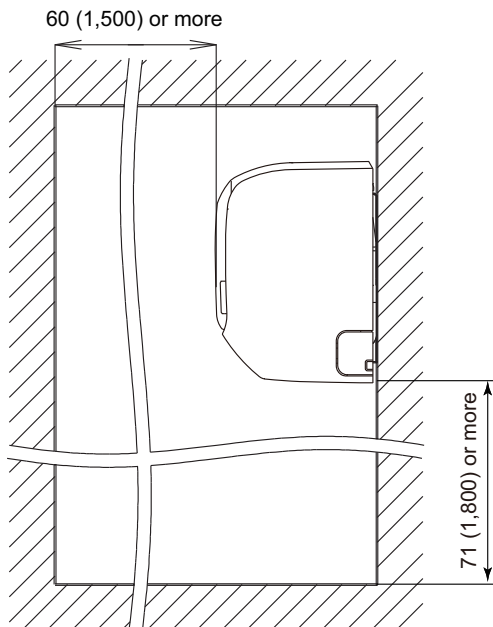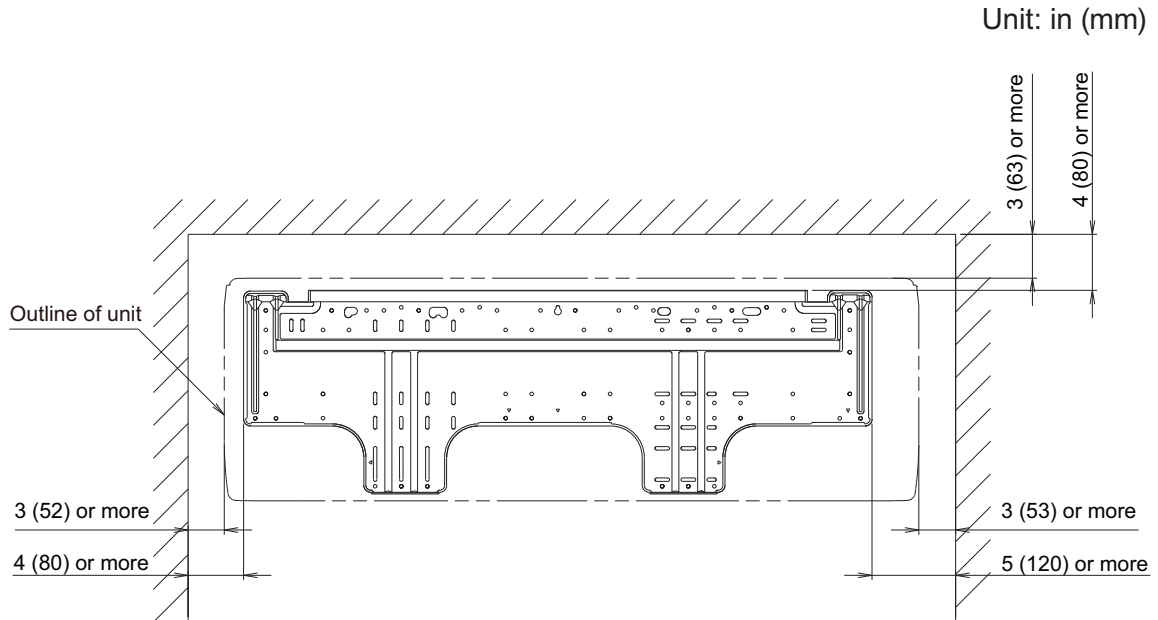


## 4. Wiring diagrams

### 4-1. Wall mounted type

■ Models: UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ

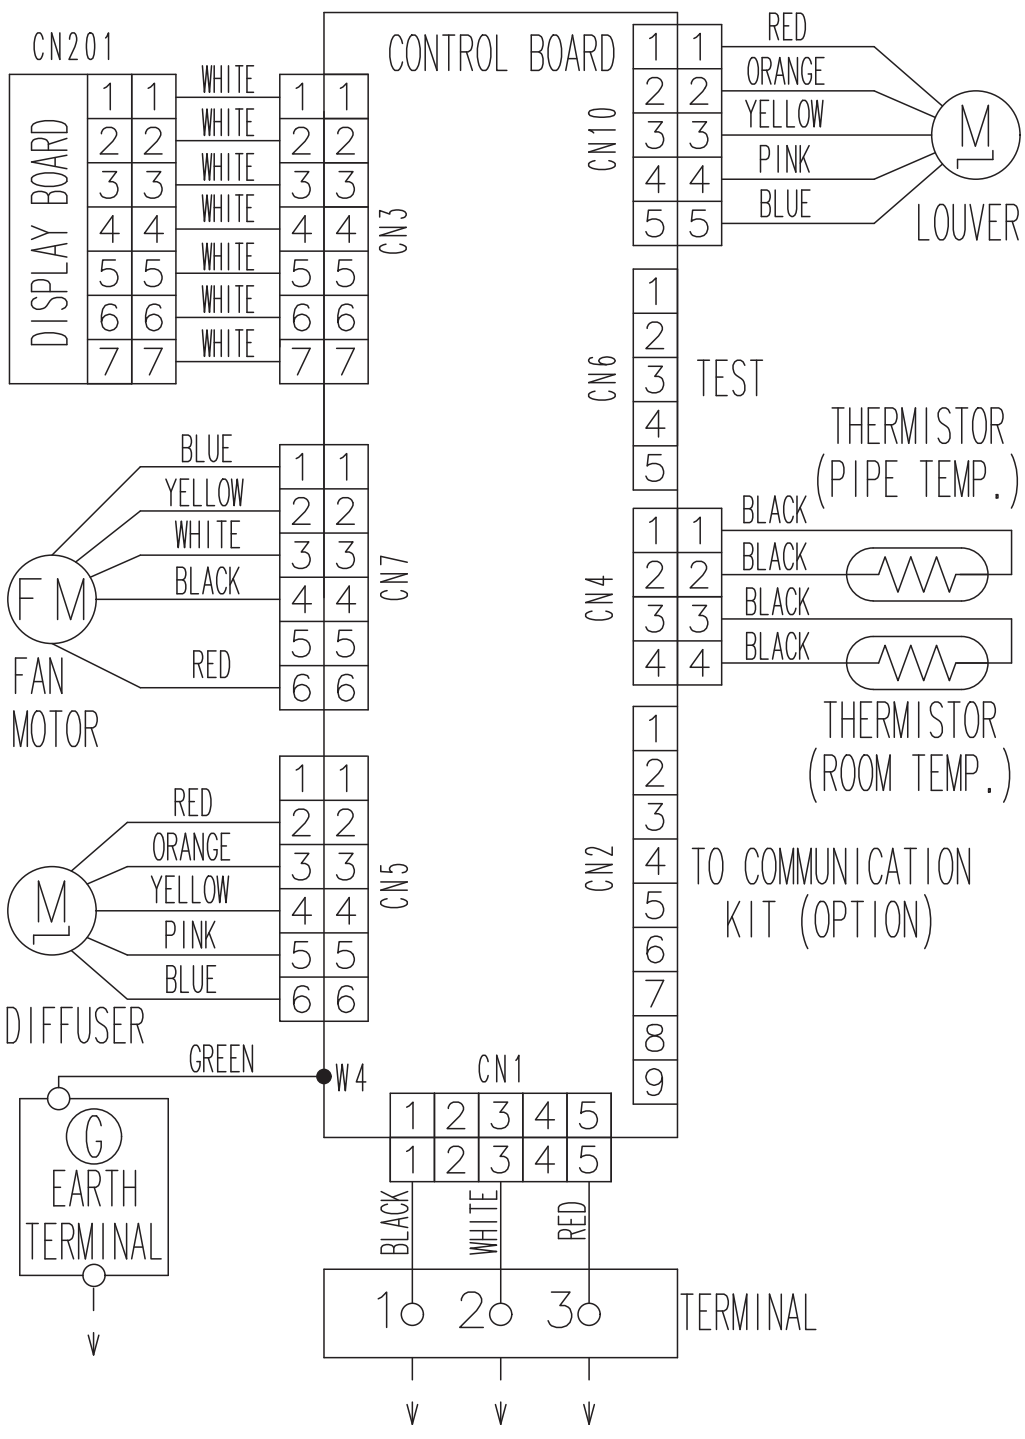

## Models: UIWH18AVFJ and UIWH24AVFJ




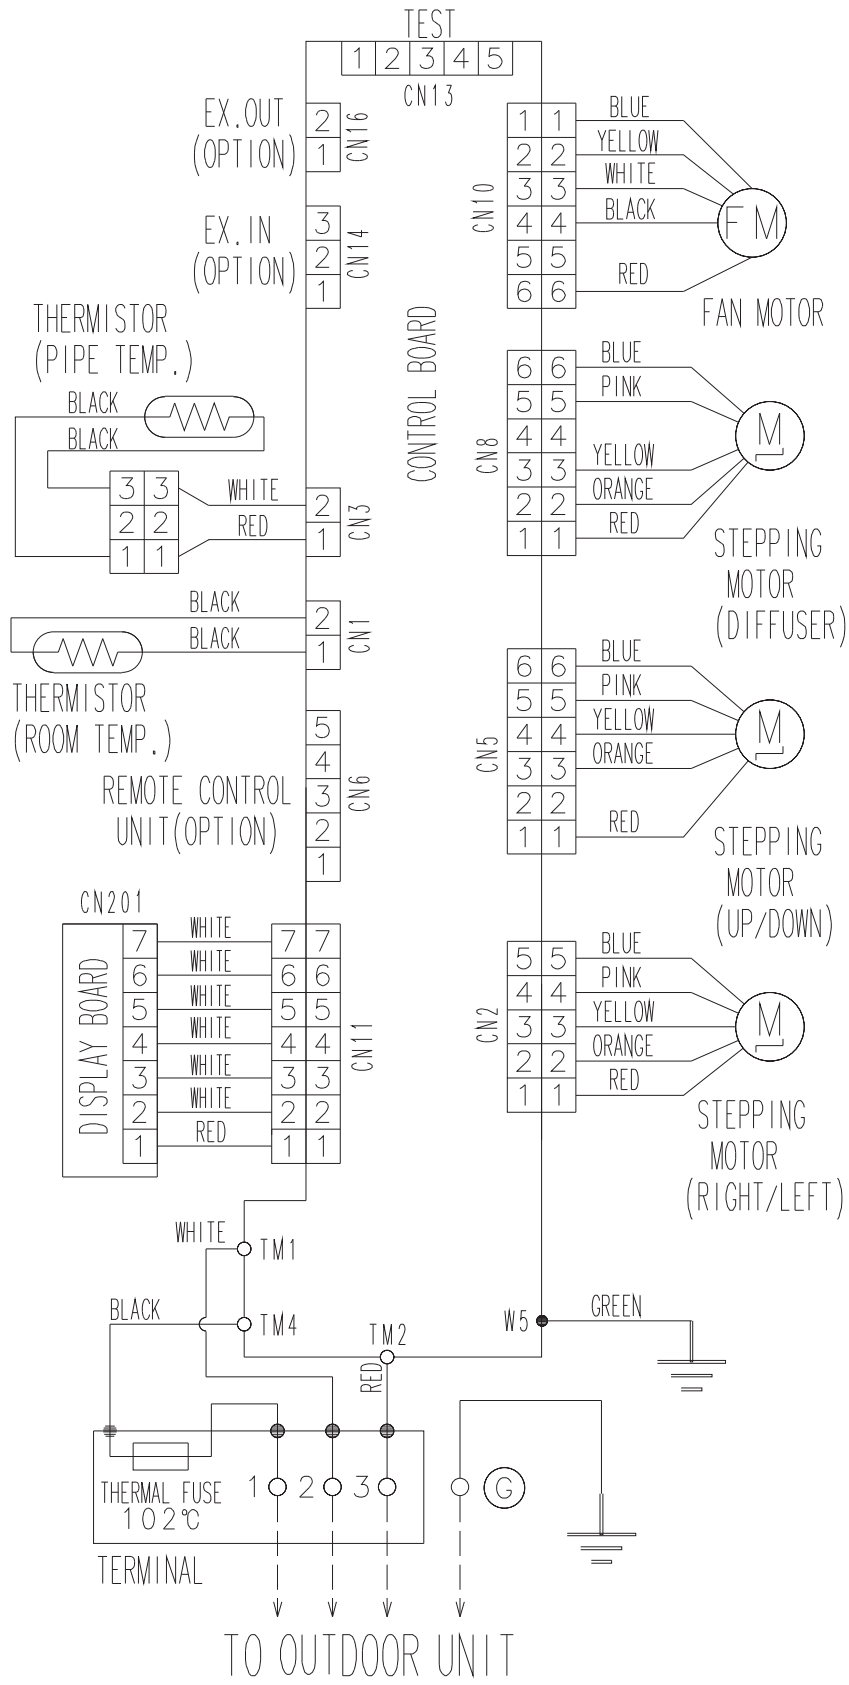


# 5. Air velocity and temperature distributions

## 5-1. Wall mounted type

### Model: UIWH07AVFJ


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

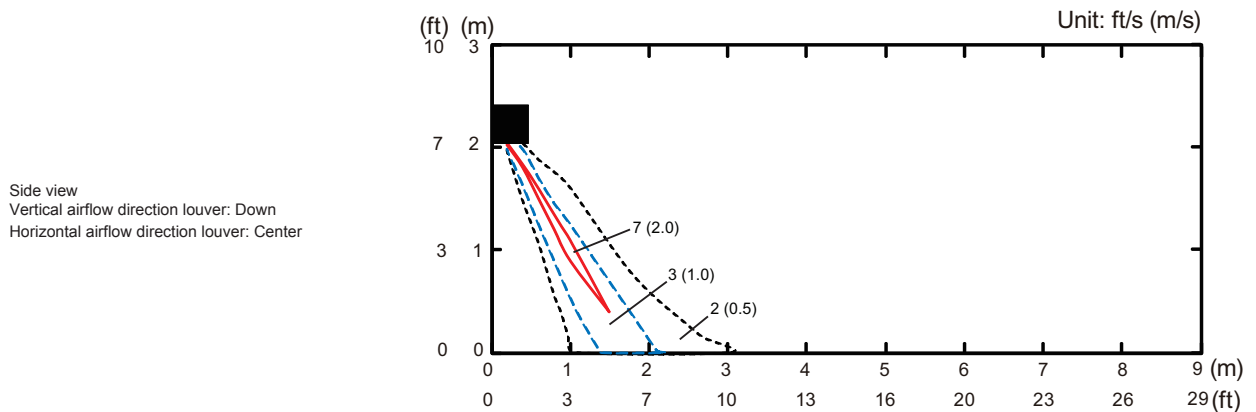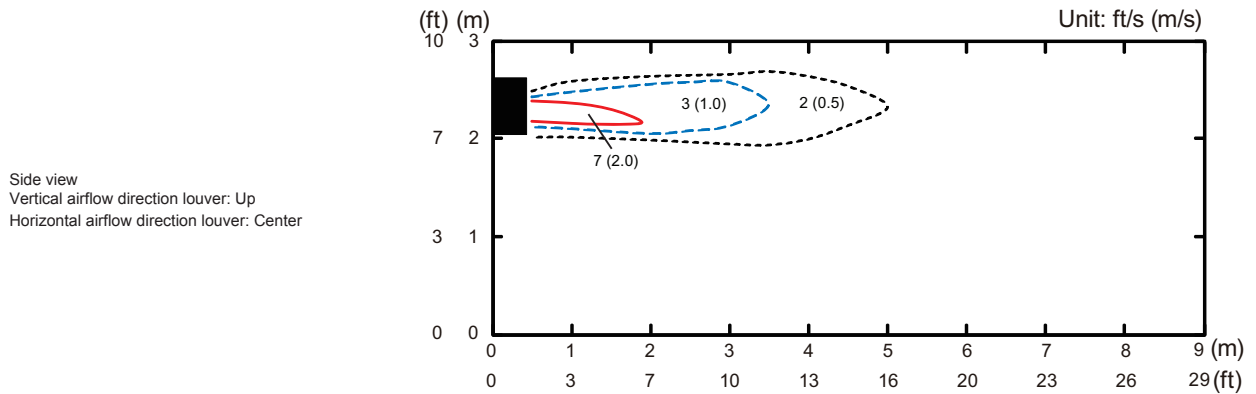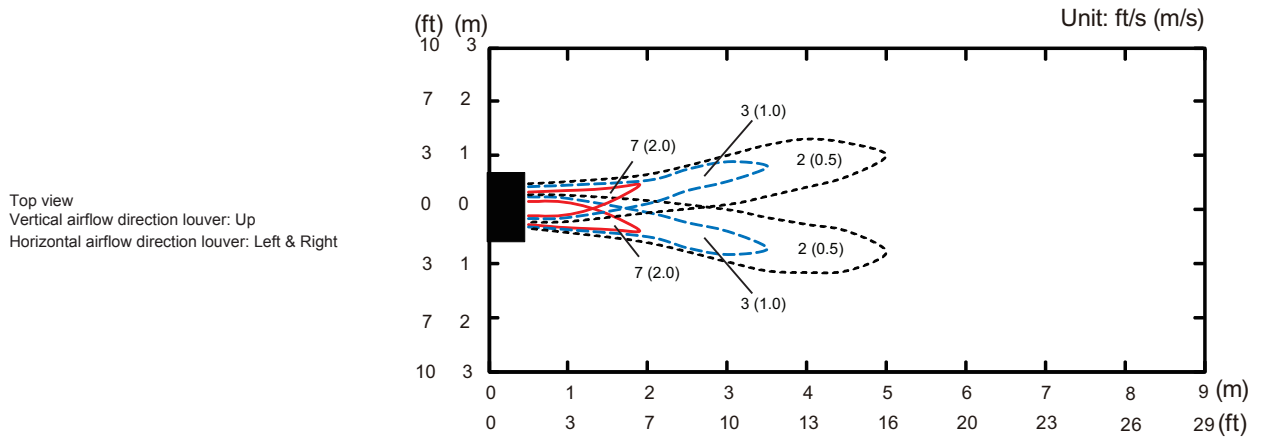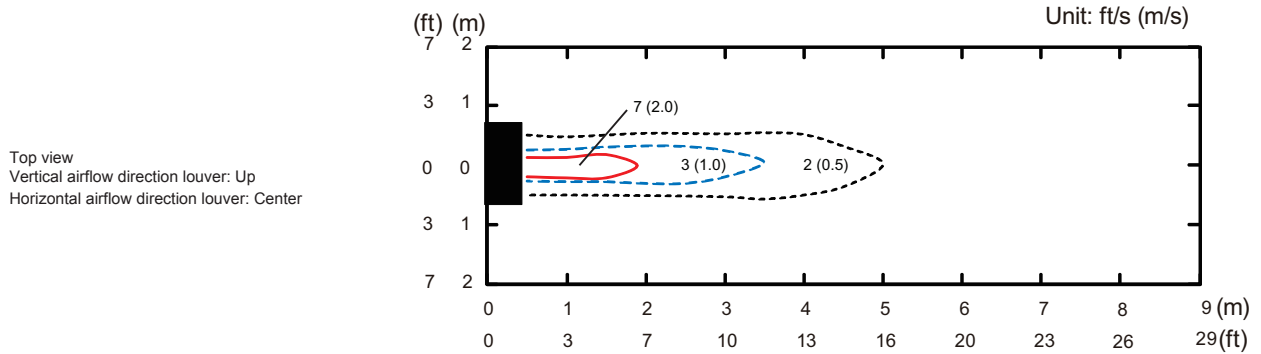


# Model: UIWH09AVFJ

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

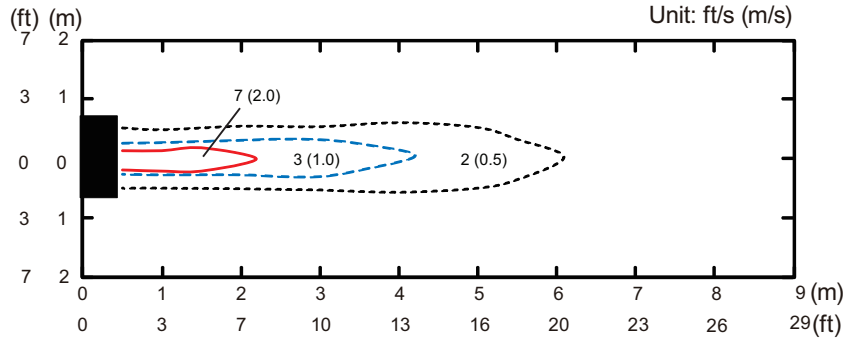


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

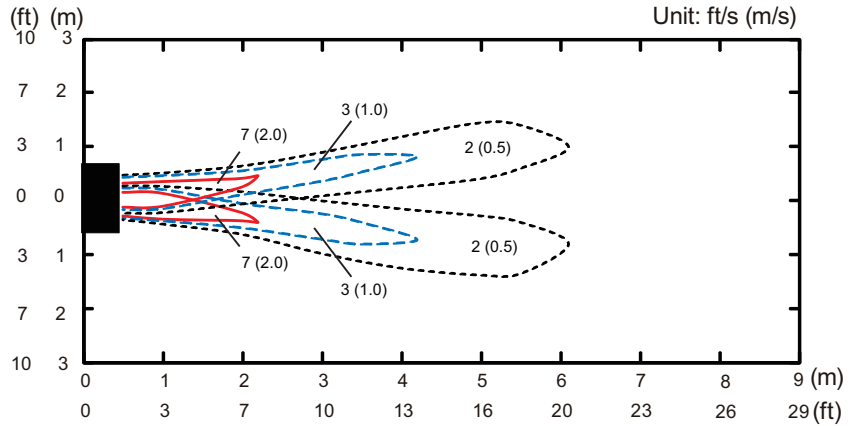

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

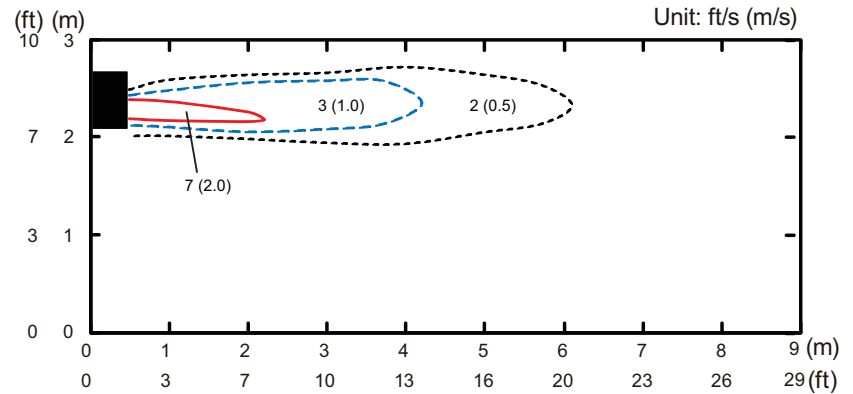


Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

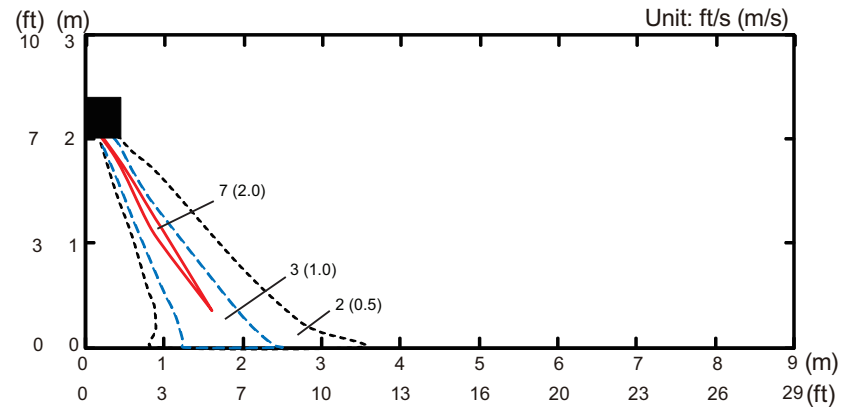


# Model: UIWH12AVFJ

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

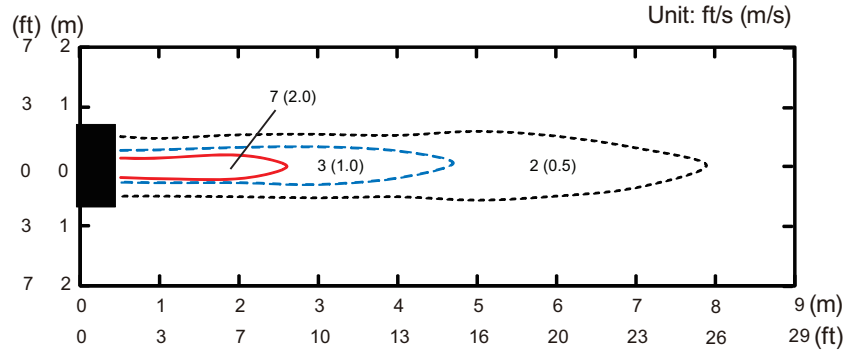


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

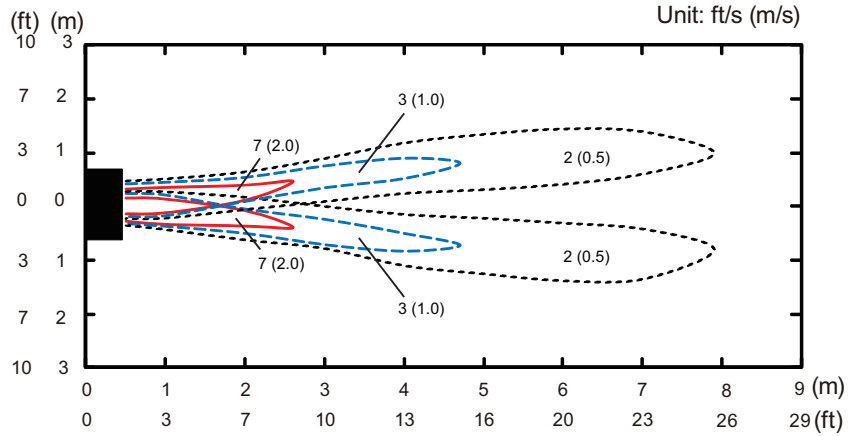

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

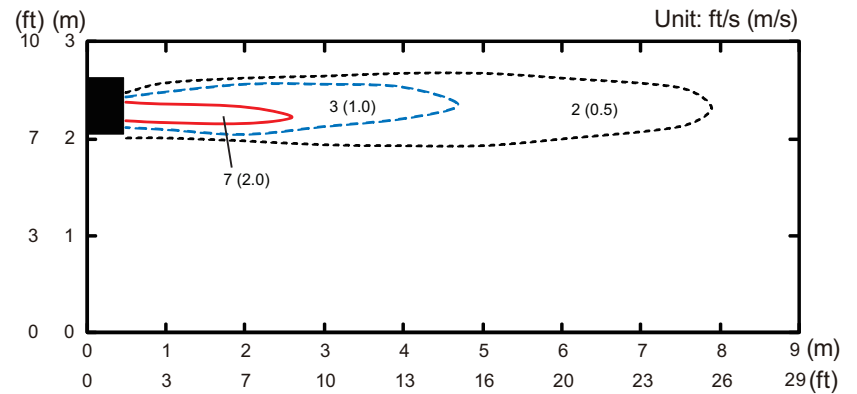


Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

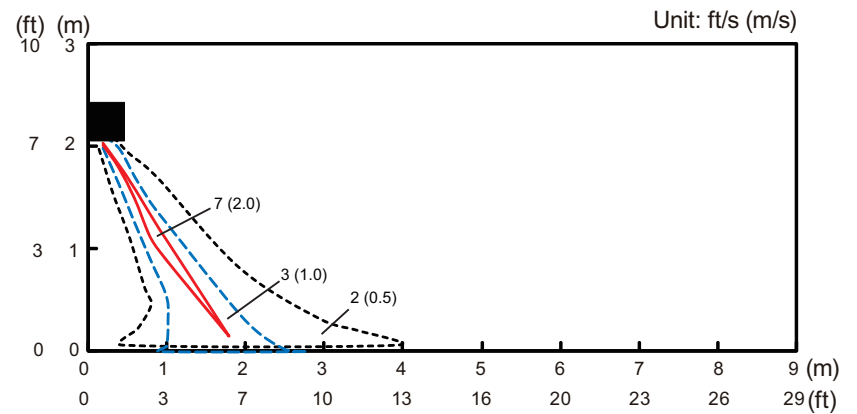


# Model: UIWH15AVFJ

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

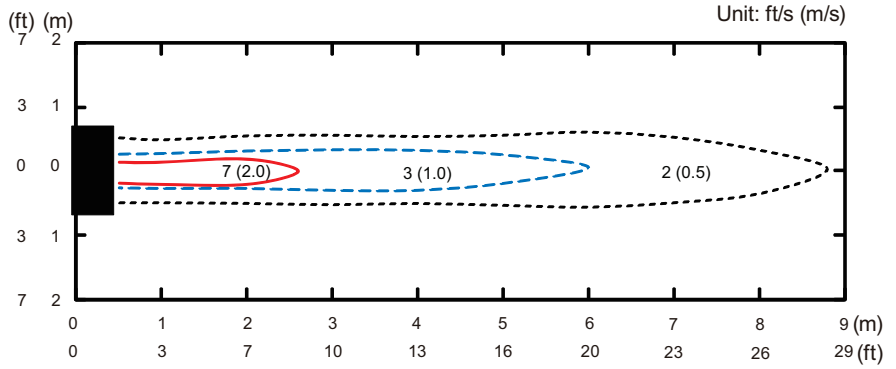


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

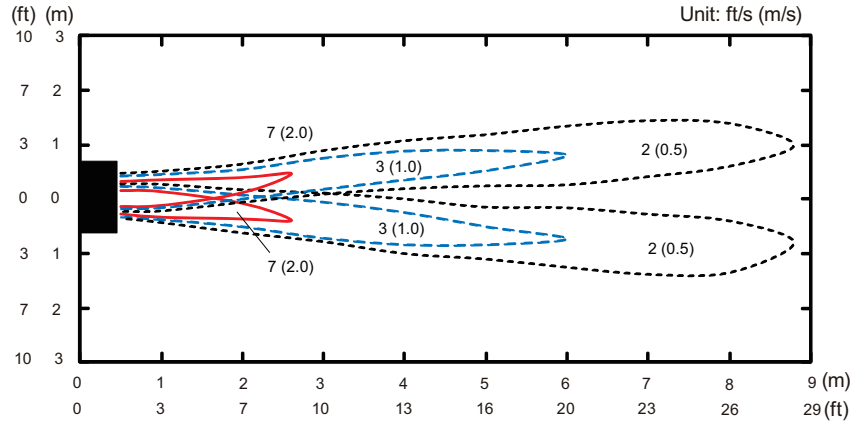

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

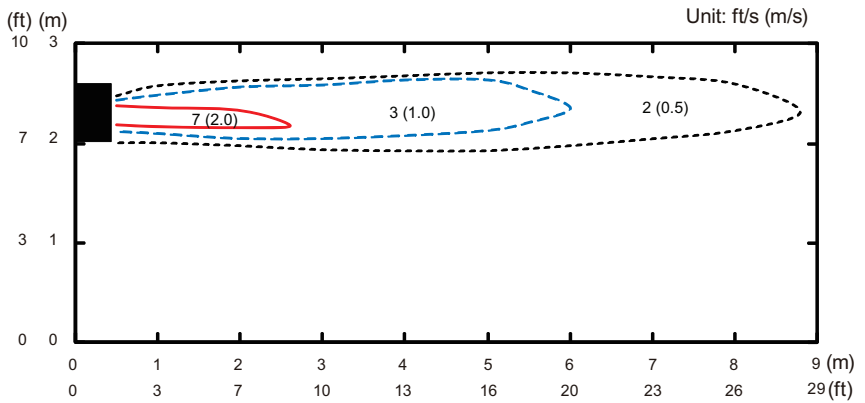

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

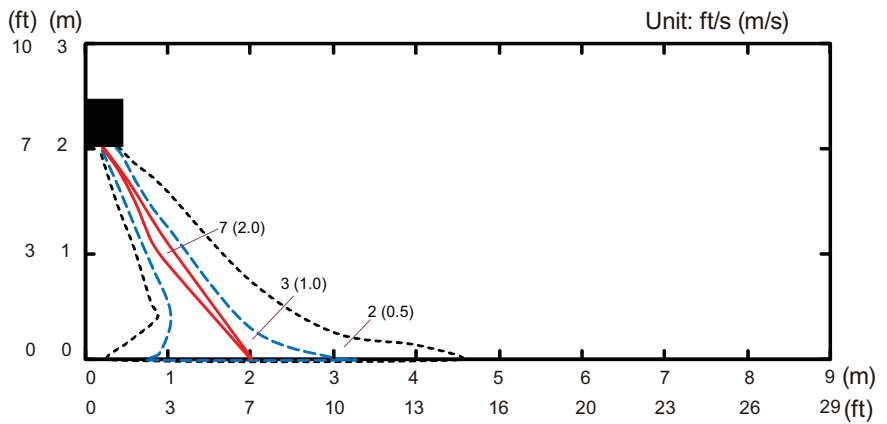




# Model: UIWH18AVFJ


MULTI TYPE  
2, 3, 4 ROOMS TYPE

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

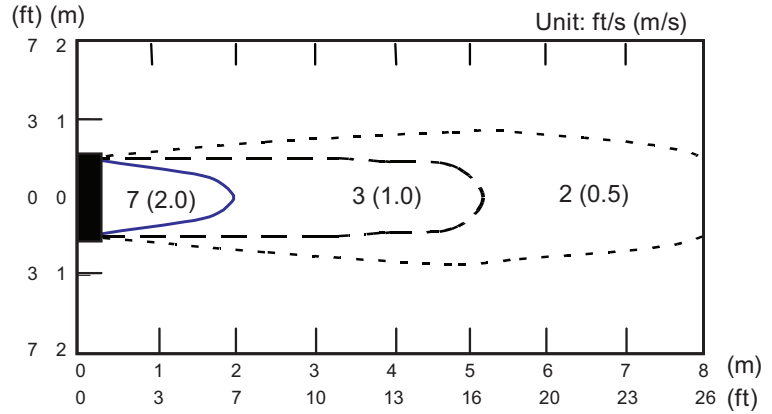


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

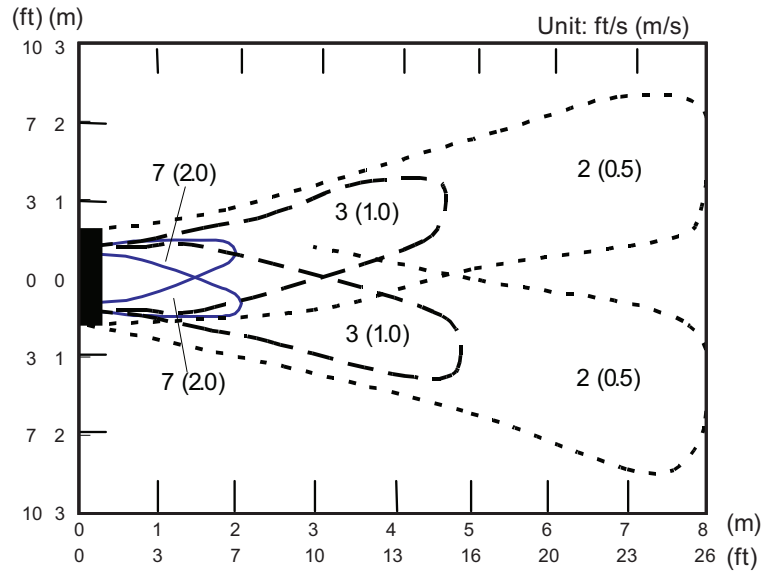

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

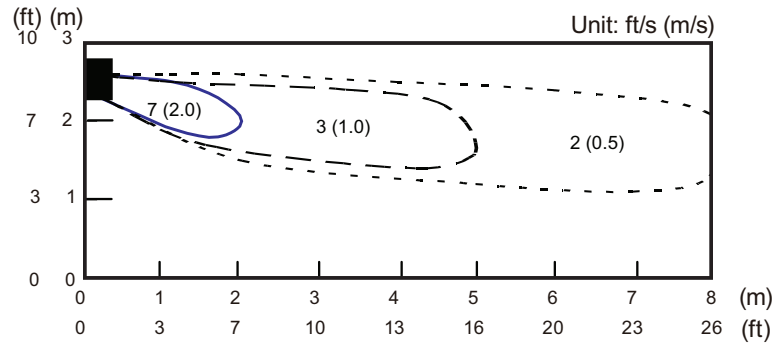


Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

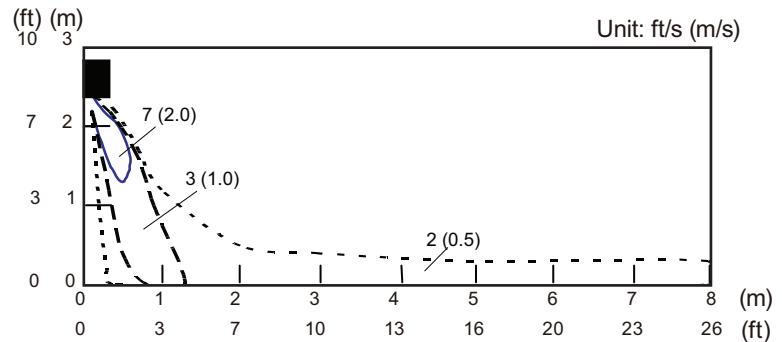


# Model: UIWH24AVFJ

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

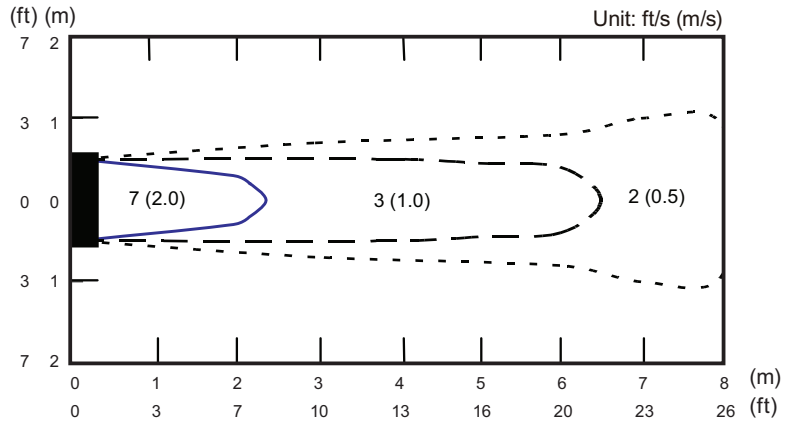


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

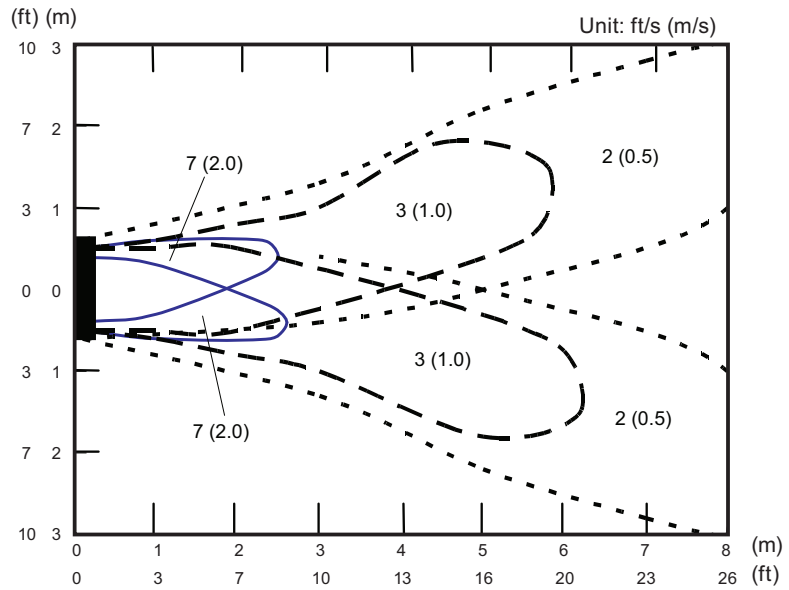

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

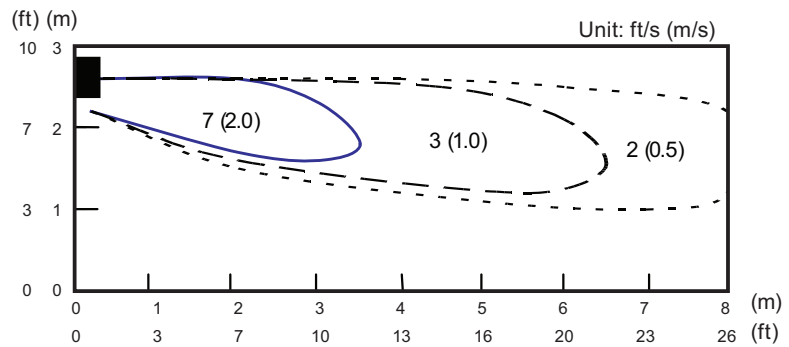

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

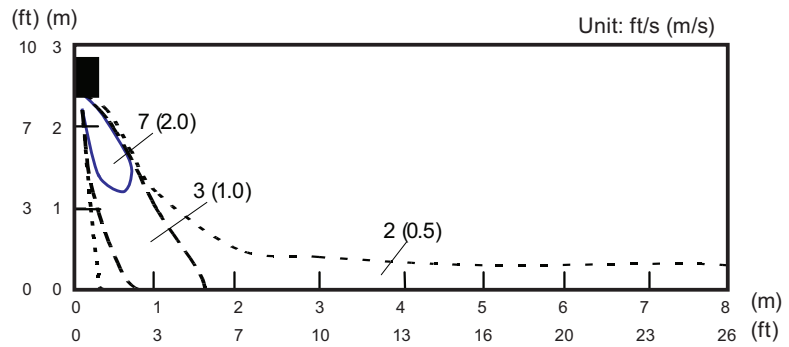

## 6. Airflow

Conversion factor:

- $1 \text{ m}^3/\text{h} = 0.2778 \text{ l/s} = 0.5886 \text{ CFM}$
- $3.6 \text{ m}^3/\text{h} = 1 \text{ l/s}$
- $1.699 \text{ m}^3/\text{h} = 1 \text{ CFM}$

### 6-1. Wall mounted type

Model	Operation mode	Fan speed	Airflow		
			m <sup>3</sup> /h	l/s	CFM
UIWH07AVFJ	Cooling	High	560	156	330
		Med	500	139	294
		Low	430	119	253
		Quiet	310	86	182
	Heating	High	560	156	330
		Med	500	139	294
		Low	430	119	253
		Quiet	330	92	194
UIWH09AVFJ	Cooling	High	600	167	353
		Med	520	144	306
		Low	430	119	253
		Quiet	310	86	182
	Heating	High	600	167	353
		Med	520	144	306
		Low	430	119	253
		Quiet	330	92	194
UIWH12AVFJ	Cooling	High	660	183	388
		Med	560	156	330
		Low	450	125	265
		Quiet	310	86	182
	Heating	High	660	183	388
		Med	560	156	330
		Low	470	131	277
		Quiet	330	92	194
UIWH15AVFJ	Cooling	High	730	203	430
		Med	600	167	353
		Low	530	147	312
		Quiet	360	100	212
	Heating	High	730	203	430
		Med	615	171	362
		Low	560	156	330
		Quiet	375	104	221
UIWH18AVFJ	Cooling	High	920	256	542
		Med	740	206	436
		Low	620	172	365
		Quiet	550	153	324
	Heating	High	920	256	542
		Med	740	206	436
		Low	620	172	365
		Quiet	550	153	324


Model	Operation mode	Fan speed	Airflow		
			m <sup>3</sup> /h	l/s	CFM
UIWH24AVFJ	Cooling	High	1,120	311	659
		Med	900	250	530
		Low	740	206	436
		Quiet	620	172	365
	Heating	High	1,100	306	647
		Med	900	250	530
		Low	740	206	436
		Quiet	620	172	365

# 7. Noise level curve


## 7-1. Wall mounted type

### ■ Model: UIWH07AVFJ

#### ● Cooling

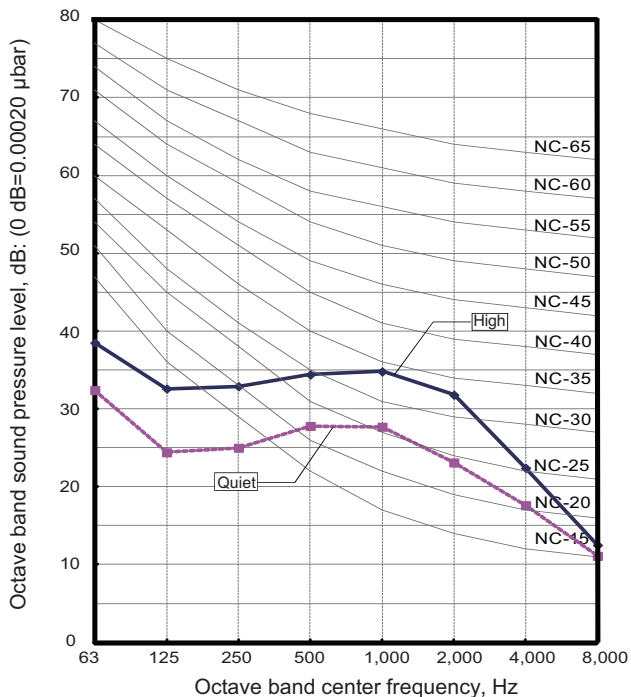


#### ● Heating

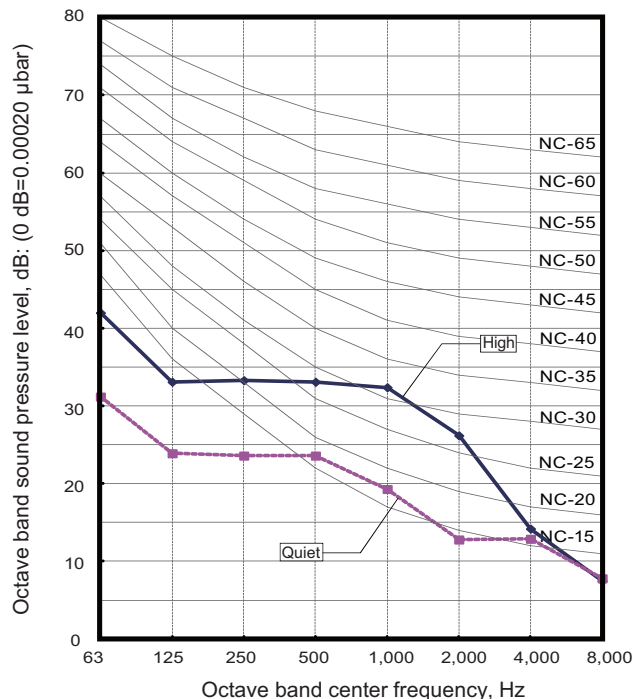


### ■ Model: UIWH09AVFJ

#### ● Cooling

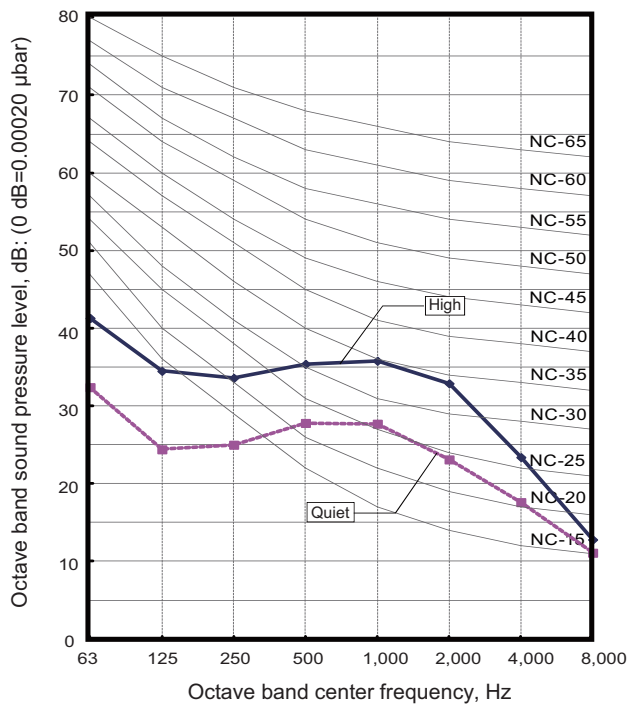


#### ● Heating

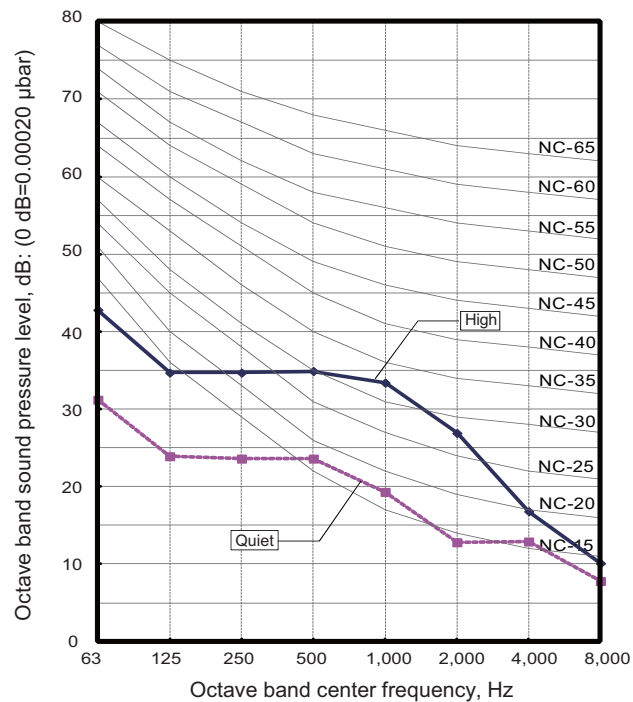


## Model: UIWH12AVFJ

### Cooling

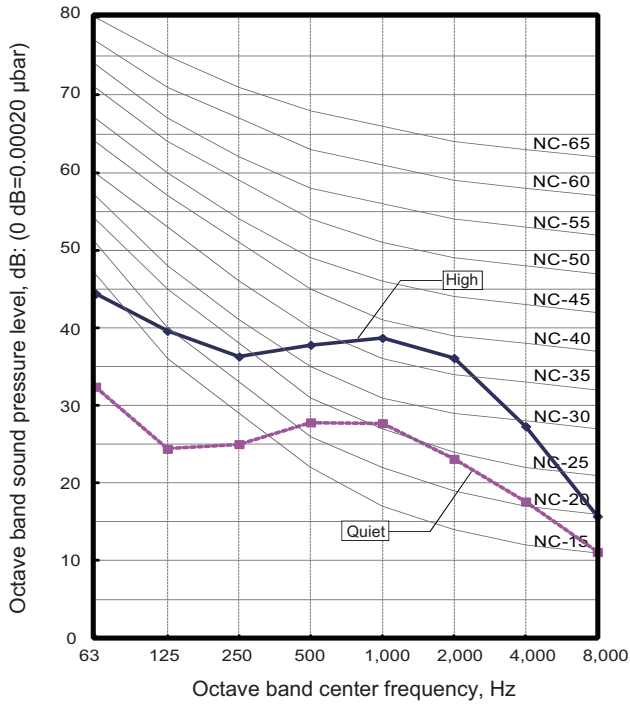


### Heating

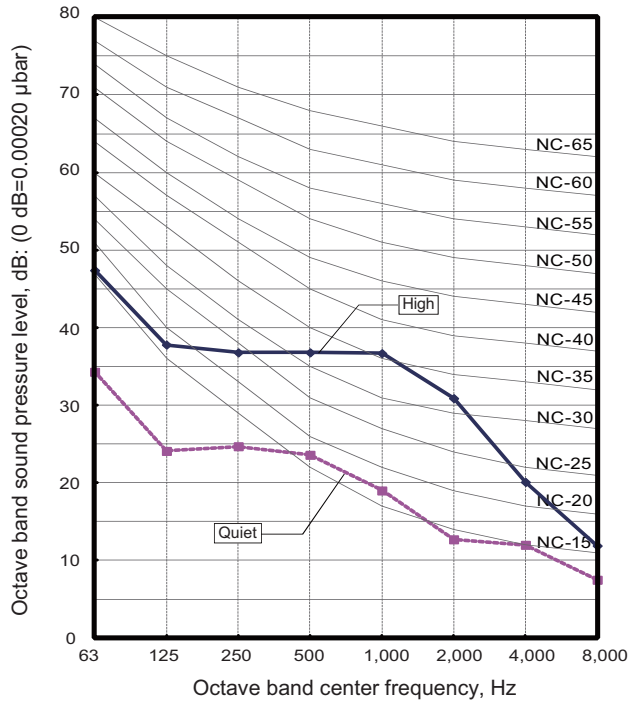


## Model: UIWH15AVFJ

### Cooling

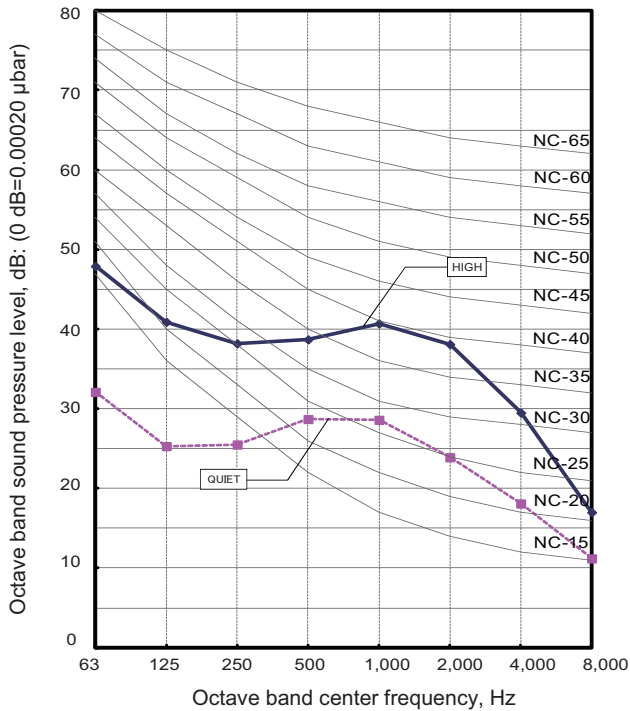


### Heating

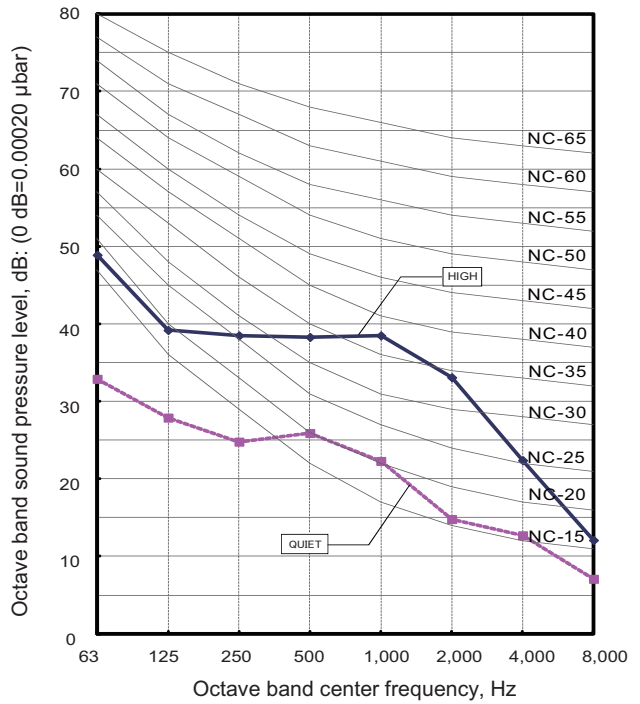


## ■ Model: UIWH18AVFJ

### ● Cooling

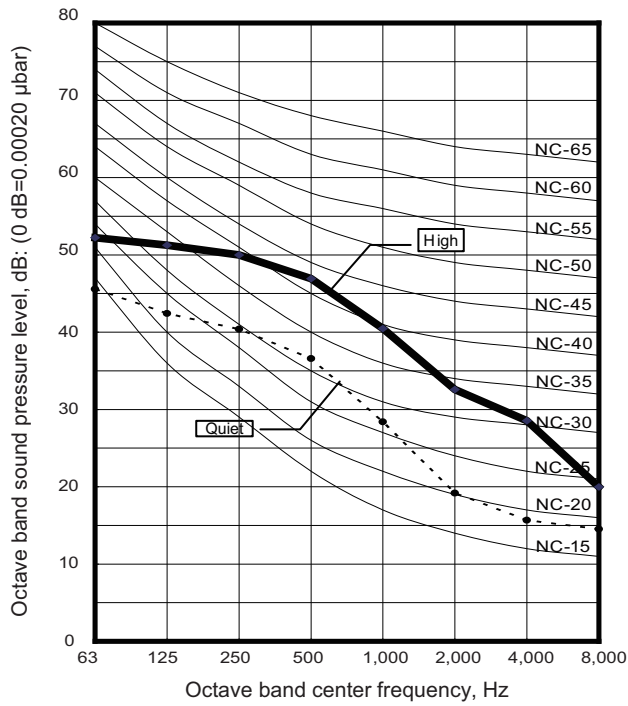


### ● Heating

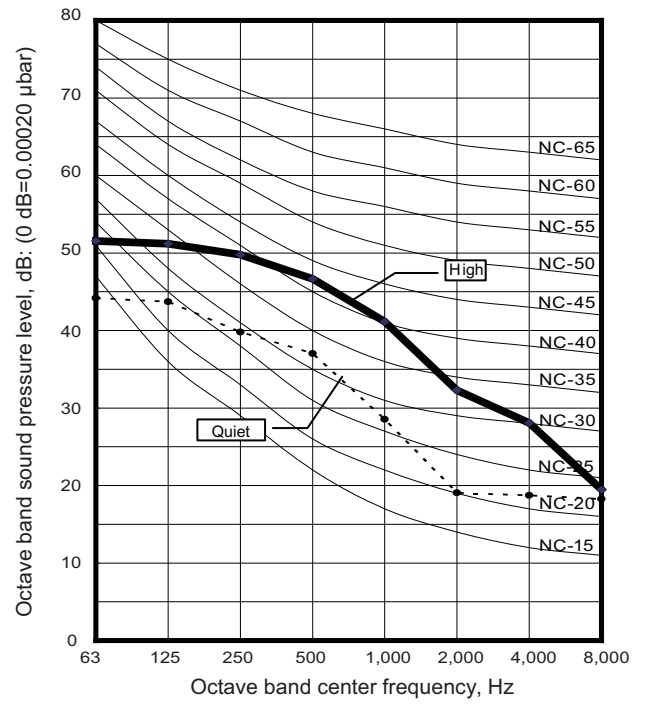


## ■ Model: UIWH24AVFJ

### ● Cooling

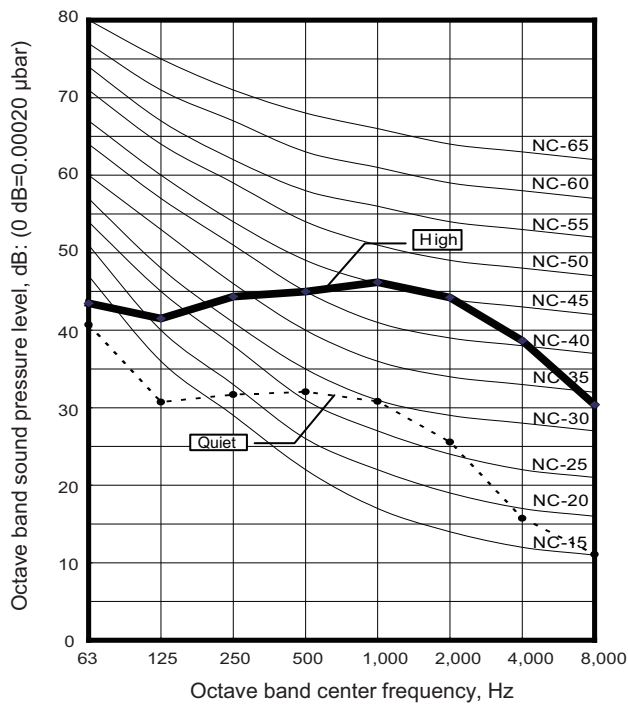


### ● Heating

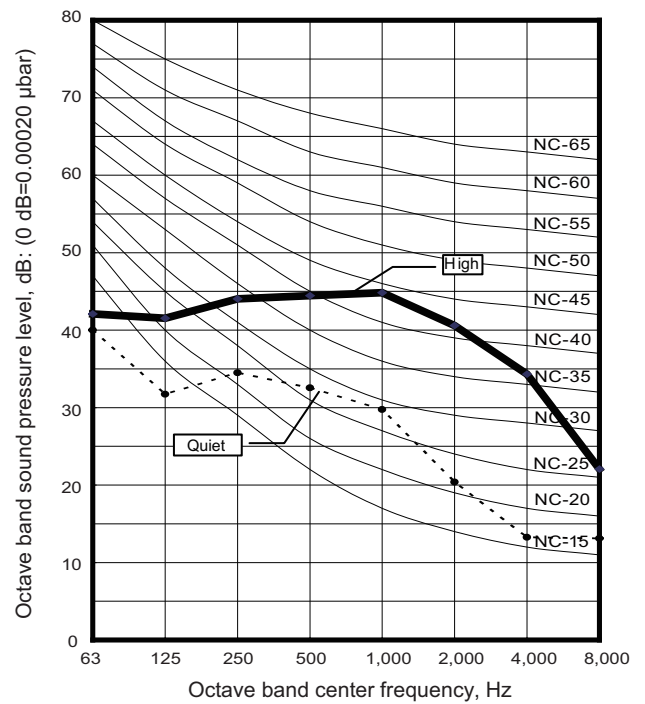

## 7-2. Sound level check point

### ■ Wall mounted type

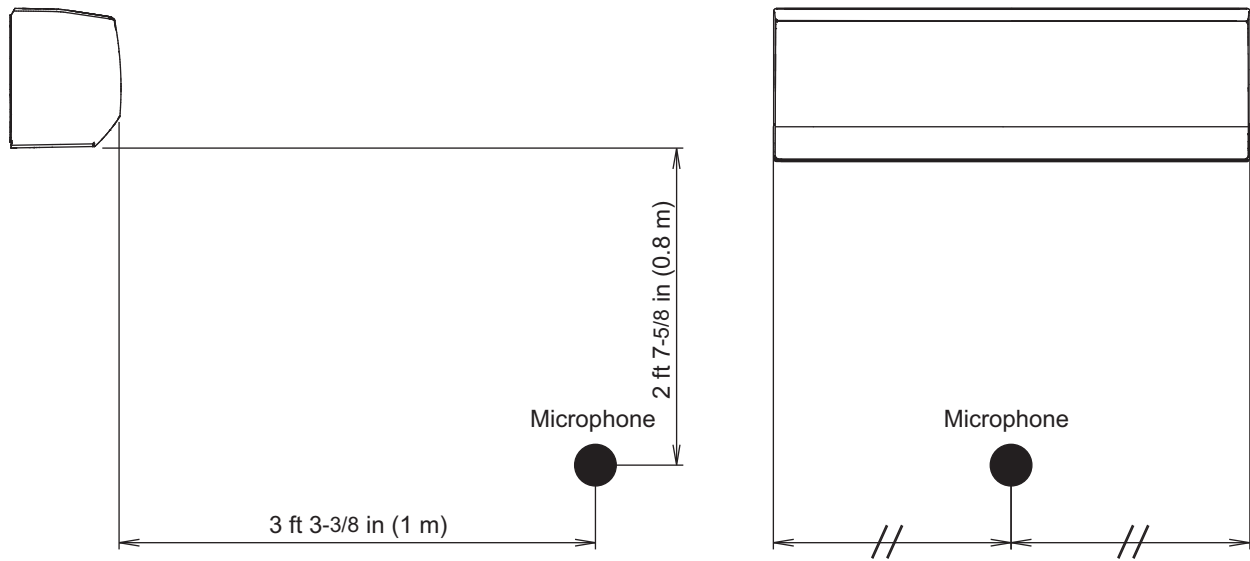

**NOTE:** Detailed shape of the actual indoor unit might be slightly different from the one illustrated above.



## 8. Electrical characteristics

Type	Model name	Power supply			Indoor rated	
		Hz	Voltage (V)	MCA (A)	Input power (W)	FLA (A)
Wall mounted	UIWH07AVFJ	60	208 / 230	0.18 / 0.16	15 / 15	0.14 / 0.13
	UIWH09AVFJ			0.20 / 0.19	17 / 17	0.16 / 0.15
	UIWH12AVFJ			0.25 / 0.24	22 / 22	0.20 / 0.19
	UIWH15AVFJ			0.34 / 0.31	28 / 28	0.27 / 0.25
	UIWH18AVFJ			0.42 / 0.40	40 / 41	0.34 / 0.32
	UIWH24AVFJ			0.71 / 0.66	68 / 69	0.57 / 0.53

Wiring spec. (Indoor unit to outdoor unit)	Connection cable	AWG	14
	Limited wiring length	ft (m)	85 (26)

MCA: Minimum Circuit Ampacity = Maximum operating current (Full load)

FLA: Full Load Amperes (Fan motor)

## 9. Safety devices

Indoor unit type	Model name	PCB* fuse	Fan motor thermal protector	Terminal thermal fuse	Float switch
Wall mounted	UIWH07AVFJ UIWH09AVFJ UIWH12AVFJ UIWH15AVFJ	250 V, 3.15 A	Activate: 221 ±18 °F (105 ±10 °C) Fan motor stop Reset: 194 ±18 °F (90 ±10 °C) Fan motor restart	—	—
	UIWH18AVFJ UIWH24AVFJ		Activate: 302 ±27 °F (150 ±15 °C) Fan motor stop Reset: 248 ±27 °F (120 ±15 °C) Fan motor restart	Activate: 216 °F (102 °C)	—

\*: Printed Circuit Board

## 10. External input and output

Indoor unit type	External input		External output	
	Control input	Operation status output	Error status output	
Wall mounted	•	•	•	(UIWH07/09/12/15AVFJ)

### 10-1. External input

With using external input function, some functions on this product can be controlled from an external device.

- “Operation/Stop” mode or "Forced stop" mode can be selected with function setting of indoor unit.
- A twisted pair cable (22AWG) should be used. Maximum length of cable is 492 ft (150 m).
- The wire connection should be separate from the power cable line.

#### ■ Control input (Operation/Stop or Forced stop)


Indoor unit type	Connector
Wall mounted UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	CNA01
UIWH18AVFJ, UIWH24AVFJ	CN14

The air conditioner can be remotely operated by means of the following on-site work.

Operation is started at the following contents by adding the contact input of a commercial on/off switch to a connector on the external control PCB and turning it on.

Unit operation	Initial setting after power is on	Starting mode other than initial setting
Operation mode	Auto changeover	Mode at previous operation
Set temperature	76 °F (24 °C)	Temperature at previous operation
Airflow mode	AUTO	Mode at previous operation
Air direction (swing)	Standard air direction (swing: off)	Air direction at previous operation


#### ● Circuit diagram example

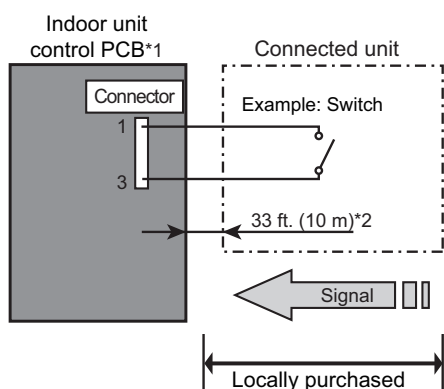


- Contact capacity: DC 24 V or more, 10 mA or more.
- \*1: PCB of Communication kit is used for wall mounted (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ) type.
- \*2: Make the distance from the PCB to the connected unit within 33 ft (10 m).
- Use non-polar relays and switches.

Indoor unit type	1-pin (Polarity)	3-pin (Polarity)
Wall mounted UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ, UIWH18AVFJ, UIWH24AVFJ	-	+

- When function setting is "Operation/Stop" mode

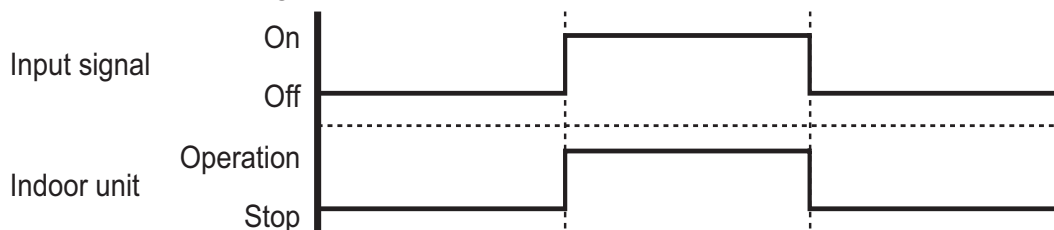


- When function setting is "Forced stop" mode

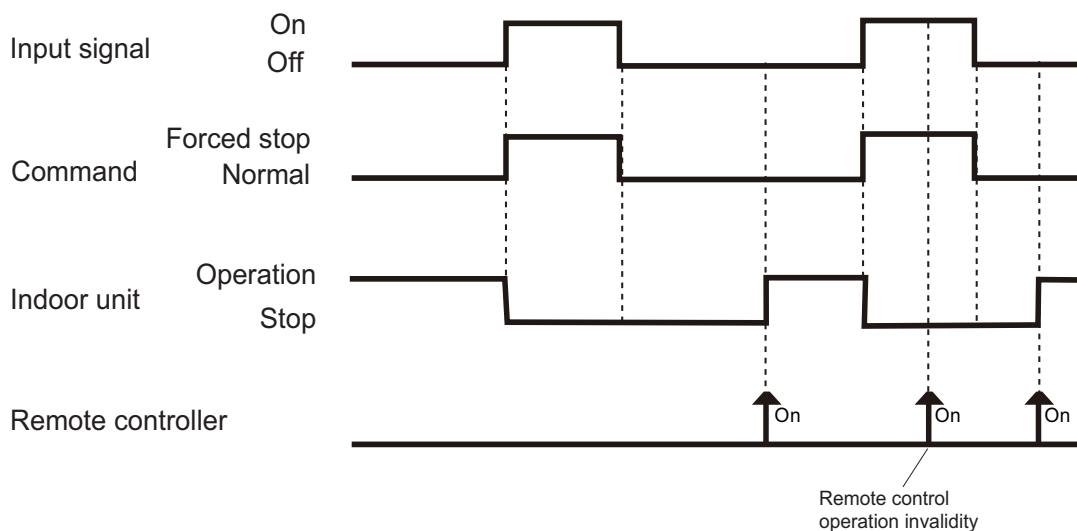

## ● Optional part

Indoor unit type		Part name	Model name
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	External connect kit	RXXWZXZ5
	UIWH18AVFJ, UIWH24AVFJ		RXXWZX



Indoor unit type		Part name	Model name
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	Communication kit	RXXCBXZ2
	UIWH18AVFJ, UIWH24AVFJ	—	—

\*For operating the external input function, the wall mounted (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ) type requires optional communication kit (RXXCBXZ2) in addition to the wire (RXXWZXZ5).

## 10-2. External output


Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

### ■ Operation status output


	Indoor unit type	Connector
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	CNB01
	UIWH18AVFJ, UIWH24AVFJ	CN16

Air conditioner operation status signal can be output.

### ● Circuit diagram example

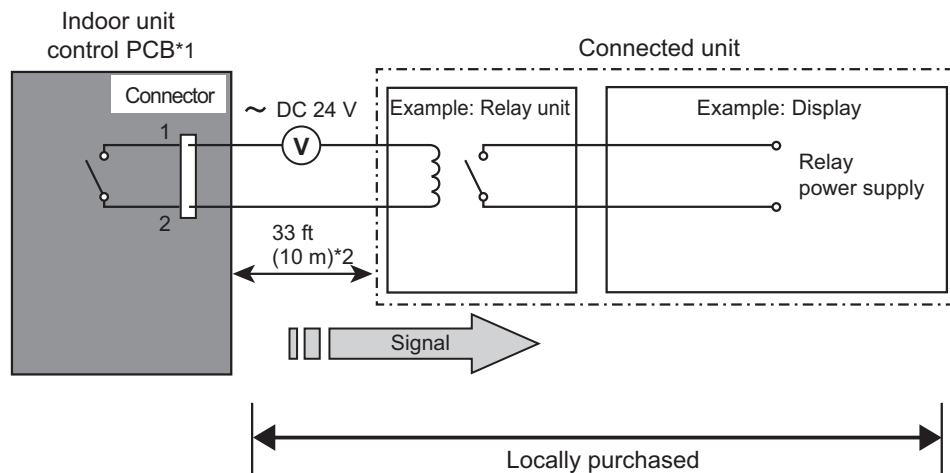


- \*1: PCB of Communication kit is used for wall mounted (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ) type.
- \*2: Make the distance from the PCB to the connected unit within 33 ft (10 m).
- Relay spec: Max. DC 24 V, 10 mA to less than 500 mA.

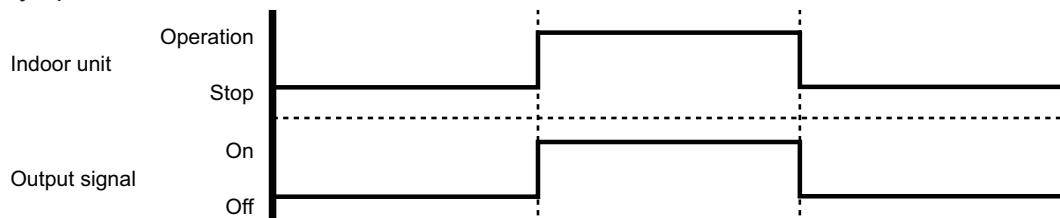

## ● Optional part

Indoor unit type		Part name	Model name
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	External connect kit	RXXWZXZ5
	UIWH18AVFJ, UIWH24AVFJ		RXXWZX



Indoor unit type		Part name	Model name
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	Communication kit	RXXCBXZ2
	UIWH18AVFJ, UIWH24AVFJ	—	—


\*For operating the external output function, the wall mounted type (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ) requires optional Communication kit (RXXCBXZ2) in addition to the wire (RXXWZXZ5).

## ■ Error status output


Indoor unit type		Connector
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	CNB02
	UIWH18AVFJ, UIWH24AVFJ	—

Air conditioner error status signal can be output.

### ● Circuit diagram example

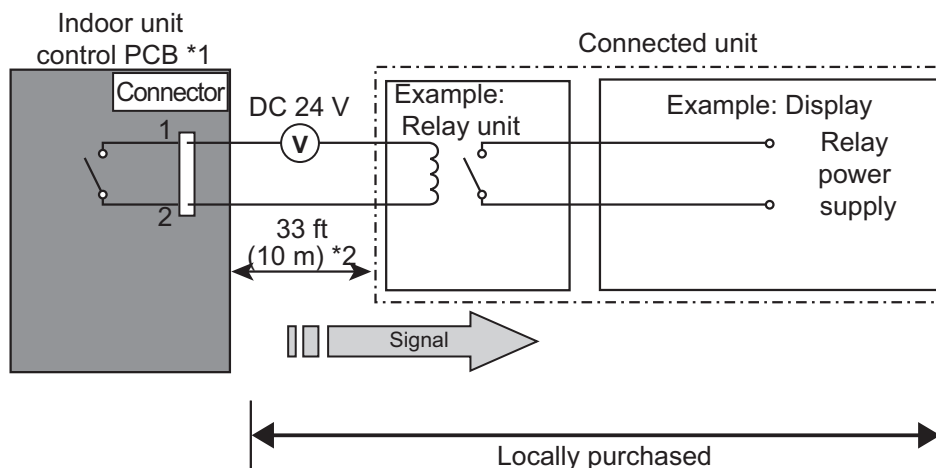


- \*1: PCB of Communication kit is used for wall mounted (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ) type.
- \*2: Make the distance from the PCB to the connected unit within 33 ft (10 m).
- Relay spec.: Max. DC 24 V, 10 mA to less than 500 mA.

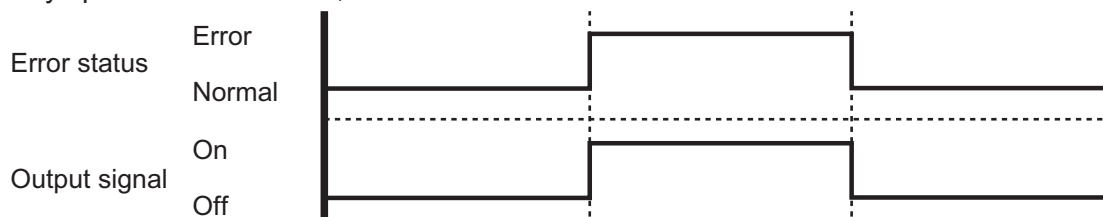

### ● Optional part

Indoor unit type	Part name	Model name
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	External connect kit
	UIWH18AVFJ, UIWH24AVFJ	—




Indoor unit type	Part name	Model name
Wall mounted	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, UIWH15AVFJ	Communication kit
	UIWH18AVFJ, UIWH24AVFJ	—

\*For operating the external input function, the wall mounted (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ) type requires Communication kit (RXXCBXZ2) in addition to the wire (RXXWZXZ5).


# 11. Remote controller

## 11-1. Wireless remote controller (AR-RAH2U)

### Overview

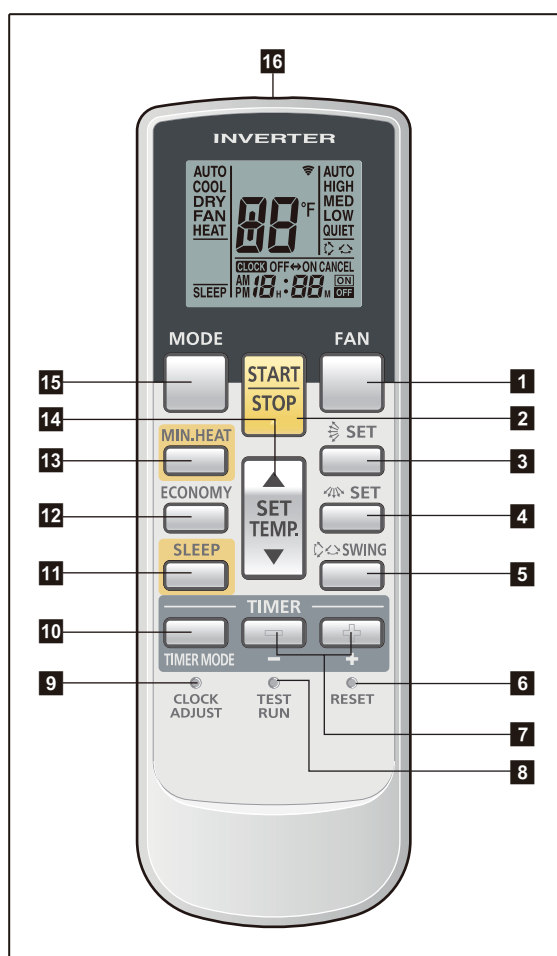

Display panel

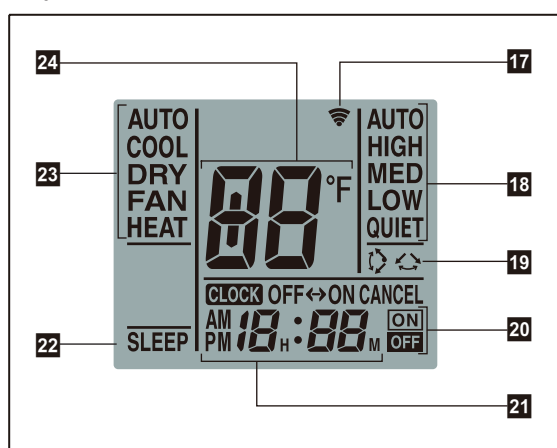

**NOTE:** Functions may differ by type of the indoor unit. For details, refer to the operation manual.


- 1 FAN button**  
Selects the fan speed (AUTO, HIGH, MED, LOW, and QUIET).
- 2 START/STOP button**  
Starts and stops operation.
- 3 SET button (vertical)**  
Adjusts the vertical airflow direction.
- 4 SET button (horizontal)**  
Adjusts the horizontal airflow direction.
- 5 SWING button**  
Sets the automatic swing operation and selects swing mode (Up/down, Left/right, Up/down/left/right, and Stop swing).
- 6 RESET button**  
Used when replacing batteries.
- 7 Timer set (- / +) button**  
Sets the current time and on-off time.
- 8 TEST RUN button**  
Only used for the initial test in the unit installation.
- 9 CLOCK ADJUST button**  
Used for adjusting the clock.
- 10 TIMER MODE button**  
Selects the timer mode (off timer, on timer, program timer, and timer reset).
- 11 SLEEP button**  
Pressed to select sleep timer.
- 12 ECONOMY button**
- 13 MIN. HEAT button**
- 14 SET TEMP. (temperature) (▲ / ▼) button**
  - Sets desired temperature.
  - Sets remote controller custom code.
- 15 MODE button**
  - Switches operation mode (AUTO, COOL, DRY, FAN, and HEAT).
  - Starts/ends the remote controller custom code (max. 4 types) change.
- 16 Signal transmitter**
- 17 Signal transmit indicator**
- 18 Fan speed indicator**
- 19 Swing indicator**
- 20 Timer mode indicator**
- 21 Clock indicator**
- 22 Sleep indicator**
- 23 Operating mode indicator**
- 24 Temperature indicator**



## ■ Specifications

### ● Controller

Unit: in (mm)

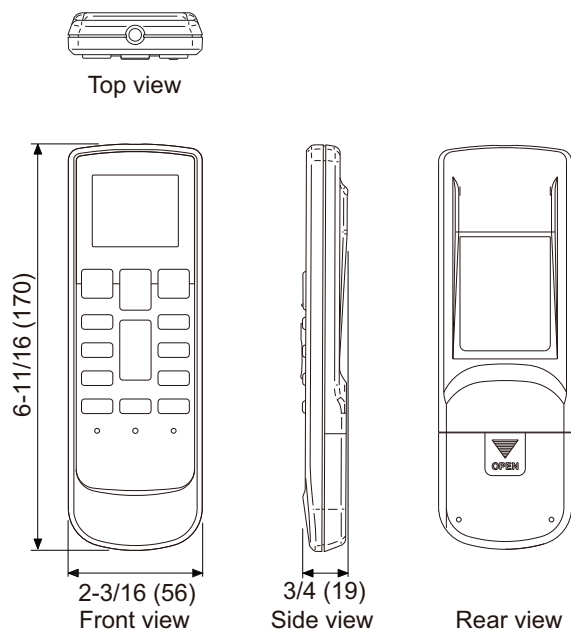


Size (H × W × D)	in (mm)	6-11/16 × 2-3/16 × 3/4 (170 × 56 × 19)
Weight	oz (g)	3 (85) (without batteries)

**NOTE:** Actual number of buttons might be different from the figure above.

### ● Holder

Unit: in (mm)

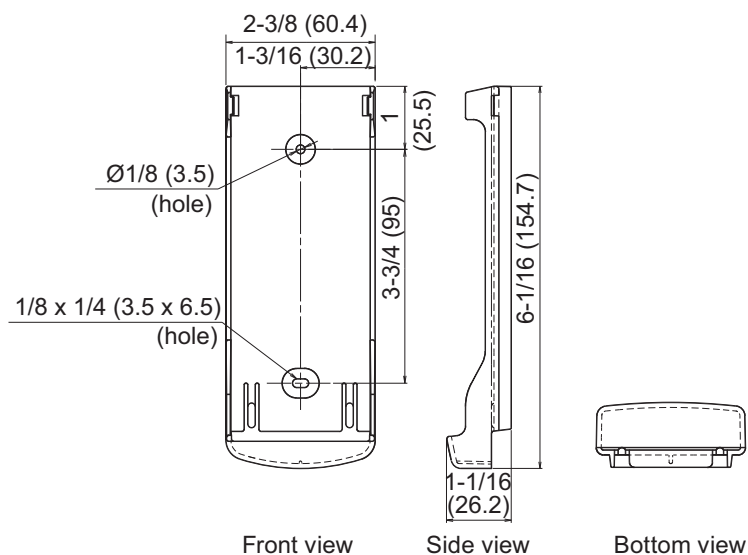


Size (H × W × D)	in (mm)	6-1/16 × 2-3/8 × 1-1/16 (154.7 × 60.4 × 26.2)
Weight	oz (g)	10 (28)

# 11-2. Wireless remote controller (AR-REG1U)


## Overview

### AR-REG1U

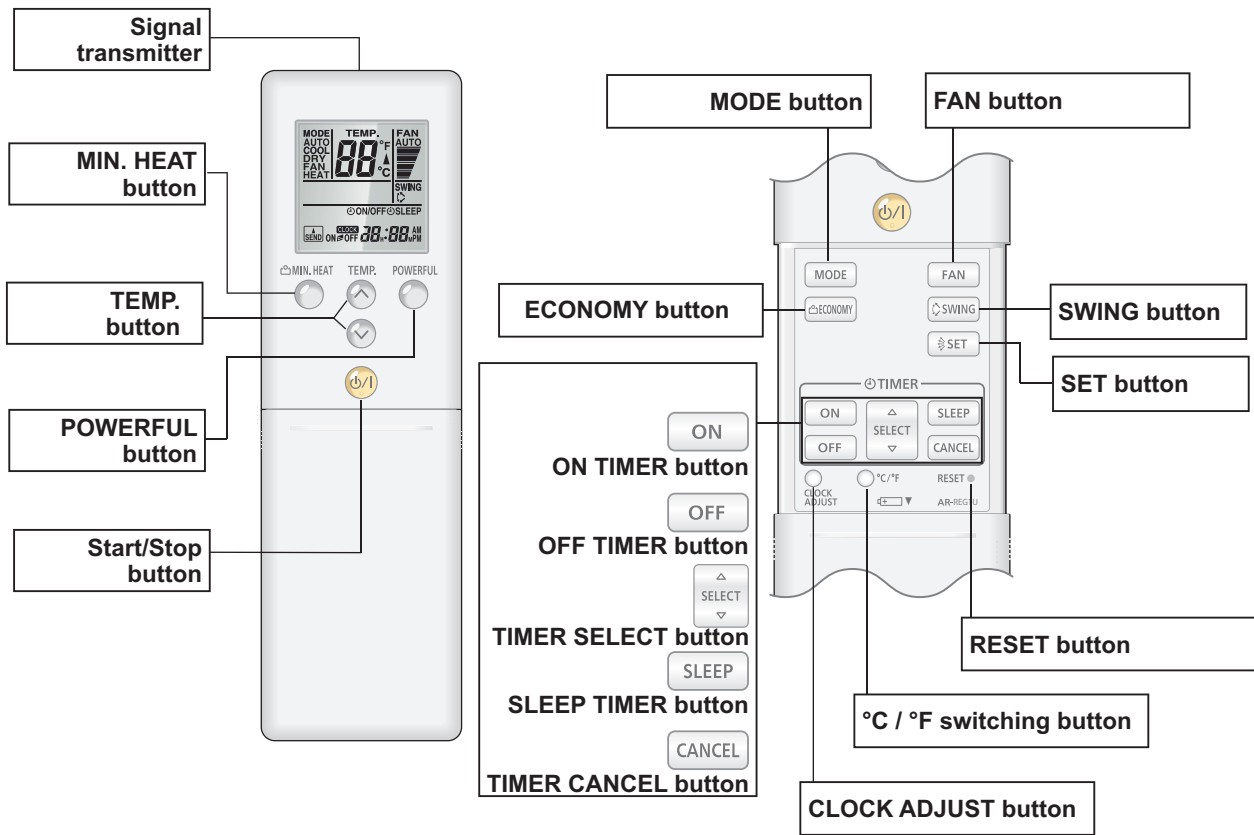

**NOTE:** Functions may differ by type of the indoor unit. For details, refer to the operation manual.

### Display panel

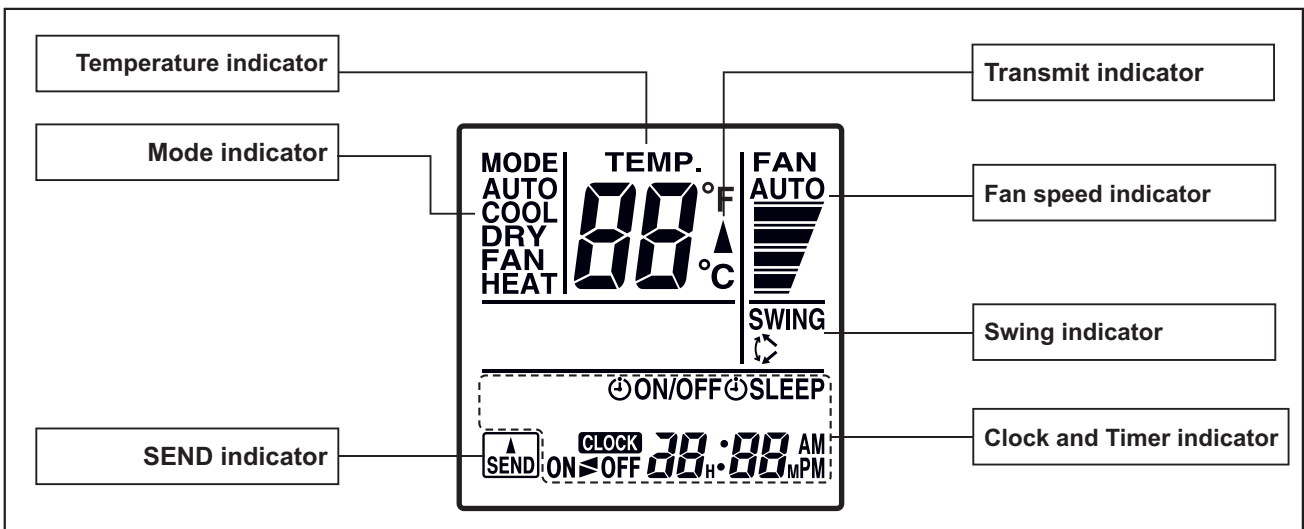


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

## ■ Specifications

### ● Controller


Unit: in (mm)

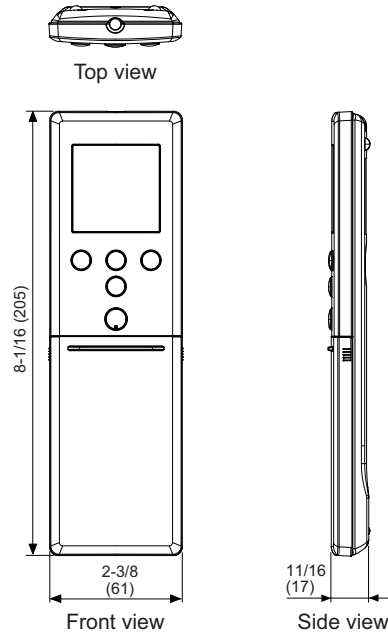

Size (H × W × D)	in (mm)	8-1/16 × 2-3/8 × 11/16 (205 × 61 × 17)
Weight	oz (g)	4.3 (122) (without batteries)

### ● Holder


Unit: in (mm)

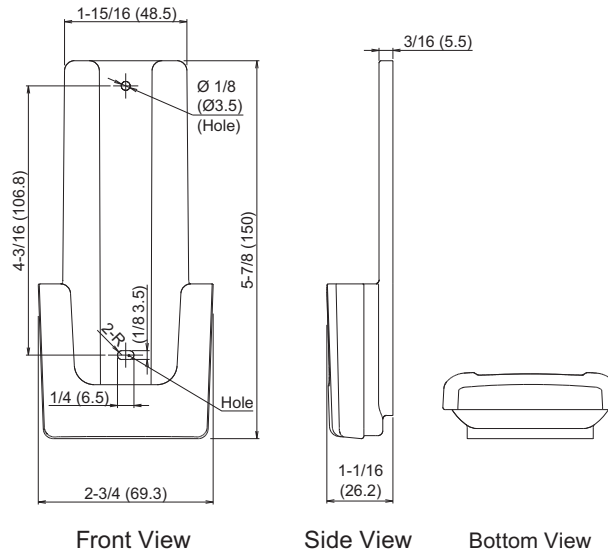


Size (H × W × D)	in (mm)	5-7/8 × 2-3/4 × 1-1/16 (150 × 69.3 × 26.2)
Weight	oz (g)	1 (27)

# 11-3. Wired remote controller (UXRNNUM: Optional part)



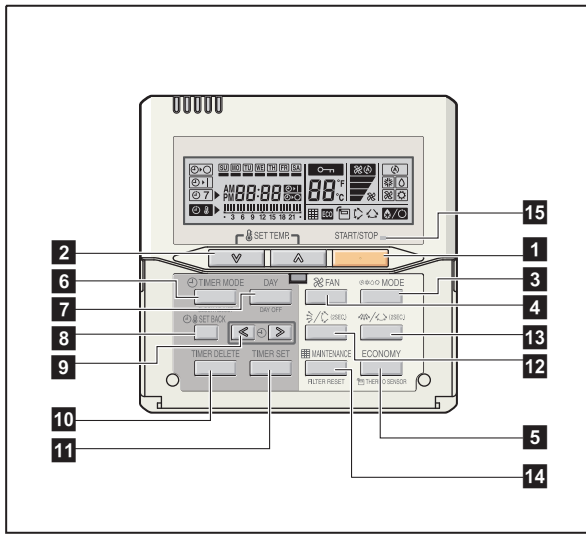



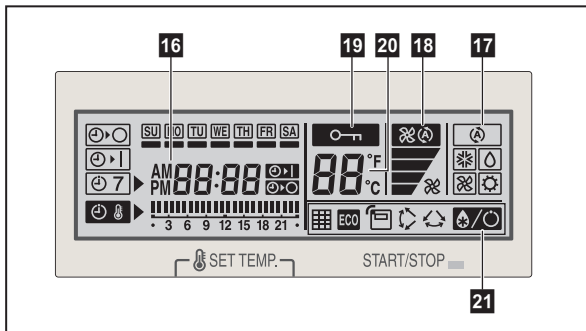









## Overview



Display panel




**NOTE:** Functions may differ by type of the indoor unit. For details, refer to the operation manual.


- 1 START/STOP button**  
Starts and stops operation.
- 2 SET TEMP. button**  
Selects the setting temperature.
- 3 MODE button**  
Selects the operating mode (AUTO , HEAT , FAN , COOL , and DRY ).
- 4 FAN button**  
Selects the fan speed AUTO , QUIET , LOW , MED , and HIGH .
- 5 ECONOMY (THERMO SENSOR) button**  
Turns the economy-efficient mode on and off.
- 6 TIMER MODE (CLOCK ADJUST) button**  
Selects the timer mode (off timer, on timer, and weekly timer). Sets the current time.
- 7 DAY (DAY OFF) button**  
Temporarily cancels one day timer.
- 8 SET BACK button**  
Selects the set back timer.
- 9 Set time button**  
Pressed to set time.
- 10 TIMER DELETE button**  
Deletes the weekly timer schedule.
- 11 TIMER SET button**  
Sets the date, hour, minute, and on-off time.
- 12 Vertical airflow direction and swing button**  
Push for 2 seconds to change the swing mode.
- 13 Horizontal airflow direction and swing button**  
Push for 2 seconds to change the swing mode.
- 14 FILTER RESET button**
- 15 Operation lamp**  
Lights during operation and when the timer is on.
- 16 Timer and clock indicator**
- 17 Operation mode indicator**
- 18 Fan speed indicator**
- 19 Operation lock indicator**
- 20 Temperature indicator**
- 21 Function indicators**
  -  Defrost indicator
  -  Thermo sensor indicator
  -  Economy indicator
  -  Vertical swing indicator
  -  Horizontal swing indicator
  -  Filter indicator

## ■ System diagram

1 remote controller:

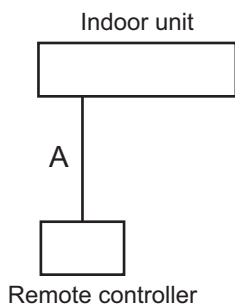


2 remote controllers:

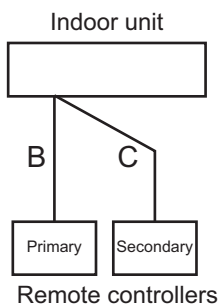

A, B, C: Remote controller cable  
 $A \leq 1,640 \text{ ft (500 m)}$ ;  $B + C \leq 1,640 \text{ ft (500 m)}$


## ■ Electrical wiring

1 remote controller:

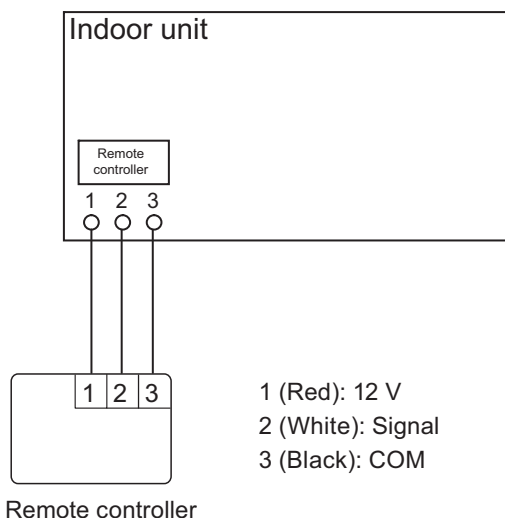

1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM

2 remote controllers:

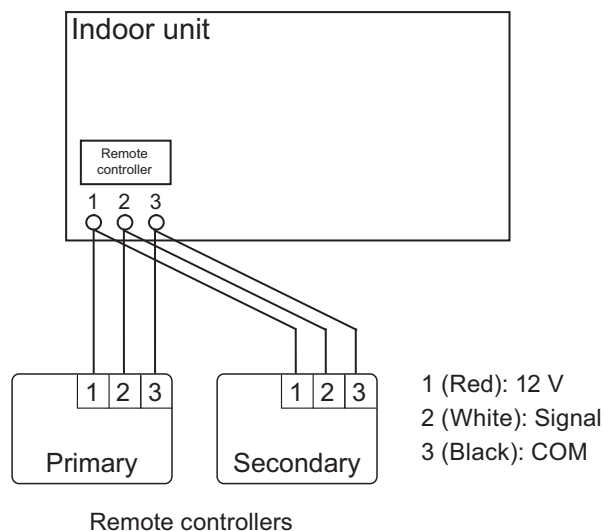

1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM

## ■ Specifications

Dimensions and other specifications on the wired remote controller are as follows.

		Unit: in (mm)
Size (H × W × D)	in (mm)	4-3/4 × 4-3/4 × 11/16 (120 × 120 × 18)
Weight	oz (g)	5.6 (160)
Cable length (accessory)	ft (m)	33 (10)
Power	V	12

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 3-core	Use sheathed PVC cable.

## ■ Installation


### ● Connection pattern

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit types	Connection pattern
Wall mounted type UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ	Pattern A
UIWH18AVFJ and UIWH24AVFJ	Pattern B

### ● Pattern A


1. Modify the remote controller cable as follows:
  - Use a tool to cut off the terminal on the end of the remote controller cable and then remove the insulation from the cut end of the cable as shown in following figure.
  - Connect the remote controller cable and connecting cable as shown in following figure.
  - Be sure to insulate the connection between the cables.

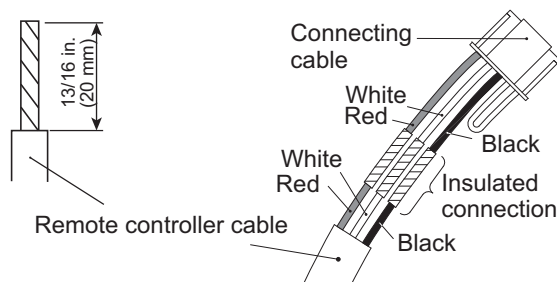

2. Connect the remote controller cable.
  - Connect the cable made in step 1. to the terminal (\*1) of optional communication kit.
  - Connect the cable from the terminal (\*2) of communication kit to the indoor unit PCB.


\*1: CNC01 (for UIWH07—15AVFJ: RXXCBXZ2)

\*2: CND01 (for UIWH07—15AVFJ: RXXCBXZ2)

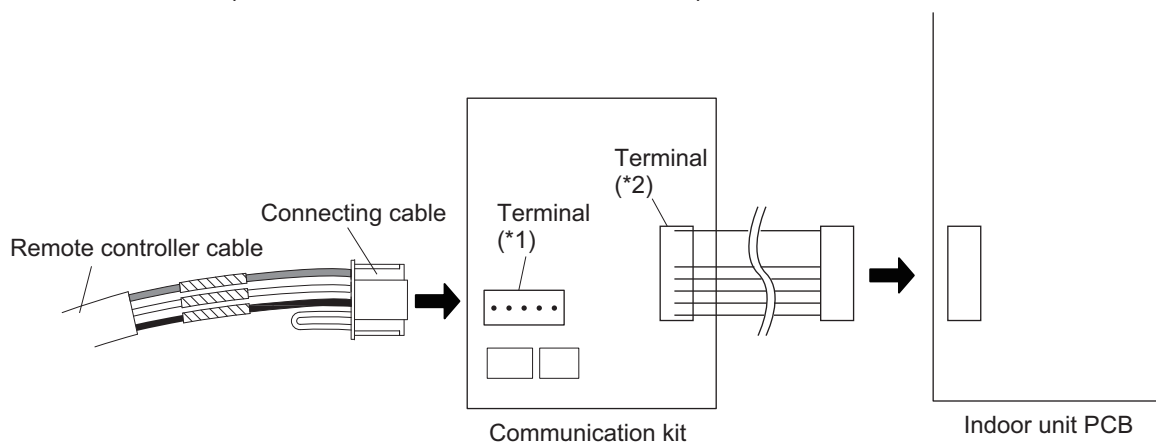


## ● Pattern B

1. Modify the remote controller cable as follows:
  - Use a tool to cut off the terminal on the end of the remote controller cable and then remove the insulation from the cut end of the cable as shown in following figure.
  - Connect the remote controller cable and connecting cable as shown in following figure.
  - Be sure to insulate the connection between the cables.

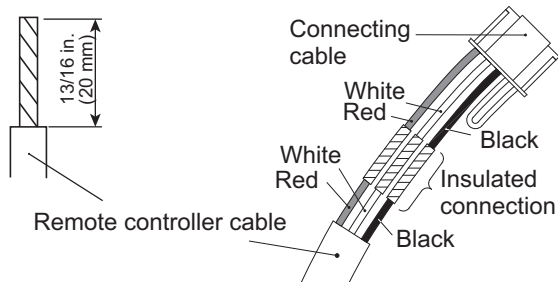

2. Connect the remote controller cable.
  - Connect the cable made in step 1. to the indoor unit PCB.

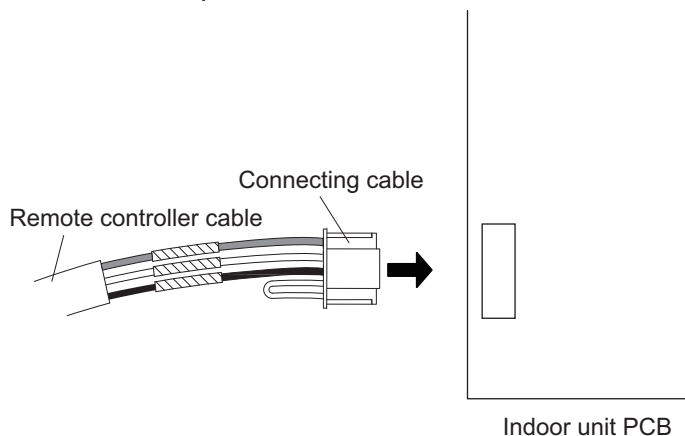


## ■ Optional parts

Wall mounted	Model name
UIWH07—15AVFJ	RXXCBXZ2


The communication kit is needed for connecting the wired remote controller to the wall mounted type.

## 11-4. Simple remote controller (UXRSNUM: Optional part)

### Overview

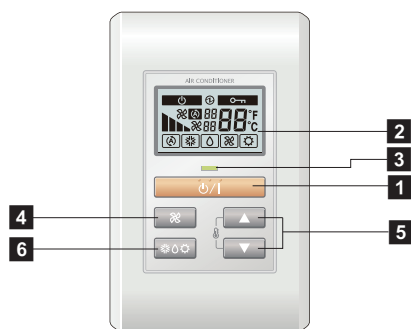

Display panel

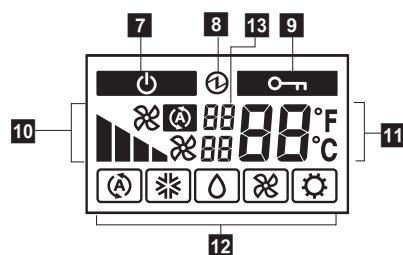

#### 1 START/STOP button

Starts and stops operation.






#### 2 Display backlight button

Lights during operation.

#### 3 Operation lamp

Lights during operation.






#### 4 FAN button

Selects the fan speed (AUTO , HIGH , MED , LOW , and QUIET ).

#### 5 SET TEMP. button

Selects the setting temperature.

#### 6 MODE button

Selects the operating mode (AUTO , COOL , DRY , FAN , HEAT ).

#### 7 Standby indicator

Indicates during the oil recovery and defrosting operation.

#### 8 Power source indicator

Indicates the main power is on.

#### 9 Central control indicator

Indicates when function is locked.

#### 10 Fan speed indicator

Deletes the weekly timer schedule.

#### 11 Set temperature

- Indicates error history number in error code history display mode.
- Indicates indoor unit address in address display mode.

#### 12 Operating mode indicator


#### 13 Indicator

- Upper:
  - Indicates the error code in error code history display mode and in self diagnosis mode.
  - Indicates the refrigerant system address in address display mode.
- Lower: Indicates the remote controller address in error code history display mode, address display mode, and self diagnosis mode.




## ■ System diagram

**1 remote controller:**

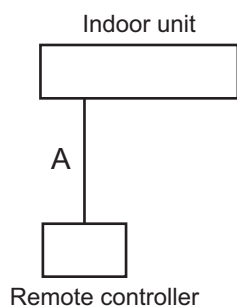


**2 remote controllers:**

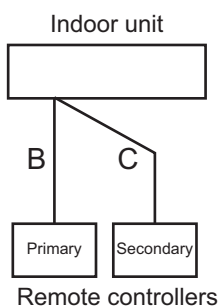


A, B, C: Remote controller cable  
 $A \leq 1,640 \text{ ft (500 m)}$ ;  $B + C \leq 1,640 \text{ ft (500 m)}$

## ■ Electrical wiring

**1 remote controller:**

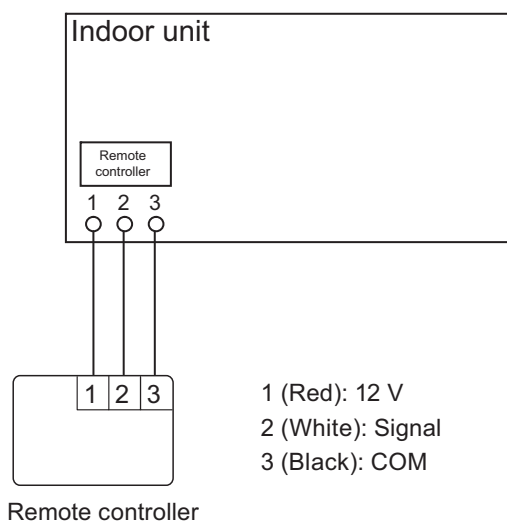


**2 remote controllers:**

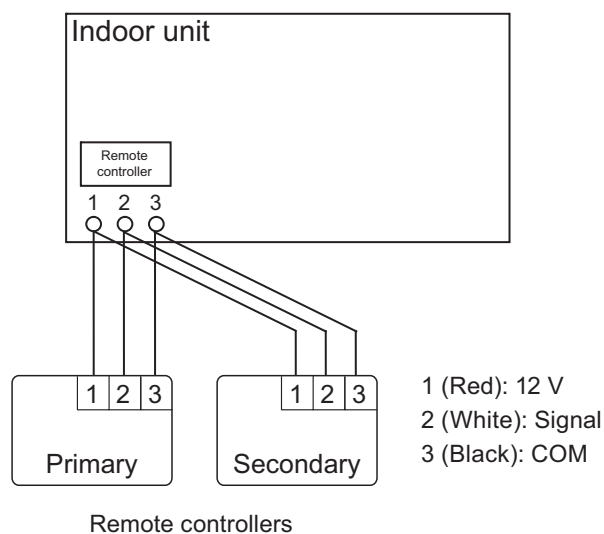

## ■ Specifications

Dimensions and other specifications on the wired remote controller are as follows.

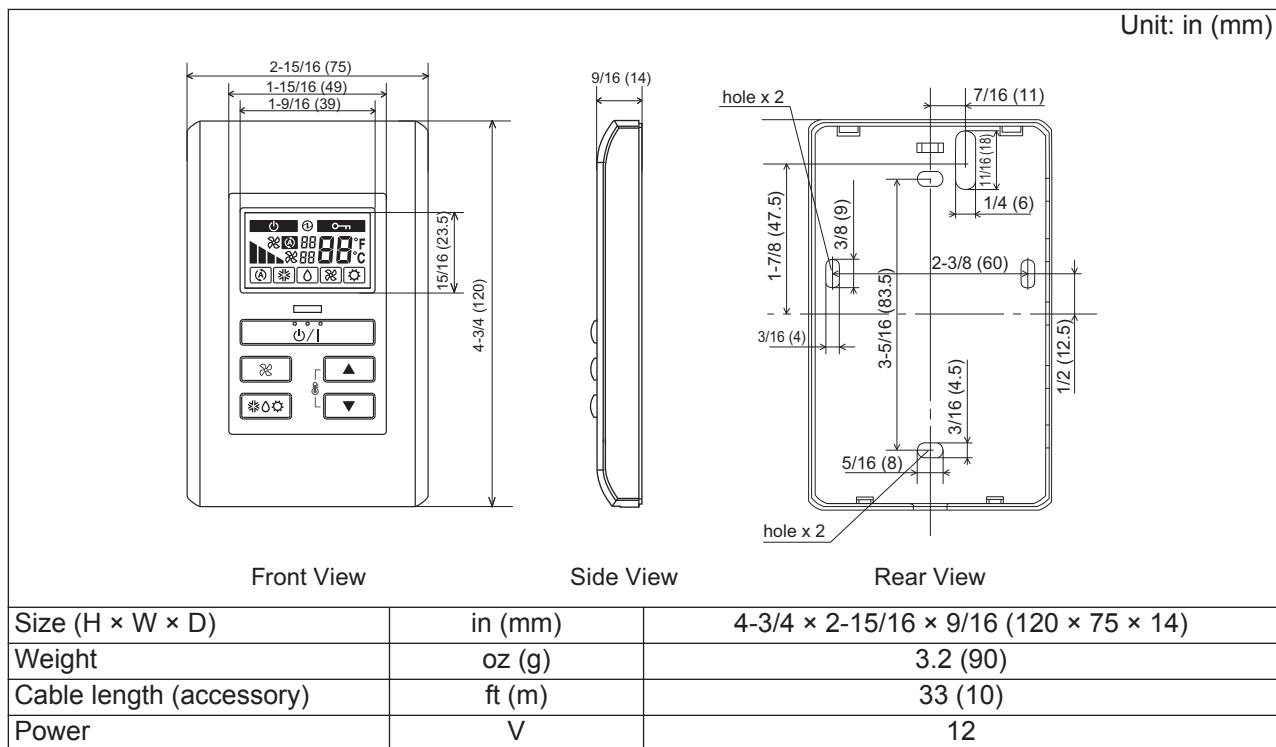

## ● Wiring specifications

Use	Size	Wire type	Remarks
Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 3 core	Use sheathed PVC cable.

## ■ Installation

### ● Connection pattern


**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit types		Connection pattern
Wall mounted type	UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ	Pattern A
	UIWH18AVFJ and UIWH24AVFJ	Pattern B

### ● Pattern A

1. Modify the remote controller cable as follows:


- Use a tool to cut off the terminal on the end of the remote controller cable and then remove the insulation from the cut end of the cable as shown in following figure.
- Connect the remote controller cable and connecting cable as shown in following figure.
- Be sure to insulate the connection between the cables.

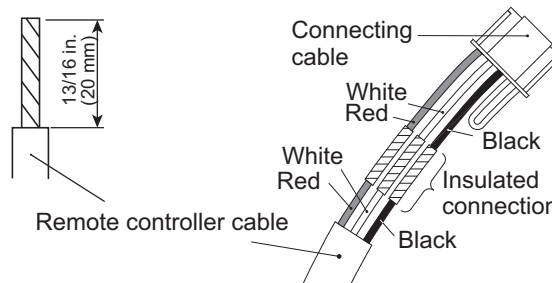

2. Connect the remote controller cable.


- Connect the cable made in step 1. to the terminal (\*1) of optional communication kit.
- Connect the cable from the terminal (\*2) of communication kit to the indoor unit PCB.

- \*1: CNC01 (for UIWH07—15AVFJ: RXXCBXZ2)
- \*2: CND01 (for UIWH07—15AVFJ: RXXCBXZ2)

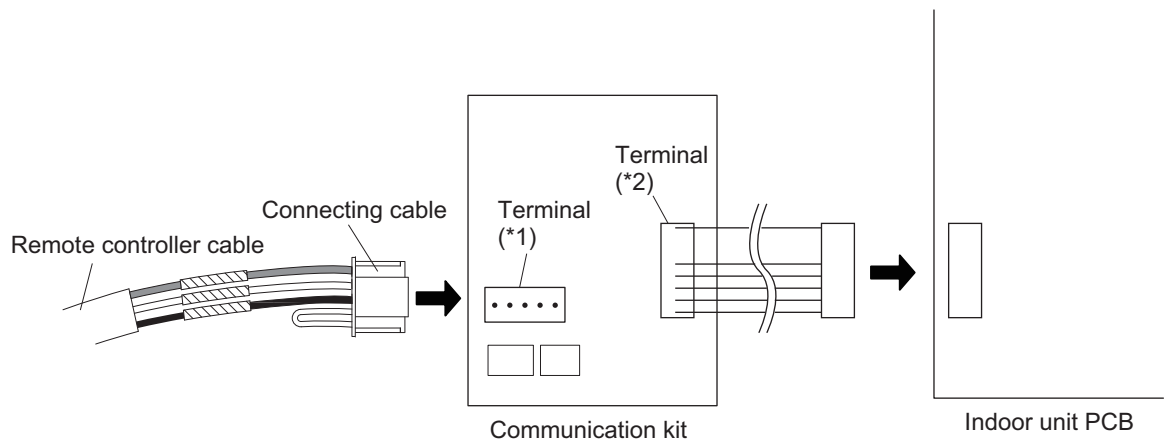


## ● Pattern B

1. Modify the remote controller cable as follows:
  - Use a tool to cut off the terminal on the end of the remote controller cable and then remove the insulation from the cut end of the cable as shown in following figure.
  - Connect the remote controller cable and connecting cable as shown in following figure.
  - Be sure to insulate the connection between the cables.

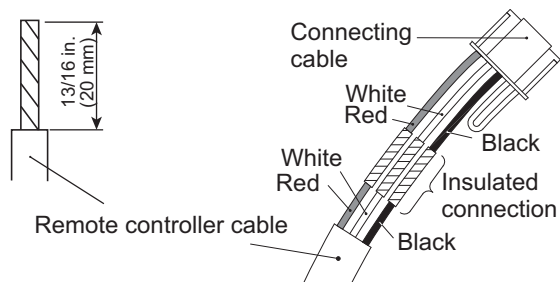

2. Connect the remote controller cable.
  - Connect the cable made in step 1. to the indoor unit PCB.

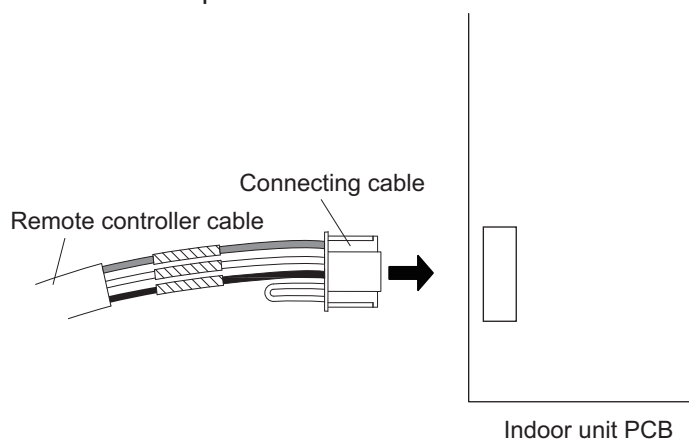

## ■ Optional parts

Wall mounted	Model name
UIWH07—15AVFJ	RXXCBXZ2

The communication kit is needed for connecting the wired remote controller to the wall mounted type.

## 12. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.

**NOTE:** Incorrect settings can cause a product malfunction.


### 12-1. Indoor unit (setting by wireless remote controller)

- The function settings of the control of the indoor unit can be changed by this procedure according to the installation conditions. Incorrect settings can cause the indoor unit malfunction.
- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.

#### ■ Preparation

Before connecting the power supply of the indoor unit, reconfirm following items:


- Piping air tight test and vacuuming have been performed firmly.
- There is no wiring mistake. Then, connect the power supply of the indoor unit.

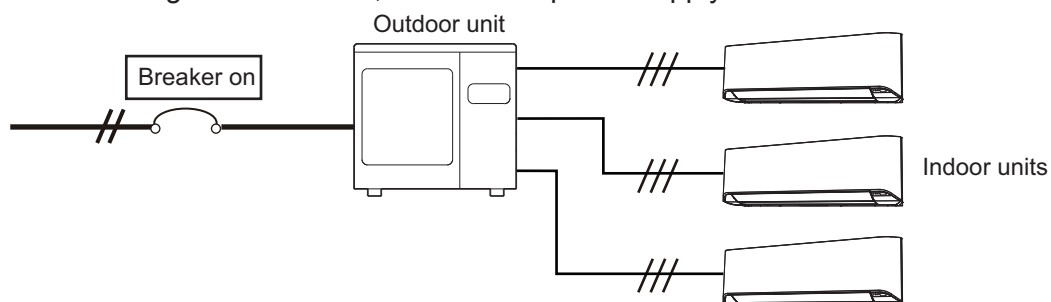

## ■ AR-RAH2U

### ● Button name and function


During address setting mode, indoor unit reject the any operation command from remote controller.

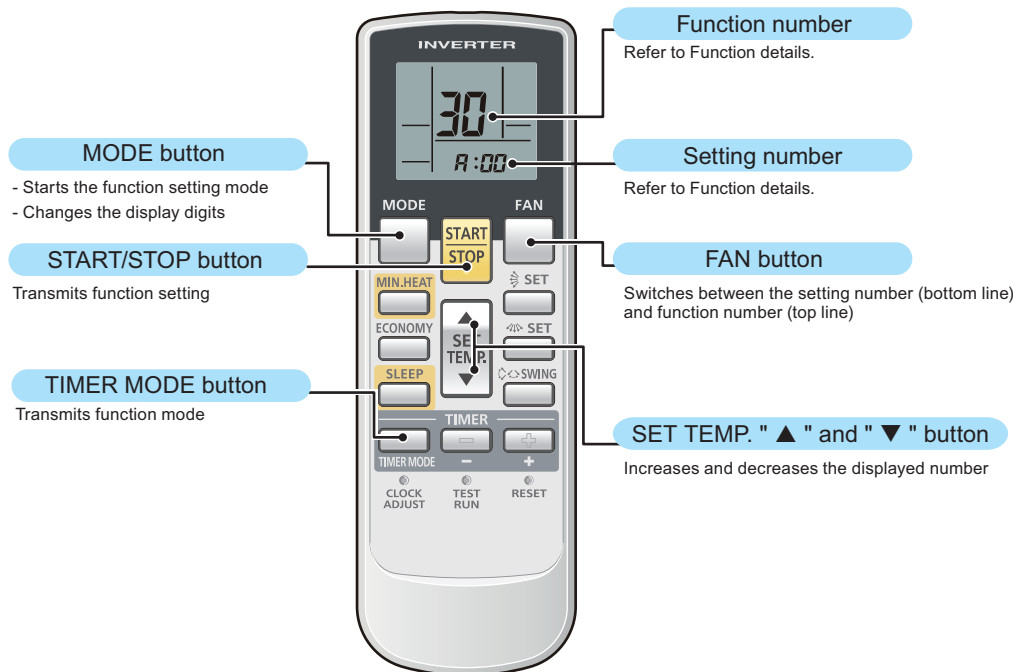


**NOTE:** Actual number of buttons might be different from the figures in following instructions.

### ● Function setting procedure


1. Connect the power supply of the outdoor unit.
2. To enter the function setting mode, while holding down the FAN and the SET TEMP. ▲ buttons, press the RESET button.

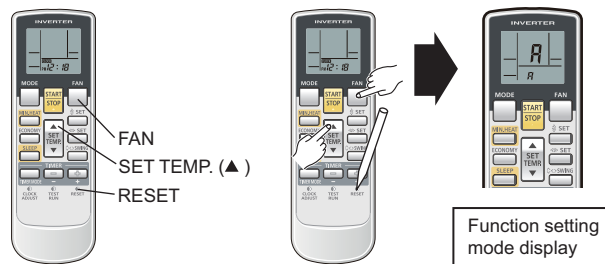


3. Press the SET TEMP. ▲ or ▼ buttons to select the custom code that matches the setting with the indoor unit. By selecting the appropriate custom code, the communication between the indoor unit and the wireless remote controller become possible.

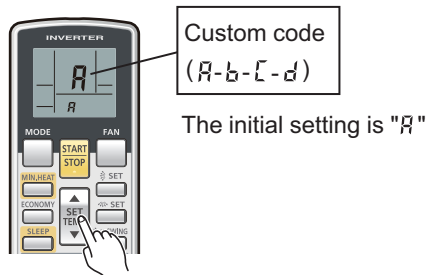


- For confirming the custom code, press the TIMER MODE button to send the code to the indoor unit.

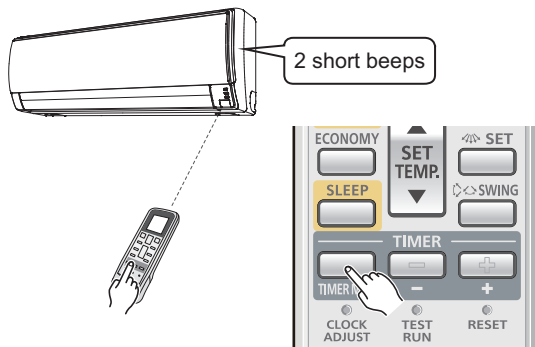

- Press the MODE button to enter the function setting mode.

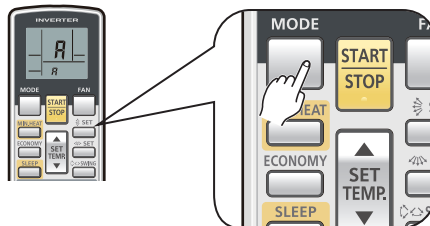


- Select the function number by pressing the ▲ or the ▼ button. Each time the MODE button is pressed, it switches between the left digit and the right digit.

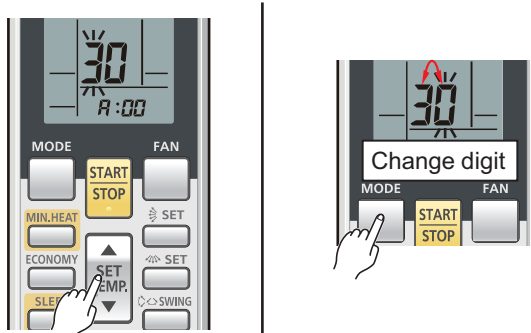


- Proceed to number setting by pressing the FAN button. To return to the function number selection, press the FAN button again.




- Select the setting number by pressing the ▲ or the ▼ button. Each time the MODE button is pressed, it switches between the left digit and the right digit.

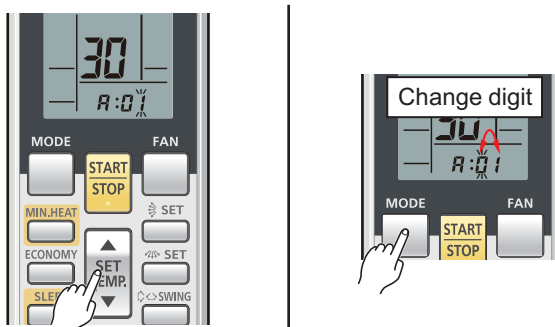

- Send the function mode information by pressing the TIMER MODE button once.

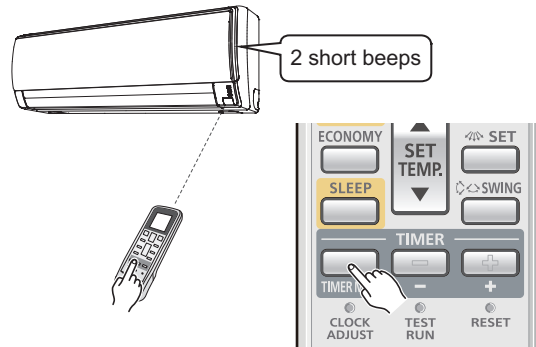


- Send the function setting information by pressing the START/STOP button once. 2 short beeps will be emitted from the indoor unit when the signal is received correctly. If wrong code is set, no beep sound will be emitted.

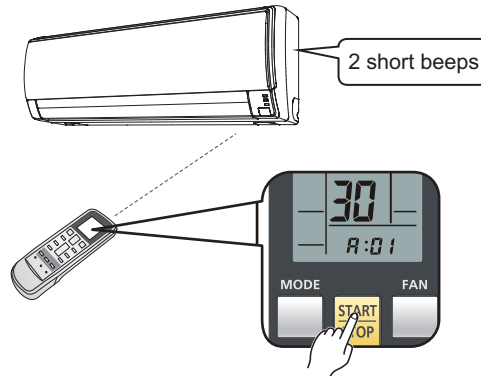

**NOTE:** Press START/STOP button within 30 seconds after pressing TIMER MODE button.


Function details: Refer to Chapter 12-4. "[Function details](#)" on page 65.

- Exit the function setting mode by pressing the RESET button.

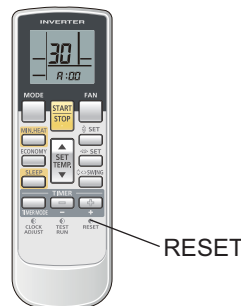

To set custom code *b*, *c*, or *d*, perform same procedures for each code.

## ● Setting up each indoor unit

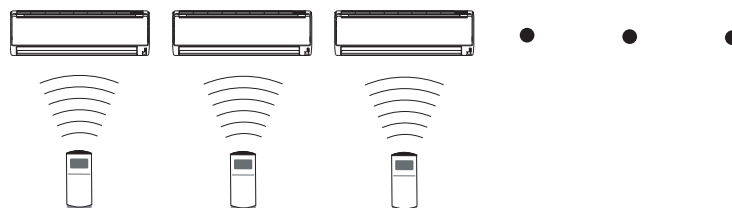

Repeat step from 1. to 11. to set up each indoor unit. If the custom code is other than "A", steps from 1. to 4. and 11. need to be performed.



## ● Resetting the power after setting up function of all indoor units

### NOTES:

- If the reset is not performed, function can not be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.  
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

Once the RESET button is pressed on the remote controller, the operation mode will be set to the AUTO MODE.


Adjust the operation mode to either cooling or heating before starting the operation of the air conditioner.

**NOTE:** If custom code other than "17" is set, the remote control must be set accordingly to the indoor unit setting.


## ● Remote controller custom code setting

Custom code setting of wireless remote controller needs to be same as the setting of the indoor unit. When you change the custom code setting of the wireless remote controller, do as follows:

1. Press the START/STOP button until only the clock is displayed on the remote controller display.

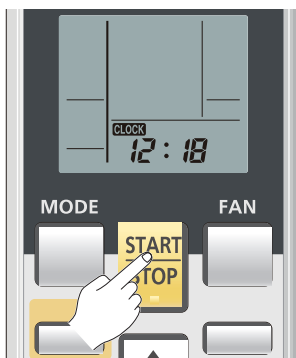


2. Press the MODE button for at least 5 seconds to display the current custom code (initially set to A).

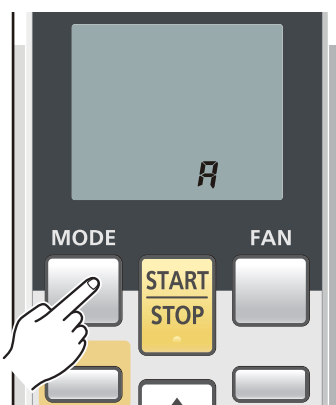

3. Press the SET TEMP. ▲ or the ▼ button to change the custom code between A → b → c → d.



4. Press the MODE button again to return to the clock display. The custom code will be changed.

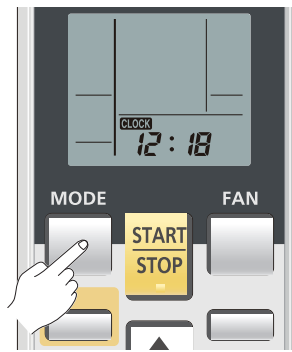


- If no buttons are pressed within 30 seconds after the custom code is displayed, the system returns to the original clock display. In this case, start again from step 1.
- The air conditioner custom code is set to A prior to shipment.
- The remote controller resets to custom code A when the batteries in the remote controller are replaced. If you use a custom code other than custom code A, reset the custom code after replacing the batteries. If you do not know the air conditioner custom code setting, try each of the custom codes (A → B → C → D) until you find the code which operates the air conditioner.

## ■ AR-REG1U


### ● Button name and function

During address setting mode, indoor unit reject the any operation command from remote controller.

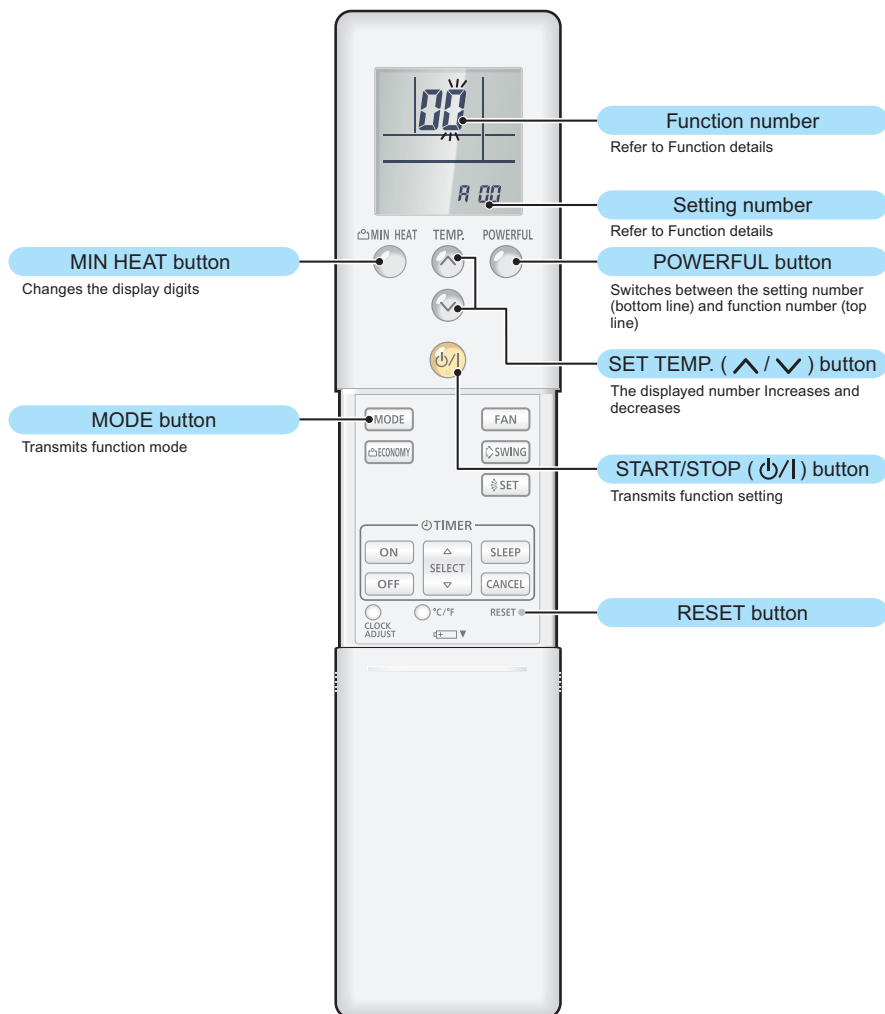

### ● Function setting procedure

1. Connect the power supply of the outdoor unit.
2. To enter the function setting mode, while holding down the POWERFUL and SET TEMP. ^ buttons, press the RESET button.

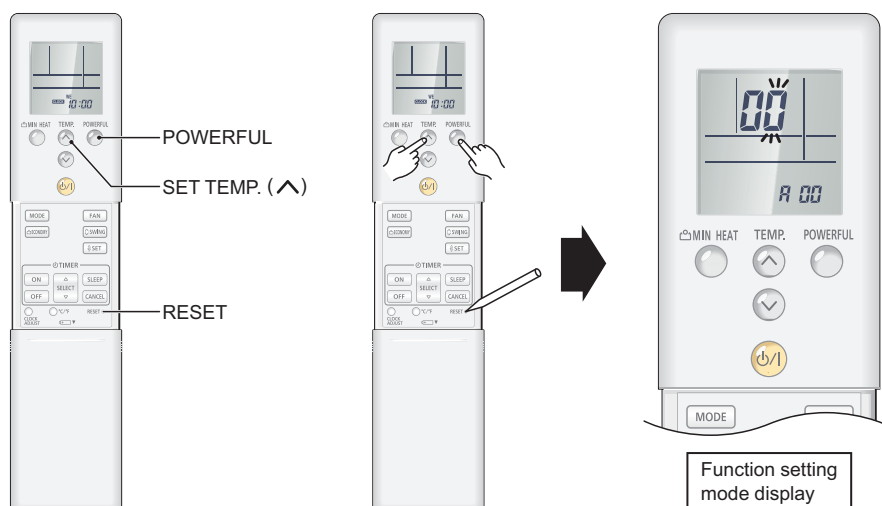


3. Select the function number by pressing the  $\wedge$  or the  $\vee$  buttons. Each time the MIN. HEAT button is pressed, it switches between the right digit and the left digit.




4. Proceed to the setting number by pressing the POWERFUL button. (To return to the function number selection, press the POWERFUL button again.)




5. Select the function number by pressing the  $\wedge$  or the  $\vee$  button. Each time the MIN. HEAT button is pressed, it switches between the right digit and the left digit.

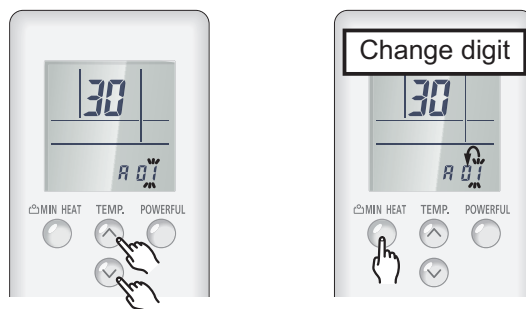

6. Press the MODE button once to transmit the function mode information.

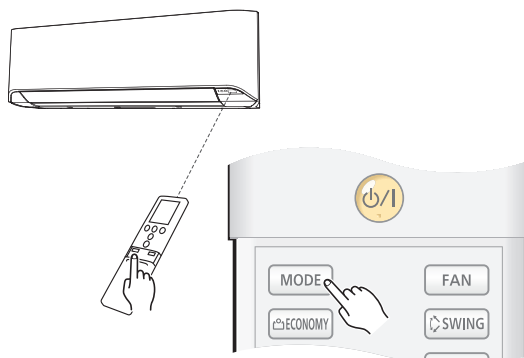


7. Press the  $\phi/|$  button once to transmit the function setting information. 2 short beeps will be emitted from the indoor unit when the signal is received correctly. If wrong code is set, no beep sound will be emitted.

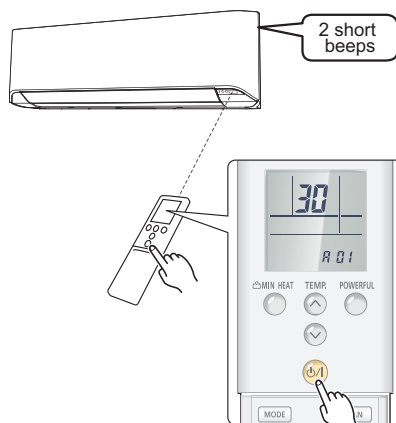


**NOTE:** Press  $\phi/|$  button within 30 seconds after pressing MODE button.

For the function details, refer to Chapter 12-4. "[Function details](#)" on page 65.

8. Exit the function setting mode by pressing the RESET button.

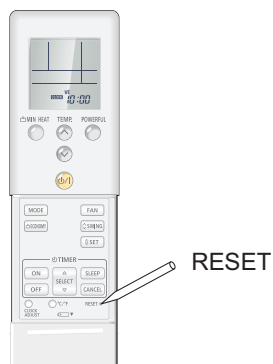

## ● Setting up each indoor unit

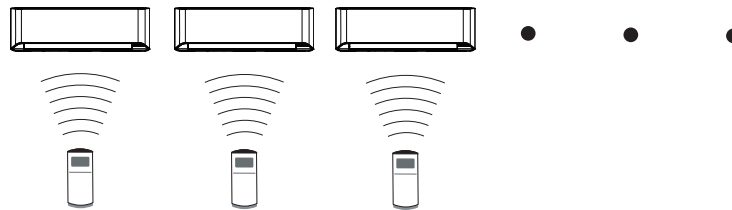

Repeat step from 1. to 8. to set up each indoor unit. If the custom code is other than "F", steps from 1. to 2. and 8. need to be performed.

## ● Resetting the power after setting up function of all indoor units

### NOTES:

- If the reset is not performed, function can not be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
 

However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

Once the RESET button is pressed on the remote controller, the operation mode will be set to the AUTO MODE.

Adjust the operation mode to either cooling or heating before starting the operation of the air conditioner.

**NOTE:** If custom code other than "F" is set, the remote control must be set accordingly to the indoor unit setting.

## ● Remote controller custom code setting

Custom code setting of wireless remote controller needs to be same as the setting of the indoor unit. When you change the custom code setting of the wireless remote controller, do as follows:

1. Press the START/STOP button until only the clock is displayed on the display.



2. Press the MODE button for at least 5 seconds to display the current custom code (initially set to A).



3. Press the SET TEMP. “ ^ ” or the “ v ” button to change the custom code between A → b → c → d.



4. Press the MODE button again to return to the clock display. The custom code will be changed.




- If no buttons are pressed within 30 seconds after the custom code is displayed, the system returns to the original clock display. In this case, start again from step 1.
- The air conditioner custom code is set to A prior to shipment.
- If you do not know the air conditioner custom code setting, try each of the custom codes (A → b → c → d) until you find the code which operates the air conditioner.



## ● Remote controller temperature unit

To change the displayed temperature unit, press the "°C/°F" switching button to select the preferred temperature unit. (Factory setting is set to "°F".):




## 12-2. Indoor unit (setting by wired remote controller)

- The function settings of the control of the indoor unit can be changed by this procedure according to the installation conditions. Incorrect settings can cause the indoor unit malfunction.
- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function cannot be used on the secondary units.

### ■ Preparation

Before connecting the power supply of the indoor unit, reconfirm following items:


- Piping air tight test and vacuuming have been performed firmly.
- There is no wiring mistake. Then, connect the power supply of the indoor unit.

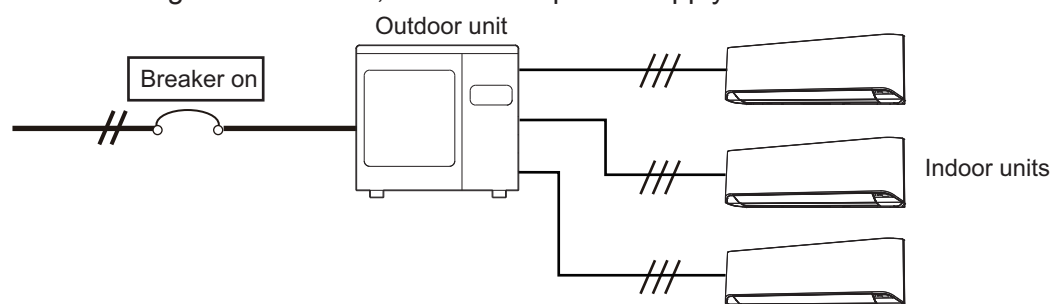

# ■ UXRNNUM


## ● Button name and function

During address setting mode, indoor unit reject the any operation command from remote controller.

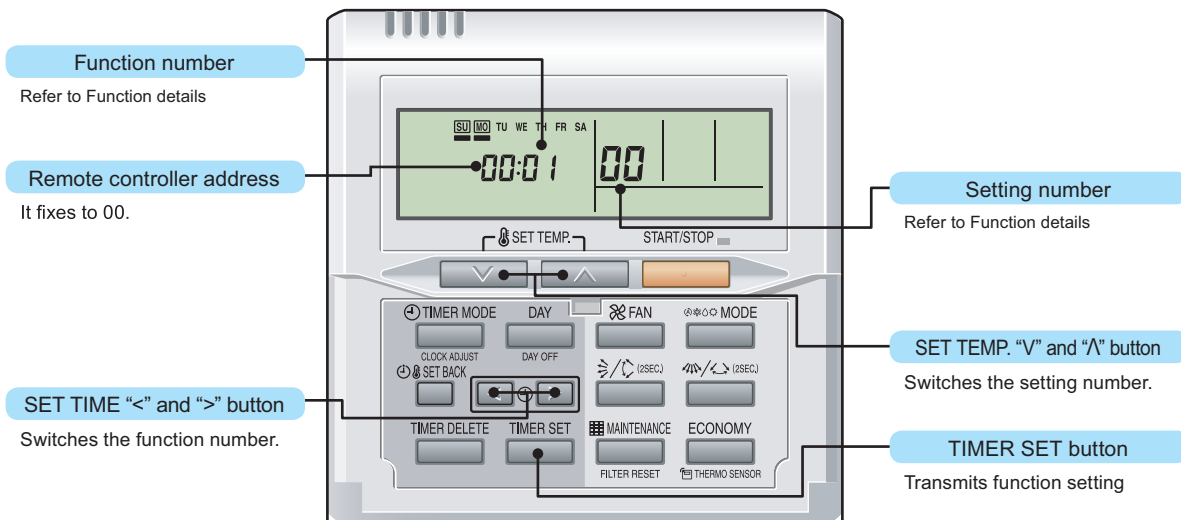


## ● Function setting procedure


1. Connect the power supply of the outdoor unit.
2. Switch to the function setting mode.  
To enter the function setting mode, hold down the 3 buttons of SET TEMP.  $\nabla$ , SET TEMP.  $\wedge$ , and FAN at the same time for 5 seconds or longer.

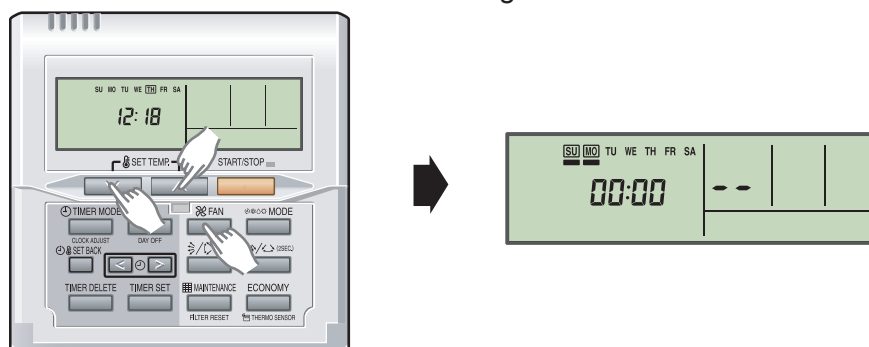


3. Select the function number by pressing the SET TIME < or the SET TIME > button.

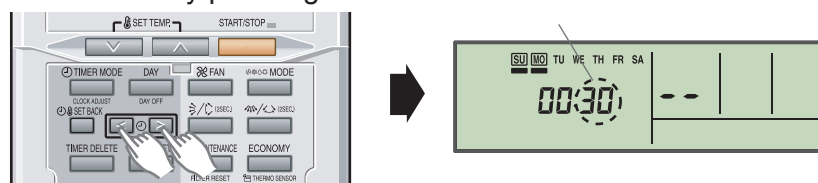

4. Select the setting number by pressing the SET TEMP.  $\wedge$  or the SET TEMP.  $\nabla$  button.  
The display flashes during setting number selection.

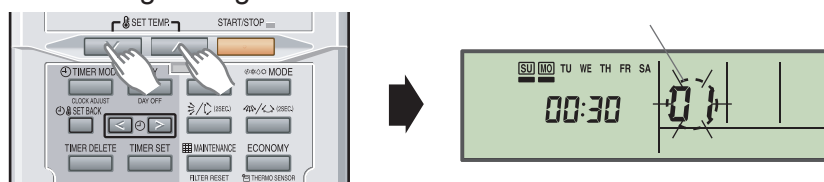


5. Confirm the setting by pressing the TIMER SET button.  
The data will be transferred to the indoor unit.

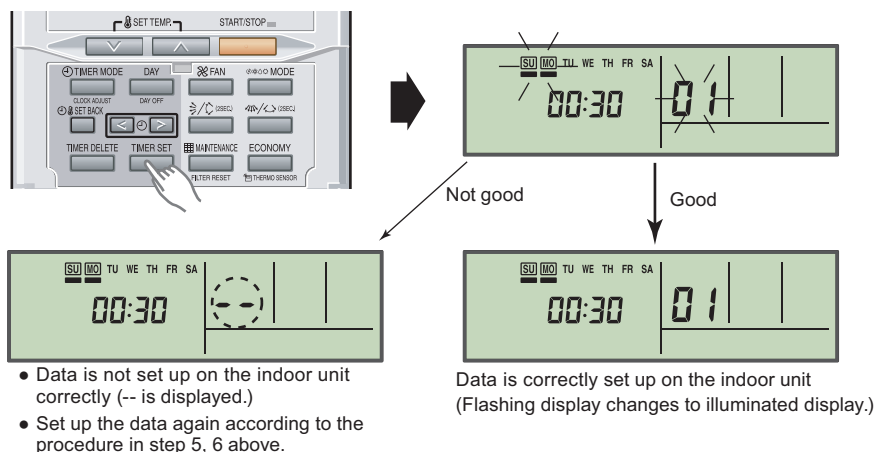

Function details: Refer to Chapter 12-4. "[Function details](#)" on page 65.

6. Exit the function setting mode by holding 3 buttons of SET TEMP.  $\nabla$ , SET TEMP.  $\wedge$  and FAN at the same time.

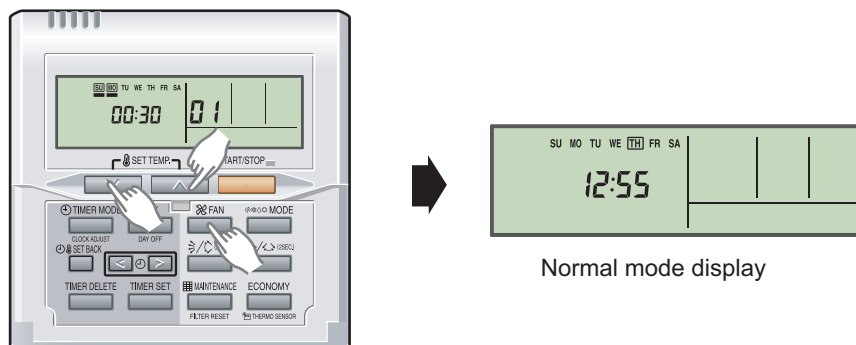

If no button is pressed within 60 seconds after buttons mentioned above are pressed, it will automatically exit the function setting mode.

If you exit the function setting mode unintentionally during setting, enter the mode again according to the procedure in step 2.

## ● Setting up each indoor unit

Repeat the procedures from step 1 to 6, and set up the indoor units requiring function setting.

## ● Resetting the power after setting up function of all indoor units

### NOTES:

- If the reset is not performed, function can not be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.  
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.


## 12-3. Indoor unit (setting by simple remote controller)

- The function settings of the control of the indoor unit can be changed by this procedure according to the installation conditions. Incorrect settings can cause the indoor unit malfunction.
- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function cannot be used on the secondary units.

### ■ Preparation

Before connecting the power supply of the indoor unit, reconfirm following items:


- Piping air tight test and vacuuming have been performed firmly.
- There is no wiring mistake. Then, connect the power supply of the indoor unit.

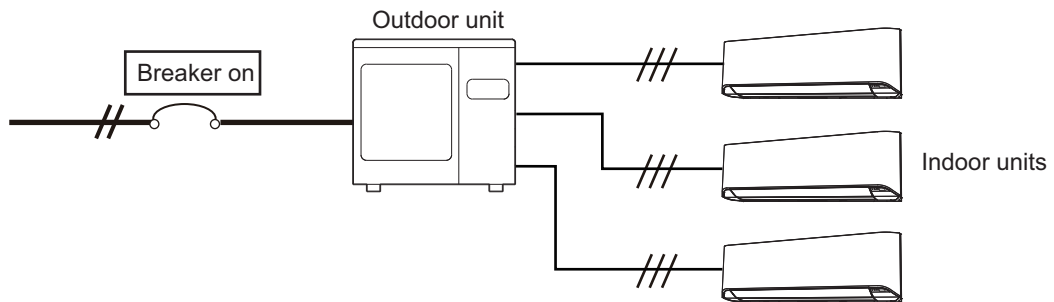

## ■ UXRSNUM


### ● Button name and function

During address setting mode, indoor unit reject the any operation command from remote controller.

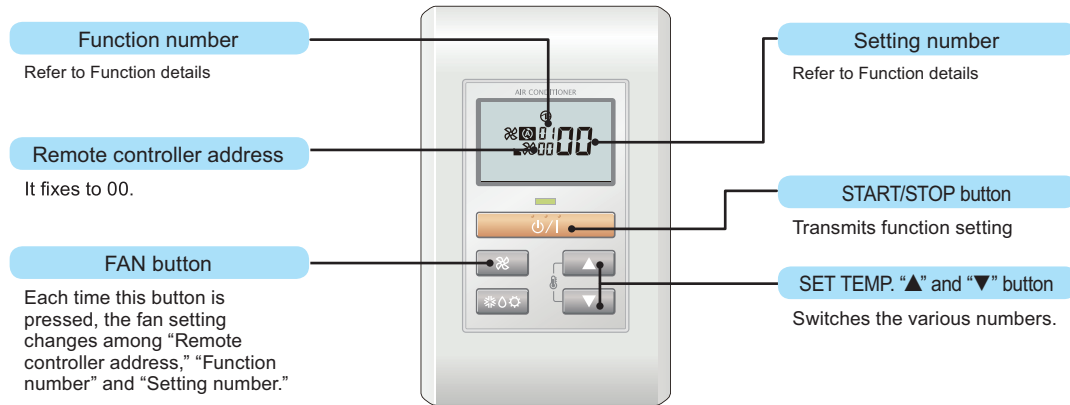


### ● Function setting procedure


1. Connect the power supply of the outdoor unit.
2. Switch to the function setting mode.  
To enter the function setting mode, hold down the 3 buttons of SET TEMP. ▲, SET TEMP. ▼ and FAN at the same time for 5 seconds or longer.

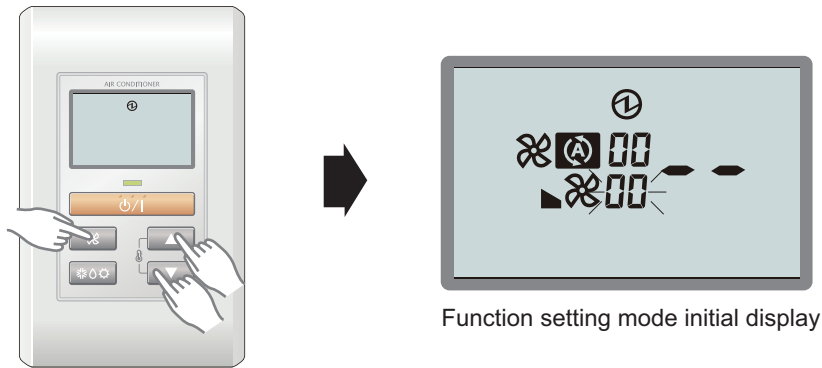

3. Press the FAN button.  
The Function number indicator flashes. Then, press either the SET TEMP. ▲ button or the SET TEMP. ▼ button to set up the function number.

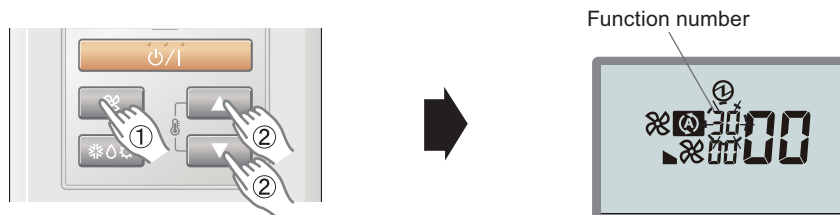


- Select the setting number by pressing the SET TEMP. ▲ or SET TEMP. ▼ button. The setting number indicator flashes during setting number selection.

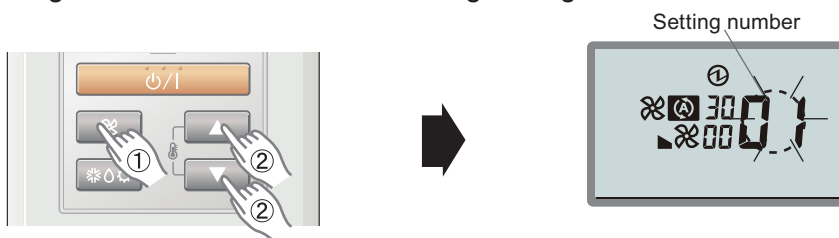

Example) Function number : 30, Setting number : 01

- Confirm the setting by pressing the TIMER SET button. The data will be transferred to the indoor unit.

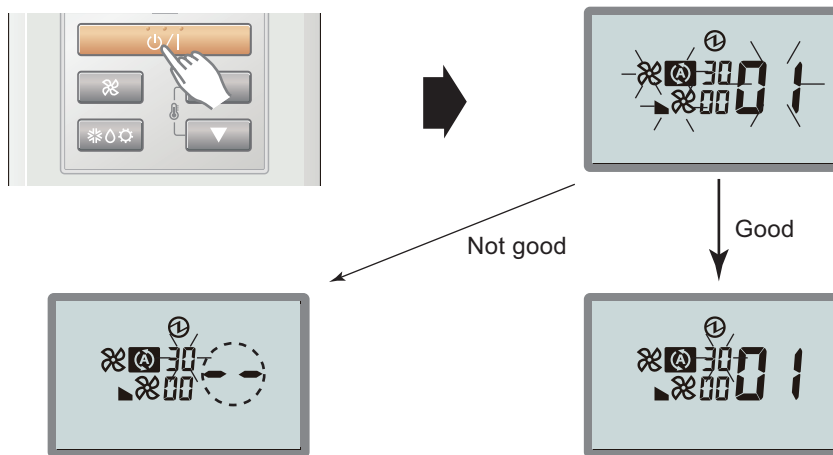


- Data is not set up on the indoor unit correctly (-- is displayed.)
- Set up the data again according to the procedure in step 3, 4 above.

Data is correctly set up on the indoor unit.

Function details: Refer to Chapter 12-4. "[Function details](#)" on page 65.

- Exit the function setting mode by pressing the 3 buttons of SET TEMP. ▲, SET TEMP. ▼, and FAN at the same time for 5 seconds or longer. After exiting the function setting mode, the display returns to the normal mode.

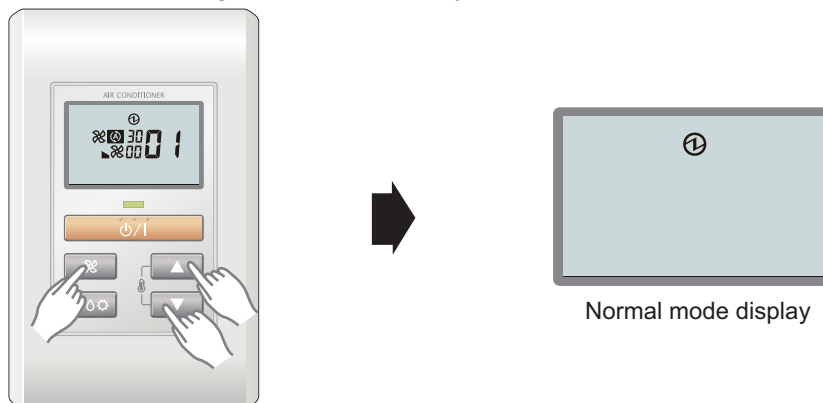

If no button is pressed within 60 seconds after buttons mentioned above are pressed, it will automatically exit the function setting mode.

If you exit the function setting mode unintentionally during setting, enter the mode again according to the procedure in step 2.

## ● Setting up each indoor unit

Repeat the procedures from step 1 to 6, and set up the indoor units requiring function setting.

## ● Resetting the power after setting up function of all indoor units

### NOTES:

- If the reset is not performed, function can not be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.  
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.



## 12-4. Function details

### ■ Contents of function setting

Each function setting listed in this section is adjustable in accordance with the installation environment.

**NOTE:** Setting will not be changed if invalid numbers or setting values are selected.

### ● Function setting list

	Functions
1)	Filter sign
2)	Room temperature control for indoor unit sensor
3)	Auto restart
4)	Room temperature sensor switching
5)	Remote controller custom code
6)	External input control
7)	Room temperature sensor switching (Aux.)
8)	Indoor unit fan control for energy saving for cooling (for UIWH07/09/12/15AVFJ only)
9)	Room temperature control for wired remote controller sensor
10)	Heat insulation condition (building insulation)

#### 1) Filter sign

Select appropriate intervals for displaying the filter sign on the indoor unit according to the estimated amount of dust in the air of the room.

If the indication is not required, select "No indication" (03).

Function number	Setting value	Setting description	Factory setting
11	00	Standard (400 hours)	
	01	Long interval (1,000 hours)	
	02	Short interval (200 hours)	
	03	No indication	◆

## 2) Room temperature control for indoor unit sensor

**NOTE:** Before performing this setting, refer to Function 95.

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment.

The temperature correction values show the difference from the Standard setting "00" (manufacturer's recommended value).

\*When Function 95-01 (High insulation) is set, the Standard setting "00" will be the same as "No correction 0.0 °F (0.0 °C)" (01).

Function number		Setting value	Setting description	Factory setting	
30 (For cooling)	31 (For heating)	00	Standard setting*	◆	
		01	No correction 0.0 °F (0.0 °C)		
		02	-1 °F (-0.5 °C)	More cooling Less heating	
		03	-2 °F (-1.0 °C)		
		04	-3 °F (-1.5 °C)		
		05	-4 °F (-2.0 °C)		
		06	-5 °F (-2.5 °C)		
		07	-6 °F (-3.0 °C)		
		08	-7 °F (-3.5 °C)		
		09	-8 °F (-4.0 °C)		
		10	+1 °F (+0.5 °C)	Less cooling More heating	
		11	+2 °F (+1.0 °C)		
		12	+3 °F (+1.5 °C)		
		13	+4 °F (+2.0 °C)		
		14	+5 °F (+2.5 °C)		
		15	+6 °F (+3.0 °C)		
16	+7 °F (+3.5 °C)				

## 3) Auto restart

Enables or disables automatic restart after a power interruption.

Function number	Setting value	Setting description	Factory setting
40	00	Enable	◆
	01	Disable	

**NOTE:** Auto restart is an emergency function such as for power outage etc. Do not attempt to use this function in normal operation. Be sure to operate the unit by remote controller or external device.

## 4) Room temperature sensor switching

(Only for wired remote controller)

When using the wired remote controller temperature sensor, change the setting to "Both" (01).

Function number	Setting value	Setting description	Factory setting
42	00	Indoor unit	◆
	01	Both	

00: Sensor on the indoor unit is active.

01: Sensors on both indoor unit and wired remote controller are active.

**NOTE:** Remote controller sensor must be turned on by using the remote controller.

**5) Remote controller custom code**

(Only for wireless remote controller)

The indoor unit custom code can be changed. Select the appropriate custom code.

Function number	Setting value	Setting description	Factory setting
44	00	A	◆
	01	B	
	02	C	
	03	D	

**6) External input control**

"Operation/Stop" mode or "Forced stop" mode can be selected.

Function number	Setting value	Setting description	Factory setting
46	00	Operation/Stop mode	◆
	01	(Setting prohibited)	
	02	Forced stop mode	

**7) Room temperature sensor switching (Aux.)**

To use the temperature sensor on the wired remote controller only, change the setting to "Wired remote controller" (01).

This function will only work if the function setting 42 is set at "Both" (01).

When the setting value is set to "Both" (00), more suitable control of the room temperature is possible by setting function setting 30 and 31 too.

Function number	Setting value	Setting description	Factory setting
48	00	Both	◆
	01	Wired remote controller	

**8) Indoor unit fan control for energy saving for cooling (for UIWH07/09/12/15AVFJ only)**

Enables or disables the power-saving function by controlling the indoor unit fan rotation when the outdoor unit is stopped during cooling operation.

Function number	Setting value	Setting description	Factory setting
49	00	Disable	◆
	01	Enable	

00: When the outdoor unit is stopped, the indoor unit fan operates continuously following the setting on the remote controller.

01: When the outdoor unit is stopped, the indoor unit fan operates intermittently at a very low speed.

## 9) Room temperature control for wired remote controller sensor

**NOTE:** Before performing this setting, refer to Function 95.

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment.

To change this setting, set Function 42 to "Both" (01).

Ensure that the thermo sensor icon is displayed on the remote controller screen.

Function number		Setting value	Setting description	Factory setting	
92 (For cooling)	93 (For heating)	00	No correction 0.0 °F (0.0 °C)	◆	
		01	No correction 0.0 °F (0.0 °C)		
		02	-1 °F (-0.5 °C)	More cooling Less heating	
		03	-2 °F (-1.0 °C)		
		04	-3 °F (-1.5 °C)		
		05	-4 °F (-2.0 °C)		
		06	-5 °F (-2.5 °C)		
		07	-6 °F (-3.0 °C)		
		08	-7 °F (-3.5 °C)		
		09	-8 °F (-4.0 °C)		
		10	+1 °F (+0.5 °C)	Less cooling More heating	
		11	+2 °F (+1.0 °C)		
		12	+3 °F (+1.5 °C)		
		13	+4 °F (+2.0 °C)		
		14	+5 °F (+2.5 °C)		
		15	+6 °F (+3.0 °C)		
16	+7 °F (+3.5 °C)				

## 10) Heat insulation condition (building insulation)

Heat insulation conditions differ according to the installed environment.

"Standard insulation" (00) allows system to rapidly respond to the cooling or heating load changes.

"High insulation" (01) is when the heat insulation structure of the building is high and does not require system to rapidly respond to cooling or heating load changes.

When "High insulation" (01) is selected:

- Overheating (overcooling) is prevented at the start-up.
- All room-temperature control settings (Function 30, 31, 92, and 93) will reset to "No correction 0.0 °F (0.0 °C)".

Function number	Setting value	Setting description	Factory setting
95	00	Standard insulation	◆
	01	High insulation	


**NOTE:** When changing Function 95, perform this setting before other room-temperature control settings (Function 30, 31, 92, and 93). If Function 95 is not set first, room-temperature control settings (Function 30, 31, 92, and 93) will be reset and you must re-do them again.

## 12-5. Wired remote controller

DIP switch 1	SW1	Prohibited
	SW2	Dual remote controller setting
	SW3	Prohibited
	SW4	°F/°C switch
	SW5	Prohibited
	SW6	Memory backup setting

\* Do not use DIP switch 2.

### Switch location

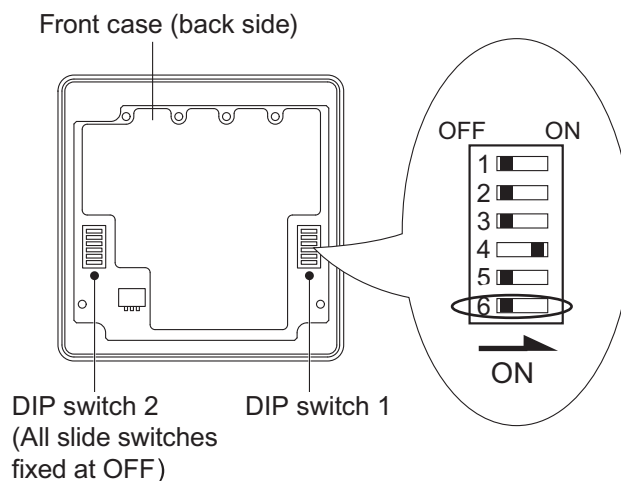


### Dip switch 1 setting

#### ● SW2: Dual remote controller setting

Set the remote controller SW2 according to the following table.

Number of remote controller	Primary unit	Secondary unit	Factory setting
	SW2	SW2	
1 (Normal)	OFF	—	◆
2 (Dual)	OFF	ON	

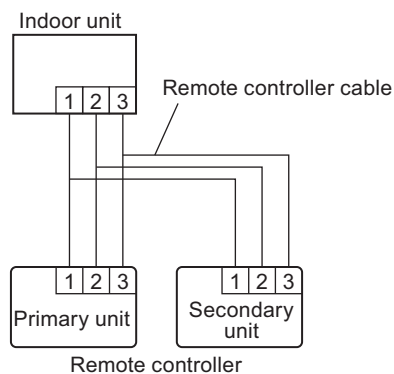

#### ● SW4: Switching temperature unit °F / °C

Displayed temperature unit can be switched between Fahrenheit (°F) and Celsius (°C).

SW4	Fahrenheit (°F) / Celsius (°C)	Factory setting
OFF	°C	
ON	°F	◆

## ● SW6: Memory backup setting (only for wired remote controller)

Set to "ON" to use batteries for the memory backup.

When batteries are not used, all of settings stored in memory will be deleted if there is a power failure.


SW6	Memory backup	Factory setting
OFF	Invalidity	◆
ON	Validity	

**NOTE:** Never turn it on in the case of simple remote controller.

## 12-6. Simple remote controller

DIP switch	SW1	Prohibited
	SW2	Dual remote controller setting
	SW3	°F/°C switch
	SW4	Prohibited
	SW5	Prohibited
	SW6	Prohibited

### ■ Switch location

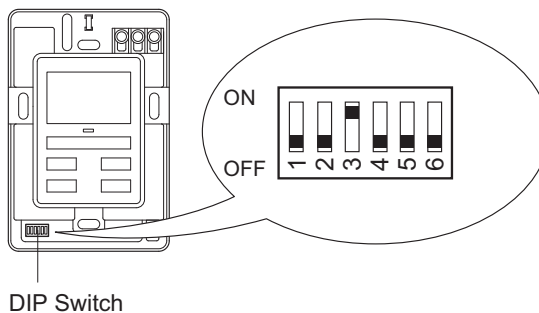


### ■ Dip switch setting

#### ● SW2: Dual remote controller setting

Set the remote controller SW2 according to the following table.

Number of remote controller	Primary unit	Secondary unit	Factory setting
	SW2	SW2	
1 (Normal)	OFF	—	◆
2 (Dual)	OFF	ON	

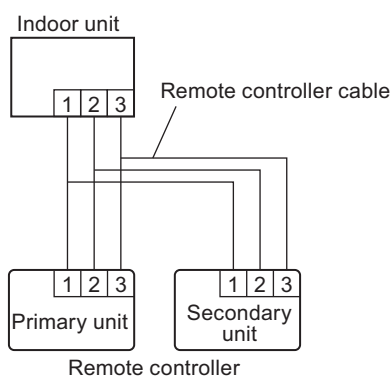

#### ● SW3: Switching temperature unit °F / °C













Displayed temperature unit can be switched between Fahrenheit (°F) and Celsius (°C).

SW3	Fahrenheit (°F) / Celsius (°C)	Factory setting
OFF	°C	
ON	°F	◆

## 13. Accessories













### 13-1. Wall mounted type

#### ■ Models: UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Operating manual		1	Cloth tape		1
Installation manual		1	Tapping screw (large), M4 × 25 mm		5
Wall hook bracket		1	Tapping screw (small), M3 × 12 mm		2
Remote controller		1	Air cleaning filter		2
Battery		2	Filter holder		2
Remote controller holder		1	Seal A <ul style="list-style-type: none"> <li>It is necessary when using 15 model.</li> <li>It is used when the diameter of gas pipe is <math>\text{Ø}1/2</math> in (12.70 mm) or more.</li> </ul>		1



## ■ Models: UIWH18AVFJ and UIWH24AVFJ

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Operating manual		1	Drain hose insulation		1
Installation manual		1	Cloth tape		1
Wall hook bracket		1	Tapping screw (large), M4 × 25 mm		8
Remote controller		1	Tapping screw (small), M3 × 12 mm		2
Battery		2	Air cleaning filter		2
Remote controller holder		1	Air cleaning filter frame		2

# 14. Optional parts

## 14-1. Controllers





### Lineup

Indoor unit type		Type			
		Wired remote controller	Wireless remote controller		Simple remote controller
		UXRNNUM	AR-RAH2U	AR-REG1U	UXRSNUM
Wall mounted	UIWH07AVFJ UIWH09AVFJ UIWH12AVFJ UIWH15AVFJ	○*	—	●	○*
	UIWH18AVFJ UIWH24AVFJ	○	●	—	○

●: Accessory, ○: Optional, —: Not applicable

\*: Optional Communication kit (RXXCBXZ2) is necessary for the installation.

### Parts

Wired remote controller	Simple remote controller
 UXRNNUM	 UXRSNUM
Wireless remote controller	
 AR-RAH2U	 AR-REG1U

## 14-2. Others




### Lineup

Indoor unit type		Type		
		External connect kit		Communication kit
		RXXWZX	RXXWZXZ5	RXXCBXZ2
Wall mounted	UIWH07AVFJ UIWH09AVFJ UIWH12AVFJ UIWH15AVFJ	—	○*1	○
	UIWH18AVFJ UIWH24AVFJ	○	—	—

●: Accessory, ○: Optional, —: Not applicable

\*1: Optional Communication kit (RXXCBXZ2) is necessary for the installation.

### Parts

External connect kit Model: RXXWZX	External connect kit Model: RXXWZXZ5
 <p>(x1) (x1)</p> <p>For wall mounted type (UIWH18AVFJ and UIWH24AVFJ)</p>	 <p>(x1) (x2)</p> <p>For wall mounted type (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ)</p>
Communication kit Model: RXXCBXZ2	
 <p>For wall mounted type (UIWH07AVFJ, UIWH09AVFJ, UIWH12AVFJ, and UIWH15AVFJ)</p>	

---

## 15. Indoor unit installation precautions

**NOTE:** The information listed below are general precautions.  
Some models also include items that do not apply.

---


### 15-1. Place where prohibited for use

- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places where there is a lot of oil splash and steam such as kitchen or machinery room.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Places where carbon fibers or any kind of powder suspended in the air.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are large such as a factory.

## 15-2. Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the indoor.
- To allow maintenance after refrigerant piping, drain piping, and electric wiring connection and installation, provide an installation service space and an inspection port, as required.  
\*Installation service space is shown on "Dimensions" on page 7.
- Be careful when installing the unit at the following places.

Condition	Contents	Countermeasures (Reference)
When the ceiling is high.	If the indoor unit is installed where the installation height given in the installation manual is exceeded, the temperature difference between the floor and ceiling of the room will be large and the heating effect will be poor. Moreover, even if the indoor unit is installed within the installation height, a similar phenomena will occur when installed in a room in which the doors are opened and closed frequently and hot air circulation is obstructed by furniture such as desks or chairs.	<ol style="list-style-type: none"> <li>1. Switch the setting to the high ceiling mode.</li> <li>2. Install a circulator.</li> <li>3. Arrange the furniture in the room so that it does not obstruct the hot air.</li> </ol>
When lower level directly contacts the outside air.	When the lower level of the room is a semi-open space such as warehouse or parking lot the surface temperature of the flooring will become low and the radiation of cold from the floor will increase. In this case, even if the room temperature is suitable, you may feel the foot level is cold.	
When the air flow distribution is poor.	When an indoor unit is installed in a position where the outlet airflow will directly contact people, a draft may be felt. In addition, when there are obstructions in the path of the intake and outlet airflow, the air distribution may become extremely bad.	<ol style="list-style-type: none"> <li>1. Adjust the louver fins or take other measures matched to the site.</li> <li>2. Change the indoor unit outlet.</li> </ol>
When inside the ceiling is high temperature and high humidity.	When the indoor unit is installed where the inside of the ceiling is 30 °C (86 °F) RH80% or greater, the dew point temperature of the outer perimeter may become higher than the cabinet surface temperature and moisture will condense on the surface of the cabinet and water drops may fall inside the room. →Refer to Fig. A. In addition, the humidity may vary considerably the same as when the inside of the ceiling is close to hermetically sealed and used as the outside air intake path.	<ol style="list-style-type: none"> <li>1. Add heat insulating material to the outside of the indoor unit cabinet. *Regarding the cassette type, use of optional High humidity correspondence kit is recommended.</li> <li>2. Strengthen the heat insulating material of the refrigerant piping and drain piping too. →Refer to Fig. B.</li> <li>3. When the humidity inside the ceiling changes considerably, install a ventilation port.</li> </ol>

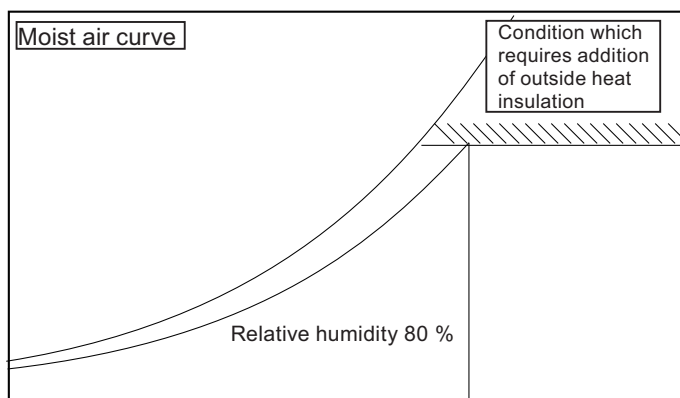

Dry bulb temperature 30 °C (86 °F)

Fig. A

**Work method when reinforcing the heat insulation of on-site piping**

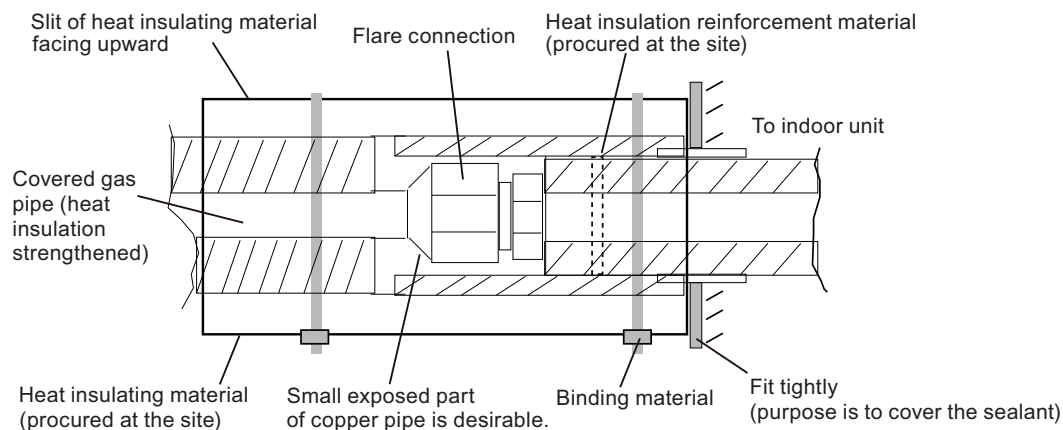


Fig. B

Condition	Contents	Countermeasures (Reference)
When the remote controller installation site is bad.	If the cold or warm air blown out from the air conditioner directly contacts the thermostat section of the remote controller, the outlet temperature of the air conditioner may be sensed and room temperature control will be different from the room temperature, and “not cooled” or “not heated” or other trouble may occur. In addition, there is the possibility that the same kind of trouble may also occur when the remote controller is effected by direct sunlight.	<ol style="list-style-type: none"> <li>1. Install the remote controller where it will not be directly exposed to the cold or hot air.</li> <li>2. Install the remote controller where it will not be directly exposed to sunlight or strong lighting.</li> </ol>
When installation environment is quiet.	When the wall mounted type was installed in a bedroom, living room, or other quiet place, the sound of the refrigerant flow may be sensed as noise and must be taken into account.	<ol style="list-style-type: none"> <li>1. Plan installation of a model with external expansion valve.</li> <li>2. Plan installation of a branch box farther from indoor unit.</li> <li>3. Plan installation using another air conditioner.</li> </ol>
When using the wireless remote controller.	Signals may not be received when using it in a room illuminated by an inverter fluorescent lamp.	Turn on the fluorescent lamp and check if the indoor unit receives the signals from the remote controller. If the indoor unit does not receive the signals, consult an authorized service personnel.
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.

# **Part 2. OUTDOOR UNIT (2 ROOMS TYPE)**

---

**MULTI TYPE:  
UOMH18AFXZJ**

# 1. Specifications

## 1-1. Model: UOMH18AFXZJ

OUTDOOR UNIT  
UOMH18AFXZJ

Type				Inverter heat pump
Model name				<b>UOMH18AFXZJ</b>
Power source				1Ø 208/230 V 60 Hz
Available voltage range				187—264V
Connectable indoor unit		Number		2
		Total capacity range		14,000 to 21,000 Btu/h
Combination of indoor unit				UIWH09AVFJ × 2
Capacity	Cooling	Rated	Btu/h	18,000
			kW	5.28
		Min.—Max.	Btu/h	6,100—21,000
			kW	1.8—6.2
	Heating	Rated	Btu/h	22,000
			kW	6.42
Min.—Max.		Btu/h	6,800—24,400	
		kW	2.0—7.2	
Input power	Cooling	Rated	kW	1.44
		Max.		2.06
	Heating	Rated		1.87
		Max.		2.10
Current	Cooling	Rated	A	6.3
	Heating			8.2
EER	Cooling	Rated	Btu/W	12.5
SEER *1	Cooling		-	18.0
COP	Heating	Rated	W/W	3.44
HSPF *1	Heating		-	9.03
Starting current				A
Maximum operating current *2				A
Fan	Type × Q'ty			Propeller × 1
	Airflow rate	Cooling	CFM (m <sup>3</sup> /h)	1,795 (3,050)
		Heating		1,619 (2,750)
	Motor	Type × Quantity		
Output		W	100	
Sound pressure level	Cooling	Rated	dB (A)	49
	Heating			49
Heat exchanger	Dimension (H × W × D)		in (mm)	26-7/16 × 35-7/16 × 1-7/16 (672 × 900 × 36.38)
	Fin pitch		FPI	18
	Rows × Stages			2 × 32
	Pipe type (Material)			Grooved H-pin (Copper)
	Fin		Type (Material)	Corrugate (Aluminum)
	Surface treatment			Corrosion resistance (Blue Fin)
Compressor	Type × Quantity			DC twin rotary × 1
	Motor output		W	1,100
Refrigerant	Type			R410A
	Charge		lb (g)	4 lb 14 oz (2,200)
Refrigerant oil	Type			POE
	Amount		in <sup>3</sup> (cm <sup>3</sup> )	39.7 (650)
Enclosure	Material			Painted galvanized steel
	Color			Beige (Approximate color of MUNSELL 10YR 7.5/1.0NN)
Dimensions	Net	(H × W × D)	in (mm)	27-9/16 × 35-7/16 × 13 (700 × 900 × 330)
	Gross			34-1/16 × 41-5/16 × 17-1/2 (865 × 1,050 × 445)
Weight	Net			119 (54)
	Gross			137 (62)
Connection pipe	Size	Liquid	in (mm)	Ø1/4 (Ø6.35) × 2
		Gas		Ø3/8 (Ø9.52) × 2
	Method			Flare
	Pre-charge length (Total)			98 (30)
	Max. length (Total)			164 (50)
	Max. length (Each)			82 (25)
	Min. length (Total)		ft (m)	49 (15)
	Min. length (Each)			16 (5)
	Max. height difference between outdoor unit and each indoor units			49 (15)
	Max. height difference between indoor units			33 (10)
Operation range	Cooling			14 to 115 (-10 to 46)
	Heating			5 to 75 (-15 to 24)

### NOTES:


- Specifications are based on the following conditions:
  - Power source of specifications : 230 V
  - Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
  - Cooling: Indoor temperature of 80 °FDB (26.7 °CDB)/67 °FWB (19.4 °CWB), and outdoor temperature of 95 °FDB (35 °CDB)/75 °FWB (23.9 °CWB).
  - Heating: Indoor temperature of 70 °FDB (21.1 °CDB)/60 °FWB (15.6 °CWB), and outdoor temperature of 47 °FDB (8.3 °CDB)/43 °FWB (6.1 °CWB).
  - \*1: Test conditions are based on AHRI 210/240.
  - \*2: The maximum current is the maximum value when the operated within the operation range.
- For other combination, refer to the combination table.
- The protective function might work when using it outside the operation range.




## 2. Dimensions

### 2-1. Model: UOMH18AFXZJ


Unit: in (mm)

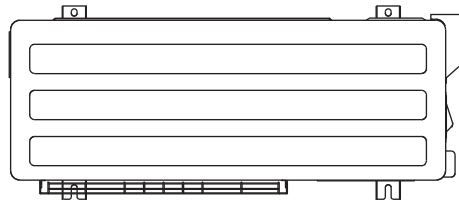


Top view

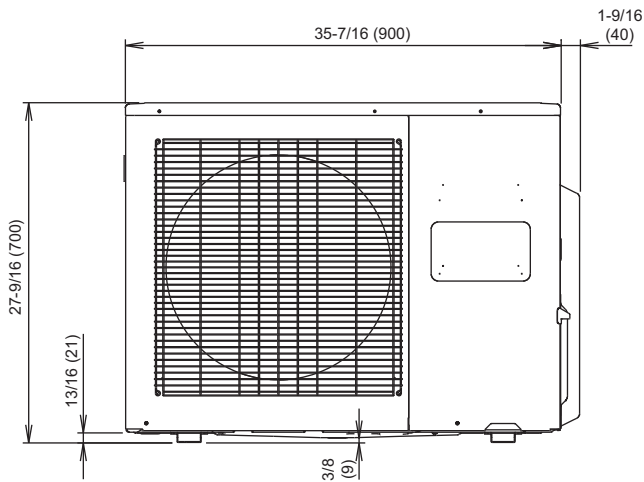


Front view

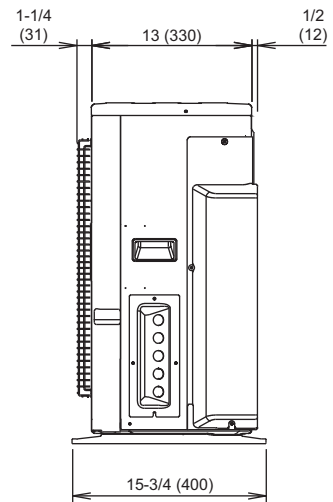

Side view

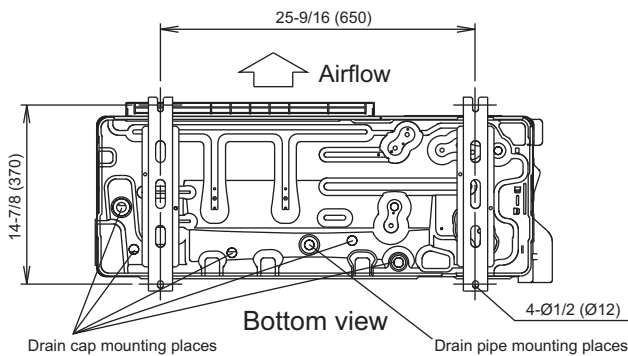

Bottom view



OUTDOOR UNIT  
UOMH18AFXZJ

# 3. Installation space

## 3-1. Model: UOMH18AFXZJ

### ■ Space requirement


Provide sufficient installation space for product safety.

#### ● Single outdoor unit installation


- When the upper space is open:

Unit: in (mm)


When there are obstacles at the rear only.

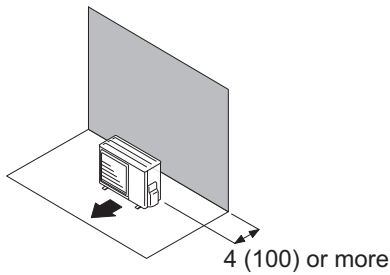


When there are obstacles at the rear and sides.

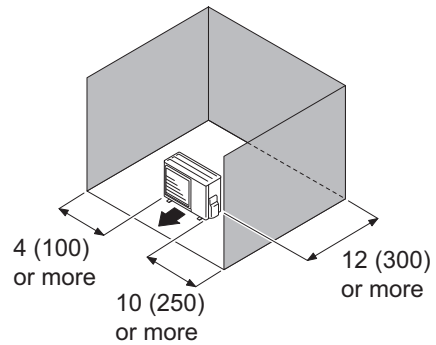

When there are obstacles at the front only.

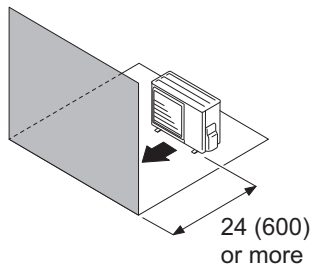


When there are obstacles at the front and rear.

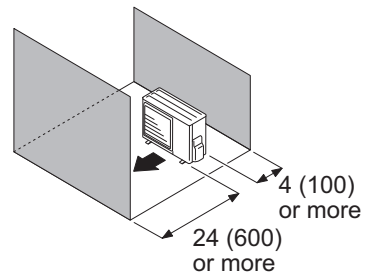


- When there is an obstruction in the upper space:

Unit: in (mm)

When there are obstacles at the rear and above.

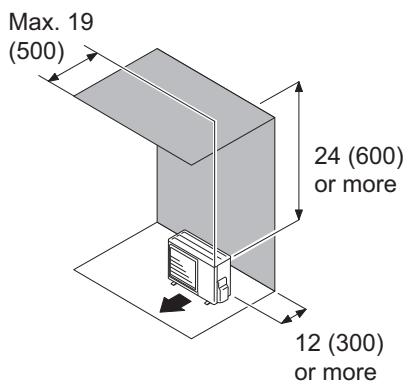

When there are obstacles at the rear, sides, and above.

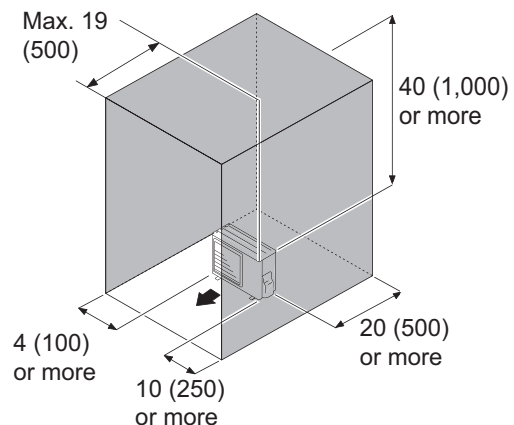


## ● Multiple outdoor unit installation


- When the upper space is open:

Unit: in (mm)


When there are obstacles at the rear only.

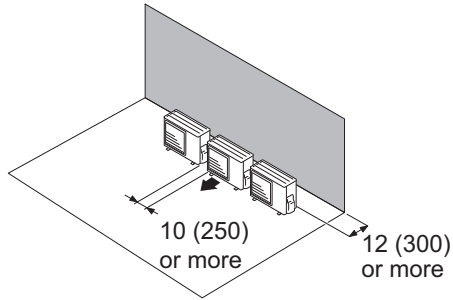

When there are obstacles at the front only.

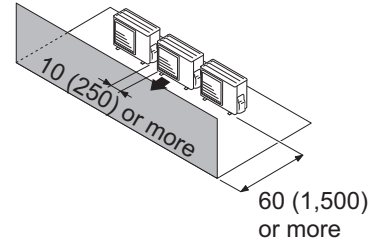


When there are obstacles at the front and rear.

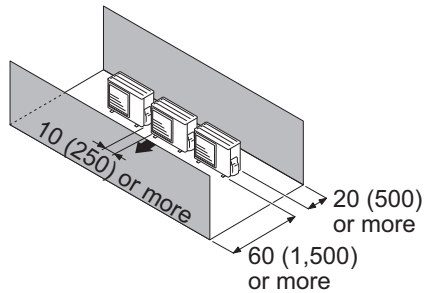

- When there is an obstruction in the upper space:

Unit: in (mm)


When there are obstacles at the rear and above.

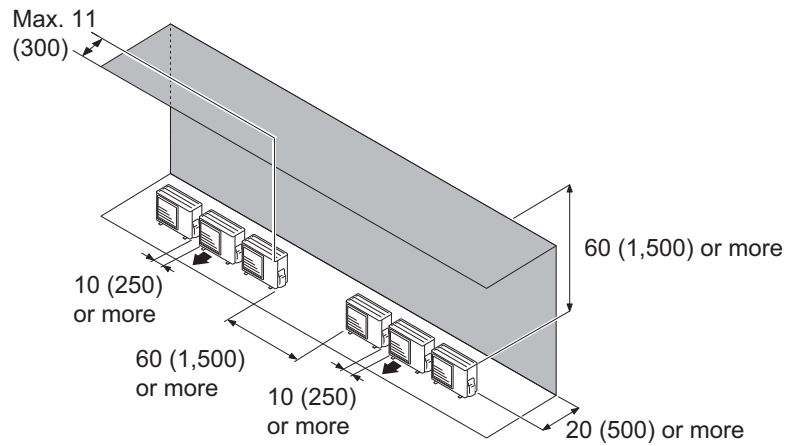



## ● Outdoor unit installation in multi-row

Unit: in (mm)

Single parallel unit arrangement

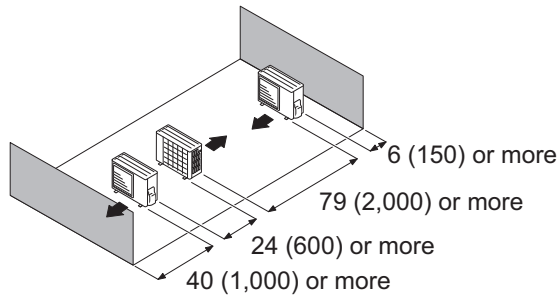

Multiple parallel unit arrangement

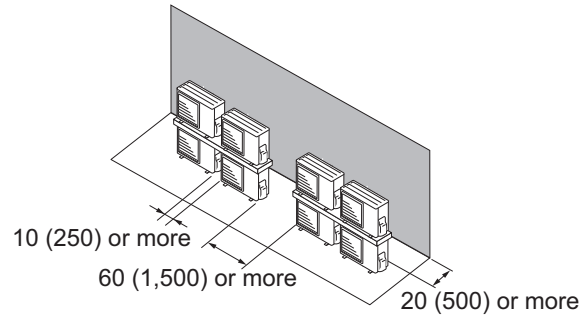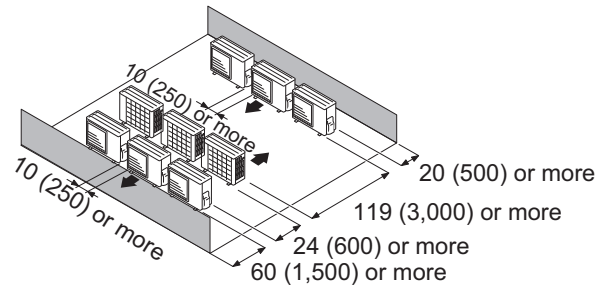


### NOTES:

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- Height above the floor level should be 2 in (50 mm) or more.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.


### ⚠ CAUTION

- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 32 °F (0 °C) or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.



# 4. Refrigerant circuit

## 4-1. Model: UOMH18AFXZJ

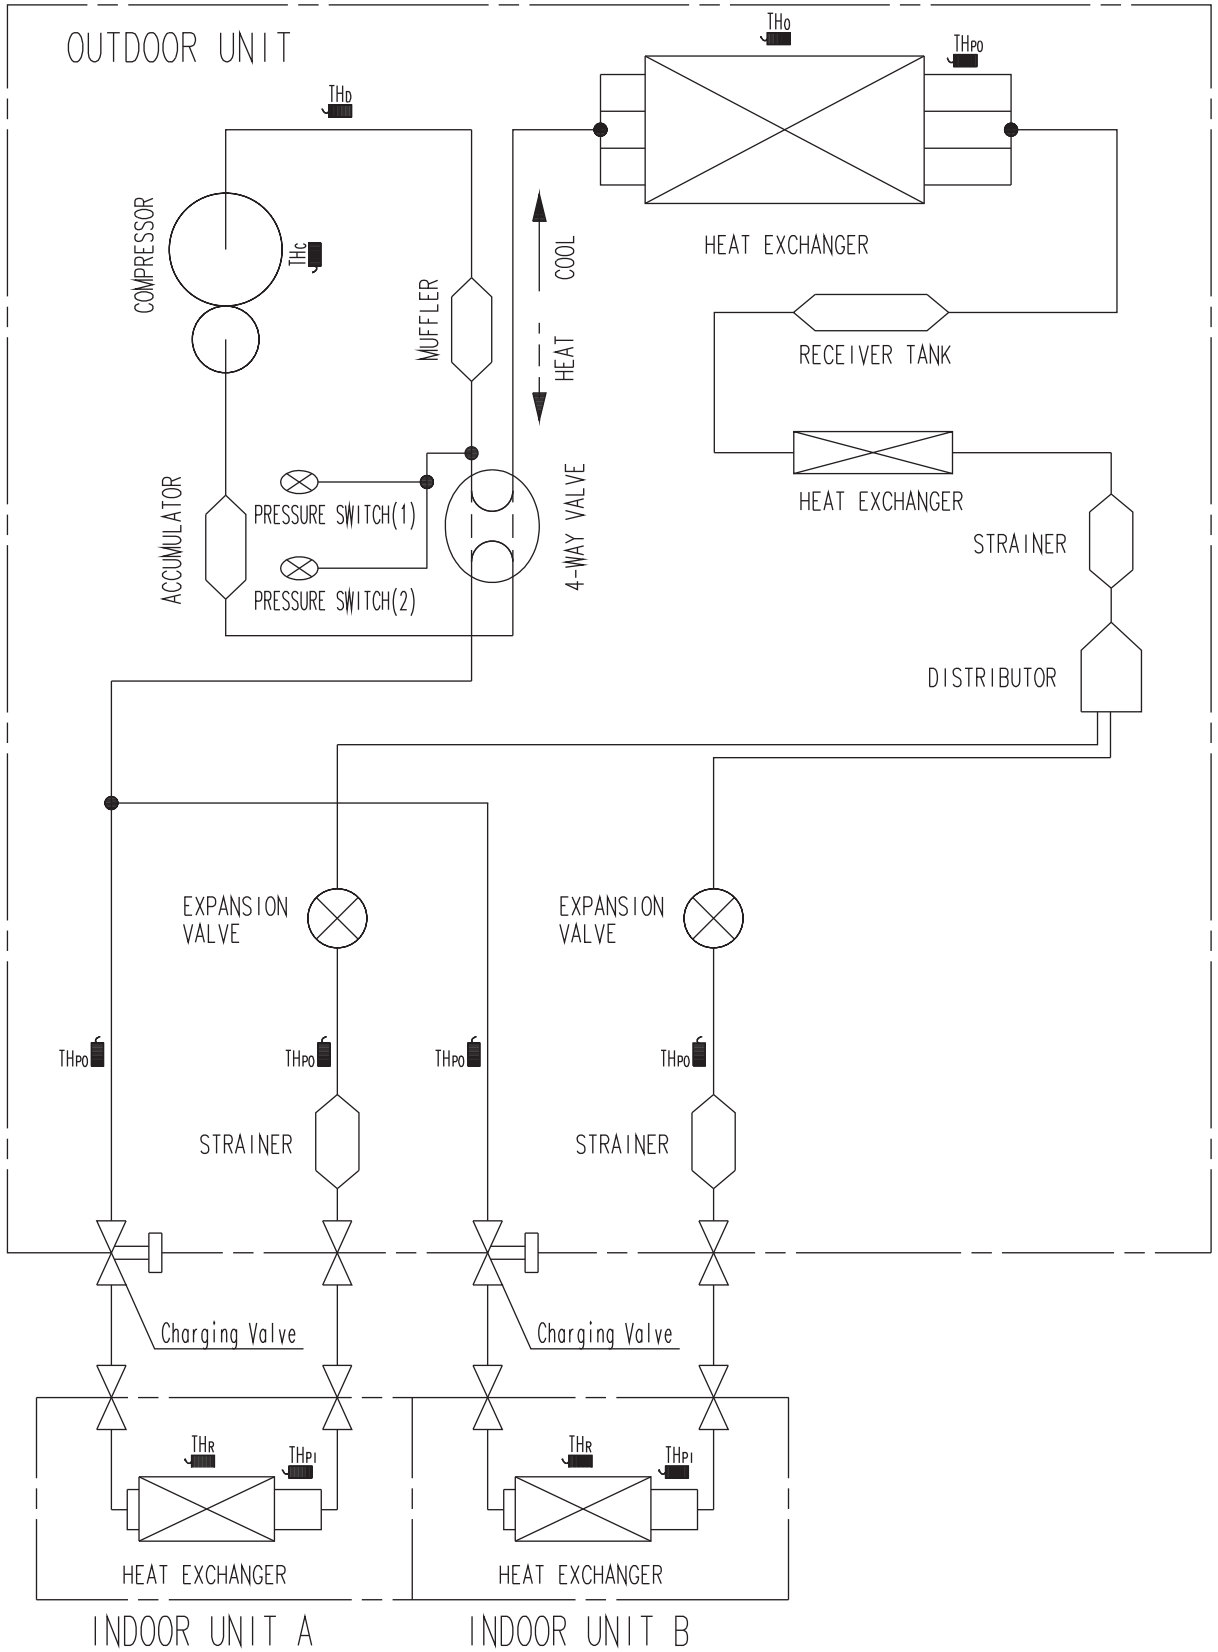

OUTDOOR UNIT  
UOMH18AFXZJ


$TH_d$  ■: THERMISTOR (DISCHARGE TEMP.)  
 $TH_o$  ■: THERMISTOR (OUTDOOR TEMP.)  
 $TH_{po}$  ■: THERMISTOR (PIPE TEMP.)  
 $TH_c$  ■: THERMISTOR (COMPRESSOR TEMP.)

$TH_r$  ■: THERMISTOR (ROOM TEMP.)  
 $TH_{pi}$  ■: THERMISTOR (PIPE TEMP.)

# 5. Wiring diagram

## 5-1. Model: UOMH18AFXZJ

OUTDOOR UNIT  
UOMH18AFXZJ

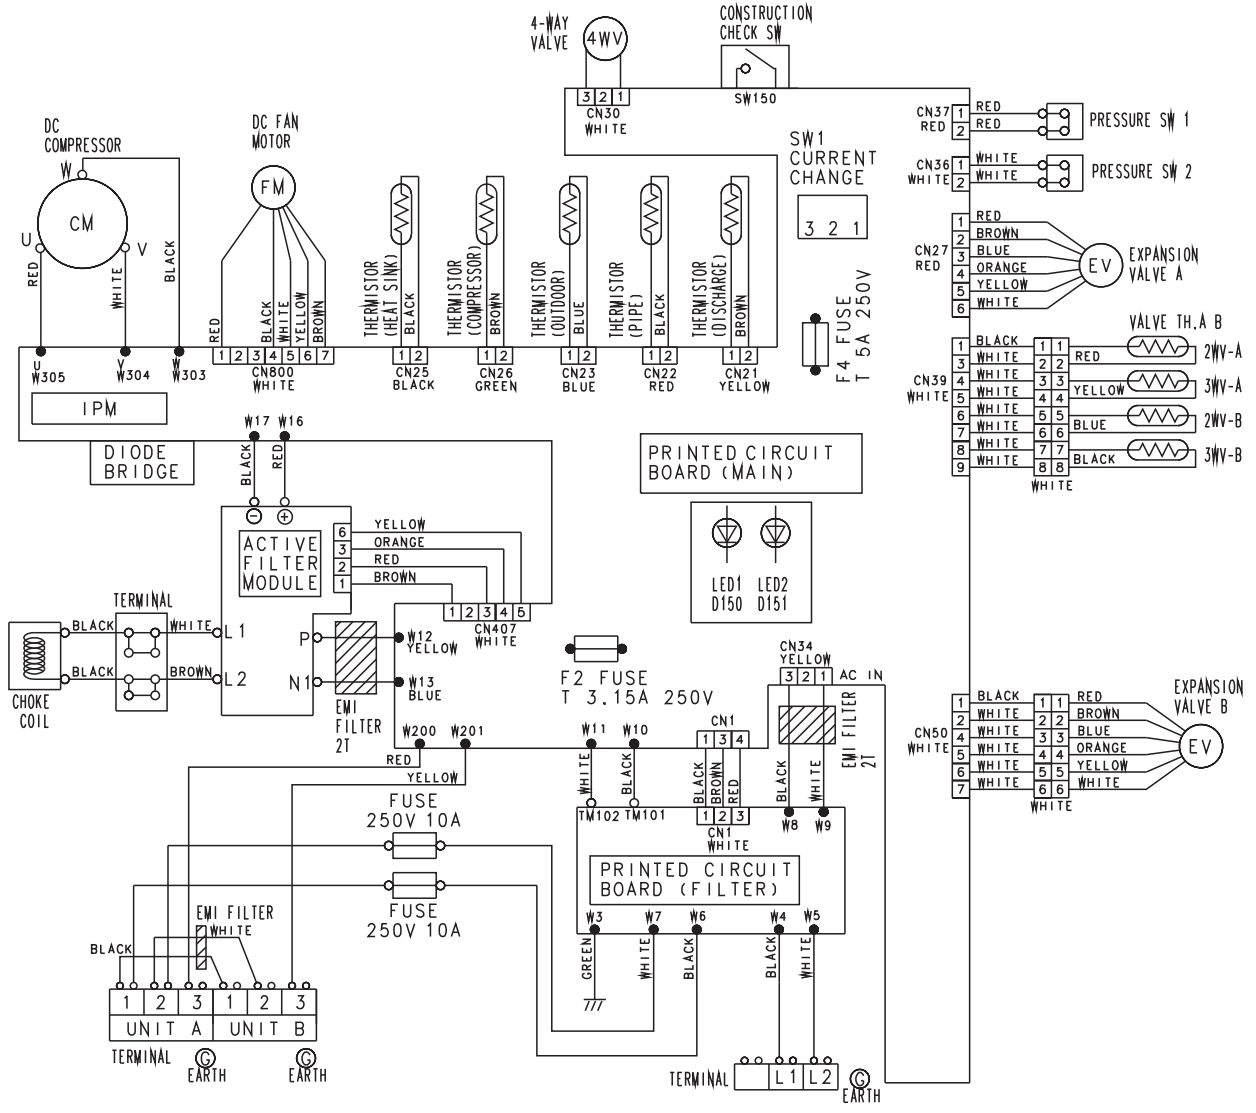

## 6. Capacity table

### 6-1. Combinations

#### ■ Model: UOMH18AFXZJ

##### ● Cooling

Combination of indoor unit			Rated capacity for each indoor unit (kBtu/h)		Maximum capacity for each indoor unit (kBtu/h)		Total capacity (kBtu/h)			Input power (kW)		
Room 1	Room 2	Total	Room 1	Room 2	Room 1	Room 2	Min.	Rated	Max.	Min.	Rated	Max.
7	7	14	7.05	7.05	8.70	8.70	6.10	14.10	17.40	0.50	1.30	1.64
7	9	16	7.09	9.11	8.66	11.14	6.10	16.20	19.80	0.50	1.44	1.81
7	12	19	6.63	11.37	7.74	13.26	6.10	18.00	21.00	0.50	1.43	2.06
9	9	18	9.00	9.00	10.50	10.50	6.10	18.00	21.00	0.50	1.44	2.06
9	12	21	7.71	10.29	9.00	12.00	6.10	18.00	21.00	0.50	1.44	2.06

#### NOTES:

Specifications are based on the following conditions.

- Power source of specifications: 230 V
- 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h
- 2 indoor units should be connected.
- Cooling: Indoor temperature of 80 °FDB (26.7 °CDB)/67 °FWB (19.4 °CWB), and outdoor temperature of 95 °FDB (35 °CDB)/75 °FWB (23.9 °CWB).
- Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
- The total ability of connected indoor units is from 14,000 Btu up to 21,000 Btu.

#### ■ Model: UOMH18AFXZJ

##### ● Heating

Combination of indoor unit			Rated capacity for each indoor unit (kBtu/h)		Maximum capacity for each indoor unit (kBtu/h)		Total capacity (kBtu/h)			Input power (kW)		
Room 1	Room 2	Total	Room 1	Room 2	Room 1	Room 2	Min.	Rated	Max.	Min.	Rated	Max.
7	7	14	9.20	9.20	10.35	10.35	6.80	18.40	20.70	0.52	1.50	1.97
7	9	16	8.93	11.48	9.58	12.32	6.80	20.40	21.90	0.52	1.77	1.92
7	12	19	8.11	13.89	8.99	15.41	6.80	22.00	24.40	0.52	1.87	2.10
9	9	18	11.00	11.00	12.20	12.20	6.80	22.00	24.40	0.52	1.87	2.10
9	12	21	9.43	12.57	10.46	13.94	6.80	22.00	24.40	0.52	1.88	2.10

#### NOTES:

Specifications are based on the following conditions.

- Power source of specifications: 230 V
- 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h
- 2 indoor units should be connected.
- Heating: Indoor temperature of 70 °FDB (21.1 °CDB)/60 °FWB (15.6 °CWB), and outdoor temperature of 47 °FDB (8.3 °CDB)/43 °FWB (6.1 °CWB).
- Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
- The total ability of connected indoor unit is from 14,000 Btu up to 21,000 Btu.

## 6-2. Cooling capacity

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

### ■ Model: UOMH18AFXZJ

- TC: Total Capacity, SHC: Sensible Heat Capacity, IP: Input Power
- The data is based on the following conditions:  
Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]

### ● Indoor units: 7,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW
14	7.49	5.86	0.35	8.46	5.86	0.36	8.92	6.46	0.36	9.55	6.78	0.36	10.21	6.94	0.37	10.53	7.71	0.37	
23	7.18	5.72	0.40	8.11	5.71	0.40	8.55	6.30	0.41	9.15	6.61	0.41	9.79	6.77	0.42	10.09	7.52	0.42	
32	7.05	5.66	0.44	7.97	5.66	0.45	8.40	6.24	0.45	8.99	6.55	0.46	9.62	6.70	0.46	9.91	7.44	0.46	
41	6.99	5.63	0.45	7.90	5.63	0.46	8.33	6.21	0.46	8.92	6.51	0.47	9.53	6.66	0.47	9.82	7.41	0.48	
50	7.05	5.66	0.46	7.97	5.66	0.46	8.40	6.24	0.47	8.99	6.55	0.47	9.62	6.70	0.48	9.91	7.44	0.48	
59	6.86	5.57	0.47	7.76	5.57	0.48	8.18	6.14	0.49	8.76	6.44	0.49	9.36	6.59	0.50	9.65	7.33	0.50	
67	7.39	5.84	0.51	8.35	5.83	0.52	8.80	6.44	0.52	9.42	6.75	0.53	10.07	6.91	0.54	10.38	7.68	0.54	
77	7.09	5.68	0.52	8.01	5.67	0.53	8.44	6.26	0.54	9.04	6.56	0.54	9.66	6.72	0.55	9.96	7.46	0.55	
87	6.65	5.45	0.58	7.52	5.44	0.59	7.92	6.00	0.59	8.48	6.30	0.60	9.07	6.45	0.61	9.35	7.16	0.61	
95	7.37	5.81	0.83	8.32	5.80	0.85	8.78	6.40	0.85	9.40	6.71	0.86	10.04	6.87	0.87	10.35	7.63	0.88	
104	7.15	5.71	0.92	8.08	5.70	0.94	8.52	6.29	0.95	9.12	6.60	0.96	9.75	6.75	0.97	10.05	7.50	0.97	
115	6.53	5.45	1.05	7.38	5.45	1.07	7.78	6.01	1.07	8.33	6.30	1.09	8.91	6.45	1.10	9.18	7.17	1.11	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
-10.0	2.19	1.72	0.35	2.48	1.72	0.36	2.61	1.89	0.36	2.80	1.99	0.36	2.99	2.03	0.37	3.09	2.26	0.37	
-5.0	2.10	1.68	0.40	2.38	1.67	0.40	2.51	1.85	0.41	2.68	1.94	0.41	2.87	1.98	0.42	2.96	2.20	0.42	
0.0	2.07	1.66	0.44	2.34	1.66	0.45	2.46	1.83	0.45	2.64	1.92	0.46	2.82	1.96	0.46	2.91	2.18	0.46	
5.0	2.05	1.65	0.45	2.31	1.65	0.46	2.44	1.82	0.46	2.61	1.91	0.47	2.79	1.95	0.47	2.88	2.17	0.48	
10.0	2.07	1.66	0.46	2.34	1.66	0.46	2.46	1.83	0.47	2.64	1.92	0.47	2.82	1.96	0.48	2.91	2.18	0.48	
15.0	2.01	1.63	0.47	2.27	1.63	0.48	2.40	1.80	0.49	2.57	1.89	0.49	2.74	1.93	0.50	2.83	2.15	0.50	
19.4	2.17	1.71	0.51	2.45	1.71	0.52	2.58	1.89	0.52	2.76	1.98	0.53	2.95	2.03	0.54	3.04	2.25	0.54	
25.0	2.08	1.66	0.52	2.35	1.66	0.53	2.47	1.83	0.54	2.65	1.92	0.54	2.83	1.97	0.55	2.92	2.19	0.55	
30.6	1.95	1.60	0.58	2.20	1.60	0.59	2.32	1.76	0.59	2.49	1.85	0.60	2.66	1.89	0.61	2.74	2.10	0.61	
35.0	2.16	1.70	0.83	2.44	1.70	0.85	2.57	1.88	0.85	2.75	1.97	0.86	2.94	2.01	0.87	3.03	2.24	0.88	
40.0	2.10	1.67	0.92	2.37	1.67	0.94	2.50	1.84	0.95	2.67	1.93	0.96	2.86	1.98	0.97	2.95	2.20	0.97	
46.1	1.91	1.60	1.05	2.16	1.60	1.07	2.28	1.76	1.07	2.44	1.85	1.09	2.61	1.89	1.10	2.69	2.10	1.11	



## ● Indoor units: 9,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
14	7.54	6.16	0.31	8.52	6.15	0.31	8.99	6.78	0.31	9.62	7.12	0.32	10.29	7.28	0.32	10.60	8.09	0.32	
23	7.23	6.01	0.35	8.17	6.00	0.35	8.61	6.62	0.35	9.22	6.94	0.36	9.86	7.11	0.36	10.16	7.90	0.36	
32	7.10	5.95	0.38	8.03	5.94	0.39	8.46	6.55	0.39	9.06	6.87	0.40	9.69	7.03	0.40	9.98	7.82	0.40	
41	7.04	5.92	0.39	7.96	5.91	0.40	8.39	6.52	0.40	8.98	6.84	0.41	9.60	7.00	0.41	9.90	7.78	0.41	
50	7.10	5.95	0.40	8.03	5.94	0.40	8.46	6.55	0.41	9.06	6.87	0.41	9.69	7.03	0.42	9.98	7.82	0.42	
59	7.24	6.01	0.45	8.18	6.00	0.46	8.62	6.62	0.47	9.23	6.95	0.47	9.87	7.11	0.48	10.17	7.90	0.48	
67	8.39	6.58	0.57	9.49	6.57	0.58	10.00	7.25	0.59	10.71	7.60	0.59	11.45	7.78	0.60	11.80	8.65	0.60	
77	8.05	6.39	0.59	9.10	6.39	0.60	9.59	7.04	0.60	10.27	7.39	0.61	10.98	7.56	0.61	11.32	8.41	0.62	
87	7.56	6.14	0.65	8.54	6.13	0.66	9.00	6.76	0.67	9.64	7.09	0.67	10.30	7.26	0.68	10.62	8.07	0.69	
95	8.97	6.81	1.08	10.14	6.80	1.10	10.69	7.50	1.11	11.44	7.87	1.12	12.23	8.05	1.13	12.61	8.95	1.14	
104	8.51	6.60	1.20	9.61	6.59	1.22	10.13	7.27	1.23	10.85	7.63	1.25	11.60	7.81	1.26	11.96	8.68	1.27	
115	7.82	6.34	1.36	8.83	6.33	1.39	9.31	6.98	1.40	9.97	7.33	1.41	10.66	7.50	1.43	10.99	8.33	1.44	

OUTDOOR UNIT  
UOMH18AFXZJ

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
-10.0	2.21	1.80	0.31	2.50	1.80	0.31	2.63	1.99	0.31	2.82	2.09	0.32	3.01	2.13	0.32	3.11	2.37	0.32	
-5.0	2.12	1.76	0.35	2.39	1.76	0.35	2.52	1.94	0.35	2.70	2.04	0.36	2.89	2.08	0.36	2.98	2.31	0.36	
0.0	2.08	1.74	0.38	2.35	1.74	0.39	2.48	1.92	0.39	2.66	2.01	0.40	2.84	2.06	0.40	2.93	2.29	0.40	
5.0	2.06	1.73	0.39	2.33	1.73	0.40	2.46	1.91	0.40	2.63	2.00	0.41	2.81	2.05	0.41	2.90	2.28	0.41	
10.0	2.08	1.74	0.40	2.35	1.74	0.40	2.48	1.92	0.41	2.66	2.01	0.41	2.84	2.06	0.42	2.93	2.29	0.42	
15.0	2.12	1.76	0.45	2.40	1.76	0.46	2.53	1.94	0.47	2.71	2.04	0.47	2.89	2.08	0.48	2.98	2.32	0.48	
19.4	2.46	1.93	0.57	2.78	1.93	0.58	2.93	2.12	0.59	3.14	2.23	0.59	3.35	2.28	0.60	3.46	2.53	0.60	
25.0	2.36	1.87	0.59	2.67	1.87	0.60	2.81	2.06	0.60	3.01	2.17	0.61	3.22	2.22	0.61	3.32	2.46	0.62	
30.6	2.21	1.80	0.65	2.50	1.80	0.66	2.64	1.98	0.67	2.82	2.08	0.67	3.02	2.13	0.68	3.11	2.36	0.69	
35.0	2.63	2.00	1.08	2.97	1.99	1.10	3.13	2.20	1.11	3.35	2.31	1.12	3.59	2.36	1.13	3.70	2.62	1.14	
40.0	2.49	1.93	1.20	2.82	1.93	1.22	2.97	2.13	1.23	3.18	2.24	1.25	3.40	2.29	1.26	3.50	2.54	1.27	
46.1	2.29	1.86	1.36	2.59	1.86	1.39	2.73	2.05	1.40	2.92	2.15	1.41	3.12	2.20	1.43	3.22	2.44	1.44	

## ● Indoor units: 12,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
14	9.71	7.59	0.41	10.98	7.58	0.42	11.57	8.37	0.42	12.39	8.78	0.43	13.25	8.98	0.43	13.66	9.98	0.43	
23	9.31	7.41	0.46	10.52	7.40	0.47	11.09	8.16	0.48	11.87	8.56	0.48	12.69	8.76	0.49	13.09	9.74	0.49	
32	9.15	7.33	0.51	10.34	7.32	0.52	10.90	8.08	0.53	11.67	8.48	0.53	12.47	8.67	0.54	12.86	9.64	0.54	
41	9.07	7.29	0.53	10.25	7.29	0.54	10.80	8.04	0.54	11.57	8.43	0.55	12.36	8.63	0.55	12.74	9.59	0.56	
50	9.15	7.33	0.53	10.34	7.32	0.54	10.90	8.08	0.55	11.67	8.48	0.55	12.47	8.67	0.56	12.86	9.64	0.56	
59	8.91	7.22	0.55	10.06	7.21	0.56	10.61	7.95	0.57	11.36	8.35	0.57	12.14	8.54	0.58	12.52	9.49	0.58	
67	11.07	8.23	0.81	12.51	8.22	0.82	13.19	9.06	0.83	14.12	9.51	0.84	15.10	9.73	0.85	15.56	10.81	0.85	
77	10.62	8.00	0.83	12.00	7.99	0.84	12.65	8.81	0.85	13.55	9.24	0.86	14.48	9.46	0.87	14.93	10.51	0.87	
87	9.97	7.67	0.92	11.26	7.66	0.93	11.87	8.45	0.94	12.71	8.87	0.95	13.59	9.08	0.96	14.01	10.09	0.97	
95	10.32	7.86	1.14	11.66	7.85	1.16	12.29	8.66	1.17	13.16	9.09	1.19	14.07	9.30	1.20	14.50	10.34	1.21	
104	9.78	7.62	1.27	11.06	7.61	1.29	11.65	8.40	1.30	12.48	8.81	1.32	13.34	9.02	1.33	13.75	10.02	1.34	
115	8.99	7.32	1.44	10.16	7.31	1.47	10.71	8.07	1.48	11.47	8.46	1.49	12.26	8.66	1.51	12.64	9.62	1.52	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
-10.0	2.85	2.23	0.41	3.22	2.22	0.42	3.39	2.45	0.42	3.63	2.57	0.43	3.88	2.63	0.43	4.00	2.93	0.43	
-5.0	2.73	2.17	0.46	3.08	2.17	0.47	3.25	2.39	0.48	3.48	2.51	0.48	3.72	2.57	0.49	3.84	2.85	0.49	
0.0	2.68	2.15	0.51	3.03	2.15	0.52	3.19	2.37	0.53	3.42	2.48	0.53	3.66	2.54	0.54	3.77	2.83	0.54	
5.0	2.66	2.14	0.53	3.00	2.14	0.54	3.17	2.36	0.54	3.39	2.47	0.55	3.62	2.53	0.55	3.74	2.81	0.56	
10.0	2.68	2.15	0.53	3.03	2.15	0.54	3.19	2.37	0.55	3.42	2.48	0.55	3.66	2.54	0.56	3.77	2.83	0.56	
15.0	2.61	2.12	0.55	2.95	2.11	0.56	3.11	2.33	0.57	3.33	2.45	0.57	3.56	2.50	0.58	3.67	2.78	0.58	
19.4	3.25	2.41	0.81	3.67	2.41	0.82	3.87	2.66	0.83	4.14	2.79	0.84	4.42	2.85	0.85	4.56	3.17	0.85	
25.0	3.11	2.34	0.83	3.52	2.34	0.84	3.71	2.58	0.85	3.97	2.71	0.86	4.24	2.77	0.87	4.38	3.08	0.87	
30.6	2.92	2.25	0.92	3.30	2.25	0.93	3.48	2.48	0.94	3.73	2.60	0.95	3.98	2.66	0.96	4.11	2.96	0.97	
35.0	3.02	2.30	1.14	3.42	2.30	1.16	3.60	2.54	1.17	3.86	2.66	1.19	4.12	2.73	1.20	4.25	3.03	1.21	
40.0	2.87	2.23	1.27	3.24	2.23	1.29	3.42	2.46	1.30	3.66	2.58	1.32	3.91	2.64	1.33	4.03	2.94	1.34	
46.1	2.63	2.15	1.44	2.98	2.14	1.47	3.14	2.36	1.48	3.36	2.48	1.49	3.59	2.54	1.51	3.70	2.82	1.52	

## ● Indoor units: 7,000 Btu + 7,000 Btu

OUTDOOR UNIT  
UOMH18AFZJJ

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kW			kW			kW			kW			kW			kW		
		kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW
14	12.74	10.15	0.56	14.40	10.14	0.57	15.18	11.18	0.57	16.25	11.73	0.58	17.38	12.00	0.59	17.91	13.34	0.59	
23	12.21	9.90	0.63	13.80	9.89	0.64	14.55	10.91	0.65	15.58	11.45	0.66	16.65	11.71	0.66	17.17	13.02	0.67	
32	12.00	9.80	0.70	13.56	9.79	0.71	14.30	10.80	0.72	15.31	11.33	0.72	16.36	11.59	0.73	16.87	12.88	0.74	
41	11.89	9.75	0.72	13.44	9.74	0.73	14.17	10.74	0.73	15.17	11.27	0.74	16.22	11.53	0.75	16.72	12.82	0.75	
50	12.00	9.80	0.72	13.56	9.79	0.74	14.30	10.80	0.74	15.31	11.33	0.75	16.36	11.59	0.76	16.87	12.88	0.76	
59	11.68	9.65	0.75	13.20	9.64	0.77	13.92	10.63	0.77	14.90	11.16	0.78	15.93	11.41	0.79	16.42	12.68	0.79	
67	14.52	10.99	1.10	16.41	10.98	1.12	17.30	12.11	1.13	18.53	12.71	1.14	19.80	13.00	1.16	20.42	14.45	1.16	
77	13.93	10.69	1.13	15.74	10.67	1.15	16.60	11.77	1.16	17.77	12.35	1.17	19.00	12.64	1.18	19.58	14.05	1.19	
87	13.07	10.26	1.25	14.77	10.24	1.27	15.57	11.30	1.28	16.68	11.86	1.30	17.83	12.13	1.31	18.38	13.48	1.32	
95	13.64	10.56	1.58	15.42	10.54	1.61	16.25	11.63	1.62	17.40	12.21	1.64	18.60	12.49	1.66	19.17	13.88	1.67	
104	12.93	10.24	1.75	14.61	10.22	1.79	15.41	11.28	1.80	16.50	11.83	1.82	17.63	12.11	1.84	18.18	13.46	1.85	
115	11.88	9.83	2.08	13.43	9.82	2.12	14.16	10.83	2.13	15.16	11.36	2.15	16.20	11.63	2.15	16.71	12.92	2.15	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
-10.0	3.73	2.97	0.56	4.22	2.97	0.57	4.45	3.28	0.57	4.76	3.44	0.58	5.09	3.52	0.59	5.25	3.91	0.59	
-5.0	3.58	2.90	0.63	4.04	2.90	0.64	4.26	3.20	0.65	4.57	3.35	0.66	4.88	3.43	0.66	5.03	3.81	0.67	
0.0	3.52	2.87	0.70	3.97	2.87	0.71	4.19	3.16	0.72	4.49	3.32	0.72	4.80	3.40	0.73	4.94	3.78	0.74	
5.0	3.49	2.86	0.72	3.94	2.85	0.73	4.15	3.15	0.73	4.45	3.30	0.74	4.75	3.38	0.75	4.90	3.76	0.75	
10.0	3.52	2.87	0.72	3.97	2.87	0.74	4.19	3.16	0.74	4.49	3.32	0.75	4.80	3.40	0.76	4.94	3.78	0.76	
15.0	3.42	2.83	0.75	3.87	2.82	0.77	4.08	3.12	0.77	4.37	3.27	0.78	4.67	3.35	0.79	4.81	3.72	0.79	
19.4	4.26	3.22	1.10	4.81	3.22	1.12	5.07	3.55	1.13	5.43	3.73	1.14	5.80	3.81	1.16	5.98	4.24	1.16	
25.0	4.08	3.13	1.13	4.61	3.13	1.15	4.86	3.45	1.16	5.21	3.62	1.17	5.57	3.70	1.18	5.74	4.12	1.19	
30.6	3.83	3.01	1.25	4.33	3.00	1.27	4.56	3.31	1.28	4.89	3.48	1.30	5.22	3.56	1.31	5.39	3.95	1.32	
35.0	4.00	3.09	1.58	4.52	3.09	1.61	4.76	3.41	1.62	5.10	3.58	1.64	5.45	3.66	1.66	5.62	4.07	1.67	
40.0	3.79	3.00	1.75	4.28	3.00	1.79	4.52	3.30	1.80	4.83	3.47	1.82	5.17	3.55	1.84	5.33	3.94	1.85	
46.1	3.48	2.88	2.08	3.94	2.88	2.12	4.15	3.17	2.13	4.44	3.33	2.15	4.75	3.41	2.15	4.90	3.79	2.15	

## ● Indoor units: 7,000 Btu + 9,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kW			kW			kW			kW			kW			kW		
		kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW	kBtu/h	kBtu/h	kW
14	14.66	11.33	0.65	16.57	11.32	0.66	17.47	12.48	0.66	18.70	13.10	0.67	19.99	13.40	0.68	20.61	14.89	0.68	
23	14.05	11.05	0.73	15.88	11.04	0.75	16.74	12.18	0.75	17.92	12.78	0.76	19.16	13.08	0.77	19.75	14.53	0.77	
32	13.81	10.94	0.81	15.60	10.93	0.82	16.45	12.06	0.83	17.61	12.65	0.84	18.82	12.94	0.85	19.40	14.38	0.85	
41	13.68	10.89	0.83	15.46	10.87	0.85	16.30	11.99	0.85	17.45	12.59	0.86	18.66	12.88	0.87	19.23	14.31	0.88	
50	13.81	10.94	0.84	15.60	10.93	0.86	16.45	12.06	0.86	17.61	12.65	0.87	18.82	12.94	0.88	19.40	14.38	0.89	
59	13.44	10.77	0.87	15.19	10.76	0.89	16.01	11.87	0.90	17.14	12.45	0.91	18.32	12.74	0.92	18.89	14.16	0.92	
67	15.48	11.74	1.09	17.49	11.73	1.11	18.44	12.94	1.11	19.74	13.58	1.13	21.11	13.89	1.14	21.76	15.44	1.15	
77	14.85	11.41	1.11	16.78	11.40	1.13	17.69	12.57	1.14	18.94	13.20	1.15	20.24	13.50	1.17	20.87	15.00	1.17	
87	13.93	10.95	1.23	15.75	10.94	1.26	16.60	12.07	1.27	17.77	12.66	1.28	19.00	12.96	1.29	19.58	14.40	1.30	
95	15.52	11.71	1.79	17.54	11.70	1.82	18.49	12.90	1.84	19.80	13.54	1.86	21.17	13.85	1.88	21.82	15.40	1.89	
104	14.75	11.37	1.99	16.67	11.36	2.03	17.58	12.53	2.04	18.82	13.15	2.06	20.12	13.45	2.09	20.74	14.95	2.10	
115	12.07	10.38	1.86	13.64	10.37	1.90	14.38	11.44	1.91	15.40	12.00	1.93	16.46	12.28	1.95	16.97	13.65	1.96	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
-10.0	4.30	3.32	0.65	4.86	3.32	0.66	5.12	3.66	0.66	5.48	3.84	0.67	5.86	3.93	0.68	6.04	4.37	0.68	
-5.0	4.12	3.24	0.73	4.65	3.24	0.75	4.91	3.57	0.75	5.25	3.75	0.76	5.61	3.83	0.77	5.79	4.26	0.77	
0.0	4.05	3.21	0.81	4.57	3.20	0.82	4.82	3.53	0.83	5.16	3.71	0.84	5.52	3.79	0.85	5.69	4.22	0.85	
5.0	4.01	3.19	0.83	4.53	3.19	0.85	4.78	3.52	0.85	5.12	3.69	0.86	5.47	3.77	0.87	5.64	4.19	0.88	
10.0	4.05	3.21	0.84	4.57	3.20	0.86	4.82	3.53	0.86	5.16	3.71	0.87	5.52	3.79	0.88	5.69	4.22	0.89	
15.0	3.94	3.16	0.87	4.45	3.15	0.89	4.69	3.48	0.90	5.02	3.65	0.91	5.37	3.73	0.92	5.54	4.15	0.92	
19.4	4.54	3.44	1.09	5.13	3.44	1.11	5.40	3.79	1.11	5.79	3.98	1.13	6.19	4.07	1.14	6.38	4.52	1.15	
25.0	4.35	3.35	1.11	4.92	3.34	1.13	5.18	3.69	1.14	5.55	3.87	1.15	5.93	3.96	1.17	6.12	4.40	1.17	
30.6	4.08	3.21	1.23	4.61	3.21	1.26	4.86	3.54	1.27	5.21	3.71	1.28	5.57	3.80	1.29	5.74	4.22	1.30	
35.0	4.55	3.43	1.79	5.14	3.43	1.82	5.42	3.78	1.84	5.80	3.97	1.86	6.20	4.06	1.88	6.39	4.51	1.89	
40.0	4.32	3.33	1.99	4.89	3.33	2.03	5.15	3.67	2.04	5.52	3.85	2.06	5.90	3.94	2.09	6.08	4.38	2.10	
46.1	3.54	3.04	1.86	4.00	3.04	1.90	4.22	3.35	1.91	4.51	3.52	1.93	4.82	3.60	1.95	4.97	4.00	1.96	

● Indoor units: 7,000 Btu + 12,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		°FDB			°FWB			°FDB			°FWB			°FDB			°FWB		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	15.12	11.76	0.69	17.08	11.74	0.70	18.01	12.95	0.71	19.28	13.59	0.72	20.61	13.90	0.73	21.25	15.45	0.73
	23	14.49	11.47	0.78	16.37	11.45	0.80	17.26	12.64	0.80	18.48	13.26	0.81	19.75	13.57	0.82	20.36	15.08	0.83
	32	14.24	11.35	0.86	16.09	11.34	0.88	16.96	12.51	0.89	18.16	13.12	0.90	19.41	13.43	0.91	20.01	14.92	0.91
	41	14.11	11.29	0.89	15.95	11.28	0.90	16.81	12.44	0.91	18.00	13.06	0.92	19.24	13.36	0.93	19.83	14.85	0.94
	50	14.24	11.35	0.90	16.09	11.34	0.92	16.96	12.51	0.92	18.16	13.12	0.93	19.41	13.43	0.94	20.01	14.92	0.95
	59	14.22	11.35	0.99	16.07	11.33	1.00	16.94	12.50	1.01	18.14	13.12	1.02	19.39	13.42	1.04	19.99	14.92	1.04
	67	17.63	12.90	1.43	19.92	12.89	1.46	21.00	14.22	1.47	22.48	14.92	1.49	24.03	15.26	1.50	24.78	16.96	1.51
	77	16.91	12.54	1.47	19.11	12.53	1.49	20.14	13.82	1.50	21.56	14.50	1.52	23.05	14.84	1.54	23.76	16.49	1.55
87	15.87	12.04	1.63	17.93	12.02	1.66	18.90	13.26	1.67	20.24	13.92	1.69	21.63	14.24	1.71	22.30	15.83	1.72	
95	16.46	12.35	2.03	18.61	12.34	2.07	19.61	13.61	2.09	21.00	14.28	2.11	22.45	14.61	2.13	23.14	16.24	2.15	
104	15.01	11.71	2.03	16.97	11.69	2.07	17.89	12.90	2.09	19.15	13.54	2.11	20.47	13.85	2.13	21.10	15.39	2.15	
115	12.17	10.68	1.86	13.76	10.67	1.89	14.50	11.77	1.90	15.53	12.35	1.93	16.60	12.64	1.95	17.11	14.05	1.96	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		°CDB			°CWB			°CDB			°CWB			°CDB			°CWB		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	4.43	3.45	0.69	5.01	3.44	0.70	5.28	3.80	0.71	5.65	3.98	0.72	6.04	4.08	0.73	6.23	4.53	0.73
	-5.0	4.25	3.36	0.78	4.80	3.36	0.80	5.06	3.70	0.80	5.42	3.89	0.81	5.79	3.98	0.82	5.97	4.42	0.83
	0.0	4.17	3.33	0.86	4.72	3.32	0.88	4.97	3.67	0.89	5.32	3.85	0.90	5.69	3.94	0.91	5.86	4.37	0.91
	5.0	4.14	3.31	0.89	4.67	3.31	0.90	4.93	3.65	0.91	5.27	3.83	0.92	5.64	3.92	0.93	5.81	4.35	0.94
	10.0	4.17	3.33	0.90	4.72	3.32	0.92	4.97	3.67	0.92	5.32	3.85	0.93	5.69	3.94	0.94	5.86	4.37	0.95
	15.0	4.17	3.33	0.99	4.71	3.32	1.00	4.97	3.66	1.01	5.32	3.84	1.02	5.68	3.93	1.04	5.86	4.37	1.04
	19.4	5.17	3.78	1.43	5.84	3.78	1.46	6.15	4.17	1.47	6.59	4.37	1.49	7.04	4.47	1.50	7.26	4.97	1.51
	25.0	4.96	3.68	1.47	5.60	3.67	1.49	5.90	4.05	1.50	6.32	4.25	1.52	6.76	4.35	1.54	6.97	4.83	1.55
30.6	4.65	3.53	1.63	5.26	3.52	1.66	5.54	3.89	1.67	5.93	4.08	1.69	6.34	4.17	1.71	6.54	4.64	1.72	
35.0	4.83	3.62	2.03	5.45	3.62	2.07	5.75	3.99	2.09	6.15	4.19	2.11	6.58	4.28	2.13	6.78	4.76	2.15	
40.0	4.40	3.43	2.03	4.97	3.43	2.07	5.24	3.78	2.09	5.61	3.97	2.11	6.00	4.06	2.13	6.19	4.51	2.15	
46.1	3.57	3.13	1.86	4.03	3.13	1.89	4.25	3.45	1.90	4.55	3.62	1.93	4.86	3.70	1.95	5.01	4.12	1.96	

● Indoor units: 9,000 Btu + 9,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		°FDB			°FWB			°FDB			°FWB			°FDB			°FWB		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	14.72	11.60	0.66	16.63	11.58	0.67	17.53	12.78	0.68	18.77	13.41	0.69	20.07	13.72	0.70	20.69	15.24	0.70
	23	14.10	11.31	0.75	15.94	11.30	0.76	16.80	12.46	0.77	17.99	13.08	0.78	19.23	13.38	0.79	19.82	14.87	0.79
	32	13.86	11.20	0.83	15.66	11.19	0.84	16.51	12.34	0.85	17.68	12.95	0.86	18.90	13.25	0.87	19.48	14.72	0.87
	41	13.74	11.14	0.85	15.52	11.13	0.87	16.36	12.27	0.87	17.52	12.88	0.88	18.73	13.18	0.89	19.31	14.65	0.90
	50	13.86	11.20	0.86	15.66	11.19	0.88	16.51	12.34	0.88	17.68	12.95	0.89	18.90	13.25	0.90	19.48	14.72	0.91
	59	14.22	11.37	1.00	16.07	11.35	1.02	16.94	12.52	1.03	18.14	13.14	1.04	19.39	13.45	1.05	19.99	14.94	1.06
	67	16.60	12.49	1.28	18.76	12.47	1.30	19.78	13.76	1.31	21.17	14.44	1.33	22.63	14.77	1.34	23.33	16.42	1.35
	77	15.92	12.14	1.31	17.99	12.12	1.33	18.97	13.37	1.34	20.31	14.03	1.36	21.71	14.36	1.37	22.38	15.96	1.38
87	14.94	11.65	1.45	16.89	11.64	1.48	17.80	12.83	1.49	19.06	13.47	1.51	20.37	13.78	1.52	21.00	15.31	1.53	
95	16.46	12.38	2.06	18.61	12.36	2.10	19.61	13.63	2.12	21.00	14.31	2.14	22.45	14.64	2.15	23.14	16.27	2.15	
104	14.91	11.69	2.06	16.85	11.67	2.10	17.77	12.87	2.12	19.02	13.51	2.14	20.33	13.82	2.15	20.96	15.36	2.15	
115	12.04	10.65	1.88	13.60	10.64	1.92	14.34	11.73	1.93	15.35	12.31	1.95	16.41	12.60	1.98	16.92	14.00	1.99	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		°CDB			°CWB			°CDB			°CWB			°CDB			°CWB		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	4.31	3.40	0.66	4.87	3.39	0.67	5.14	3.74	0.68	5.50	3.93	0.69	5.88	4.02	0.70	6.06	4.47	0.70
	-5.0	4.13	3.32	0.75	4.67	3.31	0.76	4.92	3.65	0.77	5.27	3.83	0.78	5.64	3.92	0.79	5.81	4.36	0.79
	0.0	4.06	3.28	0.83	4.59	3.28	0.84	4.84	3.62	0.85	5.18	3.79	0.86	5.54	3.88	0.87	5.71	4.31	0.87
	5.0	4.03	3.27	0.85	4.55	3.26	0.87	4.80	3.60	0.87	5.13	3.78	0.88	5.49	3.86	0.89	5.66	4.29	0.90
	10.0	4.06	3.28	0.86	4.59	3.28	0.88	4.84	3.62	0.88	5.18	3.79	0.89	5.54	3.88	0.90	5.71	4.31	0.91
	15.0	4.17	3.33	1.00	4.71	3.33	1.02	4.97	3.67	1.03	5.32	3.85	1.04	5.68	3.94	1.05	5.86	4.38	1.06
	19.4	4.87	3.66	1.28	5.50	3.66	1.30	5.80	4.03	1.31	6.21	4.23	1.33	6.63	4.33	1.34	6.84	4.81	1.35
	25.0	4.67	3.56	1.31	5.27	3.55	1.33	5.56	3.92	1.34	5.95	4.11	1.36	6.36	4.21	1.37	6.56	4.68	1.38
30.6	4.38	3.41	1.45	4.95	3.41	1.48	5.22	3.76	1.49	5.59	3.95	1.51	5.97	4.04	1.52	6.16	4.49	1.53	
35.0	4.83	3.63	2.06	5.45	3.62	2.10	5.75	4.00	2.12	6.15	4.19	2.14	6.58	4.29	2.15	6.78	4.77	2.15	
40.0	4.37	3.42	2.06	4.94	3.42	2.10	5.21	3.77	2.12	5.57	3.96	2.14	5.96	4.05	2.15	6.14	4.50	2.15	
46.1	3.53	3.12	1.88	3.99	3.12	1.92	4.20	3.44	1.93	4.50	3.61	1.95	4.81	3.69	1.98	4.96	4.10	1.99	

OUTDOOR UNIT  
UOMH18AFZJ

# ● Indoor units: 9,000 Btu + 12,000 Btu

OUTDOOR UNIT  
UOMH18AFXZJ

		Indoor temperature																		
°FDB		64			70			75			80			85			90			
°FWB		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	
14	15.31	12.02	0.72	17.31	12.00	0.73	18.24	13.24	0.74	19.53	13.89	0.75	20.88	14.22	0.76	21.52	15.80	0.76		
23	14.68	11.72	0.82	16.58	11.71	0.83	17.48	12.92	0.84	18.72	13.55	0.85	20.01	13.87	0.86	20.63	15.41	0.86		
32	14.42	11.61	0.90	16.30	11.59	0.92	17.18	12.79	0.92	18.39	13.42	0.93	19.66	13.73	0.95	20.27	15.26	0.95		
41	14.29	11.55	0.93	16.15	11.53	0.94	17.03	12.72	0.95	18.23	13.35	0.96	19.49	13.66	0.97	20.09	15.18	0.98		
50	14.42	11.61	0.94	16.30	11.59	0.95	17.18	12.79	0.96	18.39	13.42	0.97	19.66	13.73	0.98	20.27	15.26	0.99		
59	14.91	11.84	1.11	16.85	11.82	1.13	17.77	13.04	1.14	19.02	13.68	1.15	20.34	14.00	1.16	20.96	15.56	1.17		
67	18.38	13.42	1.59	20.77	13.40	1.62	21.90	14.78	1.63	23.45	15.51	1.65	25.06	15.87	1.67	25.84	17.64	1.68		
77	17.63	13.04	1.63	19.93	13.03	1.65	21.00	14.37	1.67	22.49	15.08	1.69	24.04	15.43	1.71	24.78	17.14	1.71		
87	16.55	12.52	1.80	18.70	12.50	1.84	19.71	13.79	1.85	21.10	14.47	1.87	22.56	14.81	1.89	23.26	16.45	1.90		
95	16.46	12.53	2.06	18.61	12.52	2.10	19.61	13.81	2.12	21.00	14.49	2.14	22.45	14.83	2.15	23.14	16.48	2.15		
104	14.76	11.76	2.02	16.68	11.75	2.06	17.58	12.96	2.08	18.83	13.60	2.10	20.12	13.91	2.12	20.75	15.46	2.14		
115	11.99	10.76	1.88	13.55	10.75	1.92	14.28	11.86	1.93	15.29	12.44	1.95	16.35	12.73	1.98	16.85	14.15	1.99		

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
-10.0	4.49	3.52	0.72	5.07	3.52	0.73	5.35	3.88	0.74	5.72	4.07	0.75	6.12	4.17	0.76	6.31	4.63	0.76		
-5.0	4.30	3.44	0.82	4.86	3.43	0.83	5.12	3.79	0.84	5.49	3.97	0.85	5.86	4.06	0.86	6.05	4.52	0.86		
0.0	4.23	3.40	0.90	4.78	3.40	0.92	5.03	3.75	0.92	5.39	3.93	0.93	5.76	4.02	0.95	5.94	4.47	0.95		
5.0	4.19	3.38	0.93	4.73	3.38	0.94	4.99	3.73	0.95	5.34	3.91	0.96	5.71	4.00	0.97	5.89	4.45	0.98		
10.0	4.23	3.40	0.94	4.78	3.40	0.95	5.03	3.75	0.96	5.39	3.93	0.97	5.76	4.02	0.98	5.94	4.47	0.99		
15.0	4.37	3.47	1.11	4.94	3.46	1.13	5.21	3.82	1.14	5.58	4.01	1.15	5.96	4.10	1.16	6.14	4.56	1.17		
19.4	5.39	3.93	1.59	6.09	3.93	1.62	6.42	4.33	1.63	6.87	4.55	1.65	7.35	4.65	1.67	7.57	5.17	1.68		
25.0	5.17	3.82	1.63	5.84	3.82	1.65	6.16	4.21	1.67	6.59	4.42	1.69	7.05	4.52	1.71	7.26	5.02	1.71		
30.6	4.85	3.67	1.80	5.48	3.66	1.84	5.78	4.04	1.85	6.19	4.24	1.87	6.61	4.34	1.89	6.82	4.82	1.90		
35.0	4.83	3.67	2.06	5.45	3.67	2.10	5.75	4.05	2.12	6.15	4.25	2.14	6.58	4.35	2.15	6.78	4.83	2.15		
40.0	4.33	3.45	2.02	4.89	3.44	2.06	5.15	3.80	2.08	5.52	3.99	2.10	5.90	4.08	2.12	6.08	4.53	2.14		
46.1	3.51	3.15	1.88	3.97	3.15	1.92	4.19	3.48	1.93	4.48	3.65	1.95	4.79	3.73	1.98	4.94	4.15	1.99		

## 6-3. Heating capacity

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

### ■ Model: UOMH18AFXZJ

- TC: Total Capacity, IP: Input Power
- The data is based on the following conditions:  
Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]

### ● Indoor units: 7,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	8.16	1.06	7.90	1.09	7.64	1.12	7.37	1.15	7.21	1.17
	14	12	9.31	1.13	9.02	1.17	8.71	1.20	8.41	1.23	8.22	1.25
	23	19	9.73	1.08	9.42	1.11	9.10	1.15	8.78	1.18	8.59	1.20
	32	28	10.16	1.03	9.83	1.06	9.50	1.09	9.17	1.12	8.97	1.13
	41	37	11.45	0.96	11.08	0.99	10.71	1.01	10.34	1.04	10.11	1.06
	47	43	12.21	0.96	11.82	0.99	11.42	1.02	11.02	1.05	10.78	1.07
	50	47	12.30	1.00	11.91	1.03	11.51	1.06	11.10	1.09	10.86	1.11
	59	50	12.42	0.96	12.03	0.99	11.62	1.02	11.21	1.04	10.97	1.06
68	59	12.18	0.76	11.79	0.78	11.39	0.80	10.99	0.83	10.75	0.84	
75	65	10.96	0.57	10.61	0.59	10.25	0.61	9.90	0.62	9.68	0.63	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	2.39	1.06	2.32	1.09	2.24	1.12	2.16	1.15	2.11	1.17
	-10.0	-11.1	2.73	1.13	2.64	1.17	2.55	1.20	2.46	1.23	2.41	1.25
	-5.0	-7.2	2.85	1.08	2.76	1.11	2.67	1.15	2.57	1.18	2.52	1.20
	0.0	-2.2	2.98	1.03	2.88	1.06	2.78	1.09	2.69	1.12	2.63	1.13
	5.0	2.8	3.35	0.96	3.25	0.99	3.14	1.01	3.03	1.04	2.96	1.06
	8.3	6.1	3.58	0.96	3.46	0.99	3.35	1.02	3.23	1.05	3.16	1.07
	10.0	8.3	3.60	1.00	3.49	1.03	3.37	1.06	3.25	1.09	3.18	1.11
	15.0	10.0	3.64	0.96	3.53	0.99	3.41	1.02	3.29	1.04	3.21	1.06
20.0	15.0	3.57	0.76	3.46	0.78	3.34	0.80	3.22	0.83	3.15	0.84	
23.9	18.3	3.21	0.57	3.11	0.59	3.01	0.61	2.90	0.62	2.84	0.63	

OUTDOOR UNIT  
UOMH18AFXZJ

## ● Indoor units: 9,000 Btu

		Indoor temperature									
		60		65		70		75		78	
Outdoor temperature	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°FWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	10.98	1.31	10.63	1.35	10.27	1.39	9.91	1.43	9.70
14	12	12.49	1.41	12.10	1.45	11.69	1.49	11.28	1.54	11.03	1.56
23	19	13.18	1.37	12.77	1.41	12.33	1.45	11.90	1.49	11.64	1.51
32	28	13.95	1.32	13.51	1.36	13.05	1.40	12.60	1.44	12.32	1.46
41	37	15.80	1.27	15.30	1.31	14.78	1.34	14.27	1.38	13.95	1.41
47	43	16.85	1.28	16.32	1.32	15.77	1.36	15.21	1.40	14.88	1.42
50	47	16.98	1.30	16.44	1.33	15.88	1.37	15.33	1.41	14.99	1.43
59	50	17.14	1.29	16.60	1.33	16.04	1.37	15.48	1.41	15.14	1.43
68	59	16.81	0.98	16.28	1.01	15.73	1.04	15.18	1.07	14.84	1.08
75	65	13.33	0.79	12.91	0.81	12.47	0.84	12.03	0.86	11.77	0.88

		Indoor temperature									
		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°CWB	kW		kW		kW		kW		kW	
	-15.0	-16.1	3.22	1.31	3.12	1.35	3.01	1.39	2.91	1.43	2.84
-10.0	-11.1	3.66	1.41	3.55	1.45	3.43	1.49	3.31	1.54	3.23	1.56
-5.0	-7.2	3.86	1.37	3.74	1.41	3.61	1.45	3.49	1.49	3.41	1.51
0.0	-2.2	4.09	1.32	3.96	1.36	3.83	1.40	3.69	1.44	3.61	1.46
5.0	2.8	4.63	1.27	4.48	1.31	4.33	1.34	4.18	1.38	4.09	1.41
8.3	6.1	4.94	1.28	4.78	1.32	4.62	1.36	4.46	1.40	4.36	1.42
10.0	8.3	4.98	1.30	4.82	1.33	4.66	1.37	4.49	1.41	4.39	1.43
15.0	10.0	5.02	1.29	4.87	1.33	4.70	1.37	4.54	1.41	4.44	1.43
20.0	15.0	4.93	0.98	4.77	1.01	4.61	1.04	4.45	1.07	4.35	1.08
23.9	18.3	3.91	0.79	3.78	0.81	3.65	0.84	3.53	0.86	3.45	0.88

## ● Indoor units: 12,000 Btu

		Indoor temperature									
		60		65		70		75		78	
Outdoor temperature	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°FWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	12.55	1.69	12.15	1.74	11.74	1.79	11.33	1.84	11.08
14	12	14.28	1.81	13.83	1.86	13.36	1.92	12.89	1.97	12.61	2.00
23	19	15.06	1.78	14.58	1.83	14.09	1.88	13.59	1.93	13.29	1.96
32	28	15.94	1.69	15.44	1.74	14.92	1.79	14.40	1.84	14.08	1.87
41	37	18.06	1.58	17.49	1.63	16.89	1.67	16.30	1.72	15.94	1.75
47	43	19.26	1.60	18.65	1.64	18.02	1.69	17.39	1.74	17.00	1.76
50	47	19.40	1.61	18.79	1.66	18.15	1.71	17.52	1.76	17.13	1.78
59	50	19.59	1.62	18.97	1.66	18.33	1.71	17.69	1.76	17.30	1.79
68	59	19.21	1.37	18.60	1.41	17.97	1.45	17.34	1.49	16.96	1.52
75	65	16.21	0.95	15.70	0.98	15.16	1.00	14.63	1.03	14.31	1.05

		Indoor temperature									
		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°CWB	kW		kW		kW		kW		kW	
	-15.0	-16.1	3.68	1.69	3.56	1.74	3.44	1.79	3.32	1.84	3.25
-10.0	-11.1	4.18	1.81	4.05	1.86	3.92	1.92	3.78	1.97	3.70	2.00
-5.0	-7.2	4.41	1.78	4.27	1.83	4.13	1.88	3.98	1.93	3.90	1.96
0.0	-2.2	4.67	1.69	4.53	1.74	4.37	1.79	4.22	1.84	4.13	1.87
5.0	2.8	5.29	1.58	5.12	1.63	4.95	1.67	4.78	1.72	4.67	1.75
8.3	6.1	5.64	1.60	5.47	1.64	5.28	1.69	5.10	1.74	4.98	1.76
10.0	8.3	5.69	1.61	5.51	1.66	5.32	1.71	5.13	1.76	5.02	1.78
15.0	10.0	5.74	1.62	5.56	1.66	5.37	1.71	5.18	1.76	5.07	1.79
20.0	15.0	5.63	1.37	5.45	1.41	5.27	1.45	5.08	1.49	4.97	1.52
23.9	18.3	4.75	0.95	4.60	0.98	4.44	1.00	4.29	1.03	4.19	1.05

## ● Indoor units: 7,000 Btu + 7,000 Btu

		Indoor temperature									
		60		65		70		75		78	
Outdoor temperature	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°FDB	kW		kW		kW		kW		kW	
	°FWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	13.01	1.82	12.60	1.88	12.18	1.93	11.75	1.99	11.49	2.02
14	12	14.68	1.94	14.22	1.99	13.74	2.05	13.26	2.11	12.97	2.14
23	19	16.52	1.90	16.00	1.95	15.46	2.01	14.92	2.07	14.59	2.10
32	28	18.62	1.84	18.04	1.90	17.43	1.95	16.82	2.01	16.45	2.04
41	37	20.74	1.79	20.09	1.84	19.41	1.89	18.73	1.95	18.32	1.98
47	43	22.12	1.86	21.42	1.91	20.70	1.97	19.98	2.03	19.54	2.06
50	47	22.29	1.88	21.58	1.93	20.85	1.99	20.12	2.05	19.68	2.08
59	50	22.51	1.90	21.80	1.95	21.06	2.01	20.32	2.07	19.88	2.10
68	59	22.07	1.66	21.37	1.71	20.65	1.76	19.93	1.80	19.49	1.83
75	65	20.19	1.11	19.55	1.14	18.89	1.17	18.23	1.20	17.83	1.22

		Indoor temperature									
		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°CDB	kW		kW		kW		kW		kW	
	°CWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
-15.0	-16.1	3.81	1.82	3.69	1.88	3.57	1.93	3.44	1.99	3.37	2.02
-10.0	-11.1	4.30	1.94	4.17	1.99	4.03	2.05	3.89	2.11	3.80	2.14
-5.0	-7.2	4.84	1.90	4.69	1.95	4.53	2.01	4.37	2.07	4.28	2.10
0.0	-2.2	5.46	1.84	5.29	1.90	5.11	1.95	4.93	2.01	4.82	2.04
5.0	2.8	6.08	1.79	5.89	1.84	5.69	1.89	5.49	1.95	5.37	1.98
8.3	6.1	6.48	1.86	6.28	1.91	6.07	1.97	5.85	2.03	5.73	2.06
10.0	8.3	6.53	1.88	6.33	1.93	6.11	1.99	5.90	2.05	5.77	2.08
15.0	10.0	6.60	1.90	6.39	1.95	6.17	2.01	5.96	2.07	5.83	2.10
20.0	15.0	6.47	1.66	6.26	1.71	6.05	1.76	5.84	1.80	5.71	1.83
23.9	18.3	5.92	1.11	5.73	1.14	5.54	1.17	5.34	1.20	5.22	1.22

## ● Indoor units: 7,000 Btu + 9,000 Btu

		Indoor temperature									
		60		65		70		75		78	
Outdoor temperature	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°FDB	kW		kW		kW		kW		kW	
	°FWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	13.25	1.77	12.84	1.82	12.40	1.88	11.97	1.93	11.70	1.96
14	12	15.05	1.79	14.58	1.84	14.09	1.89	13.59	1.94	13.29	1.98
23	19	16.93	1.79	16.39	1.84	15.84	1.89	15.28	1.94	14.95	1.98
32	28	19.38	1.77	18.77	1.82	18.13	1.87	17.50	1.92	17.11	1.95
41	37	21.95	1.74	21.25	1.79	20.53	1.84	19.82	1.90	19.38	1.93
47	43	23.41	1.81	22.67	1.87	21.90	1.92	21.13	1.97	20.67	2.01
50	47	23.58	1.79	22.84	1.84	22.06	1.89	21.29	1.94	20.82	1.98
59	50	23.81	1.79	23.06	1.84	22.28	1.89	21.50	1.94	21.03	1.98
68	59	23.35	1.62	22.61	1.66	21.84	1.71	21.08	1.76	20.62	1.79
75	65	23.64	1.08	22.89	1.11	22.12	1.14	21.34	1.17	20.87	1.19

		Indoor temperature									
		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°CDB	kW		kW		kW		kW		kW	
	°CWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
-15.0	-16.1	3.88	1.77	3.76	1.82	3.63	1.88	3.51	1.93	3.43	1.96
-10.0	-11.1	4.41	1.79	4.27	1.84	4.13	1.89	3.98	1.94	3.90	1.98
-5.0	-7.2	4.96	1.79	4.80	1.84	4.64	1.89	4.48	1.94	4.38	1.98
0.0	-2.2	5.68	1.77	5.50	1.82	5.31	1.87	5.13	1.92	5.02	1.95
5.0	2.8	6.43	1.74	6.23	1.79	6.02	1.84	5.81	1.90	5.68	1.93
8.3	6.1	6.86	1.81	6.64	1.87	6.42	1.92	6.19	1.97	6.06	2.01
10.0	8.3	6.91	1.79	6.69	1.84	6.47	1.89	6.24	1.94	6.10	1.98
15.0	10.0	6.98	1.79	6.76	1.84	6.53	1.89	6.30	1.94	6.16	1.98
20.0	15.0	6.84	1.62	6.63	1.66	6.40	1.71	6.18	1.76	6.04	1.79
23.9	18.3	6.93	1.08	6.71	1.11	6.48	1.14	6.26	1.17	6.12	1.19

OUTDOOR UNIT  
UOMH18AFXJ

## ● Indoor units: 7,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	5	3	15.02	1.95	14.54	2.00	14.05	2.06	13.56	2.12	13.26	2.15	
	14	12	16.95	1.96	16.42	2.02	15.86	2.08	15.31	2.14	14.97	2.15	
	23	19	18.86	1.96	18.26	2.02	17.65	2.08	17.03	2.14	16.65	2.15	
	32	28	21.65	1.94	20.97	1.99	20.26	2.05	19.55	2.11	19.12	2.14	
	41	37	24.45	1.91	23.68	1.96	22.88	2.02	22.08	2.07	21.59	2.11	
	47	43	26.08	1.98	25.25	2.04	24.40	2.10	23.55	2.15	23.03	2.15	
	50	47	26.27	1.96	25.44	2.02	24.58	2.08	23.72	2.14	23.20	2.15	
	59	50	26.53	1.96	25.69	2.01	24.83	2.07	23.96	2.13	23.43	2.15	
	68	59	26.01	1.57	25.19	1.62	24.34	1.66	23.49	1.71	22.97	1.74	
	75	65	24.13	1.28	23.37	1.31	22.58	1.35	21.79	1.39	21.31	1.41	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	-15.0	-16.1	4.40	1.95	4.26	2.00	4.12	2.06	3.97	2.12	3.89	2.15	
	-10.0	-11.1	4.97	1.96	4.81	2.02	4.65	2.08	4.49	2.14	4.39	2.15	
	-5.0	-7.2	5.53	1.96	5.35	2.02	5.17	2.08	4.99	2.14	4.88	2.15	
	0.0	-2.2	6.35	1.94	6.14	1.99	5.94	2.05	5.73	2.11	5.60	2.14	
	5.0	2.8	7.17	1.91	6.94	1.96	6.71	2.02	6.47	2.07	6.33	2.11	
	8.3	6.1	7.64	1.98	7.40	2.04	7.15	2.10	6.90	2.15	6.75	2.15	
	10.0	8.3	7.70	1.96	7.46	2.02	7.20	2.08	6.95	2.14	6.80	2.15	
	15.0	10.0	7.78	1.96	7.53	2.01	7.28	2.07	7.02	2.13	6.87	2.15	
	20.0	15.0	7.62	1.57	7.38	1.62	7.13	1.66	6.88	1.71	6.73	1.74	
	23.9	18.3	7.07	1.28	6.85	1.31	6.62	1.35	6.39	1.39	6.25	1.41	

## ● Indoor units: 9,000 Btu + 9,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	5	3	14.84	1.95	14.37	2.00	13.88	2.06	13.40	2.12	13.10	2.15	
	14	12	16.75	1.96	16.22	2.02	15.67	2.08	15.12	2.14	14.79	2.15	
	23	19	18.86	1.96	18.26	2.02	17.65	2.08	17.03	2.14	16.65	2.15	
	32	28	21.59	1.94	20.91	1.99	20.20	2.05	19.49	2.11	19.06	2.14	
	41	37	24.45	1.91	23.68	1.96	22.88	2.02	22.08	2.07	21.59	2.11	
	47	43	26.08	1.98	25.25	2.04	24.40	2.10	23.55	2.15	23.03	2.15	
	50	47	26.27	1.96	25.44	2.02	24.58	2.08	23.72	2.14	23.20	2.15	
	59	50	26.53	1.96	25.69	2.02	24.83	2.08	23.96	2.14	23.43	2.15	
	68	59	26.01	1.77	25.19	1.82	24.34	1.87	23.49	1.92	22.97	1.96	
	75	65	24.13	1.18	23.37	1.21	22.58	1.25	21.79	1.28	21.31	1.30	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	-15.0	-16.1	4.35	1.95	4.21	2.00	4.07	2.06	3.93	2.12	3.84	2.15	
	-10.0	-11.1	4.91	1.96	4.75	2.02	4.59	2.08	4.43	2.14	4.34	2.15	
	-5.0	-7.2	5.53	1.96	5.35	2.02	5.17	2.08	4.99	2.14	4.88	2.15	
	0.0	-2.2	6.33	1.94	6.13	1.99	5.92	2.05	5.71	2.11	5.59	2.14	
	5.0	2.8	7.17	1.91	6.94	1.96	6.71	2.02	6.47	2.07	6.33	2.11	
	8.3	6.1	7.64	1.98	7.40	2.04	7.15	2.10	6.90	2.15	6.75	2.15	
	10.0	8.3	7.70	1.96	7.46	2.02	7.20	2.08	6.95	2.14	6.80	2.15	
	15.0	10.0	7.78	1.96	7.53	2.02	7.28	2.08	7.02	2.14	6.87	2.15	
	20.0	15.0	7.62	1.77	7.38	1.82	7.13	1.87	6.88	1.92	6.73	1.96	
	23.9	18.3	7.07	1.18	6.85	1.21	6.62	1.25	6.39	1.28	6.25	1.30	




## ● Indoor units: 9,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	14.87	1.95	14.40	2.01	13.91	2.06	13.42	2.12	13.13	2.15	
	14	12	16.78	1.97	16.25	2.03	15.70	2.09	15.15	2.15	14.82	2.15	
	23	19	18.86	1.97	18.26	2.03	17.65	2.09	17.03	2.15	16.65	2.15	
	32	28	21.59	1.94	20.91	2.00	20.20	2.05	19.49	2.11	19.06	2.15	
	41	37	24.45	1.91	23.68	1.96	22.88	2.02	22.08	2.07	21.59	2.11	
	47	43	26.08	1.98	25.25	2.04	24.40	2.10	23.55	2.15	23.03	2.15	
	50	47	26.27	1.97	25.44	2.03	24.58	2.09	23.72	2.15	23.20	2.15	
	59	50	26.53	1.96	25.69	2.02	24.83	2.07	23.96	2.13	23.43	2.15	
68	59	26.01	1.57	25.19	1.62	24.34	1.66	23.49	1.71	22.97	1.74		
75	65	24.12	1.28	23.36	1.31	22.57	1.35	21.78	1.39	21.30	1.41		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	4.36	1.95	4.22	2.01	4.08	2.06	3.93	2.12	3.85	2.15	
	-10.0	-11.1	4.92	1.97	4.76	2.03	4.60	2.09	4.44	2.15	4.34	2.15	
	-5.0	-7.2	5.53	1.97	5.35	2.03	5.17	2.09	4.99	2.15	4.88	2.15	
	0.0	-2.2	6.33	1.94	6.13	2.00	5.92	2.05	5.71	2.11	5.59	2.15	
	5.0	2.8	7.17	1.91	6.94	1.96	6.71	2.02	6.47	2.07	6.33	2.11	
	8.3	6.1	7.64	1.98	7.40	2.04	7.15	2.10	6.90	2.15	6.75	2.15	
	10.0	8.3	7.70	1.97	7.46	2.03	7.20	2.09	6.95	2.15	6.80	2.15	
	15.0	10.0	7.78	1.96	7.53	2.02	7.28	2.07	7.02	2.13	6.87	2.15	
20.0	15.0	7.62	1.57	7.38	1.62	7.13	1.66	6.88	1.71	6.73	1.74		
23.9	18.3	7.07	1.28	6.85	1.31	6.61	1.35	6.38	1.39	6.24	1.41		

OUTDOOR UNIT  
UOMH18AFXJ

## 7. Capacity compensation rate for pipe length and height difference

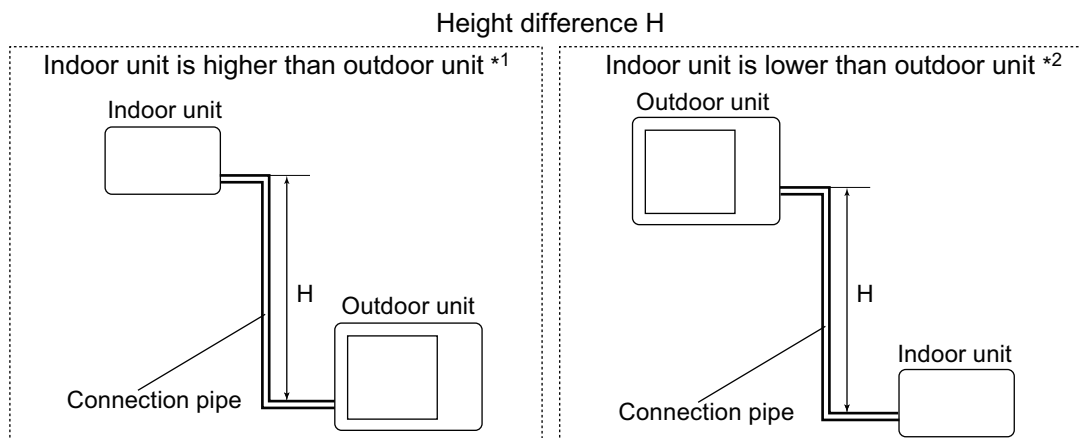

### 7-1. Model: UOMH18AFXZJ

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

#### ■ Indoor unit: 7,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.956	0.942	0.928
		10	33	-	-	0.977	0.963	0.950	0.936
		7.5	25	-	0.988	0.981	0.967	0.953	0.940
		5	16	0.995	0.992	0.985	0.971	0.957	0.943
		0	0	1.003	1.000	0.993	0.979	0.965	0.951
	Indoor unit is lower than outdoor unit *2	-5	-16	1.003	1.000	0.993	0.979	0.965	0.951
		-7.5	-25	-	1.000	0.993	0.979	0.965	0.951
		-10	-33	-	-	0.993	0.979	0.965	0.951
		-15	-49	-	-	-	0.979	0.965	0.951

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.977	0.958	0.939
		10	33	-	-	0.993	0.977	0.958	0.939
		7.5	25	-	1.000	0.993	0.977	0.958	0.939
		5	16	0.990	1.000	0.993	0.977	0.958	0.939
		0	0	0.990	1.000	0.993	0.977	0.958	0.939
	Indoor unit is lower than outdoor unit *2	-5	-16	0.985	0.995	0.988	0.972	0.953	0.934
		-7.5	-25	-	0.993	0.986	0.970	0.951	0.932
		-10	-33	-	-	0.983	0.967	0.948	0.930
		-15	-49	-	-	-	0.962	0.944	0.925

## ■ Indoor unit: 9,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.956	0.942	0.928
		10	33	-	-	0.977	0.963	0.950	0.936
		7.5	25	-	0.988	0.981	0.967	0.953	0.940
		5	16	0.999	0.992	0.985	0.971	0.957	0.943
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	1.007	1.000	0.993	0.979	0.965	0.951
		-5	-16	1.007	1.000	0.993	0.979	0.965	0.951
		-7.5	-25	-	1.000	0.993	0.979	0.965	0.951
		-10	-33	-	-	0.993	0.979	0.965	0.951
		-15	-49	-	-	-	0.979	0.965	0.951

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.977	0.958	0.939
		10	33	-	-	0.993	0.977	0.958	0.939
		7.5	25	-	1.000	0.993	0.977	0.958	0.939
		5	16	0.993	1.000	0.993	0.977	0.958	0.939
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	0.993	1.000	0.993	0.977	0.958	0.939
		-5	-16	0.988	0.995	0.988	0.972	0.953	0.934
		-7.5	-25	-	0.993	0.986	0.970	0.951	0.932
		-10	-33	-	-	0.983	0.967	0.948	0.930
		-15	-49	-	-	-	0.962	0.944	0.925

## ■ Indoor unit: 12,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.933	0.899	0.859
		10	33	-	-	0.970	0.940	0.906	0.866
		7.5	25	-	0.988	0.974	0.944	0.910	0.869
		5	16	1.006	0.992	0.978	0.948	0.913	0.873
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	1.014	1.000	0.986	0.956	0.921	0.880
		-5	-16	1.014	1.000	0.986	0.956	0.921	0.880
		-7.5	-25	-	1.000	0.986	0.956	0.921	0.880
		-10	-33	-	-	0.986	0.956	0.921	0.880
		-15	-49	-	-	-	0.956	0.921	0.880

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.975	0.957	0.940
		10	33	-	-	0.990	0.975	0.957	0.940
		7.5	25	-	1.000	0.990	0.975	0.957	0.940
		5	16	0.995	1.000	0.990	0.975	0.957	0.940
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	0.995	1.000	0.990	0.975	0.957	0.940
		-5	-16	0.990	0.995	0.985	0.970	0.952	0.936
		-7.5	-25	-	0.993	0.983	0.968	0.950	0.934
		-10	-33	-	-	0.980	0.965	0.947	0.931
		-15	-49	-	-	-	0.960	0.943	0.926

## 8. Additional charge calculation

### 8-1. Model: UOMH18AFXZJ

Refrigerant type		R410A
Refrigerant amount	lb oz	4 lb 14 oz
	g	2,200

#### ■ Refrigerant charge

Total pipe length	ft	98 or less	131	164 (Max.)	0.21 oz/ft (20 g/m)
	m	30 or less	40	50 (Max.)	
Additional charge	lb oz	0	7.1 oz	14.1 oz	
	g	0	200	400	

---

## 9. Airflow

---

### 9-1. Model: UOMH18AFXZJ

#### ● Cooling

m <sup>3</sup> /h	3,050
l/s	847
CFM	1,795

#### ● Heating


m <sup>3</sup> /h	2,750
l/s	764
CFM	1,619

# 10. Operation noise (sound pressure)


## 10-1. Noise level curve

■ Model: UOMH18AFXZJ


● Cooling

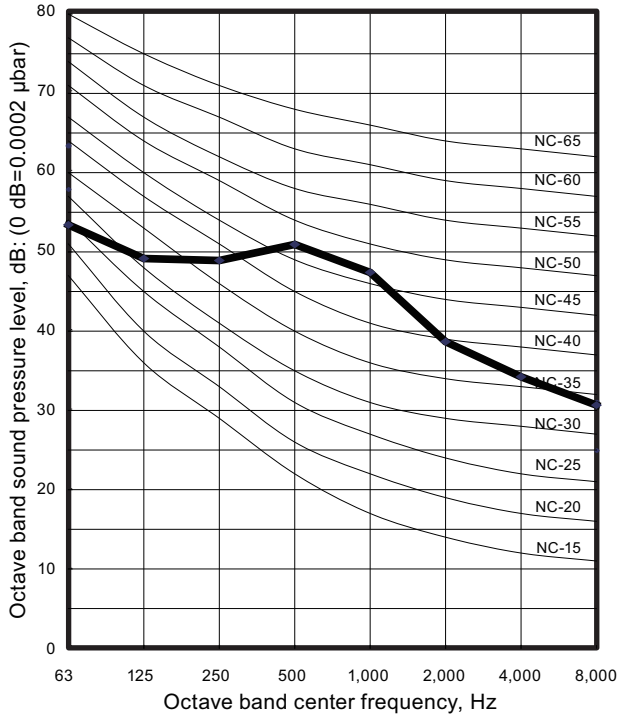

● Heating

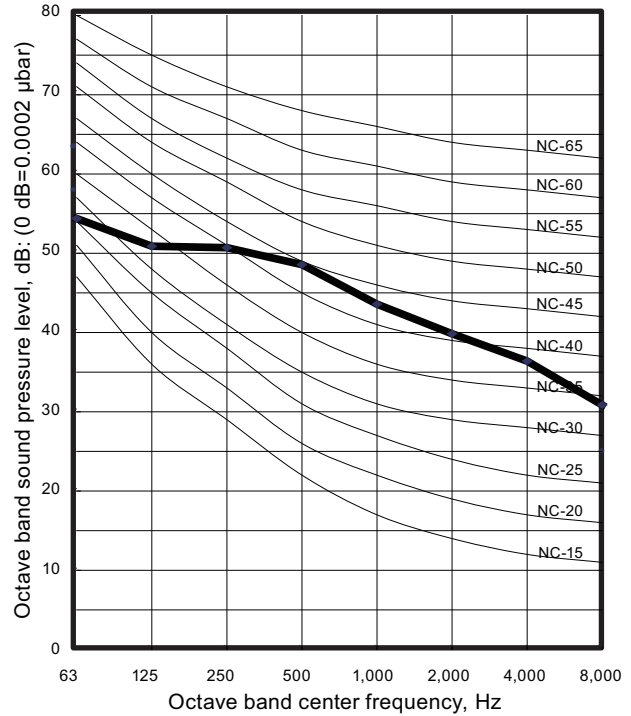

## 10-2. Sound level check point

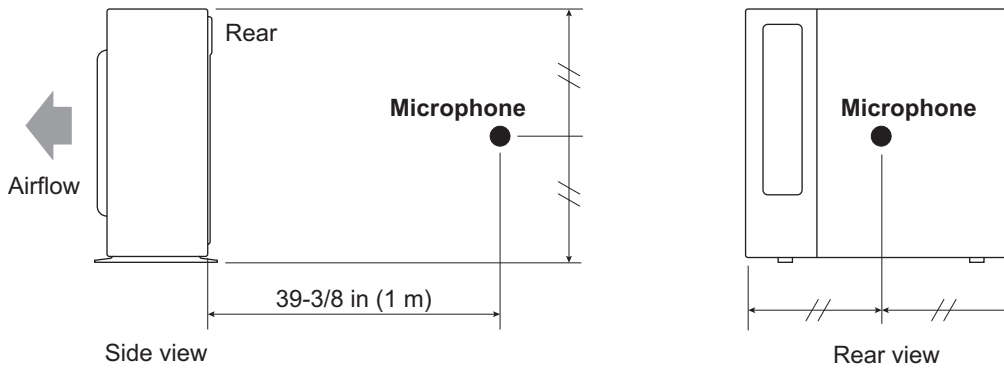

**NOTE:** Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.

# 11. Electrical characteristics

Model name			UOMH18AFXZJ
Power supply	Voltage	V	208/230 ~
	Frequency	Hz	60
MCA *1		A	13
Starting current		A	8.2
Wiring spec. *2	MAX. CKT. BKR *3	A	15
	Power cable	AWG	14

\*1: Minimum Circuit Ampacity (Calculation based on UL1995)

\*2: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005.  
As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.

\*3: Maximum Circuit Breaker




## 12. Safety devices

Type of protection	Protection form		Model
			UOMH18AFXZJ
Circuit protection	Current fuse (Main PCB)		250 V, 5 A 250 V, 3.15 A
	Current fuse (Near the terminal)		250 V, 10 A
Fan motor protection	Temperature thermistor	Activate	302 ±27 °F (150 ±15 °C) Fan motor stop
		Reset	248 ±27 °F (120 ±15 °C) Fan motor restart
Compressor protection	Temperature thermistor	Activate	230 ±4 °F (110 ±2 °C) Compressor stop
		Reset	176 ±4 °F (80 ±2 °C) Compressor restart
Refrigerant circuit protection	Pressure switch 1	Activate	609 ±15 PSI (4.2 ±0.1 MPa)
		Reset	464 ±22 PSI (3.2 ±0.15 MPa)

\*Pressure switch 2: For control device. (Refer to the wiring diagram.)



# 13. Accessories

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Drain pipe		1
Drain cap		5			

OUTDOOR UNIT  
UOMH18AFXJ

## 14. Outdoor unit installation precautions

**NOTE:** The information listed below are general precautions.  
Some models also include items that do not apply.

### 14-1. Place where prohibited for use

- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places not affected by heat radiation from other heat sources.
- Places where the air is not stagnant.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are product.

### 14-2. Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the outdoor unit.
- To allow maintenance after refrigerant piping, drain piping, and electric wiring connection and installation, provide an installation service space.  
\*Installation service space is shown in "[Installation space](#)" on page 82.
- Be careful when installing the set at the following places.

Condition	Contents	Countermeasures (Reference)
When installed near adjacent houses.	Perform installation work so that operating sound does not disturb the neighbors.	<ol style="list-style-type: none"> <li>1. Install a soundproof barrier.</li> <li>2. Change the installation site.</li> </ol>
When there is the possibility of strong wind.	<ul style="list-style-type: none"> <li>• If the outdoor unit is exposed to strong wind, capacity may drop, frost may form during heating, and operation may be stopped by high pressure rise. In addition, when a very strong wind blows, the fan may be damaged.</li> <li>• When a very strong wind blows, there is the possibility of the outdoor unit being toppled over if held only by foundation bolts.</li> </ul>	<ol style="list-style-type: none"> <li>1. Install the outdoor unit with keeping a sufficient distance between the outlet side of the unit and a facing wall or fence.</li> <li>2. Make the outlet direction and wind direction perpendicular.</li> <li>3. Fasten the outdoor unit using toppling prevention hardware (purchased locally).</li> </ol>
When snow accumulates.	If the outdoor unit is covered by accumulated snow, it may not be able to operate.	<ol style="list-style-type: none"> <li>1. Make the foundation as high as possible.</li> <li>2. Perform snow prevention work.</li> </ol>
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.

# **Part 3. OUTDOOR UNIT (3 ROOMS TYPE)**

---

**MULTI TYPE:  
UOMH24AFXZJ**

# 1. Specifications

## 1-1. Model: UOMH24AFXZJ

OUTDOOR UNIT  
UOMH24AFXZJ

Type				Inverter heat pump	
<b>Model name</b>				<b>UOMH24AFXZJ</b>	
Power source				1Ø 208/230 V 60 Hz	
Available voltage range				187—264V	
Connectable indoor unit		Number		2 to 3	
		Total capacity range		14,000 to 21,000 Btu/h	
Combination of indoor unit				UIWH09AVFJ + UIWH07AVFJ × 2	
Capacity	Cooling	Rated	Btu/h	22,000	
			kW	6.42	
		Min.—Max.	Btu/h	6,100—27,000	
			kW	1.8—7.9	
	Heating	Rated	Btu/h	24,000	
			kW	7.02	
Min.—Max.		Btu/h	6,800—29,800		
		kW	2.0—8.7		
Input power	Cooling	Rated	kW	1.76	
		Max.		2.60	
	Heating	Rated		1.73	
		Max.		2.93	
Current	Cooling	Rated	A	7.7	
	Heating			7.6	
EER	Cooling	Rated	Btu/W	12.50	
SEER *1	Cooling		-	18.00	
COP	Heating	Rated	W/W	4.04	
HSPF *1	Heating		-	9.50	
Starting current				A	
Maximum operating current *2				A	
Fan	Type × Q'ty			Propeller × 1	
	Airflow rate	Cooling	CFM (m <sup>3</sup> /h)	1,942 (3,300)	
		Heating		1,942 (3,300)	
	Motor	Type × Quantity		DC motor × 1	
Output		W	100		
Sound pressure level		Cooling	Rated	dB (A)	
		Heating		51	
				52	
Heat exchanger		Dimension (H × W × D)		in (mm)	
				26-7/16 × 35-7/16 × 1-7/16 (672 × 900 × 36.38)	
		Fin pitch		FPI	
				18	
		Rows × Stages		2 × 32	
		Pipe type (Material)		Grooved H-pin (Copper)	
		Type (Material)		Corrugate (Aluminum)	
		Fin		Surface treatment	
				Corrosion resistance (Blue Fin)	
Compressor	Type × Quantity		DC twin rotary × 1		
	Motor output		W	1,100	
Refrigerant		Type	R410A		
		Charge	lb (g)	4 lb 14 oz (2,200)	
Refrigerant oil		Type	POE		
		Amount	in <sup>3</sup> (cm <sup>3</sup> )	39.7 (650)	
Enclosure		Material		Painted galvanized steel	
		Color		Beige (Approximate color of MUNSELL 10YR 7.5/1.0NN)	
Dimensions	Net	(H × W × D)		in (mm)	
	Gross			27-9/16 × 35-7/16 × 13 (700 × 900 × 330)	
				34-1/16 × 41-5/16 × 17-1/2 (865 × 1,050 × 445)	
Weight	Net			lb (kg)	
	Gross			124 (56)	
				141 (64)	
Connection pipe	Size	Liquid	in (mm)	Ø1/4 (Ø6.35) × 3	
		Gas		Ø3/8 (Ø9.52) × 2 + Ø1/2 (Ø12.7) × 1	
	Method		Flare		
	Pre-charge length (Total)		98 (30)		
	Max. length (Total)		164 (50)		
	Max. length (Each)		82 (25)		
	Min. length (Total)		49 (15)		
	Min. length (Each)		16 (5)		
	Max. height difference between outdoor unit and each indoor units		49 (15)		
	Max. height difference between indoor units		33 (10)		
Operation range		Cooling	°F (°C)		
		Heating	14 to 115 (-10 to 46) 5 to 75 (-15 to 24)		


**NOTES:**

- Specifications are based on the following conditions:
  - Power source of specifications : 230 V
  - Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
  - Cooling: Indoor temperature of 80 °FDB (26.7 °CDB)/67 °FWB (19.4 °CWB), and outdoor temperature of 95 °FDB (35 °CDB)/75 °FWB (23.9 °CWB).
  - Heating: Indoor temperature of 70 °FDB (21.1 °CDB)/60 °FWB (15.6 °CWB), and outdoor temperature of 47 °FDB (8.3 °CDB)/43 °FWB (6.1 °CWB).
  - \*1: Test conditions are based on AHRI 210/240.
  - \*2: The maximum current is the maximum value when the operated within the operation range.
- For other combination, refer to the combination table.
- The protective function might work when using it outside the operation range.

## 2. Dimensions

### 2-1. Model: UOMH24AFXZJ

Unit: in (mm)

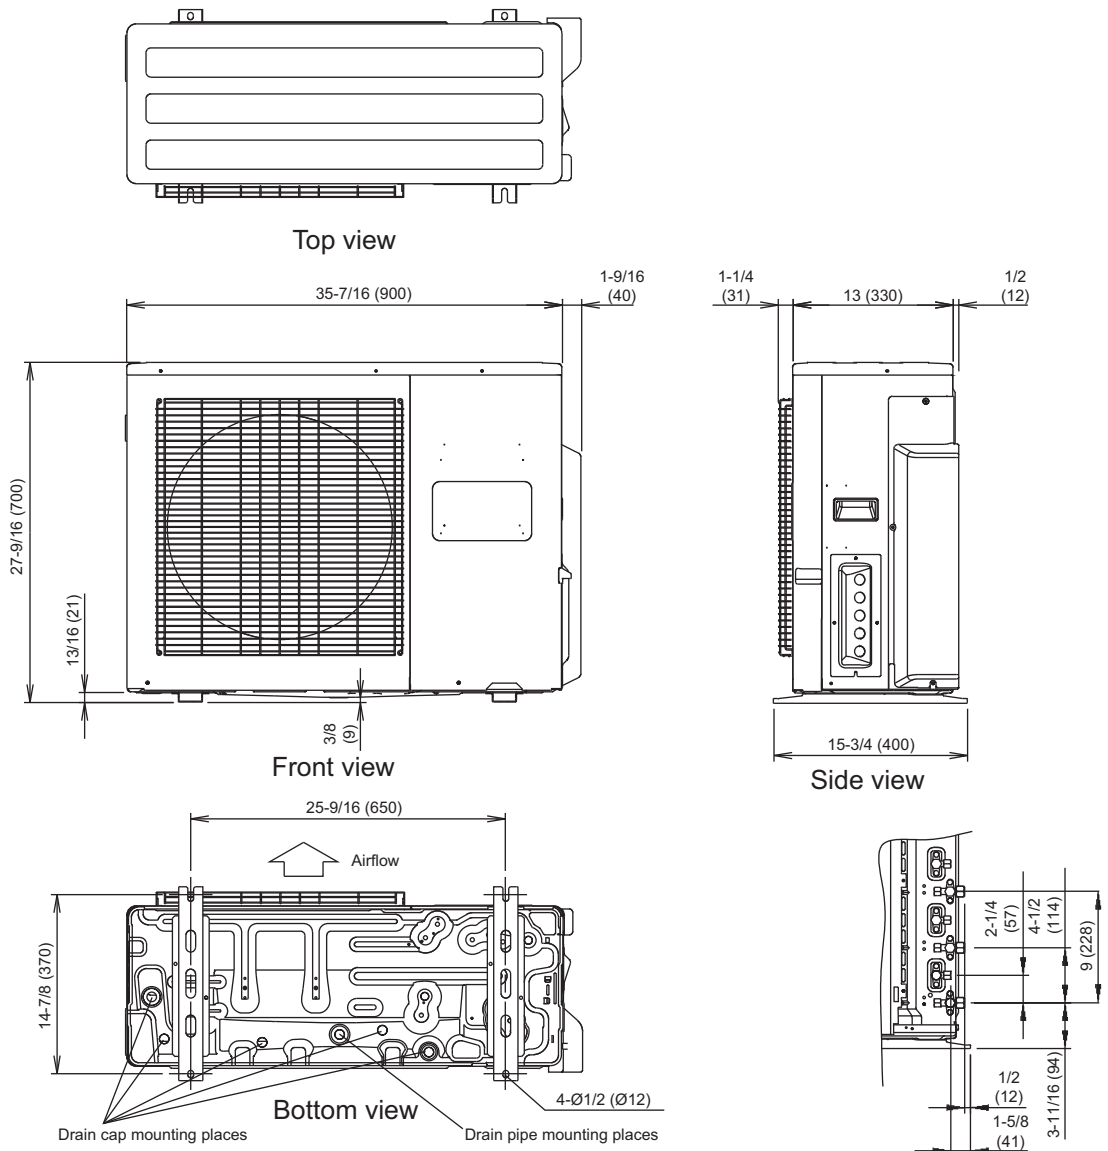

OUTDOOR UNIT  
UOMH24AFXZJ

# 3. Installation space

## 3-1. Model: UOMH24AFXZJ

### ■ Space requirement


Provide sufficient installation space for product safety.

#### ● Single outdoor unit installation


- When the upper space is open:

Unit: in (mm)


When there are obstacles at the rear only.

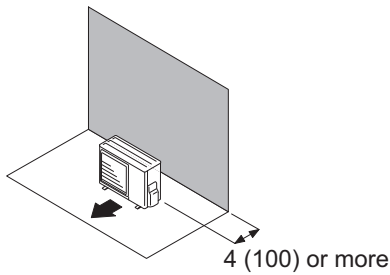


When there are obstacles at the rear and sides.

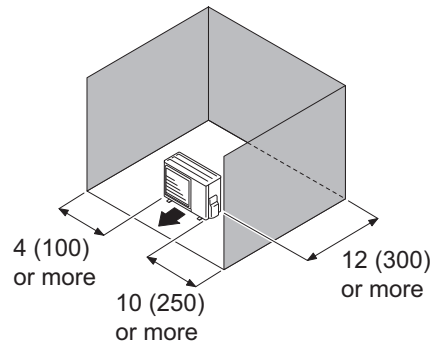

When there are obstacles at the front only.

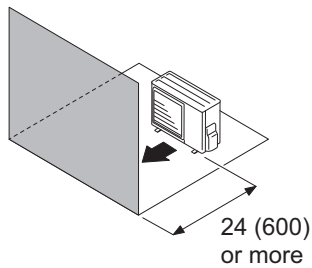


When there are obstacles at the front and rear.

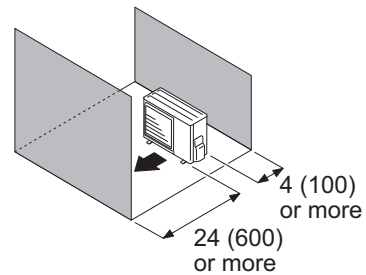


- When there is an obstruction in the upper space:

Unit: in (mm)

When there are obstacles at the rear and above.

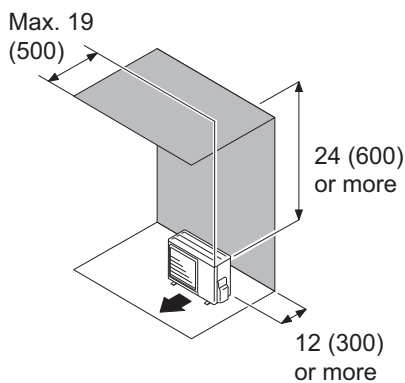

When there are obstacles at the rear, sides, and above.

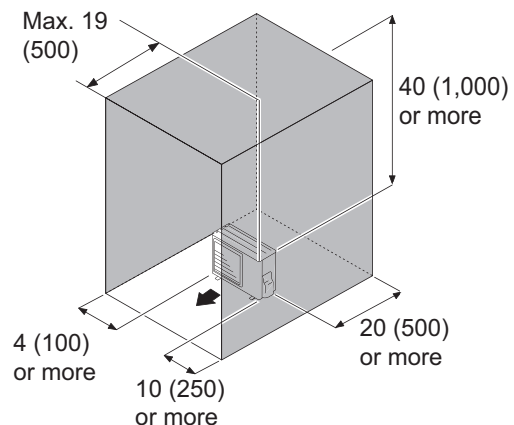



## ● Multiple outdoor unit installation

- When the upper space is open:


Unit: in (mm)

When there are obstacles at the rear only.

When there are obstacles at the front only.

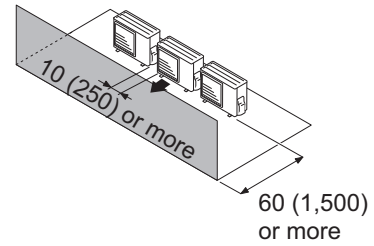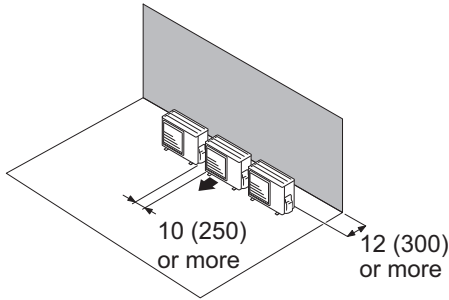


When there are obstacles at the front and rear.

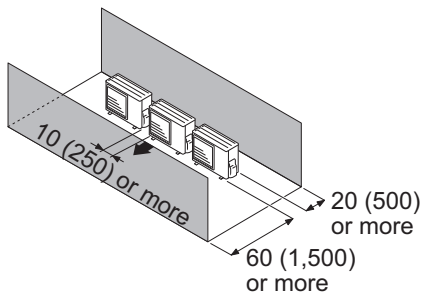

- When there is an obstruction in the upper space:

Unit: in (mm)


When there are obstacles at the rear and above.

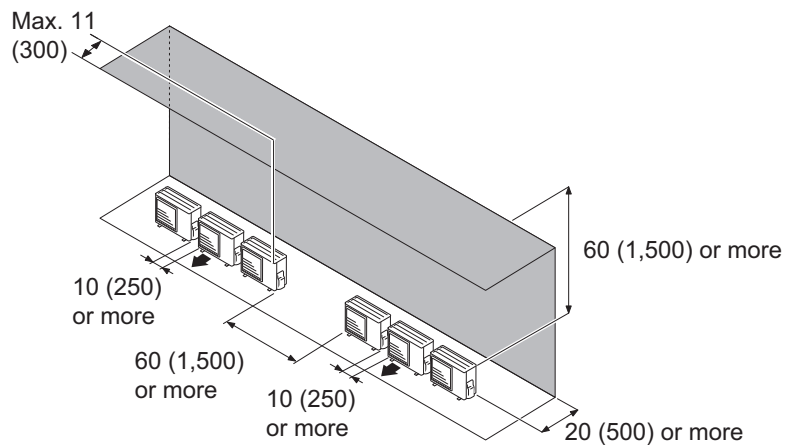



## ● Outdoor unit installation in multi-row

Unit: in (mm)

Single parallel unit arrangement

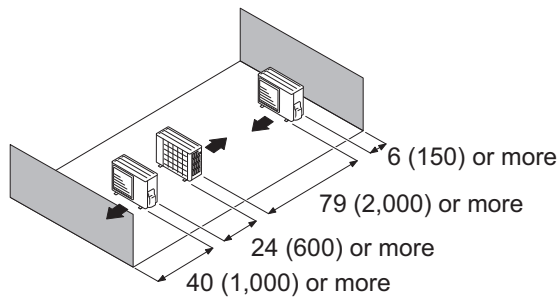

Multiple parallel unit arrangement

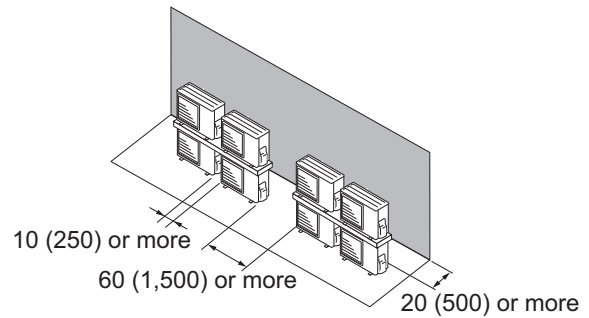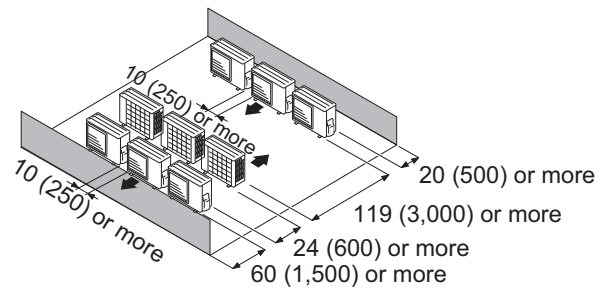


### NOTES:

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- Height above the floor level should be 2 in (50 mm) or more.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.

### ⚠ CAUTION


- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 32 °F (0 °C) or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.





# 4. Refrigerant circuit

## 4-1. Model: UOMH24AFXZJ

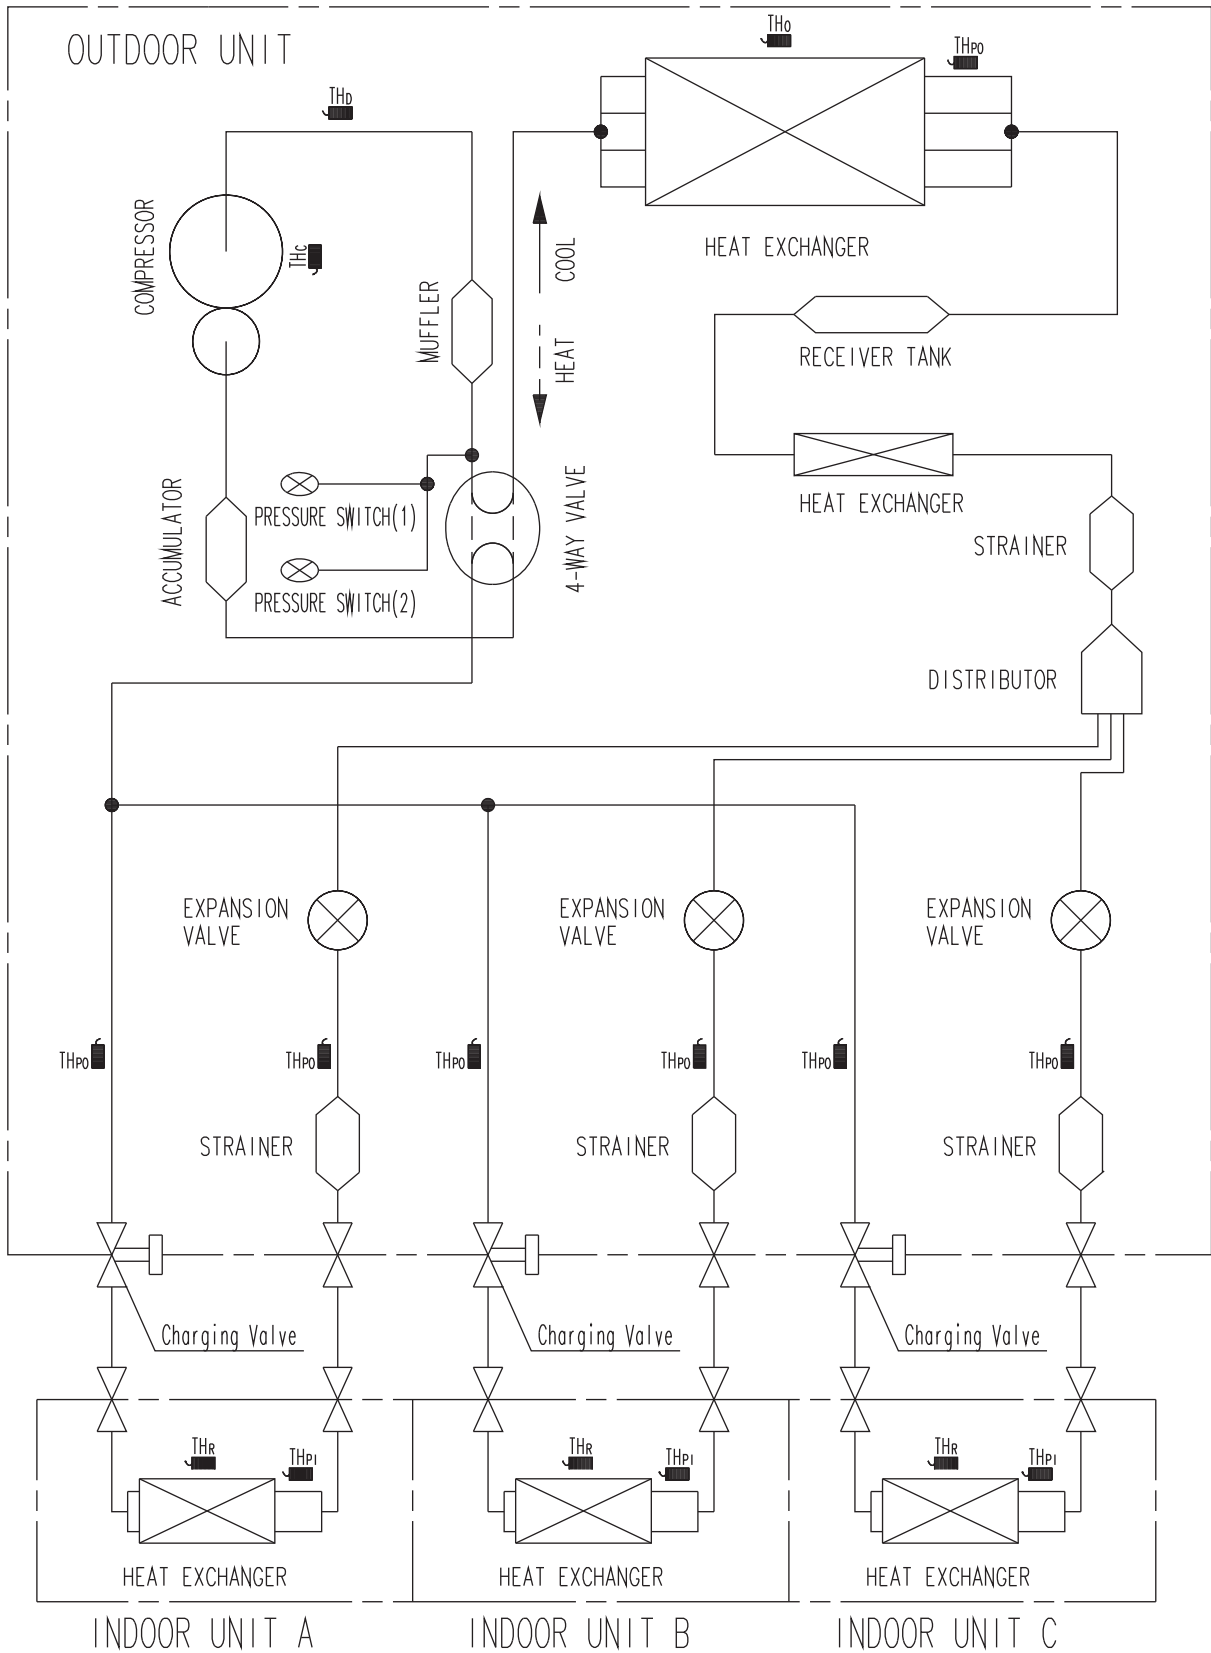

OUTDOOR UNIT  
UOMH24AFXZJ


TH<sub>b</sub> : THERMISTOR(DISCHARGE TEMP.)  
 TH<sub>o</sub> : THERMISTOR(OUTDOOR TEMP.)  
 TH<sub>po</sub> : THERMISTOR(PIPE TEMP.)  
 TH<sub>c</sub> : THERMISTOR(COMPRESSOR TEMP.)

TH<sub>r</sub> : THERMISTOR(ROOM TEMP.)  
 TH<sub>pi</sub> : THERMISTOR(PIPE TEMP.)

# 5. Wiring diagram

## 5-1. Model: UOMH24AFXZJ

OUTDOOR UNIT  
UOMH24AFXZJ

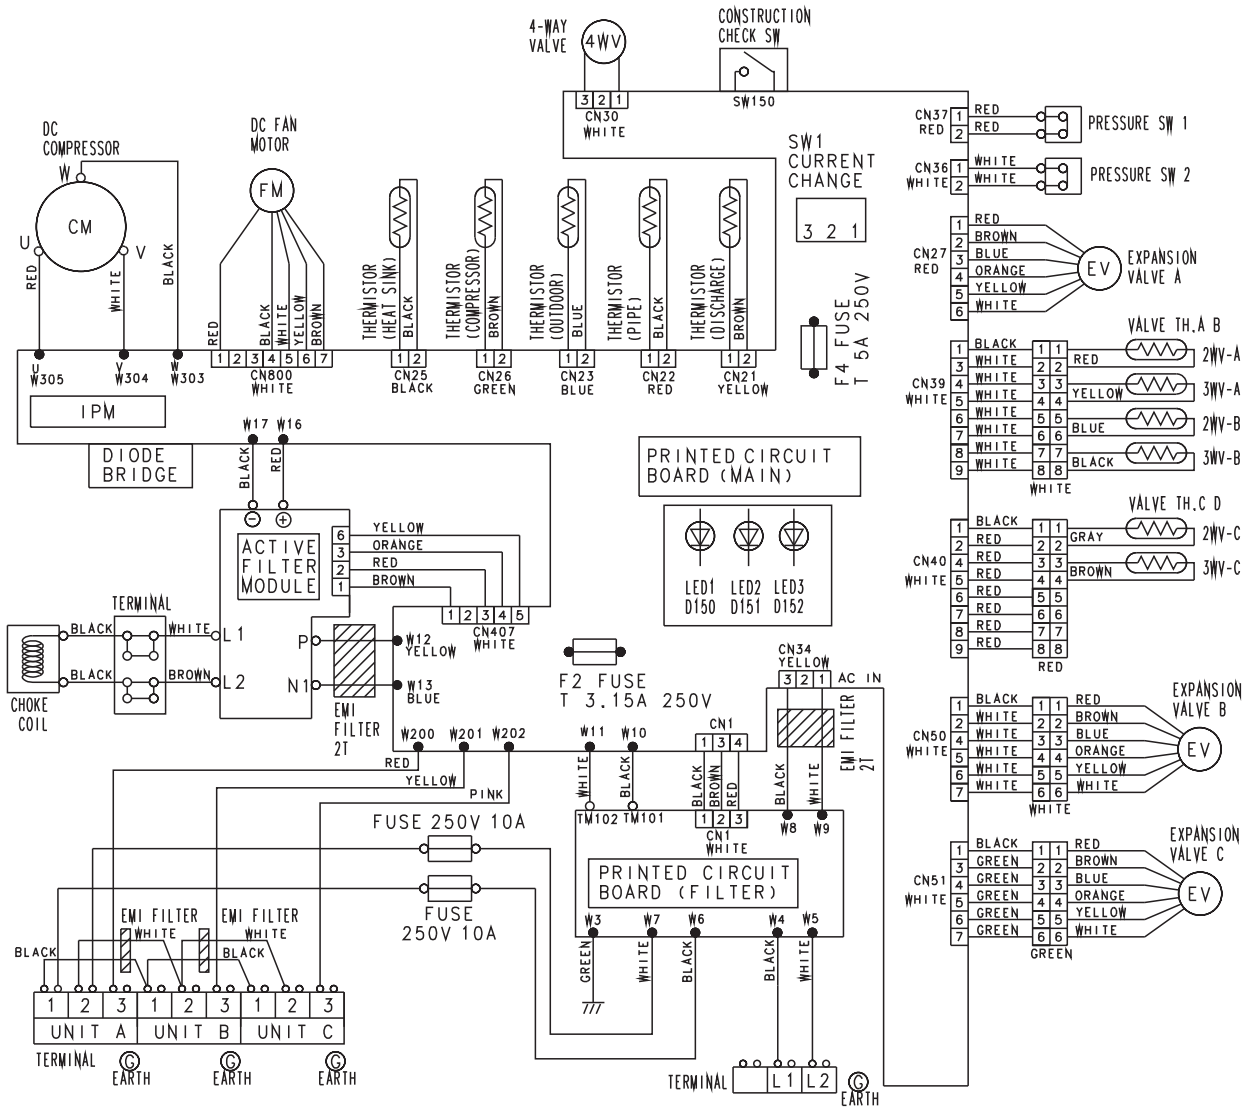

## 6. Capacity table

### 6-1. Combinations

#### ■ Model: UOMH24AFXZJ

#### ● Cooling

Combination of indoor unit				Rated capacity for each indoor unit (kBtu/h)			Maximum capacity for each indoor unit (kBtu/h)			Total capacity (kBtu/h)			Input power (kW)		
Room 1	Room 2	Room 3	Total	Room 1	Room 2	Room 3	Room 1	Room 2	Room 3	Min.	Rated	Max.	Min.	Rated	Max.
7	7	-	14	7.05	7.05	-	8.70	8.70	-	6.10	14.10	17.40	0.50	1.20	1.51
7	9	-	16	7.09	9.11	-	8.66	11.14	-	6.10	16.20	19.80	0.50	1.36	1.78
7	12	-	19	7.07	12.13	-	8.33	14.27	-	6.10	19.20	22.60	0.50	1.63	2.20
7	15	-	22	6.87	13.73	-	8.05	16.10	-	6.10	20.60	24.15	0.50	1.70	2.54
7	18	-	25	6.16	15.84	-	7.20	18.50	-	6.10	22.00	25.70	0.50	1.76	2.87
9	9	-	18	9.00	9.00	-	10.75	10.75	-	6.10	18.00	21.50	0.50	1.55	2.02
9	12	-	21	9.00	12.00	-	10.11	13.49	-	6.10	21.00	23.60	0.50	1.73	2.45
9	15	-	24	8.41	13.09	-	9.70	15.10	-	6.10	21.50	24.80	0.50	1.75	2.66
9	18	-	27	7.33	14.67	-	8.67	17.33	-	6.10	22.00	26.00	0.50	1.76	2.87
12	12	-	24	11.00	11.00	-	12.50	12.50	-	6.10	22.00	25.00	0.50	1.74	2.74
12	15	-	27	10.15	11.85	-	12.46	14.54	-	6.10	22.00	27.00	0.50	1.75	2.87
7	7	7	21	7.00	7.00	7.00	8.57	8.57	8.57	6.10	21.00	25.70	0.50	1.75	2.47
7	7	9	23	6.70	6.70	8.61	8.22	8.22	10.57	6.10	22.00	27.00	0.50	1.76	2.60
7	7	12	26	5.92	5.92	10.15	7.27	7.27	12.46	6.10	22.00	27.00	0.50	1.76	2.87
7	9	9	25	6.16	7.92	7.92	7.56	9.72	9.72	6.10	22.00	27.00	0.50	1.76	2.87
9	9	9	27	7.33	7.33	7.33	9.00	9.00	9.00	6.10	22.00	27.00	0.50	1.77	2.87

#### NOTES:

Specifications are based on the following conditions.

- Power source of specifications: 230 V
- 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h, 15: 14,000 Btu/h, 18: 18,000 Btu/h
- 2 or more indoor units should be connected.
- Cooling: Indoor temperature of 80 °FDB (26.7 °CDB)/ 67 °FWB (19.4 °CWB), and outdoor temperature of 95 °FDB (35 °CDB) / 75 °FWB (23.9 °CWB).
- Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
- The total ability of connected indoor units is from 14,000 Btu up to 27,000 Btu.

# Model: UOMH24AFXZJ

## ● Heating

Combination of indoor unit				Rated capacity for each indoor unit (kBtu/h)			Maximum capacity for each indoor unit (kBtu/h)			Total capacity (kBtu/h)			Input power (kW)		
Room 1	Room 2	Room 3	Total	Room 1	Room 2	Room 3	Room 1	Room 2	Room 3	Min.	Rated	Max.	Min.	Rated	Max.
7	7	-	14	9.40	9.40	-	10.35	10.35	-	6.80	18.80	20.70	0.52	1.37	1.97
7	9	-	16	9.06	11.64	-	10.37	13.33	-	6.80	20.70	23.70	0.52	1.56	2.57
7	12	-	19	8.18	14.02	-	9.43	16.17	-	6.80	22.20	25.60	0.52	1.89	2.71
7	15	-	22	7.70	15.40	-	9.17	18.33	-	6.80	23.10	27.50	0.50	1.91	2.81
7	18	-	25	6.72	17.28	-	7.84	20.16	-	6.80	24.00	28.00	0.50	1.92	2.93
9	9	-	18	11.00	11.00	-	12.50	12.50	-	6.80	22.00	25.00	0.52	1.74	2.69
9	12	-	21	9.94	13.26	-	11.19	14.91	-	6.80	23.20	26.10	0.52	1.99	2.73
9	15	-	24	9.23	14.37	-	10.78	16.77	-	6.80	23.60	27.55	0.50	1.95	2.83
9	18	-	27	8.00	16.00	-	9.67	19.33	-	6.80	24.00	29.00	0.50	1.90	2.93
12	12	-	24	12.00	12.00	-	13.70	13.70	-	6.80	24.00	27.40	0.52	2.08	2.93
12	15	-	27	11.08	12.92	-	13.59	15.86	-	6.80	24.00	29.45	0.50	1.91	2.93
7	7	7	21	7.73	7.73	7.73	9.37	9.37	9.37	6.80	23.20	28.10	0.50	1.68	2.84
7	7	9	23	7.30	7.30	9.39	9.07	9.07	11.66	6.80	24.00	29.80	0.50	1.73	2.93
7	7	12	26	6.46	6.46	11.08	8.08	8.08	13.85	6.80	24.00	30.00	0.50	1.72	2.86
7	9	9	25	6.72	8.64	8.64	8.40	10.80	10.8	6.80	24.00	30.00	0.50	1.72	2.93
9	9	9	27	8.00	8.00	8.00	10.00	10.00	10.00	6.80	24.00	30.00	0.50	1.71	2.93

### NOTES:

Specifications are based on the following conditions.

- Power source of specifications: 230 V
- 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h, 14: 14,000 Btu/h, 18: 18,000Btu/h
- 2 indoor units should be connected.
- Heating: Indoor temperature of 70 °FDB (21.1 °CDB)/ 60 °FWB (15.6 °CWB), and outdoor temperature of 47 °FDB (8.3 °CDB) / 43 °FWB (6.1 °CWB).
- Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
- The total ability of connected indoor unit is from 14,000 Btu up to 21,000 Btu.

OUTDOOR UNIT  
UOMH24AFXZJ

## 6-2. Cooling capacity

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

### ■ Model: UOMH24AFXZJ

- TC: Total Capacity, SHC: Sensible Heat Capacity, IP: Input Power
- The data is based on the following conditions:  
Pipe length: 7.5 m, Height difference: 0 m [Outdoor unit—Indoor unit]

### ● Indoor units: 7,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	7.49	5.86	0.35	8.46	5.86	0.36	8.92	6.46	0.36	9.55	6.78	0.36	10.21	6.94	0.37	10.53	7.71	0.37
	23	7.18	5.72	0.40	8.11	5.71	0.40	8.55	6.30	0.41	9.15	6.61	0.41	9.79	6.77	0.42	10.09	7.52	0.42
	32	7.05	5.66	0.44	7.97	5.66	0.45	8.40	6.24	0.45	8.99	6.55	0.46	9.62	6.70	0.46	9.91	7.44	0.46
	41	6.99	5.63	0.45	7.90	5.63	0.46	8.33	6.21	0.46	8.92	6.51	0.47	9.53	6.66	0.47	9.82	7.41	0.48
	50	7.05	5.66	0.46	7.97	5.66	0.46	8.40	6.24	0.47	8.99	6.55	0.47	9.62	6.70	0.48	9.91	7.44	0.48
	59	6.86	5.57	0.47	7.76	5.57	0.48	8.18	6.14	0.49	8.76	6.44	0.49	9.36	6.59	0.50	9.65	7.33	0.50
	67	7.39	5.84	0.51	8.35	5.83	0.52	8.80	6.44	0.52	9.42	6.75	0.53	10.07	6.91	0.54	10.38	7.68	0.54
	77	7.09	5.68	0.52	8.01	5.67	0.53	8.44	6.26	0.54	9.04	6.56	0.54	9.66	6.72	0.55	9.96	7.46	0.55
87	6.65	5.45	0.58	7.52	5.44	0.59	7.92	6.00	0.59	8.48	6.30	0.60	9.07	6.45	0.61	9.35	7.16	0.61	
95	7.37	5.81	0.83	8.32	5.80	0.85	8.78	6.40	0.85	9.40	6.71	0.86	10.04	6.87	0.87	10.35	7.63	0.88	
104	7.15	5.71	0.92	8.08	5.70	0.94	8.52	6.29	0.95	9.12	6.60	0.96	9.75	6.75	0.97	10.05	7.50	0.97	
115	6.53	5.45	1.05	7.38	5.45	1.07	7.78	6.01	1.07	8.33	6.30	1.09	8.91	6.45	1.10	9.18	7.17	1.11	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
	-10.0	2.19	1.72	0.35	2.48	1.72	0.36	2.61	1.89	0.36	2.80	1.99	0.36	2.99	2.03	0.37	3.09	2.26	0.37
	-5.0	2.10	1.68	0.40	2.38	1.67	0.40	2.51	1.85	0.41	2.68	1.94	0.41	2.87	1.98	0.42	2.96	2.20	0.42
	0.0	2.07	1.66	0.44	2.34	1.66	0.45	2.46	1.83	0.45	2.64	1.92	0.46	2.82	1.96	0.46	2.91	2.18	0.46
	5.0	2.05	1.65	0.45	2.31	1.65	0.46	2.44	1.82	0.46	2.61	1.91	0.47	2.79	1.95	0.47	2.88	2.17	0.48
	10.0	2.07	1.66	0.46	2.34	1.66	0.46	2.46	1.83	0.47	2.64	1.92	0.47	2.82	1.96	0.48	2.91	2.18	0.48
	15.0	2.01	1.63	0.47	2.27	1.63	0.48	2.40	1.80	0.49	2.57	1.89	0.49	2.74	1.93	0.50	2.83	2.15	0.50
	19.4	2.17	1.71	0.51	2.45	1.71	0.52	2.58	1.89	0.52	2.76	1.98	0.53	2.95	2.03	0.54	3.04	2.25	0.54
	25.0	2.08	1.66	0.52	2.35	1.66	0.53	2.47	1.83	0.54	2.65	1.92	0.54	2.83	1.97	0.55	2.92	2.19	0.55
30.6	1.95	1.60	0.58	2.20	1.60	0.59	2.32	1.76	0.59	2.49	1.85	0.60	2.66	1.89	0.61	2.74	2.10	0.61	
35.0	2.16	1.70	0.83	2.44	1.70	0.85	2.57	1.88	0.85	2.75	1.97	0.86	2.94	2.01	0.87	3.03	2.24	0.88	
40.0	2.10	1.67	0.92	2.37	1.67	0.94	2.50	1.84	0.95	2.67	1.93	0.96	2.86	1.98	0.97	2.95	2.20	0.97	
46.1	1.91	1.60	1.05	2.16	1.60	1.07	2.28	1.76	1.07	2.44	1.85	1.09	2.61	1.89	1.10	2.69	2.10	1.11	

OUTDOOR UNIT  
UOMH24AFXZJ

# ● Indoor units: 9,000 Btu

		Indoor temperature																			
		64			70			75			80			85			90				
		54			60			63			67			71			73				
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW				
	14	7.54	6.16	0.31	8.52	6.15	0.31	8.99	6.78	0.31	9.62	7.12	0.32	10.29	7.28	0.32	10.60	8.09	0.32		
	23	7.23	6.01	0.35	8.17	6.00	0.35	8.61	6.62	0.35	9.22	6.94	0.36	9.86	7.11	0.36	10.16	7.90	0.36		
	32	7.10	5.95	0.38	8.03	5.94	0.39	8.46	6.55	0.39	9.06	6.87	0.40	9.69	7.03	0.40	9.98	7.82	0.40		
	41	7.04	5.92	0.39	7.96	5.91	0.40	8.39	6.52	0.40	8.98	6.84	0.41	9.60	7.00	0.41	9.90	7.78	0.41		
	50	7.10	5.95	0.40	8.03	5.94	0.40	8.46	6.55	0.41	9.06	6.87	0.41	9.69	7.03	0.42	9.98	7.82	0.42		
	59	7.24	6.01	0.45	8.18	6.00	0.46	8.62	6.62	0.47	9.23	6.95	0.47	9.87	7.11	0.48	10.17	7.90	0.48		
	67	8.39	6.58	0.57	9.49	6.57	0.58	10.00	7.25	0.59	10.71	7.60	0.59	11.45	7.78	0.60	11.80	8.65	0.60		
	77	8.05	6.39	0.59	9.10	6.39	0.60	9.59	7.04	0.60	10.27	7.39	0.61	10.98	7.56	0.61	11.32	8.41	0.62		
	87	7.56	6.14	0.65	8.54	6.13	0.66	9.00	6.76	0.67	9.64	7.09	0.67	10.30	7.26	0.68	10.62	8.07	0.69		
95	8.97	6.81	1.08	10.14	6.80	1.10	10.69	7.50	1.11	11.44	7.87	1.12	12.23	8.05	1.13	12.61	8.95	1.14			
104	8.51	6.60	1.20	9.61	6.59	1.22	10.14	7.27	1.23	10.85	7.63	1.25	11.60	7.81	1.26	11.96	8.68	1.27			
115	7.82	6.34	1.36	8.83	6.33	1.39	9.31	6.98	1.40	9.97	7.33	1.41	10.66	7.50	1.43	10.99	8.33	1.44			

		Indoor temperature																			
		17.8			21.1			23.9			26.7			29.4			32.2				
		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	°CWB	kW			kW			kW			kW			kW							
	-10.0	2.21	1.80	0.31	2.50	1.80	0.31	2.63	1.99	0.31	2.82	2.09	0.32	3.01	2.13	0.32	3.11	2.37	0.32		
	-5.0	2.12	1.76	0.35	2.39	1.76	0.35	2.52	1.94	0.35	2.70	2.04	0.36	2.89	2.08	0.36	2.98	2.31	0.36		
	0.0	2.08	1.74	0.38	2.35	1.74	0.39	2.48	1.92	0.39	2.66	2.01	0.40	2.84	2.06	0.40	2.93	2.29	0.40		
	5.0	2.06	1.73	0.39	2.33	1.73	0.40	2.46	1.91	0.40	2.63	2.00	0.41	2.81	2.05	0.41	2.90	2.28	0.41		
	10.0	2.08	1.74	0.40	2.35	1.74	0.40	2.48	1.92	0.41	2.66	2.01	0.41	2.84	2.06	0.42	2.93	2.29	0.42		
	15.0	2.12	1.76	0.45	2.40	1.76	0.46	2.53	1.94	0.47	2.71	2.04	0.47	2.89	2.08	0.48	2.98	2.32	0.48		
	19.4	2.46	1.93	0.57	2.78	1.93	0.58	2.93	2.12	0.59	3.14	2.23	0.59	3.35	2.28	0.60	3.46	2.53	0.60		
	25.0	2.36	1.87	0.59	2.67	1.87	0.60	2.81	2.06	0.60	3.01	2.17	0.61	3.22	2.22	0.61	3.32	2.46	0.62		
	30.6	2.21	1.80	0.65	2.50	1.80	0.66	2.64	1.98	0.67	2.82	2.08	0.67	3.02	2.13	0.68	3.11	2.36	0.69		
35.0	2.63	2.00	1.08	2.97	1.99	1.10	3.13	2.20	1.11	3.35	2.31	1.12	3.59	2.36	1.13	3.70	2.62	1.14			
40.0	2.49	1.93	1.20	2.82	1.93	1.22	2.97	2.13	1.23	3.18	2.24	1.25	3.40	2.29	1.26	3.50	2.54	1.27			
46.1	2.29	1.86	1.36	2.59	1.86	1.39	2.73	2.05	1.40	2.92	2.15	1.41	3.12	2.20	1.43	3.22	2.44	1.44			

# ● Indoor units: 12,000 Btu

		Indoor temperature																			
		64			70			75			80			85			90				
		54			60			63			67			71			73				
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW				
	14	9.71	7.59	0.41	10.98	7.58	0.42	11.57	8.37	0.42	12.39	8.78	0.43	13.25	8.98	0.43	13.66	9.98	0.43		
	23	9.31	7.41	0.46	10.52	7.40	0.47	11.09	8.16	0.48	11.87	8.56	0.48	12.69	8.76	0.49	13.09	9.74	0.49		
	32	9.15	7.33	0.51	10.34	7.32	0.52	10.90	8.08	0.53	11.67	8.48	0.53	12.47	8.67	0.54	12.86	9.64	0.54		
	41	9.07	7.29	0.53	10.25	7.29	0.54	10.80	8.04	0.54	11.57	8.43	0.55	12.36	8.63	0.55	12.74	9.59	0.56		
	50	9.15	7.33	0.53	10.34	7.32	0.54	10.90	8.08	0.55	11.67	8.48	0.55	12.47	8.67	0.56	12.86	9.64	0.56		
	59	8.91	7.22	0.55	10.06	7.21	0.56	10.61	7.95	0.57	11.36	8.35	0.57	12.14	8.54	0.58	12.52	9.49	0.58		
	67	11.07	8.23	0.81	12.51	8.22	0.82	13.19	9.06	0.83	14.12	9.51	0.84	15.10	9.73	0.85	15.56	10.81	0.85		
	77	10.62	8.00	0.83	12.00	7.99	0.84	12.65	8.81	0.85	13.55	9.24	0.86	14.48	9.46	0.87	14.93	10.51	0.87		
	87	9.97	7.67	0.92	11.26	7.66	0.93	11.87	8.45	0.94	12.71	8.87	0.95	13.59	9.08	0.96	14.01	10.09	0.97		
95	10.32	7.86	1.14	11.66	7.85	1.16	12.29	8.66	1.17	13.16	9.09	1.19	14.07	9.30	1.20	14.50	10.34	1.21			
104	9.79	7.62	1.27	11.06	7.62	1.29	11.66	8.40	1.30	12.48	8.82	1.32	13.34	9.02	1.33	13.75	10.02	1.34			
115	8.99	7.32	1.44	10.16	7.31	1.47	10.71	8.07	1.48	11.47	8.46	1.49	12.26	8.66	1.51	12.64	9.62	1.52			

		Indoor temperature																			
		17.8			21.1			23.9			26.7			29.4			32.2				
		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	°CWB	kW			kW			kW			kW			kW							
	-10.0	2.85	2.23	0.41	3.22	2.22	0.42	3.39	2.45	0.42	3.63	2.57	0.43	3.88	2.63	0.43	4.00	2.93	0.43		
	-5.0	2.73	2.17	0.46	3.08	2.17	0.47	3.25	2.39	0.48	3.48	2.51	0.48	3.72	2.57	0.49	3.84	2.85	0.49		
	0.0	2.68	2.15	0.51	3.03	2.15	0.52	3.19	2.37	0.53	3.42	2.48	0.53	3.66	2.54	0.54	3.77	2.83	0.54		
	5.0	2.66	2.14	0.53	3.00	2.14	0.54	3.17	2.36	0.54	3.39	2.47	0.55	3.62	2.53	0.55	3.74	2.81	0.56		
	10.0	2.68	2.15	0.53	3.03	2.15	0.54	3.19	2.37	0.55	3.42	2.48	0.55	3.66	2.54	0.56	3.77	2.83	0.56		
	15.0	2.61	2.12	0.55	2.95	2.11	0.56	3.11	2.33	0.57	3.33	2.45	0.57	3.56	2.50	0.58	3.67	2.78	0.58		
	19.4	3.25	2.41	0.81	3.67	2.41	0.82	3.87	2.66	0.83	4.14	2.79	0.84	4.42	2.85	0.85	4.56	3.17	0.85		
	25.0	3.11	2.34	0.83	3.52	2.34	0.84	3.71	2.58	0.85	3.97	2.71	0.86	4.24	2.77	0.87	4.38	3.08	0.87		
	30.6	2.92	2.25	0.92	3.30	2.25	0.93	3.48	2.48	0.94	3.73	2.60	0.95	3.98	2.66	0.96	4.11	2.96	0.97		
35.0	3.02	2.30	1.14	3.42	2.30	1.16	3.60	2.54	1.17	3.86	2.66	1.19	4.12	2.73	1.20	4.25	3.03	1.21			
40.0	2.87	2.23	1.27	3.24	2.23	1.29	3.42	2.46	1.30	3.66	2.58	1.32	3.91	2.64	1.33	4.03	2.94	1.34			
46.1	2.63	2.15	1.44	2.98	2.14	1.47	3.14	2.36	1.48	3.36	2.48	1.49	3.59	2.54	1.51	3.70	2.82	1.52			

OUTDOOR UNIT UOMH24AFXZJ

## ● Indoor units: 14,000 Btu

	Indoor temperature																	
	64			70			75			80			85			90		
	54			60			63			67			71			73		
Outdoor temperature	°FDB			TC			SHC			IP			kW			kBTu/h		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	13.58	10.38	0.60	15.34	10.37	0.61	16.18	11.44	0.62	17.32	12.00	0.62	18.51	12.28	0.63	19.08	13.65	0.63
14	13.01	10.13	0.68	14.70	10.12	0.69	15.50	11.16	0.70	16.60	11.71	0.71	17.74	11.98	0.72	18.29	13.32	0.72
23	12.79	10.03	0.75	14.45	10.01	0.77	15.23	11.05	0.77	16.31	11.59	0.78	17.43	11.86	0.79	17.97	13.18	0.79
32	12.67	9.98	0.77	14.32	9.96	0.79	15.10	10.99	0.79	16.16	11.53	0.80	17.28	11.80	0.81	17.81	13.11	0.81
41	12.79	10.03	0.78	14.45	10.01	0.80	15.23	11.05	0.80	16.31	11.59	0.81	17.43	11.86	0.82	17.97	13.18	0.83
50	12.79	10.03	0.86	14.45	10.02	0.88	15.23	11.05	0.88	16.31	11.59	0.89	17.43	11.86	0.90	17.97	13.18	0.91
59	13.49	10.39	0.89	15.25	10.38	0.90	16.07	11.45	0.91	17.21	12.01	0.92	18.40	12.29	0.93	18.97	13.66	0.94
67	12.94	10.10	0.91	14.63	10.09	0.92	15.42	11.13	0.93	16.51	11.67	0.94	17.65	11.94	0.95	18.19	13.28	0.96
77	12.15	9.69	1.01	13.73	9.68	1.03	14.47	10.68	1.03	15.49	11.20	1.05	16.56	11.46	1.06	17.07	12.74	1.06
87	13.25	10.24	1.40	14.98	10.23	1.43	15.79	11.28	1.44	16.91	11.84	1.46	18.07	12.11	1.47	18.63	13.46	1.48
95	12.57	9.93	1.56	14.20	9.92	1.58	14.97	10.94	1.60	16.03	11.48	1.62	17.14	11.74	1.63	17.67	13.05	1.64
104	11.38	9.52	1.69	12.86	9.51	1.72	13.56	10.49	1.74	14.52	11.00	1.76	15.52	11.26	1.78	16.00	12.51	1.79
115																		

	Indoor temperature																	
	17.8			21.1			23.9			26.7			29.4			32.2		
	12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB			TC			SHC			IP			kW			kBTu/h		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	3.98	3.04	0.60	4.50	3.04	0.61	4.74	3.35	0.62	5.08	3.52	0.62	5.43	3.60	0.63	5.59	4.00	0.63
-10.0	3.81	2.97	0.68	4.31	2.97	0.69	4.54	3.27	0.70	4.86	3.43	0.71	5.20	3.51	0.72	5.36	3.90	0.72
-5.0	3.75	2.94	0.75	4.23	2.94	0.77	4.46	3.24	0.77	4.78	3.40	0.78	5.11	3.48	0.79	5.27	3.86	0.79
0.0	3.71	2.92	0.77	4.20	2.92	0.79	4.42	3.22	0.79	4.74	3.38	0.80	5.06	3.46	0.81	5.22	3.84	0.81
5.0	3.75	2.94	0.78	4.23	2.94	0.80	4.46	3.24	0.80	4.78	3.40	0.81	5.11	3.48	0.82	5.27	3.86	0.83
10.0	3.75	2.94	0.86	4.23	2.94	0.88	4.46	3.24	0.88	4.78	3.40	0.89	5.11	3.48	0.90	5.27	3.86	0.91
15.0	3.95	3.04	0.89	4.47	3.04	0.90	4.71	3.35	0.91	5.04	3.52	0.92	5.39	3.60	0.93	5.56	4.00	0.94
19.4	3.79	2.96	0.91	4.29	2.96	0.92	4.52	3.26	0.93	4.84	3.42	0.94	5.17	3.50	0.95	5.33	3.89	0.96
25.0	3.56	2.84	1.01	4.02	2.84	1.03	4.24	3.13	1.03	4.54	3.28	1.05	4.85	3.36	1.06	5.00	3.73	1.06
30.6	3.88	3.00	1.40	4.39	3.00	1.43	4.63	3.31	1.44	4.95	3.47	1.46	5.30	3.55	1.47	5.46	3.94	1.48
35.0	3.68	2.91	1.56	4.16	2.91	1.58	4.39	3.21	1.60	4.70	3.36	1.62	5.02	3.44	1.63	5.18	3.83	1.64
40.0	3.34	2.79	1.69	3.77	2.79	1.72	3.97	3.07	1.74	4.26	3.22	1.76	4.55	3.30	1.78	4.69	3.67	1.79
46.1																		

## ● Indoor units: 18,000 Btu

	Indoor temperature																	
	64			70			75			80			85			90		
	54			60			63			67			71			73		
Outdoor temperature	°FDB			TC			SHC			IP			kW			kBTu/h		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	14.33	10.78	0.70	16.19	10.77	0.71	17.07	11.88	0.72	18.28	12.46	0.73	19.54	12.75	0.73	20.14	14.17	0.74
14	13.73	10.52	0.79	15.52	10.50	0.81	16.36	11.59	0.81	17.52	12.16	0.82	18.72	12.44	0.83	19.30	13.83	0.84
23	13.49	10.41	0.88	15.25	10.40	0.89	16.08	11.47	0.90	17.21	12.04	0.91	18.40	12.31	0.92	18.97	13.69	0.92
32	13.37	10.36	0.90	15.11	10.34	0.91	15.93	11.41	0.92	17.06	11.97	0.93	18.24	12.25	0.94	18.8	13.62	0.95
41	13.49	10.41	0.91	15.25	10.40	0.93	16.08	11.47	0.93	17.21	12.04	0.94	18.40	12.31	0.96	18.97	13.69	0.96
50	13.96	10.62	1.07	15.77	10.60	1.09	16.63	11.70	1.10	17.80	12.27	1.12	19.03	12.56	1.13	19.62	13.96	1.13
59	15.33	11.26	1.21	17.33	11.24	1.23	18.27	12.40	1.24	19.56	13.01	1.25	20.91	13.32	1.27	21.55	14.80	1.28
67	14.71	10.94	1.24	16.62	10.93	1.26	17.52	12.06	1.27	18.76	12.65	1.28	20.05	12.94	1.30	20.67	14.39	1.30
77	13.80	10.50	1.37	15.60	10.49	1.40	16.44	11.57	1.41	17.60	12.14	1.42	18.82	12.42	1.44	19.40	13.81	1.45
87	15.21	11.16	1.95	17.18	11.14	1.98	18.12	12.29	2.00	19.40	12.90	2.02	20.73	13.20	2.04	21.37	14.67	2.06
95	14.42	10.82	2.16	16.30	10.81	2.20	17.18	11.92	2.22	18.39	12.51	2.24	19.66	12.80	2.27	20.27	14.22	2.28
104	11.48	9.75	1.87	12.97	9.74	1.90	13.67	10.74	1.92	14.64	11.27	1.94	15.65	11.53	1.96	16.13	12.81	1.97
115																		

	Indoor temperature																	
	17.8			21.1			23.9			26.7			29.4			32.2		
	12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB			TC			SHC			IP			kW			kBTu/h		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	4.20	3.16	0.70	4.75	3.16	0.71	5.00	3.48	0.72	5.36	3.65	0.73	5.73	3.74	0.73	5.9	4.15	0.74
-10.0	4.02	3.08	0.79	4.55	3.08	0.81	4.79	3.40	0.81	5.13	3.56	0.82	5.49	3.65	0.83	5.66	4.05	0.84
-5.0	3.95	3.05	0.88	4.47	3.05	0.89	4.71	3.36	0.90	5.04	3.53	0.91	5.39	3.61	0.92	5.56	4.01	0.92
0.0	3.92	3.04	0.90	4.43	3.03	0.91	4.67	3.34	0.92	5.00	3.51	0.93	5.34	3.59	0.94	5.51	3.99	0.95
5.0	3.95	3.05	0.91	4.47	3.05	0.93	4.71	3.36	0.93	5.04	3.53	0.94	5.39	3.61	0.96	5.56	4.01	0.96
10.0	4.09	3.11	1.07	4.62	3.11	1.09	4.87	3.43	1.10	5.22	3.60	1.12	5.58	3.68	1.13	5.75	4.09	1.13
15.0	4.49	3.30	1.21	5.08	3.30	1.23	5.35	3.64	1.24	5.73	3.81	1.25	6.13	3.90	1.27	6.32	4.34	1.28
19.4	4.31	3.21	1.24	4.87	3.20	1.26	5.13	3.53	1.27	5.50	3.71	1.28	5.88	3.79	1.3	6.06	4.22	1.30
25.0	4.04	3.08	1.37	4.57	3.07	1.40	4.82	3.39	1.41	5.16	3.56	1.42	5.51	3.64	1.44	5.69	4.05	1.45
30.6	4.46	3.27	1.95	5.04	3.27	1.98	5.31	3.60	2.00	5.68	3.78	2.02	6.08	3.87	2.04	6.26	4.30	2.06
35.0	4.23	3.17	2.16	4.78	3.17	2.20	5.03	3.49	2.22	5.39	3.67	2.24	5.76	3.75	2.27	5.94	4.17	2.28
40.0	3.36	2.86	1.87	3.80	2.85	1.90	4.01	3.15	1.92	4.29	3.30	1.94	4.59	3.38	1.96	4.73	3.76	1.97
46.1																		

## ● Indoor units: 7,000 Btu + 7,000 Btu

Outdoor temperature	Indoor temperature																	
	64			70			75			80			85			90		
	°FDB			°FWB			°FDB			°FWB			°FDB			°FWB		
54			60			63			67			71			73			
°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
14	12.74	10.15	0.51	14.40	10.14	0.52	15.18	11.18	0.53	16.25	11.73	0.53	17.38	12.00	0.54	17.91	13.34	0.54
23	12.21	9.90	0.58	13.80	9.89	0.59	14.55	10.91	0.60	15.58	11.45	0.60	16.65	11.71	0.61	17.17	13.02	0.61
32	12.00	9.80	0.64	13.56	9.79	0.65	14.30	10.80	0.66	15.31	11.33	0.67	16.36	11.59	0.67	16.87	12.88	0.68
41	11.89	9.75	0.66	13.44	9.74	0.67	14.17	10.74	0.68	15.17	11.27	0.68	16.22	11.53	0.69	16.72	12.82	0.70
50	12.00	9.80	0.67	13.56	9.79	0.68	14.30	10.80	0.68	15.31	11.33	0.69	16.36	11.59	0.70	16.87	12.88	0.70
59	11.68	9.65	0.69	13.20	9.64	0.71	13.92	10.63	0.71	14.90	11.16	0.72	15.93	11.41	0.73	16.42	12.68	0.73
67	14.52	10.99	1.01	16.41	10.98	1.03	17.30	12.11	1.04	18.53	12.71	1.05	19.80	13.00	1.06	20.42	14.45	1.07
77	13.93	10.69	1.04	15.74	10.67	1.06	16.60	11.77	1.06	17.77	12.35	1.08	19.00	12.64	1.09	19.58	14.05	1.09
87	13.07	10.26	1.15	14.77	10.24	1.17	15.57	11.30	1.18	16.68	11.86	1.19	17.83	12.13	1.21	18.38	13.48	1.21
95	13.64	10.56	1.46	15.42	10.54	1.48	16.25	11.63	1.49	17.40	12.21	1.51	18.60	12.49	1.53	19.17	13.88	1.54
104	12.94	10.24	1.62	14.62	10.22	1.64	15.41	11.28	1.66	16.50	11.84	1.68	17.64	12.11	1.70	18.18	13.46	1.70
115	12.00	9.93	1.83	13.57	9.92	1.87	14.30	10.94	1.88	15.31	11.48	1.90	16.37	11.74	1.92	16.87	13.05	1.93

Outdoor temperature	Indoor temperature																	
	17.8			21.1			23.9			26.7			29.4			32.2		
	°CDB			°CWB			°CDB			°CWB			°CDB			°CWB		
12.2			15.6			17.2			19.4			21.7			22.8			
°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	kW			kW			kW			kW			kW			kW		
-10.0	3.73	2.97	0.51	4.22	2.97	0.52	4.45	3.28	0.53	4.76	3.44	0.53	5.09	3.52	0.54	5.25	3.91	0.54
-5.0	3.58	2.90	0.58	4.04	2.90	0.59	4.26	3.20	0.60	4.57	3.35	0.60	4.88	3.43	0.61	5.03	3.81	0.61
0.0	3.52	2.87	0.64	3.97	2.87	0.65	4.19	3.16	0.66	4.49	3.32	0.67	4.80	3.40	0.67	4.94	3.78	0.68
5.0	3.49	2.86	0.66	3.94	2.85	0.67	4.15	3.15	0.68	4.45	3.30	0.68	4.75	3.38	0.69	4.90	3.76	0.70
10.0	3.52	2.87	0.67	3.97	2.87	0.68	4.19	3.16	0.68	4.49	3.32	0.69	4.80	3.40	0.70	4.94	3.78	0.70
15.0	3.42	2.83	0.69	3.87	2.82	0.71	4.08	3.12	0.71	4.37	3.27	0.72	4.67	3.35	0.73	4.81	3.72	0.73
19.4	4.26	3.22	1.01	4.81	3.22	1.03	5.07	3.55	1.04	5.43	3.73	1.05	5.80	3.81	1.06	5.98	4.24	1.07
25.0	4.08	3.13	1.04	4.61	3.13	1.06	4.86	3.45	1.06	5.21	3.62	1.08	5.57	3.70	1.09	5.74	4.12	1.09
30.6	3.83	3.01	1.15	4.33	3.00	1.17	4.56	3.31	1.18	4.89	3.48	1.19	5.22	3.56	1.21	5.39	3.95	1.21
35.0	4.00	3.09	1.46	4.52	3.09	1.48	4.76	3.41	1.49	5.10	3.58	1.51	5.45	3.66	1.53	5.62	4.07	1.54
40.0	3.79	3.00	1.62	4.28	3.00	1.64	4.52	3.31	1.66	4.84	3.47	1.68	5.17	3.55	1.70	5.33	3.94	1.70
46.1	3.52	2.91	1.83	3.98	2.91	1.87	4.19	3.21	1.88	4.49	3.36	1.90	4.80	3.44	1.92	4.95	3.83	1.93

## ● Indoor units: 7,000 Btu + 9,000 Btu

Outdoor temperature	Indoor temperature																	
	64			70			75			80			85			90		
	°FDB			°FWB			°FDB			°FWB			°FDB			°FWB		
54			60			63			67			71			73			
°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
14	14.66	11.33	0.64	16.57	11.32	0.65	17.47	12.48	0.65	18.70	13.10	0.66	19.99	13.40	0.67	20.61	14.89	0.67
23	14.05	11.05	0.72	15.88	11.04	0.73	16.74	12.18	0.74	17.92	12.78	0.75	19.16	13.08	0.76	19.75	14.53	0.76
32	13.81	10.94	0.80	15.60	10.93	0.81	16.45	12.06	0.82	17.61	12.65	0.83	18.82	12.94	0.84	19.40	14.38	0.84
41	13.68	10.89	0.82	15.46	10.87	0.83	16.30	11.99	0.84	17.45	12.59	0.85	18.66	12.88	0.86	19.23	14.31	0.86
50	13.81	10.94	0.83	15.60	10.93	0.84	16.45	12.06	0.85	17.61	12.65	0.86	18.82	12.94	0.87	19.40	14.38	0.87
59	13.44	10.77	0.86	15.19	10.76	0.87	16.01	11.87	0.88	17.14	12.45	0.89	18.32	12.74	0.90	18.89	14.16	0.91
67	15.48	11.74	1.07	17.49	11.73	1.09	18.44	12.94	1.10	19.74	13.58	1.11	21.11	13.89	1.12	21.76	15.44	1.13
77	14.85	11.41	1.09	16.78	11.40	1.11	17.69	12.57	1.12	18.94	13.20	1.13	20.24	13.50	1.15	20.87	15.00	1.15
87	13.93	10.95	1.21	15.75	10.94	1.24	16.60	12.07	1.25	17.77	12.66	1.26	19.00	12.96	1.27	19.58	14.40	1.28
95	15.52	11.71	1.76	17.54	11.70	1.80	18.49	12.90	1.81	19.80	13.54	1.83	21.17	13.85	1.85	21.82	15.40	1.86
104	14.75	11.37	1.96	16.67	11.36	1.99	17.58	12.53	2.01	18.82	13.15	2.03	20.12	13.45	2.05	20.74	14.95	2.07
115	12.19	10.43	1.86	13.77	10.41	1.90	14.52	11.49	1.91	15.54	12.06	1.93	16.61	12.33	1.96	17.13	13.71	1.97

Outdoor temperature	Indoor temperature																	
	17.8			21.1			23.9			26.7			29.4			32.2		
	°CDB			°CWB			°CDB			°CWB			°CDB			°CWB		
12.2			15.6			17.2			19.4			21.7			22.8			
°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	kW			kW			kW			kW			kW			kW		
-10.0	4.30	3.32	0.64	4.86	3.32	0.65	5.12	3.66	0.65	5.48	3.84	0.66	5.86	3.93	0.67	6.04	4.37	0.67
-5.0	4.12	3.24	0.72	4.65	3.24	0.73	4.91	3.57	0.74	5.25	3.75	0.75	5.61	3.83	0.76	5.79	4.26	0.76
0.0	4.05	3.21	0.80	4.57	3.20	0.81	4.82	3.53	0.82	5.16	3.71	0.83	5.52	3.79	0.84	5.69	4.22	0.84
5.0	4.01	3.19	0.82	4.53	3.19	0.83	4.78	3.52	0.84	5.12	3.69	0.85	5.47	3.77	0.86	5.64	4.19	0.86
10.0	4.05	3.21	0.83	4.57	3.20	0.84	4.82	3.53	0.85	5.16	3.71	0.86	5.52	3.79	0.87	5.69	4.22	0.87
15.0	3.94	3.16	0.86	4.45	3.15	0.87	4.69	3.48	0.88	5.02	3.65	0.89	5.37	3.73	0.90	5.54	4.15	0.91
19.4	4.54	3.44	1.07	5.13	3.44	1.09	5.40	3.79	1.10	5.79	3.98	1.11	6.19	4.07	1.12	6.38	4.52	1.13
25.0	4.35	3.35	1.09	4.92	3.34	1.11	5.18	3.69	1.12	5.55	3.87	1.13	5.93	3.96	1.15	6.12	4.40	1.15
30.6	4.08	3.21	1.21	4.61	3.21	1.24	4.86	3.54	1.25	5.21	3.71	1.26	5.57	3.80	1.27	5.74	4.22	1.28
35.0	4.55	3.43	1.76	5.14	3.43	1.80	5.42	3.78	1.81	5.80	3.97	1.83	6.20	4.06	1.85	6.39	4.51	1.86
40.0	4.32	3.33	1.96	4.89	3.33	1.99	5.15	3.67	2.01	5.52	3.85	2.03	5.90	3.94	2.05	6.08	4.38	2.07
46.1	3.57	3.06	1.86	4.04	3.05	1.90	4.25	3.37	1.91	4.56	3.53	1.93	4.87	3.61	1.96	5.02	4.02	1.97



**● Indoor units: 7,000 Btu + 12,000 Btu**

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
	14	16.27	12.65	0.73	18.39	12.64	0.74	19.38	13.94	0.75	20.75	14.63	0.76	22.18	14.96	0.77	22.87	16.63	0.77
	23	15.59	12.34	0.83	17.62	12.33	0.84	18.58	13.60	0.85	19.89	14.27	0.86	21.26	14.60	0.87	21.92	16.23	0.87
	32	15.32	12.22	0.91	17.31	12.20	0.93	18.25	13.46	0.94	19.54	14.12	0.95	20.89	14.45	0.96	21.54	16.06	0.96
	41	15.19	12.15	0.94	17.16	12.14	0.95	18.09	13.39	0.96	19.37	14.05	0.97	20.71	14.38	0.98	21.34	15.98	0.99
	50	15.32	12.22	0.95	17.31	12.20	0.97	18.25	13.46	0.98	19.54	14.12	0.99	20.89	14.45	1.00	21.54	16.06	1.00
	59	15.31	12.21	1.04	17.30	12.20	1.06	18.23	13.45	1.07	19.52	14.12	1.08	20.87	14.44	1.09	21.51	16.05	1.10
	67	18.97	13.89	1.51	21.44	13.87	1.54	22.60	15.30	1.55	24.20	16.05	1.57	25.87	16.43	1.59	26.66	18.26	1.60
77	18.20	13.50	1.55	20.56	13.48	1.58	21.68	14.87	1.59	23.21	15.61	1.61	24.81	15.97	1.63	25.58	17.75	1.63	
87	17.08	12.96	1.72	19.30	12.94	1.75	20.34	14.27	1.76	21.78	14.98	1.78	23.28	15.32	1.80	24.00	17.03	1.81	
95	17.72	13.29	2.15	20.02	13.28	2.19	21.11	14.64	2.21	22.60	15.37	2.23	24.16	15.72	2.26	24.91	17.47	2.27	
104	16.80	12.89	2.39	18.99	12.87	2.43	20.02	14.20	2.45	21.43	14.90	2.48	22.91	15.25	2.50	23.62	16.94	2.52	
115	13.10	11.50	2.05	14.80	11.48	2.09	15.61	12.67	2.10	16.71	13.29	2.13	17.86	13.60	2.15	18.41	15.12	2.16	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	4.77	3.71	0.73	5.39	3.70	0.74	5.68	4.08	0.75	6.08	4.29	0.76	6.50	4.39	0.77	6.70	4.87	0.77
	-5.0	4.57	3.62	0.83	5.16	3.61	0.84	5.44	3.99	0.85	5.83	4.18	0.86	6.23	4.28	0.87	6.42	4.76	0.87
	0.0	4.49	3.58	0.91	5.07	3.58	0.93	5.35	3.95	0.94	5.73	4.14	0.95	6.12	4.24	0.96	6.31	4.71	0.96
	5.0	4.45	3.56	0.94	5.03	3.56	0.95	5.30	3.92	0.96	5.68	4.12	0.97	6.07	4.21	0.98	6.26	4.68	0.99
	10.0	4.49	3.58	0.95	5.07	3.58	0.97	5.35	3.95	0.98	5.73	4.14	0.99	6.12	4.24	1.00	6.31	4.71	1.00
	15.0	4.49	3.58	1.04	5.07	3.57	1.06	5.34	3.94	1.07	5.72	4.14	1.08	6.12	4.23	1.09	6.31	4.70	1.10
	19.4	5.56	4.07	1.51	6.28	4.07	1.54	6.62	4.48	1.55	7.09	4.71	1.57	7.58	4.81	1.59	7.81	5.35	1.60
	25.0	5.33	3.96	1.55	6.03	3.95	1.58	6.35	4.36	1.59	6.80	4.57	1.61	7.27	4.68	1.63	7.50	5.20	1.63
30.6	5.00	3.80	1.72	5.66	3.79	1.75	5.96	4.18	1.76	6.38	4.39	1.78	6.82	4.49	1.80	7.03	4.99	1.81	
35.0	5.19	3.90	2.15	5.87	3.89	2.19	6.19	4.29	2.21	6.62	4.50	2.23	7.08	4.61	2.26	7.30	5.12	2.27	
40.0	4.92	3.78	2.39	5.57	3.77	2.43	5.87	4.16	2.45	6.28	4.37	2.48	6.71	4.47	2.50	6.92	4.97	2.52	
46.1	3.84	3.37	2.05	4.34	3.37	2.09	4.57	3.71	2.10	4.90	3.90	2.13	5.23	3.99	2.15	5.40	4.43	2.16	

**● Indoor units: 7,000 Btu + 14,000 Btu**

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
	14	17.06	13.38	0.80	19.28	13.36	0.81	20.32	14.74	0.82	21.76	15.47	0.83	23.26	15.82	0.84	23.98	17.59	0.84
	23	16.35	13.05	0.91	18.47	13.03	0.92	19.48	14.38	0.93	20.85	15.09	0.94	22.29	15.44	0.95	22.98	17.16	0.96
	32	16.06	12.92	1.00	18.15	12.90	1.02	19.14	14.23	1.03	20.49	14.94	1.04	21.90	15.28	1.05	22.58	16.98	1.05
	41	15.92	12.85	1.03	17.99	12.84	1.04	18.97	14.16	1.05	20.31	14.86	1.06	21.71	15.20	1.08	22.38	16.90	1.08
	50	16.06	12.92	1.04	18.15	12.90	1.06	19.14	14.23	1.07	20.49	14.94	1.08	21.90	15.28	1.09	22.58	16.98	1.10
	59	16.70	13.22	1.24	18.88	13.20	1.26	19.90	14.56	1.27	21.31	15.28	1.29	22.78	15.63	1.30	23.48	17.37	1.31
	67	19.27	14.42	1.55	21.78	14.40	1.58	22.96	15.89	1.59	24.58	16.67	1.61	26.28	17.06	1.63	27.09	18.95	1.64
77	18.49	14.02	1.59	20.89	14.00	1.61	22.02	15.44	1.63	23.58	16.20	1.64	25.21	16.58	1.66	25.98	18.42	1.67	
87	17.35	13.45	1.76	19.61	13.44	1.79	20.67	14.82	1.81	22.13	15.55	1.83	23.65	15.91	1.85	24.38	17.68	1.86	
95	18.93	14.21	2.45	21.40	14.19	2.49	22.56	15.66	2.51	24.15	16.43	2.54	25.82	16.81	2.57	26.61	18.68	2.58	
104	16.87	13.29	2.39	19.07	13.28	2.43	20.10	14.65	2.45	21.52	15.37	2.48	23.01	15.72	2.51	23.72	17.48	2.52	
115	12.44	11.62	1.87	14.06	11.60	1.90	14.83	12.80	1.92	15.87	13.43	1.94	16.97	13.74	1.96	17.49	15.27	1.97	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	5.00	3.92	0.80	5.65	3.92	0.81	5.96	4.32	0.82	6.38	4.53	0.83	6.82	4.64	0.84	7.03	5.15	0.84
	-5.0	4.79	3.82	0.91	5.41	3.82	0.92	5.71	4.21	0.93	6.11	4.42	0.94	6.53	4.52	0.95	6.73	5.03	0.96
	0.0	4.71	3.79	1.00	5.32	3.78	1.02	5.61	4.17	1.03	6.00	4.38	1.04	6.42	4.48	1.05	6.62	4.98	1.05
	5.0	4.67	3.77	1.03	5.27	3.76	1.04	5.56	4.15	1.05	5.95	4.35	1.06	6.36	4.46	1.08	6.56	4.95	1.08
	10.0	4.71	3.79	1.04	5.32	3.78	1.06	5.61	4.17	1.07	6.00	4.38	1.08	6.42	4.48	1.09	6.62	4.98	1.10
	15.0	4.90	3.87	1.24	5.53	3.87	1.26	5.83	4.27	1.27	6.24	4.48	1.29	6.68	4.58	1.30	6.88	5.09	1.31
	19.4	5.65	4.23	1.55	6.38	4.22	1.58	6.73	4.66	1.59	7.20	4.89	1.61	7.70	5.00	1.63	7.94	5.56	1.64
	25.0	5.42	4.11	1.59	6.12	4.10	1.61	6.45	4.53	1.63	6.91	4.75	1.64	7.39	4.86	1.66	7.62	5.40	1.67
30.6	5.08	3.94	1.76	5.75	3.94	1.79	6.06	4.34	1.81	6.49	4.56	1.83	6.93	4.66	1.85	7.15	5.18	1.86	
35.0	5.55	4.17	2.45	6.27	4.16	2.49	6.61	4.59	2.51	7.08	4.82	2.54	7.57	4.93	2.57	7.80	5.48	2.58	
40.0	4.95	3.90	2.39	5.59	3.89	2.43	5.89	4.29	2.45	6.31	4.50	2.48	6.74	4.61	2.51	6.95	5.12	2.52	
46.1	3.65	3.41	1.87	4.12	3.40	1.90	4.34	3.75	1.92	4.65	3.94	1.94	4.97	4.03	1.96	5.13	4.48	1.97	

OUTDOOR UNIT  
UOMH24FXZJ

# ● Indoor units: 7,000 Btu + 18,000 Btu

		Indoor temperature																			
°FDB		64			70			75			80			85			90				
°FWB		54			60			63			67			71			73				
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW		
		14	23	32	41	50	59	67	77	87	95	104	115								
		19.44	14.44	1.05	21.97	14.42	1.06	23.16	15.91	1.07	24.80	16.70	1.08	26.51	17.08	1.10	27.33	18.98	1.10		
		18.63	14.09	1.18	21.06	14.07	1.21	22.20	15.52	1.22	23.77	16.29	1.23	25.41	16.67	1.24	26.19	18.52	1.25		
		18.31	13.95	1.31	20.69	13.93	1.33	21.81	15.37	1.34	23.35	16.12	1.36	24.96	16.50	1.37	25.74	18.33	1.38		
		18.15	13.87	1.34	20.51	13.86	1.37	21.62	15.29	1.38	23.15	16.04	1.39	24.74	16.41	1.41	25.51	18.24	1.42		
		18.31	13.95	1.36	20.69	13.93	1.38	21.81	15.37	1.39	23.35	16.12	1.41	24.96	16.50	1.43	25.74	18.33	1.43		
		18.83	14.18	1.59	21.28	14.16	1.61	22.43	15.62	1.63	24.02	16.39	1.65	25.68	16.77	1.66	26.47	18.64	1.67		
		21.52	15.38	1.94	24.32	15.36	1.97	25.64	16.95	1.99	27.45	17.78	2.01	29.34	18.19	2.04	30.25	20.22	2.05		
		20.64	14.95	1.98	23.33	14.93	2.02	24.59	16.47	2.04	26.33	17.28	2.06	28.14	17.68	2.08	29.01	19.65	2.09		
		19.37	14.35	2.20	21.89	14.33	2.24	23.08	15.81	2.26	24.71	16.59	2.28	26.41	16.97	2.31	27.23	18.86	2.32		
		20.15	14.74	2.77	22.77	14.72	2.82	24.00	16.24	2.84	25.70	17.04	2.87	27.47	17.44	2.90	28.32	19.38	2.92		
		16.90	13.31	2.31	19.10	13.30	2.35	20.13	14.67	2.37	21.55	15.39	2.40	23.04	15.75	2.43	23.75	17.50	2.44		
		12.43	11.69	1.81	14.04	11.68	1.84	14.81	12.88	1.86	15.85	13.52	1.88	16.95	13.83	1.90	17.47	15.37	1.91		

OUTDOOR UNIT UOMH24FXZJ

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
		-10.0	5.70	4.23	1.05	6.44	4.23	1.06	6.79	4.66	1.07	7.27	4.89	1.08	7.77	5.01	1.10	8.01	5.56	1.10
		5.46	4.13	1.18	6.17	4.12	1.21	6.51	4.55	1.22	6.97	4.77	1.23	7.45	4.88	1.24	7.68	5.43	1.25	
		5.37	4.09	1.31	6.06	4.08	1.33	6.39	4.50	1.34	6.84	4.73	1.36	7.32	4.83	1.37	7.54	5.37	1.38	
		5.32	4.07	1.34	6.01	4.06	1.37	6.34	4.48	1.38	6.78	4.70	1.39	7.25	4.81	1.41	7.48	5.35	1.42	
		5.37	4.09	1.36	6.06	4.08	1.38	6.39	4.50	1.39	6.84	4.73	1.41	7.32	4.83	1.43	7.54	5.37	1.43	
		5.52	4.15	1.59	6.24	4.15	1.61	6.58	4.58	1.63	7.04	4.80	1.65	7.53	4.91	1.66	7.76	5.46	1.67	
		6.31	4.51	1.94	7.13	4.50	1.97	7.51	4.97	1.99	8.04	5.21	2.01	8.60	5.33	2.04	8.87	5.93	2.05	
		6.05	4.38	1.98	6.84	4.38	2.02	7.21	4.83	2.04	7.72	5.07	2.06	8.25	5.18	2.08	8.50	5.76	2.09	
		5.68	4.21	2.20	6.42	4.20	2.24	6.76	4.63	2.26	7.24	4.86	2.28	7.74	4.97	2.31	7.98	5.53	2.32	
		5.91	4.32	2.77	6.67	4.32	2.82	7.04	4.76	2.84	7.53	5.00	2.87	8.05	5.11	2.90	8.30	5.68	2.92	
		4.95	3.90	2.31	5.60	3.90	2.35	5.90	4.30	2.37	6.32	4.51	2.40	6.75	4.62	2.43	6.96	5.13	2.44	
		3.64	3.43	1.81	4.12	3.42	1.84	4.34	3.77	1.86	4.65	3.96	1.88	4.97	4.05	1.90	5.12	4.50	1.91	

# ● Indoor units: 9,000 Btu + 9,000 Btu

		Indoor temperature																			
°FDB		64			70			75			80			85			90				
°FWB		54			60			63			67			71			73				
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW		
		14	15.07	11.87	0.66	17.03	11.86	0.67	17.95	13.08	0.67	19.22	13.73	0.68	20.54	14.04	0.69	21.18	15.61	0.69	
		23	14.44	11.58	0.74	16.32	11.57	0.76	17.20	12.76	0.76	18.42	13.39	0.77	19.69	13.70	0.78	20.30	15.23	0.78	
		32	14.19	11.47	0.82	16.03	11.45	0.84	16.90	12.63	0.84	18.10	13.26	0.85	19.35	13.56	0.86	19.94	15.07	0.87	
		41	14.06	11.41	0.84	15.89	11.39	0.86	16.75	12.57	0.86	17.94	13.19	0.87	19.17	13.49	0.88	19.77	14.99	0.89	
		50	14.19	11.47	0.85	16.03	11.45	0.87	16.90	12.63	0.88	18.10	13.26	0.89	19.35	13.56	0.90	19.94	15.07	0.90	
		59	14.56	11.64	0.99	16.45	11.62	1.01	17.35	12.82	1.02	18.57	13.46	1.03	19.85	13.77	1.04	20.47	15.30	1.05	
		67	16.99	12.78	1.27	19.21	12.77	1.29	20.25	14.08	1.30	21.68	14.78	1.32	23.17	15.12	1.33	23.89	16.81	1.34	
		77	16.30	12.43	1.30	18.42	12.41	1.32	19.42	13.69	1.33	20.79	14.37	1.35	22.23	14.70	1.36	22.91	16.34	1.37	
		87	15.30	11.93	1.44	17.29	11.91	1.46	18.22	13.14	1.48	19.51	13.79	1.49	20.86	14.11	1.51	21.50	15.68	1.52	
		95	16.86	12.67	2.04	19.05	12.66	2.08	20.08	13.96	2.10	21.50	14.65	2.12	22.98	14.99	2.14	23.69	16.66	2.16	
		104	15.98	12.29	2.27	18.06	12.27	2.31	19.04	13.54	2.33	20.39	14.20	2.35	21.80	14.53	2.38	22.47	16.15	2.39	
		115	12.45	10.96	1.90	14.07	10.94	1.94	14.83	12.07	1.95	15.88	12.67	1.97	16.98	12.96	2.00	17.50	14.40	2.01	

		Indoor temperature																			
°CDB		17.8			21.1			23.9			26.7			29.4			32.2				
°CWB		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
		kW			kW			kW			kW			kW			kW				
		-10.0	4.42	3.48	0.66	4.99	3.48	0.67	5.26	3.83	0.67	5.63	4.02	0.68	6.02	4.12	0.69	6.21	4.57	0.69	
		-5.0	4.23	3.39	0.74	4.78	3.39	0.76	5.04	3.74	0.76	5.40	3.92	0.77	5.77	4.02	0.78	5.95	4.46	0.78	
		0.0	4.16	3.36	0.82	4.70	3.36	0.84	4.95	3.70	0.84	5.30	3.88	0.85	5.67	3.97	0.86	5.84	4.42	0.87	
		5.0	4.12	3.34	0.84	4.66	3.34	0.86	4.91	3.68	0.86	5.26	3.86	0.87	5.62	3.95	0.88	5.79	4.39	0.89	
		10.0	4.16	3.36	0.85	4.70	3.36	0.87	4.95	3.70	0.88	5.30	3.88	0.89	5.67	3.97	0.90	5.84	4.42	0.90	
		15.0	4.27	3.41	0.99	4.82	3.41	1.01	5.08	3.76	1.02	5.44	3.94	1.03	5.82	4.03	1.04	6.00	4.48	1.05	
		19.4	4.98	3.75	1.27	5.63	3.74	1.29	5.93	4.13	1.30	6.35	4.33	1.32	6.79	4.43	1.33	7.00	4.93	1.34	
		25.0	4.78	3.64	1.30	5.40	3.64	1.32	5.69	4.01	1.33	6.09	4.21	1.35	6.51	4.31	1.36	6.72	4.79	1.37	
		30.6	4.48	3.50	1.44	5.07	3.49	1.46	5.34	3.85	1.48	5.72	4.04	1.49	6.11	4.13	1.51	6.30	4.60	1.52	
		35.0	4.94	3.71	2.04	5.58	3.71	2.08	5.89	4.09	2.10	6.30	4.29	2.12	6.74	4.39	2.14	6.94	4.88	2.16	
		40.0	4.68	3.60	2.27	5.29	3.60	2.3													

## ● Indoor units: 9,000 Btu + 12,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
	14	15.69	12.43	0.71	17.73	12.42	0.72	18.69	13.70	0.72	20.01	14.37	0.73	21.39	14.71	0.74	22.05	16.34	0.74
	23	15.04	12.13	0.80	16.99	12.12	0.81	17.91	13.36	0.82	19.18	14.02	0.83	20.50	14.35	0.84	21.13	15.95	0.84
	32	14.77	12.01	0.88	16.70	11.99	0.90	17.60	13.23	0.91	18.84	13.88	0.92	20.15	14.20	0.93	20.77	15.78	0.93
	41	14.64	11.95	0.91	16.55	11.93	0.92	17.45	13.16	0.93	18.68	13.81	0.94	19.97	14.13	0.95	20.58	15.70	0.96
	50	14.77	12.01	0.92	16.70	11.99	0.93	17.60	13.23	0.94	18.84	13.88	0.95	20.15	14.20	0.96	20.77	15.78	0.97
	59	15.28	12.24	1.08	17.27	12.23	1.10	18.20	13.49	1.11	19.49	14.16	1.12	20.84	14.48	1.14	21.48	16.10	1.14
	67	18.83	13.88	1.56	21.28	13.86	1.58	22.44	15.29	1.60	24.02	16.05	1.61	25.68	16.42	1.63	26.47	18.25	1.64
	77	18.07	13.49	1.59	20.42	13.48	1.62	21.52	14.87	1.63	23.04	15.60	1.65	24.63	15.96	1.67	25.39	17.74	1.68
	87	16.95	12.95	1.77	19.16	12.93	1.80	20.20	14.27	1.81	21.62	14.97	1.83	23.12	15.32	1.85	23.83	17.02	1.86
	95	18.50	13.68	2.46	20.91	13.66	2.50	22.04	15.07	2.52	23.60	15.82	2.55	25.23	16.18	2.58	26.01	17.99	2.59
	104	16.63	12.86	2.35	18.79	12.84	2.39	19.81	14.17	2.41	21.21	14.87	2.44	22.67	15.21	2.46	23.37	16.90	2.48
	115	12.42	11.30	1.89	14.03	11.28	1.92	14.79	12.45	1.94	15.84	13.06	1.96	16.93	13.36	1.98	17.45	14.85	1.99

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
	-10.0	4.60	3.64	0.71	5.20	3.64	0.72	5.48	4.01	0.72	5.87	4.21	0.73	6.27	4.31	0.74	6.46	4.79	0.74
	-5.0	4.41	3.56	0.80	4.98	3.55	0.81	5.25	3.92	0.82	5.62	4.11	0.83	6.01	4.21	0.84	6.19	4.67	0.84
	0.0	4.33	3.52	0.88	4.89	3.51	0.90	5.16	3.88	0.91	5.52	4.07	0.92	5.90	4.16	0.93	6.09	4.63	0.93
	5.0	4.29	3.50	0.91	4.85	3.50	0.92	5.11	3.86	0.93	5.47	4.05	0.94	5.85	4.14	0.95	6.03	4.60	0.96
	10.0	4.33	3.52	0.92	4.89	3.51	0.93	5.16	3.88	0.94	5.52	4.07	0.95	5.90	4.16	0.96	6.09	4.63	0.97
	15.0	4.48	3.59	1.08	5.06	3.58	1.10	5.34	3.95	1.11	5.71	4.15	1.12	6.11	4.24	1.14	6.30	4.72	1.14
	19.4	5.52	4.07	1.56	6.24	4.06	1.58	6.58	4.48	1.60	7.04	4.70	1.61	7.53	4.81	1.63	7.76	5.35	1.64
	25.0	5.29	3.95	1.59	5.98	3.95	1.62	6.31	4.36	1.63	6.75	4.57	1.65	7.22	4.68	1.67	7.44	5.20	1.68
	30.6	4.97	3.80	1.77	5.62	3.79	1.80	5.92	4.18	1.81	6.34	4.39	1.83	6.77	4.49	1.85	6.98	4.99	1.86
	35.0	5.42	4.01	2.46	6.13	4.00	2.50	6.46	4.42	2.52	6.92	4.64	2.55	7.39	4.74	2.58	7.62	5.27	2.59
	40.0	4.87	3.77	2.35	5.51	3.76	2.39	5.81	4.15	2.41	6.22	4.36	2.44	6.64	4.46	2.46	6.85	4.95	2.48
	46.1	3.64	3.31	1.89	4.11	3.31	1.92	4.34	3.65	1.94	4.64	3.83	1.96	4.96	3.92	1.98	5.11	4.35	1.99

## ● Indoor units: 9,000 Btu + 14,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
	14	17.42	13.68	0.83	19.68	13.66	0.84	20.75	15.07	0.85	22.22	15.81	0.86	23.75	16.18	0.87	24.48	17.98	0.87
	23	16.69	13.34	0.94	18.86	13.33	0.95	19.88	14.7	0.96	21.29	15.43	0.97	22.76	15.78	0.98	23.46	17.54	0.99
	32	16.4	13.21	1.03	18.53	13.19	1.05	19.54	14.55	1.06	20.92	15.27	1.07	22.36	15.63	1.09	23.05	17.37	1.09
	41	16.26	13.14	1.06	18.37	13.13	1.08	19.37	14.48	1.09	20.73	15.19	1.10	22.16	15.54	1.11	22.85	17.28	1.12
	50	16.40	13.21	1.08	18.53	13.19	1.09	19.54	14.55	1.10	20.92	15.27	1.12	22.36	15.63	1.13	23.05	17.37	1.13
	59	17.32	13.63	1.33	19.57	13.62	1.35	20.63	15.02	1.36	22.09	15.76	1.38	23.61	16.13	1.39	24.34	17.92	1.40
	67	19.64	14.72	1.60	22.19	14.71	1.62	23.39	16.22	1.64	25.05	17.02	1.66	26.77	17.42	1.68	27.60	19.36	1.68
	77	18.83	14.31	1.63	21.28	14.30	1.66	22.44	15.77	1.68	24.02	16.55	1.69	25.68	16.93	1.71	26.47	18.82	1.72
	87	17.67	13.74	1.81	19.97	13.72	1.84	21.06	15.13	1.86	22.54	15.88	1.88	24.10	16.25	1.90	24.84	18.06	1.91
	95	19.44	14.58	2.56	21.97	14.56	2.61	23.16	16.06	2.63	24.80	16.86	2.66	26.51	17.25	2.69	27.33	19.17	2.71
	104	16.45	13.23	2.22	18.59	13.22	2.26	19.59	14.58	2.28	20.98	15.30	2.30	22.43	15.65	2.33	23.12	17.39	2.34
	115	12.13	11.63	1.74	13.71	11.61	1.77	14.45	12.81	1.79	15.47	13.44	1.81	16.54	13.75	1.83	17.05	15.28	1.84

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
	-10.0	5.10	4.01	0.83	5.77	4.00	0.84	6.08	4.42	0.85	6.51	4.63	0.86	6.96	4.74	0.87	7.18	5.27	0.87
	-5.0	4.89	3.91	0.94	5.53	3.91	0.95	5.83	4.31	0.96	6.24	4.52	0.97	6.67	4.63	0.98	6.88	5.14	0.99
	0.0	4.81	3.87	1.03	5.43	3.87	1.05	5.73	4.27	1.06	6.13	4.48	1.07	6.55	4.58	1.09	6.76	5.09	1.09
	5.0	4.76	3.85	1.06	5.38	3.85	1.08	5.68	4.24	1.09	6.08	4.45	1.10	6.50	4.56	1.11	6.70	5.06	1.12
	10.0	4.81	3.87	1.08	5.43	3.87	1.09	5.73	4.27	1.10	6.13	4.48	1.12	6.55	4.58	1.13	6.76	5.09	1.13
	15.0	5.08	4.00	1.33	5.74	3.99	1.35	6.05	4.40	1.36	6.47	4.62	1.38	6.92	4.73	1.39	7.13	5.25	1.40
	19.4	5.75	4.32	1.60	6.50	4.31	1.62	6.86	4.75	1.64	7.34	4.99	1.66	7.85	5.10	1.68	8.09	5.67	1.68
	25.0	5.52	4.19	1.63	6.24	4.19	1.66	6.58	4.62	1.68	7.04	4.85	1.69	7.53	4.96	1.71	7.76	5.51	1.72
	30.6	5.18	4.03	1.81	5.85	4.02	1.84	6.17	4.44	1.86	6.61	4.65	1.88	7.06	4.76	1.90	7.28	5.29	1.91
	35.0	5.70	4.27	2.56	6.44	4.27	2.61	6.79	4.71	2.63	7.27	4.94	2.66	7.77	5.05	2.69	8.01	5.62	2.71
	40.0	4.82	3.88	2.22	5.45	3.87	2.26	5.74	4.27	2.28	6.15	4.48	2.30	6.57	4.59	2.33	6.78	5.10	2.34
	46.1	3.55	3.41	1.74	4.02	3.40	1.77	4.24	3.75	1.79	4.53	3.94	1.81	4.85	4.03	1.83	5.00	4.48	1.84

### ● Indoor units: 9,000 Btu + 18,000 Btu

		Indoor temperature																					
°FDB		64			70			75			80			85			90						
°FWB		54			60			63			67			71			73						
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP				
	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW			kBTu/h			kW	
14	19.67	14.86	1.05	22.23	14.84	1.06	23.43	16.37	1.07	25.09	17.18	1.08	26.82	17.57	1.10	27.65	19.53	1.10	29.04	20.07	1.12		
23	18.85	14.50	1.18	21.30	14.48	1.21	22.46	15.97	1.22	24.04	16.76	1.23	25.70	17.15	1.24	26.50	19.06	1.25	27.92	20.00	1.26		
32	18.52	14.35	1.31	20.93	14.33	1.33	22.07	15.81	1.34	23.63	16.59	1.36	25.26	16.97	1.37	26.04	18.86	1.38	27.86	19.99	1.39		
41	18.36	14.27	1.34	20.75	14.26	1.37	21.87	15.73	1.38	23.42	16.50	1.39	25.03	16.88	1.41	25.81	18.77	1.42	27.82	19.98	1.43		
50	18.52	14.35	1.36	20.93	14.33	1.38	22.07	15.81	1.39	23.63	16.59	1.41	25.26	16.97	1.43	26.04	18.86	1.43	27.86	19.99	1.44		
59	19.88	14.95	1.74	22.47	14.93	1.77	23.68	16.47	1.78	25.36	17.28	1.80	27.11	17.68	1.82	27.94	19.65	1.83	29.05	20.40	1.84		
67	22.10	15.96	2.00	24.97	15.94	2.04	26.32	17.58	2.05	28.18	18.45	2.08	30.13	18.88	2.10	31.06	20.98	2.11	32.14	22.10	2.12		
77	21.19	15.51	2.05	23.95	15.50	2.08	25.25	17.09	2.10	27.03	17.94	2.12	28.90	18.35	2.15	29.79	20.40	2.16	30.91	21.60	2.17		
87	19.89	14.89	2.27	22.48	14.87	2.31	23.70	16.40	2.33	25.37	17.21	2.36	27.12	17.61	2.38	27.96	19.57	2.40	29.00	20.40	2.41		
95	20.38	15.17	2.77	23.04	15.15	2.82	24.28	16.71	2.84	26.00	17.54	2.87	27.79	17.94	2.90	28.65	19.94	2.92	29.79	21.00	2.93		
104	17.00	13.65	2.31	19.21	13.63	2.35	20.25	15.04	2.37	21.68	15.78	2.40	23.18	16.15	2.43	23.89	17.94	2.44	25.00	19.00	2.45		
115	12.57	12.03	1.81	14.21	12.01	1.84	14.98	13.25	1.86	16.04	13.91	1.88	17.14	14.23	1.90	17.67	15.81	1.91	18.50	16.50	1.92		

		Indoor temperature																			
°CDB		17.8			21.1			23.9			26.7			29.4			32.2				
°CWB		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	kW			kW			kW			kW			kW			kW					
-10.0	5.77	4.35	1.05	6.52	4.35	1.06	6.87	4.80	1.07	7.35	5.03	1.08	7.86	5.15	1.10	8.10	5.72	1.10	8.50	5.72	1.10
-5.0	5.52	4.25	1.18	6.24	4.24	1.21	6.58	4.68	1.22	7.05	4.91	1.23	7.53	5.03	1.24	7.77	5.58	1.25	8.10	5.58	1.25
0.0	5.43	4.21	1.31	6.14	4.20	1.33	6.47	4.63	1.34	6.92	4.86	1.36	7.40	4.97	1.37	7.63	5.53	1.38	8.10	5.53	1.38
5.0	5.38	4.18	1.34	6.08	4.18	1.37	6.41	4.61	1.38	6.86	4.84	1.39	7.34	4.95	1.41	7.56	5.50	1.42	8.10	5.50	1.42
10.0	5.43	4.21	1.36	6.14	4.20	1.38	6.47	4.63	1.39	6.92	4.86	1.41	7.40	4.97	1.43	7.63	5.53	1.43	8.10	5.53	1.43
15.0	5.83	4.38	1.74	6.58	4.38	1.77	6.94	4.83	1.78	7.43	5.07	1.80	7.94	5.18	1.82	8.19	5.76	1.83	8.50	5.76	1.83
19.4	6.48	4.68	2.00	7.32	4.67	2.04	7.72	5.15	2.05	8.26	5.41	2.08	8.83	5.53	2.10	9.10	6.15	2.11	9.50	6.15	2.11
25.0	6.21	4.55	2.05	7.02	4.54	2.08	7.40	5.01	2.10	7.92	5.26	2.12	8.47	5.38	2.15	8.73	5.98	2.16	9.10	5.98	2.16
30.6	5.83	4.36	2.27	6.59	4.36	2.31	6.94	4.81	2.33	7.44	5.05	2.36	7.95	5.16	2.38	8.19	5.74	2.40	8.50	5.74	2.40
35.0	5.97	4.45	2.77	6.75	4.44	2.82	7.12	4.90	2.84	7.62	5.14	2.87	8.15	5.26	2.90	8.40	5.84	2.92	8.70	5.84	2.92
40.0	4.98	4.00	2.31	5.63	4.00	2.35	5.93	4.41	2.37	6.35	4.63	2.40	6.79	4.73	2.43	7.00	5.26	2.44	7.30	5.26	2.44
46.1	3.68	3.53	1.81	4.16	3.52	1.84	4.39	3.88	1.86	4.70	4.08	1.88	5.02	4.17	1.90	5.18	4.63	1.91	5.50	4.63	1.91

### ● Indoor units: 12,000 Btu + 12,000 Btu

		Indoor temperature																					
°FDB		64			70			75			80			85			90						
°FWB		54			60			63			67			71			73						
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP				
	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW			kBTu/h			kW	
14	16.79	13.20	0.80	18.97	13.19	0.82	20.00	14.55	0.82	21.41	15.27	0.83	22.89	15.62	0.84	23.60	17.36	0.85	24.50	17.36	0.85		
23	16.09	12.88	0.91	18.18	12.87	0.93	19.17	14.19	0.93	20.52	14.89	0.94	21.94	15.24	0.96	22.62	16.94	0.96	23.50	16.94	0.96		
32	15.81	12.75	1.00	17.87	12.74	1.02	18.83	14.05	1.03	20.17	14.74	1.04	21.56	15.08	1.05	22.22	16.76	1.06	23.10	16.76	1.06		
41	15.67	12.69	1.03	17.71	12.67	1.05	18.67	13.98	1.06	19.99	14.67	1.07	21.37	15.01	1.08	22.03	16.68	1.09	22.90	16.68	1.09		
50	15.81	12.75	1.04	17.87	12.74	1.06	18.83	14.05	1.07	20.17	14.74	1.08	21.56	15.08	1.10	22.22	16.76	1.10	23.10	16.76	1.10		
59	16.44	13.05	1.25	18.58	13.03	1.27	19.59	14.37	1.28	20.97	15.08	1.29	22.42	15.43	1.31	23.11	17.15	1.32	24.00	17.15	1.32		
67	20.60	14.93	1.86	23.28	14.91	1.89	24.54	16.45	1.90	26.28	17.26	1.92	28.09	17.66	1.95	28.96	19.63	1.96	30.00	19.63	1.96		
77	19.76	14.51	1.90	22.33	14.50	1.93	23.54	15.99	1.95	25.21	16.78	1.97	26.94	17.17	1.99	27.78	19.08	2.00	28.90	19.08	2.00		
87	18.54	13.93	2.11	20.96	13.91	2.14	22.09	15.35	2.16	23.65	16.10	2.18	25.29	16.48	2.21	26.07	18.31	2.22	27.10	18.31	2.22		
95	19.60	14.45	2.74	22.15	14.43	2.79	23.35	15.91	2.81	25.00	16.70	2.84	26.73	17.09	2.87	27.55	18.99	2.89	28.70	18.99	2.89		
104	16.86	13.24	2.40	19.05	13.22	2.44	20.09	14.58	2.46	21.51	15.30	2.49	22.99	15.66	2.52	23.70	17.40	2.53	24.80	17.40	2.53		
115	12.56	11.67	1.88	14.20	11.65	1.91	14.97	12.85	1.93	16.02	13.49	1.95	17.13	13.80	1.97	17.66	15.34	1.98	18.50	15.34	1.98		

		Indoor temperature																			
°CDB		17.8			21.1			23.9			26.7			29.4			32.2				
°CWB		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	kW			kW			kW			kW			kW			kW					
-10.0	4.92	3.87	0.8	5.56	3.87	0.82	5.86	4.26	0.82	6.28	4.47	0.83	6.71	4.58	0.84	6.92	5.09	0.85	7.30	5.09	0.85
-5.0	4.72	3.78	0.91	5.33	3.77	0.93	5.62	4.16	0.93	6.01	4.37	0.94	6.43	4.47	0.96	6.63	4.96	0.96	7.00	4.96	0.96
0.0	4.63	3.74	1.00	5.24	3.73	1.02	5.52	4.12	1.03	5.91	4.32	1.04	6.32	4.42	1.05	6.51	4.91	1.06	6.90	4.91	1.06
5.0	4.59	3.72	1.03	5.19	3.71	1.05	5.47	4.10	1.06	5.86	4.30	1.07	6.26	4.40	1.08	6.46	4.89	1.09	6.85	4.89	1.09
10.0	4.63	3.74	1.04	5.24	3.73	1.06	5.52	4.12	1.07	5.91	4.32	1.08	6.32	4.42	1.10	6.51	4.91	1.10	6.90	4.91	1.10
15.0	4.82	3.82	1.25	5.45	3.82	1.27	5.74	4.21	1.28	6.15	4.42	1.29	6.57	4.52	1.31	6.77	5.03	1.32	7.15	5.03	1.32
19.4	6.04	4.38	1.86	6.82	4.37	1.89	7.19	4.82	1.90	7.70	5.06	1.92	8.23	5.18	1.95	8.49	5.75	1.96	9.00	5.75	1.96
25.0	5.79	4.25	1.90	6.55	4.25	1.93	6.90	4.69	1.95	7.39	4.92	1.97	7.90	5.03	1.99	8.14	5.59	2.00	8.60	5.59	2.00
30.6	5.44	4.08	2.11	6.14	4.08	2.14	6.47	4.50	2.16	6.93	4.72	2.18	7.41	4.83	2.21	7.64	5.37	2.22	8.10	5.37	2.22
35.0	5.74	4.23	2.74	6.49	4.23	2.79	6.84	4.66	2.81	7.33	4.89	2.84	7.83	5.01	2.87	8.07	5.57	2.89	8.50	5.57	2.89
40.0	4.94	3.88	2.40	5.58	3.87	2.44	5.89	4.27	2.46	6.30	4.49	2.49	6.74	4.59	2.52	6.95	5.10	2.53	7.30	5.10	2.53
46.1	3.68	3.42	1.88	4.16	3.42	1.91	4.39	3.77	1.93	4.70	3.95	1.95	5.02	4.05	1.97	5.18	4.50	1.98	5.50	4.50	1.98

OUTDOOR UNIT  
UOMH24AFXZJ

## ● Indoor units: 12,000 Btu + 14,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW
	14	20.43	15.69	1.05	23.08	15.67	1.06	24.34	17.28	1.07	26.05	18.13	1.08	27.85	18.55	1.10	28.71	20.62	1.10
	23	19.58	15.30	1.18	22.12	15.28	1.21	23.32	16.86	1.22	24.97	17.69	1.23	26.69	18.10	1.24	27.52	20.12	1.25
	32	19.24	15.15	1.31	21.74	15.13	1.33	22.92	16.69	1.34	24.53	17.51	1.36	26.23	17.92	1.37	27.04	19.91	1.38
	41	19.07	15.07	1.34	21.55	15.05	1.37	22.71	16.60	1.38	24.32	17.42	1.39	26.00	17.83	1.41	26.80	19.81	1.42
	50	19.24	15.15	1.36	21.74	15.13	1.38	22.92	16.69	1.39	24.53	17.51	1.41	26.23	17.92	1.43	27.04	19.91	1.43
	59	19.78	15.40	1.59	22.36	15.38	1.61	23.57	16.96	1.63	25.23	17.80	1.65	26.98	18.21	1.66	27.81	20.24	1.67
	67	22.95	16.85	2.00	25.93	16.83	2.04	27.34	18.56	2.05	29.27	19.48	2.08	31.29	19.93	2.10	32.25	22.15	2.11
	77	22.01	16.38	2.05	24.87	16.36	2.08	26.22	18.05	2.10	28.07	18.94	2.12	30.01	19.37	2.15	30.94	21.53	2.16
87	20.65	15.72	2.27	23.34	15.70	2.31	24.61	17.32	2.33	26.35	18.17	2.36	28.16	18.59	2.38	29.03	20.67	2.40	
95	21.17	16.01	2.77	23.92	15.99	2.82	25.22	17.64	2.84	27.00	18.51	2.87	28.86	18.94	2.90	29.75	21.05	2.92	
104	17.65	14.41	2.31	19.95	14.39	2.35	21.03	15.88	2.37	22.51	16.66	2.40	24.07	17.05	2.43	24.81	18.94	2.44	
115	13.06	12.70	1.81	14.76	12.68	1.84	15.55	13.99	1.86	16.65	14.68	1.88	17.80	15.02	1.90	18.35	16.69	1.91	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	5.99	4.60	1.05	6.77	4.59	1.06	7.13	5.06	1.07	7.64	5.31	1.08	8.16	5.44	1.10	8.42	6.04	1.10
	-5.0	5.74	4.49	1.18	6.48	4.48	1.21	6.84	4.94	1.22	7.32	5.19	1.23	7.82	5.31	1.24	8.06	5.90	1.25
	0.0	5.64	4.44	1.31	6.37	4.43	1.33	6.72	4.89	1.34	7.19	5.13	1.36	7.69	5.25	1.37	7.92	5.84	1.38
	5.0	5.59	4.42	1.34	6.31	4.41	1.37	6.66	4.87	1.38	7.13	5.11	1.39	7.62	5.22	1.41	7.85	5.81	1.42
	10.0	5.64	4.44	1.36	6.37	4.43	1.38	6.72	4.89	1.39	7.19	5.13	1.41	7.69	5.25	1.43	7.92	5.84	1.43
	15.0	5.80	4.51	1.59	6.55	4.51	1.61	6.91	4.97	1.63	7.40	5.22	1.65	7.91	5.34	1.66	8.15	5.93	1.67
	19.4	6.73	4.94	2.00	7.60	4.93	2.04	8.01	5.44	2.05	8.58	5.71	2.08	9.17	5.84	2.10	9.45	6.49	2.11
	25.0	6.45	4.80	2.05	7.29	4.79	2.08	7.68	5.29	2.10	8.23	5.55	2.12	8.80	5.68	2.15	9.07	6.31	2.16
30.6	6.05	4.61	2.27	6.84	4.60	2.31	7.21	5.08	2.33	7.72	5.33	2.36	8.25	5.45	2.38	8.51	6.06	2.40	
35.0	6.20	4.69	2.77	7.01	4.69	2.82	7.39	5.17	2.84	7.91	5.43	2.87	8.46	5.55	2.90	8.72	6.17	2.92	
40.0	5.17	4.22	2.31	5.85	4.22	2.35	6.16	4.65	2.37	6.60	4.88	2.40	7.05	5.00	2.43	7.27	5.55	2.44	
46.1	3.83	3.72	1.81	4.32	3.72	1.84	4.56	4.10	1.86	4.88	4.30	1.88	5.22	4.40	1.90	5.38	4.89	1.91	

## ● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW
	14	17.92	14.58	0.73	20.25	14.56	0.74	21.35	16.06	0.75	22.86	16.85	0.79	24.44	17.24	0.76	25.19	19.16	0.77
	23	17.18	14.22	0.82	19.41	14.20	0.84	20.46	15.67	0.84	21.91	16.44	0.89	23.42	16.82	0.86	24.14	18.70	0.87
	32	16.88	14.08	0.91	19.07	14.06	0.92	20.11	15.51	0.93	21.53	16.28	0.98	23.01	16.65	0.95	23.72	18.51	0.96
	41	16.73	14.01	0.93	18.90	13.99	0.95	19.93	15.43	0.96	21.34	16.19	1.01	22.81	16.57	0.98	23.51	18.41	0.98
	50	16.88	14.08	0.94	19.07	14.06	0.96	20.11	15.51	0.97	21.53	16.28	1.02	23.01	16.65	0.99	23.72	18.51	1.00
	59	16.43	13.86	0.98	18.57	13.84	1.00	19.57	15.27	1.01	20.96	16.02	1.06	22.40	16.39	1.03	23.09	18.22	1.03
	67	20.99	16.04	1.52	23.72	16.02	1.55	25.00	17.67	1.56	26.77	18.55	1.64	28.61	18.97	1.59	29.50	21.09	1.60
	77	20.13	15.59	1.55	22.75	15.57	1.58	23.98	17.18	1.59	25.67	18.03	1.68	27.45	18.44	1.63	28.29	20.50	1.64
87	18.89	14.97	1.72	21.35	14.95	1.75	22.50	16.49	1.77	24.09	17.30	1.86	25.76	17.70	1.81	26.55	19.67	1.82	
95	20.15	15.60	2.28	22.77	15.58	2.32	24.00	17.19	2.34	25.70	18.04	2.47	27.47	18.45	2.40	28.32	20.51	2.41	
104	18.22	14.72	2.31	20.59	14.70	2.35	21.70	16.21	2.37	23.24	17.01	2.50	24.84	17.41	2.43	25.61	19.35	2.44	
115	13.58	12.91	1.81	15.35	12.90	1.84	16.18	14.22	1.86	17.32	14.93	1.96	18.52	15.27	1.90	19.09	16.97	1.91	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	5.25	4.27	0.73	5.94	4.27	0.74	6.26	4.71	0.75	6.70	4.94	0.79	7.16	5.05	0.76	7.38	5.62	0.77
	-5.0	5.03	4.17	0.82	5.69	4.16	0.84	6.00	4.59	0.84	6.42	4.82	0.89	6.86	4.93	0.86	7.08	5.48	0.87
	0.0	4.95	4.13	0.91	5.59	4.12	0.92	5.89	4.55	0.93	6.31	4.77	0.98	6.74	4.88	0.95	6.95	5.42	0.96
	5.0	4.90	4.10	0.93	5.54	4.10	0.95	5.84	4.52	0.96	6.25	4.75	1.01	6.68	4.86	0.98	6.89	5.40	0.98
	10.0	4.95	4.13	0.94	5.59	4.12	0.96	5.89	4.55	0.97	6.31	4.77	1.02	6.74	4.88	0.99	6.95	5.42	1.00
	15.0	4.81	4.06	0.98	5.44	4.06	1.00	5.74	4.48	1.01	6.14	4.70	1.06	6.57	4.80	1.03	6.77	5.34	1.03
	19.4	6.15	4.70	1.52	6.95	4.70	1.55	7.33	5.18	1.56	7.84	5.44	1.64	8.39	5.56	1.59	8.65	6.18	1.60
	25.0	5.90	4.57	1.55	6.67	4.56	1.58	7.03	5.03	1.59	7.52	5.28	1.68	8.04	5.41	1.63	8.29	6.01	1.64
30.6	5.54	4.39	1.72	6.26	4.38	1.75	6.60	4.83	1.77	7.06	5.07	1.86	7.55	5.19	1.81	7.78	5.77	1.82	
35.0	5.91	4.57	2.28	6.67	4.57	2.32	7.04	5.04	2.34	7.53	5.29	2.47	8.05	5.41	2.40	8.30	6.01	2.41	
40.0	5.34	4.31	2.31	6.03	4.31	2.35	6.36	4.75	2.37	6.81	4.99	2.50	7.28	5.10	2.43	7.50	5.67	2.44	
46.1	3.98	3.78	1.81	4.50	3.78	1.84	4.74	4.17	1.86	5.08	4.37	1.96	5.43	4.48	1.90	5.60	4.97	1.91	

OUTDOOR UNIT  
UOMH24FXZJ

## ● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu

		Indoor temperature																		
°FDB		64			70			75			80			85			90			
°FWB		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBTu/h			kW			kBTu/h			kW			kBTu/h			kW			kBTu/h
14	18.79	15.33	0.79	21.24	15.31	0.81	22.39	16.88	0.81	23.97	17.72	0.84	25.62	18.13	0.83	26.41	20.15	0.84		
23	18.01	14.95	0.9	20.35	14.93	0.92	21.45	16.47	0.92	22.97	17.29	0.95	24.55	17.69	0.94	25.31	19.66	0.95		
32	17.69	14.80	0.99	20.00	14.78	1.01	21.08	16.31	1.02	22.57	17.11	1.05	24.13	17.51	1.04	24.87	19.46	1.05		
41	17.54	14.72	1.02	19.82	14.71	1.04	20.89	16.22	1.04	22.37	17.02	1.08	23.91	17.42	1.07	24.65	19.36	1.07		
50	17.69	14.80	1.03	20.00	14.78	1.05	21.08	16.31	1.06	22.57	17.11	1.09	24.13	17.51	1.08	24.87	19.46	1.09		
59	18.01	14.95	1.18	20.36	14.94	1.20	21.46	16.48	1.21	22.98	17.29	1.25	24.56	17.69	1.24	25.32	19.66	1.24		
67	22.15	16.93	1.68	25.04	16.91	1.71	26.39	18.65	1.73	28.26	19.57	1.78	30.21	20.03	1.77	31.14	22.26	1.78		
77	21.25	16.46	1.72	24.01	16.44	1.75	25.32	18.13	1.77	27.10	19.03	1.82	28.97	19.47	1.81	29.87	21.64	1.82		
87	19.94	15.80	1.91	22.54	15.78	1.94	23.76	17.40	1.96	25.44	18.26	2.02	27.19	18.68	2.00	28.03	20.77	2.02		
95	21.17	16.42	2.51	23.92	16.40	2.55	25.22	18.09	2.57	27.00	18.99	2.65	28.86	19.42	2.63	29.75	21.59	2.64		
104	18.42	15.15	2.31	20.82	15.13	2.35	21.94	16.69	2.37	23.49	17.51	2.45	25.11	17.92	2.43	25.89	19.91	2.44		
115	13.69	13.32	1.81	15.47	13.30	1.84	16.30	14.68	1.86	17.46	15.40	1.92	18.66	15.76	1.90	19.24	17.51	1.91		

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
-10.0	5.51	4.49	0.79	6.22	4.49	0.81	6.56	4.95	0.81	7.02	5.19	0.84	7.51	5.31	0.83	7.74	5.9	0.84		
-5.0	5.28	4.38	0.90	5.96	4.38	0.92	6.29	4.83	0.92	6.73	5.07	0.95	7.20	5.18	0.94	7.42	5.76	0.95		
0.0	5.19	4.34	0.99	5.86	4.33	1.01	6.18	4.78	1.02	6.61	5.01	1.05	7.07	5.13	1.04	7.29	5.70	1.05		
5.0	5.14	4.32	1.02	5.81	4.31	1.04	6.12	4.75	1.04	6.56	4.99	1.08	7.01	5.10	1.07	7.22	5.67	1.07		
10.0	5.19	4.34	1.03	5.86	4.33	1.05	6.18	4.78	1.06	6.61	5.01	1.09	7.07	5.13	1.08	7.29	5.70	1.09		
15.0	5.28	4.38	1.18	5.97	4.38	1.20	6.29	4.83	1.21	6.73	5.07	1.25	7.20	5.18	1.24	7.42	5.76	1.24		
19.4	6.49	4.96	1.68	7.34	4.96	1.71	7.74	5.47	1.73	8.28	5.74	1.78	8.85	5.87	1.77	9.13	6.52	1.78		
25.0	6.23	4.82	1.72	7.04	4.82	1.75	7.42	5.31	1.77	7.94	5.58	1.82	8.49	5.71	1.81	8.75	6.34	1.82		
30.6	5.84	4.63	1.91	6.60	4.62	1.94	6.96	5.10	1.96	7.45	5.35	2.02	7.97	5.48	2.00	8.22	6.09	2.02		
35.0	6.20	4.81	2.51	7.01	4.81	2.55	7.39	5.30	2.57	7.91	5.56	2.65	8.46	5.69	2.63	8.72	6.33	2.64		
40.0	5.40	4.44	2.31	6.10	4.43	2.35	6.43	4.89	2.37	6.89	5.13	2.45	7.36	5.25	2.43	7.59	5.84	2.44		
46.1	4.01	3.90	1.81	4.53	3.90	1.84	4.78	4.30	1.86	5.12	4.51	1.92	5.47	4.62	1.90	5.64	5.13	1.91		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 12,000 Btu

		Indoor temperature																		
°FDB		64			70			75			80			85			90			
°FWB		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBTu/h			kW			kBTu/h			kW			kBTu/h			kW			kBTu/h
14	19.24	15.47	0.92	21.74	15.45	0.94	22.92	17.04	0.94	24.54	17.88	0.95	26.23	18.30	0.97	27.04	20.33	0.97		
23	18.44	15.09	1.04	20.83	15.07	1.06	21.96	16.63	1.07	23.51	17.45	1.08	25.14	17.85	1.09	25.91	19.84	1.10		
32	18.11	14.94	1.15	20.47	14.92	1.17	21.58	16.46	1.18	23.11	17.27	1.19	24.70	17.67	1.21	25.46	19.64	1.21		
41	17.95	14.86	1.18	20.29	14.84	1.20	21.39	16.37	1.21	22.90	17.18	1.23	24.48	17.58	1.24	25.24	19.54	1.25		
50	18.11	14.94	1.20	20.47	14.92	1.22	21.58	16.46	1.23	23.11	17.27	1.24	24.70	17.67	1.26	25.46	19.64	1.26		
59	18.72	15.23	1.41	21.16	15.21	1.44	22.31	16.78	1.45	23.88	17.61	1.46	25.53	18.01	1.48	26.32	20.02	1.49		
67	22.95	17.21	2.00	25.93	17.19	2.04	27.34	18.96	2.05	29.27	19.89	2.08	31.29	20.35	2.10	32.25	22.62	2.11		
77	22.01	16.72	2.05	24.87	16.70	2.08	26.22	18.43	2.10	28.07	19.34	2.12	30.01	19.78	2.15	30.94	21.99	2.16		
87	20.65	16.05	2.27	23.34	16.03	2.31	24.61	17.68	2.33	26.35	18.56	2.36	28.16	18.99	2.38	29.03	21.10	2.40		
95	21.17	16.35	2.77	23.92	16.33	2.82	25.22	18.01	2.84	27.00	18.90	2.87	28.86	19.34	2.90	29.75	21.50	2.92		
104	17.65	14.72	2.31	19.95	14.70	2.35	21.03	16.21	2.37	22.51	17.01	2.40	24.07	17.41	2.43	24.81	19.34	2.44		
115	13.19	13.10	1.81	14.90	13.08	1.84	15.71	14.43	1.86	16.82	15.14	1.88	17.98	15.49	1.90	18.54	17.22	1.91		

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
-10.0	5.64	4.53	0.92	6.37	4.53	0.94	6.72	4.99	0.94	7.19	5.24	0.95	7.69	5.36	0.97	7.92	5.96	0.97		
-5.0	5.40	4.42	1.04	6.11	4.42	1.06	6.44	4.87	1.07	6.89	5.11	1.08	7.37	5.23	1.09	7.59	5.81	1.10		
0.0	5.31	4.38	1.15	6.00	4.37	1.17	6.32	4.82	1.18	6.77	5.06	1.19	7.24	5.18	1.21	7.46	5.76	1.21		
5.0	5.26	4.36	1.18	5.95	4.35	1.2	6.27	4.80	1.21	6.71	5.04	1.23	7.17	5.15	1.24	7.40	5.73	1.25		
10.0	5.31	4.38	1.20	6.00	4.37	1.22	6.32	4.82	1.23	6.77	5.06	1.24	7.24	5.18	1.26	7.46	5.76	1.26		
15.0	5.49	4.46	1.41	6.20	4.46	1.44	6.54	4.92	1.45	7.00	5.16	1.46	7.48	5.28	1.48	7.71	5.87	1.49		
19.4	6.73	5.04	2.00	7.60	5.04	2.04	8.01	5.56	2.05	8.58	5.83	2.08	9.17	5.96	2.10	9.45	6.63	2.11		
25.0	6.45	4.90	2.05	7.29	4.90	2.08	7.68	5.40	2.10	8.23	5.67	2.12	8.80	5.80	2.15	9.07	6.44	2.16		
30.6	6.05	4.70	2.27	6.84	4.70	2.31	7.21	5.18	2.33	7.72	5.44	2.36	8.25	5.56	2.38	8.51	6.18	2.40		
35.0	6.20	4.79	2.77	7.01	4.79	2.82	7.39	5.28	2.84	7.91	5.54	2.87	8.46	5.67	2.90	8.72	6.30	2.92		
40.0	5.17	4.31	2.31	5.85	4.31	2.35	6.16	4.75	2.37	6.60	4.99	2.40	7.05	5.10	2.43	7.27	5.67	2.44		
46.1	3.86	3.84	1.81	4.37	3.83	1.84	4.60	4.23	1.86	4.93	4.44	1.88	5.27	4.54	1.90	5.43	5.05	1.91		

### ● Indoor units: 7,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature																				
		64			70			75			80			85			90					
		°FDB			°FWB			°FDB			°FWB			°FDB			°FWB					
Outdoor temperature	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP		
	14	18.83	15.35	0.88	21.28	15.33	0.90	22.43	16.91	0.90	24.02	17.75	0.91	25.68	18.16	0.92	26.47	20.18	0.93			
	23	18.05	14.98	1.00	20.39	14.96	1.01	21.50	16.50	1.02	23.02	17.31	1.03	24.61	17.71	1.05	25.37	19.69	1.05			
32	17.73	14.82	1.10	20.04	14.81	1.12	21.13	16.33	1.13	22.62	17.14	1.14	24.18	17.54	1.15	24.93	19.49	1.16				
41	17.58	14.75	1.13	19.86	14.73	1.15	20.94	16.25	1.16	22.42	17.05	1.17	23.97	17.44	1.18	24.70	19.39	1.19				
50	17.73	14.82	1.14	20.04	14.81	1.16	21.13	16.33	1.17	22.62	17.14	1.19	24.18	17.54	1.20	24.93	19.49	1.21				
59	18.72	15.30	1.41	21.16	15.28	1.44	22.31	16.86	1.45	23.88	17.69	1.46	25.53	18.10	1.48	26.32	20.11	1.49				
67	22.61	17.14	1.94	25.55	17.12	1.97	26.93	18.88	1.99	28.84	19.81	2.01	30.83	20.27	2.04	31.78	22.53	2.05				
77	21.69	16.66	1.98	24.51	16.64	2.02	25.83	18.35	2.04	27.66	19.26	2.06	29.57	19.71	2.08	30.48	21.90	2.09				
87	20.35	15.99	2.20	23.00	15.97	2.24	24.24	17.62	2.26	25.96	18.49	2.28	27.75	18.91	2.31	28.61	21.02	2.32				
95	21.17	16.43	2.77	23.92	16.41	2.82	25.22	18.10	2.84	27.00	18.99	2.87	28.86	19.43	2.90	29.75	21.60	2.92				
104	17.65	14.78	2.31	19.95	14.77	2.35	21.03	16.29	2.37	22.51	17.09	2.40	24.07	17.49	2.43	24.81	19.44	2.44				
115	13.06	13.03	1.81	14.76	13.01	1.84	15.55	14.35	1.86	16.65	15.06	1.88	17.80	15.41	1.90	18.35	17.13	1.91				

		Indoor temperature																				
		17.8			21.1			23.9			26.7			29.4			32.2					
		°CDB			°CWB			°CDB			°CWB			°CDB			°CWB					
Outdoor temperature	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP		
	-10.0	5.52	4.5	0.88	6.24	4.49	0.90	6.58	4.96	0.90	7.04	5.20	0.91	7.53	5.32	0.92	7.76	5.91	0.93			
	-5.0	5.29	4.39	1.00	5.98	4.38	1.01	6.30	4.84	1.02	6.75	5.07	1.03	7.21	5.19	1.05	7.43	5.77	1.05			
0.0	5.20	4.34	1.10	5.87	4.34	1.12	6.19	4.79	1.13	6.63	5.02	1.14	7.09	5.14	1.15	7.31	5.71	1.16				
5.0	5.15	4.32	1.13	5.82	4.32	1.15	6.14	4.76	1.16	6.57	5.00	1.17	7.02	5.11	1.18	7.24	5.68	1.19				
10.0	5.20	4.34	1.14	5.87	4.34	1.16	6.19	4.79	1.17	6.63	5.02	1.19	7.09	5.14	1.20	7.31	5.71	1.21				
15.0	5.49	4.48	1.41	6.20	4.48	1.44	6.54	4.94	1.45	7.00	5.18	1.46	7.48	5.30	1.48	7.71	5.89	1.49				
19.4	6.63	5.02	1.94	7.49	5.02	1.97	7.89	5.53	1.99	8.45	5.81	2.01	9.04	5.94	2.04	9.31	6.60	2.05				
25.0	6.36	4.88	1.98	7.18	4.88	2.02	7.57	5.38	2.04	8.11	5.64	2.06	8.67	5.78	2.08	8.93	6.42	2.09				
30.6	5.96	4.69	2.20	6.74	4.68	2.24	7.11	5.16	2.26	7.61	5.42	2.28	8.13	5.54	2.31	8.38	6.16	2.32				
35.0	6.20	4.81	2.77	7.01	4.81	2.82	7.39	5.30	2.84	7.91	5.57	2.87	8.46	5.70	2.90	8.72	6.33	2.92				
40.0	5.17	4.33	2.31	5.85	4.33	2.35	6.16	4.77	2.37	6.60	5.01	2.40	7.05	5.13	2.43	7.27	5.70	2.44				
46.1	3.83	3.82	1.81	4.32	3.81	1.84	4.56	4.21	1.86	4.88	4.41	1.88	5.22	4.52	1.90	5.38	5.02	1.91				

### ● Indoor units: 9,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature																				
		64			70			75			80			85			90					
		°FDB			°FWB			°FDB			°FWB			°FDB			°FWB					
Outdoor temperature	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP	°FDB	TC	SHC	IP		
	14	19.24	15.78	0.92	21.74	15.76	0.94	22.92	17.38	0.94	24.54	18.24	0.95	26.23	18.66	0.97	27.04	20.74	0.97			
	23	18.44	15.39	1.04	20.83	15.37	1.06	21.96	16.96	1.07	23.51	17.80	1.08	25.14	18.21	1.09	25.91	20.23	1.10			
32	18.11	15.24	1.15	20.47	15.22	1.17	21.58	16.79	1.18	23.11	17.61	1.19	24.70	18.02	1.21	25.46	20.03	1.21				
41	17.95	15.16	1.18	20.29	15.14	1.20	21.39	16.7	1.21	22.90	17.52	1.23	24.48	17.93	1.24	25.24	19.93	1.25				
50	18.11	15.24	1.20	20.47	15.22	1.22	21.58	16.79	1.23	23.11	17.61	1.24	24.70	18.02	1.26	25.46	20.03	1.26				
59	19.78	16.04	1.59	22.36	16.02	1.61	23.57	17.67	1.63	25.23	18.54	1.65	26.98	18.97	1.66	27.81	21.08	1.67				
67	22.95	17.55	2.00	25.93	17.53	2.04	27.34	19.33	2.05	29.27	20.29	2.08	31.29	20.76	2.10	32.25	23.07	2.11				
77	22.01	17.06	2.05	24.87	17.04	2.08	26.22	18.79	2.10	28.07	19.72	2.12	30.01	20.18	2.15	30.94	22.43	2.16				
87	20.65	16.37	2.27	23.34	16.35	2.31	24.61	18.04	2.33	26.35	18.93	2.36	28.16	19.37	2.38	29.03	21.52	2.40				
95	21.17	16.68	2.77	23.92	16.66	2.82	25.22	18.37	2.84	27.00	19.28	2.87	28.86	19.73	2.90	29.75	21.92	2.92				
104	17.65	15.01	2.31	19.95	14.99	2.35	21.03	16.54	2.37	22.51	17.35	2.40	24.07	17.75	2.43	24.81	19.73	2.44				
115	13.06	13.06	1.81	14.76	13.21	1.84	15.55	14.57	1.86	16.65	15.29	1.88	17.80	15.64	1.90	18.35	17.39	1.91				

		Indoor temperature																				
		17.8			21.1			23.9			26.7			29.4			32.2					
		°CDB			°CWB			°CDB			°CWB			°CDB			°CWB					
Outdoor temperature	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP	°CDB	TC	SHC	IP		
	-10.0	5.64	4.62	0.92	6.37	4.62	0.94	6.72	5.09	0.94	7.19	5.35	0.95	7.69	5.47	0.97	7.92	6.08	0.97			
	-5.0	5.40	4.51	1.04	6.11	4.51	1.06	6.44	4.97	1.07	6.89	5.22	1.08	7.37	5.34	1.09	7.59	5.93	1.10			
0.0	5.31	4.47	1.15	6.00	4.46	1.17	6.32	4.92	1.18	6.77	5.16	1.19	7.24	5.28	1.21	7.46	5.87	1.21				
5.0	5.26	4.44	1.18	5.95	4.44	1.20	6.27	4.89	1.21	6.71	5.14	1.23	7.17	5.25	1.24	7.40	5.84	1.25				
10.0	5.31	4.47	1.20	6.00	4.46	1.22	6.32	4.92	1.23	6.77	5.16	1.24	7.24	5.28	1.26	7.46	5.87	1.26				
15.0	5.80	4.70	1.59	6.55	4.69	1.61	6.91	5.18	1.63	7.40	5.43	1.65	7.91	5.56	1.66	8.15	6.18	1.67				
19.4	6.73	5.14	2.00	7.60	5.14	2.04	8.01	5.67	2.05	8.58	5.95	2.08	9.17	6.08	2.10	9.45	6.76	2.11				
25.0	6.45	5.00	2.05	7.29	4.99	2.08	7.68	5.51	2.10	8.23	5.78	2.12	8.80	5.91	2.15	9.07	6.57	2.16				
30.6	6.05	4.80	2.27	6.84	4.79	2.31	7.21	5.29	2.33	7.72	5.55	2.36	8.25	5.68	2.38	8.51	6.31	2.40				
35.0	6.20	4.89	2.77	7.01	4.88	2.82	7.39	5.39	2.84	7.91	5.65	2.87	8.46	5.78	2.90	8.72	6.43	2.92				
40.0	5.17	4.40	2.31	5.85	4.39	2.35	6.16	4.85	2.37	6.60	5.09	2.40	7.05	5.20	2.43	7.27	5.78	2.44				
46.1	3.83	3.83	1.81	4.32	3.87	1.84	4.56	4.27	1.86	4.88	4.48	1.88	5.22	4.58	1.90	5.38	5.10	1.91				

OUTDOOR UNIT  
UOMH24FXZJ

# 6-3. Heating capacity

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

## ■ Model: UOMH24AFXZJ

- TC: Total Capacity, IP: Input Power
- The data is based on the following conditions:  
Pipe length: 7.5 m, Height difference: 0 m [Outdoor unit—Indoor unit]

## ● Indoor units: 7,000 Btu

OUTDOOR UNIT  
UOMH24AFXZJ

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	8.16	1.06	7.90	1.09	7.64	1.12	7.37	1.15	7.21	1.17
	14	12	9.31	1.13	9.02	1.17	8.71	1.20	8.41	1.23	8.22	1.25
	23	19	9.73	1.08	9.42	1.11	9.10	1.15	8.78	1.18	8.59	1.20
	32	28	10.16	1.03	9.83	1.06	9.50	1.09	9.17	1.12	8.97	1.13
	41	37	11.45	0.96	11.08	0.99	10.71	1.01	10.34	1.04	10.11	1.06
	47	43	12.21	0.96	11.82	0.99	11.42	1.02	11.02	1.05	10.78	1.07
	50	47	12.30	1.00	11.91	1.03	11.51	1.06	11.10	1.09	10.86	1.11
	59	50	12.42	0.96	12.03	0.99	11.62	1.02	11.21	1.04	10.97	1.06
	68	59	12.18	0.76	11.79	0.78	11.39	0.80	10.99	0.83	10.75	0.84
	75	65	10.96	0.57	10.61	0.59	10.25	0.61	9.90	0.62	9.68	0.63

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	2.39	1.06	2.32	1.09	2.24	1.12	2.16	1.15	2.11	1.17
	-10.0	-11.1	2.73	1.13	2.64	1.17	2.55	1.20	2.46	1.23	2.41	1.25
	-5.0	-7.2	2.85	1.08	2.76	1.11	2.67	1.15	2.57	1.18	2.52	1.20
	0.0	-2.2	2.98	1.03	2.88	1.06	2.78	1.09	2.69	1.12	2.63	1.13
	5.0	2.8	3.35	0.96	3.25	0.99	3.14	1.01	3.03	1.04	2.96	1.06
	8.3	6.1	3.58	0.96	3.46	0.99	3.35	1.02	3.23	1.05	3.16	1.07
	10.0	8.3	3.60	1.00	3.49	1.03	3.37	1.06	3.25	1.09	3.18	1.11
	15.0	10.0	3.64	0.96	3.53	0.99	3.41	1.02	3.29	1.04	3.21	1.06
	20.0	15.0	3.57	0.76	3.46	0.78	3.34	0.80	3.22	0.83	3.15	0.84
	23.9	18.3	3.21	0.57	3.11	0.59	3.01	0.61	2.90	0.62	2.84	0.63



## ● Indoor units: 9,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	10.98	1.31	10.63	1.35	10.27	1.39	9.91	1.43	9.70	1.45
14	12	12.49	1.41	12.10	1.45	11.69	1.49	11.28	1.54	11.03	1.56	
23	19	13.18	1.37	12.77	1.41	12.33	1.45	11.90	1.49	11.64	1.51	
32	28	13.95	1.32	13.51	1.36	13.05	1.40	12.60	1.44	12.32	1.46	
41	37	15.80	1.27	15.30	1.31	14.78	1.34	14.27	1.38	13.95	1.41	
47	43	16.85	1.28	16.32	1.32	15.77	1.36	15.21	1.40	14.88	1.42	
50	47	16.98	1.30	16.44	1.33	15.88	1.37	15.33	1.41	14.99	1.43	
59	50	17.14	1.29	16.60	1.33	16.04	1.37	15.48	1.41	15.14	1.43	
68	59	16.81	0.98	16.28	1.01	15.73	1.04	15.18	1.07	14.84	1.08	
75	65	13.33	0.79	12.91	0.81	12.47	0.84	12.03	0.86	11.77	0.88	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	3.22	1.31	3.12	1.35	3.01	1.39	2.91	1.43	2.84	1.45
-10.0	-11.1	3.66	1.41	3.55	1.45	3.43	1.49	3.31	1.54	3.23	1.56	
-5.0	-7.2	3.86	1.37	3.74	1.41	3.61	1.45	3.49	1.49	3.41	1.51	
0.0	-2.2	4.09	1.32	3.96	1.36	3.83	1.40	3.69	1.44	3.61	1.46	
5.0	2.8	4.63	1.27	4.48	1.31	4.33	1.34	4.18	1.38	4.09	1.41	
8.3	6.1	4.94	1.28	4.78	1.32	4.62	1.36	4.46	1.40	4.36	1.42	
10.0	8.3	4.98	1.30	4.82	1.33	4.66	1.37	4.49	1.41	4.39	1.43	
15.0	10.0	5.02	1.29	4.87	1.33	4.70	1.37	4.54	1.41	4.44	1.43	
20.0	15.0	4.93	0.98	4.77	1.01	4.61	1.04	4.45	1.07	4.35	1.08	
23.9	18.3	3.91	0.79	3.78	0.81	3.65	0.84	3.53	0.86	3.45	0.88	

## ● Indoor units: 12,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	12.55	1.69	12.15	1.74	11.74	1.79	11.33	1.84	11.08	1.87
14	12	14.28	1.81	13.83	1.86	13.36	1.92	12.89	1.97	12.61	2.00	
23	19	15.06	1.78	14.58	1.83	14.09	1.88	13.59	1.93	13.29	1.96	
32	28	15.94	1.69	15.44	1.74	14.92	1.79	14.40	1.84	14.08	1.87	
41	37	18.06	1.58	17.49	1.63	16.89	1.67	16.30	1.72	15.94	1.75	
47	43	19.26	1.60	18.65	1.64	18.02	1.69	17.39	1.74	17.00	1.76	
50	47	19.40	1.61	18.79	1.66	18.15	1.71	17.52	1.76	17.13	1.78	
59	50	19.59	1.62	18.97	1.66	18.33	1.71	17.69	1.76	17.30	1.79	
68	59	19.21	1.37	18.60	1.41	17.97	1.45	17.34	1.49	16.96	1.52	
75	65	16.21	0.95	15.70	0.98	15.16	1.00	14.63	1.03	14.31	1.05	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	3.68	1.69	3.56	1.74	3.44	1.79	3.32	1.84	3.25	1.87
-10.0	-11.1	4.18	1.81	4.05	1.86	3.92	1.92	3.78	1.97	3.70	2.00	
-5.0	-7.2	4.41	1.78	4.27	1.83	4.13	1.88	3.98	1.93	3.90	1.96	
0.0	-2.2	4.67	1.69	4.53	1.74	4.37	1.79	4.22	1.84	4.13	1.87	
5.0	2.8	5.29	1.58	5.12	1.63	4.95	1.67	4.78	1.72	4.67	1.75	
8.3	6.1	5.64	1.60	5.47	1.64	5.28	1.69	5.10	1.74	4.98	1.76	
10.0	8.3	5.69	1.61	5.51	1.66	5.32	1.71	5.13	1.76	5.02	1.78	
15.0	10.0	5.74	1.62	5.56	1.66	5.37	1.71	5.18	1.76	5.07	1.79	
20.0	15.0	5.63	1.37	5.45	1.41	5.27	1.45	5.08	1.49	4.97	1.52	
23.9	18.3	4.75	0.95	4.60	0.98	4.44	1.00	4.29	1.03	4.19	1.05	

## ● Indoor units: 14,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	13.66	1.67	13.23	1.72	12.78	1.76	12.34	1.81	12.07	1.84		
14	12	15.58	1.78	15.09	1.84	14.58	1.89	14.07	1.94	13.76	1.97		
23	19	16.55	1.76	16.03	1.81	15.48	1.86	14.94	1.91	14.61	1.94		
32	28	17.62	1.69	17.07	1.74	16.49	1.79	15.91	1.84	15.56	1.87		
41	37	19.81	1.59	19.19	1.63	18.54	1.68	17.89	1.73	17.50	1.76		
47	43	21.13	1.61	20.46	1.65	19.77	1.70	19.08	1.75	18.66	1.77		
50	47	21.29	1.62	20.62	1.67	19.92	1.72	19.22	1.77	18.80	1.80		
59	50	22.14	1.71	21.44	1.76	20.72	1.81	19.99	1.86	19.55	1.89		
68	59	21.08	1.33	20.41	1.37	19.72	1.40	19.03	1.44	18.61	1.47		
75	65	20.42	1.16	19.78	1.20	19.11	1.23	18.44	1.26	18.03	1.29		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	4.00	1.67	3.88	1.72	3.75	1.76	3.62	1.81	3.54	1.84		
-10.0	-11.1	4.57	1.78	4.42	1.84	4.27	1.89	4.12	1.94	4.03	1.97		
-5.0	-7.2	4.85	1.76	4.70	1.81	4.54	1.86	4.38	1.91	4.28	1.94		
0.0	-2.2	5.17	1.69	5.00	1.74	4.83	1.79	4.66	1.84	4.56	1.87		
5.0	2.8	5.81	1.59	5.62	1.63	5.43	1.68	5.24	1.73	5.13	1.76		
8.3	6.1	6.19	1.61	6.00	1.65	5.79	1.70	5.59	1.75	5.47	1.77		
10.0	8.3	6.24	1.62	6.04	1.67	5.84	1.72	5.63	1.77	5.51	1.80		
15.0	10.0	6.49	1.71	6.28	1.76	6.07	1.81	5.86	1.86	5.73	1.89		
20.0	15.0	6.18	1.33	5.98	1.37	5.78	1.40	5.58	1.44	5.46	1.47		
23.9	18.3	5.99	1.16	5.80	1.20	5.60	1.23	5.40	1.26	5.29	1.29		

## ● Indoor units: 18,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	16.93	2.37	16.40	2.44	15.84	2.51	15.29	2.58	14.95	2.63		
14	12	19.26	2.47	18.65	2.54	18.02	2.61	17.39	2.68	17.01	2.73		
23	19	20.62	2.55	19.96	2.62	19.29	2.69	18.61	2.77	18.20	2.82		
32	28	22.38	2.40	21.67	2.47	20.94	2.54	20.21	2.61	19.76	2.65		
41	37	25.35	2.37	24.55	2.44	23.72	2.51	22.89	2.58	22.38	2.63		
47	43	27.03	2.40	26.18	2.47	25.29	2.54	24.41	2.61	23.87	2.65		
50	47	27.23	2.44	26.37	2.51	25.48	2.58	24.59	2.65	24.05	2.69		
59	50	27.50	2.37	26.63	2.44	25.73	2.51	24.83	2.58	24.29	2.63		
68	59	26.96	1.99	26.11	2.05	25.23	2.11	24.35	2.17	23.81	2.20		
75	65	24.27	1.42	23.50	1.47	22.71	1.51	21.91	1.55	21.43	1.58		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	4.96	2.37	4.81	2.44	4.64	2.51	4.48	2.58	4.38	2.63		
-10.0	-11.1	5.64	2.47	5.47	2.54	5.28	2.61	5.10	2.68	4.98	2.73		
-5.0	-7.2	6.04	2.55	5.85	2.62	5.65	2.69	5.46	2.77	5.34	2.82		
0.0	-2.2	6.56	2.40	6.35	2.47	6.14	2.54	5.92	2.61	5.79	2.65		
5.0	2.8	7.43	2.37	7.19	2.44	6.95	2.51	6.71	2.58	6.56	2.63		
8.3	6.1	7.92	2.40	7.67	2.47	7.41	2.54	7.15	2.61	7.00	2.65		
10.0	8.3	7.98	2.44	7.73	2.51	7.47	2.58	7.21	2.65	7.05	2.69		
15.0	10.0	8.06	2.37	7.81	2.44	7.54	2.51	7.28	2.58	7.12	2.63		
20.0	15.0	7.90	1.99	7.65	2.05	7.39	2.11	7.14	2.17	6.98	2.20		
23.9	18.3	7.11	1.42	6.89	1.47	6.65	1.51	6.42	1.55	6.28	1.58		

## ● Indoor units: 7,000 Btu + 7,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	13.26	1.82	12.84	1.88	12.41	1.93	11.97	1.99	11.71	2.02
14	12	15.69	1.94	15.20	1.99	14.68	2.05	14.17	2.11	13.86	2.14	
23	19	17.23	1.90	16.69	1.95	16.13	2.01	15.56	2.07	15.22	2.10	
32	28	19.10	1.84	18.49	1.90	17.87	1.95	17.24	2.01	16.86	2.04	
41	37	20.74	1.79	20.09	1.84	19.41	1.89	18.73	1.95	18.32	1.98	
47	43	22.12	1.86	21.42	1.91	20.70	1.97	19.98	2.03	19.54	2.06	
50	47	23.28	1.88	22.55	1.93	21.78	1.99	21.02	2.05	20.56	2.08	
59	50	25.64	1.90	24.83	1.95	23.99	2.01	23.15	2.07	22.64	2.10	
68	59	23.32	1.66	22.59	1.71	21.82	1.76	21.06	1.80	20.59	1.83	
75	65	20.19	1.11	19.55	1.14	18.89	1.17	18.23	1.20	17.83	1.22	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	3.89	1.82	3.76	1.88	3.64	1.93	3.51	1.99	3.43	2.02
-10.0	-11.1	4.60	1.94	4.45	1.99	4.30	2.05	4.15	2.11	4.06	2.14	
-5.0	-7.2	5.05	1.90	4.89	1.95	4.73	2.01	4.56	2.07	4.46	2.10	
0.0	-2.2	5.60	1.84	5.42	1.90	5.24	1.95	5.05	2.01	4.94	2.04	
5.0	2.8	6.08	1.79	5.89	1.84	5.69	1.89	5.49	1.95	5.37	1.98	
8.3	6.1	6.48	1.86	6.28	1.91	6.07	1.97	5.85	2.03	5.73	2.06	
10.0	8.3	6.82	1.88	6.61	1.93	6.38	1.99	6.16	2.05	6.03	2.08	
15.0	10.0	7.51	1.90	7.28	1.95	7.03	2.01	6.78	2.07	6.64	2.10	
20.0	15.0	6.84	1.66	6.62	1.71	6.40	1.76	6.17	1.80	6.04	1.83	
23.9	18.3	5.92	1.11	5.73	1.14	5.54	1.17	5.34	1.20	5.22	1.22	

## ● Indoor units: 7,000 Btu + 9,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	14.81	2.38	14.34	2.45	13.86	2.52	13.37	2.59	13.08	2.63
14	12	17.49	2.53	16.94	2.60	16.36	2.67	15.79	2.75	15.44	2.79	
23	19	19.23	2.48	18.62	2.55	17.99	2.62	17.36	2.69	16.98	2.74	
32	28	21.50	2.40	20.82	2.47	20.12	2.54	19.41	2.62	18.98	2.66	
41	37	23.75	2.33	23.00	2.40	22.22	2.47	21.44	2.54	20.97	2.58	
47	43	25.33	2.43	24.53	2.50	23.70	2.57	22.87	2.64	22.37	2.69	
50	47	26.58	2.42	25.74	2.49	24.87	2.57	24.00	2.64	23.47	2.68	
59	50	26.75	2.23	25.91	2.29	25.03	2.36	24.15	2.42	23.62	2.46	
68	59	24.68	1.87	23.90	1.93	23.09	1.98	22.29	2.04	21.80	2.07	
75	65	23.39	1.44	22.65	1.48	21.88	1.53	21.12	1.57	20.65	1.60	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	4.34	2.38	4.20	2.45	4.06	2.52	3.92	2.59	3.83	2.63
-10.0	-11.1	5.13	2.53	4.96	2.60	4.80	2.67	4.63	2.75	4.53	2.79	
-5.0	-7.2	5.63	2.48	5.46	2.55	5.27	2.62	5.09	2.69	4.98	2.74	
0.0	-2.2	6.30	2.40	6.10	2.47	5.90	2.54	5.69	2.62	5.56	2.66	
5.0	2.8	6.96	2.33	6.74	2.40	6.51	2.47	6.28	2.54	6.15	2.58	
8.3	6.1	7.42	2.43	7.19	2.50	6.95	2.57	6.70	2.64	6.56	2.69	
10.0	8.3	7.79	2.42	7.54	2.49	7.29	2.57	7.03	2.64	6.88	2.68	
15.0	10.0	7.84	2.23	7.59	2.29	7.34	2.36	7.08	2.42	6.92	2.46	
20.0	15.0	7.23	1.87	7.01	1.93	6.77	1.98	6.53	2.04	6.39	2.07	
23.9	18.3	6.85	1.44	6.64	1.48	6.41	1.53	6.19	1.57	6.05	1.60	

OUTDOOR UNIT  
UOMH24FXZJ

## ● Indoor units: 7,000 Btu + 12,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	16.31	2.51	15.79	2.58	15.26	2.66	14.72	2.73	14.40	2.78	14.40	2.78
14	12	18.98	2.67	18.38	2.74	17.76	2.82	17.14	2.90	16.76	2.95	16.76	2.95
23	19	21.00	2.61	20.34	2.69	19.65	2.76	18.96	2.84	18.54	2.89	18.54	2.89
32	28	23.63	2.54	22.88	2.61	22.11	2.68	21.33	2.76	20.86	2.80	20.86	2.80
41	37	25.65	2.46	24.84	2.53	24.00	2.60	23.16	2.68	22.65	2.72	22.65	2.72
47	43	27.36	2.56	26.50	2.63	25.60	2.71	24.70	2.79	24.16	2.83	24.16	2.83
50	47	28.64	2.56	27.73	2.63	26.79	2.70	25.86	2.78	25.29	2.83	25.29	2.83
59	50	28.71	2.25	27.81	2.31	26.87	2.38	25.92	2.45	25.35	2.49	25.35	2.49
68	59	27.93	1.89	27.05	1.94	26.13	2.00	25.22	2.06	24.66	2.09	24.66	2.09
75	65	25.23	1.65	24.44	1.70	23.61	1.74	22.79	1.79	22.28	1.82	22.28	1.82

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	4.78	2.51	4.63	2.58	4.47	2.66	4.32	2.73	4.22	2.78	4.22	2.78
-10.0	-11.1	5.56	2.67	5.39	2.74	5.21	2.82	5.02	2.90	4.91	2.95	4.91	2.95
-5.0	-7.2	6.15	2.61	5.96	2.69	5.76	2.76	5.56	2.84	5.43	2.89	5.43	2.89
0.0	-2.2	6.92	2.54	6.71	2.61	6.48	2.68	6.25	2.76	6.11	2.80	6.11	2.80
5.0	2.8	7.52	2.46	7.28	2.53	7.03	2.60	6.79	2.68	6.64	2.72	6.64	2.72
8.3	6.1	8.02	2.56	7.77	2.63	7.50	2.71	7.24	2.79	7.08	2.83	7.08	2.83
10.0	8.3	8.39	2.56	8.13	2.63	7.85	2.70	7.58	2.78	7.41	2.83	7.41	2.83
15.0	10.0	8.42	2.25	8.15	2.31	7.87	2.38	7.60	2.45	7.43	2.49	7.43	2.49
20.0	15.0	8.19	1.89	7.93	1.94	7.66	2.00	7.39	2.06	7.23	2.09	7.23	2.09
23.9	18.3	7.40	1.65	7.16	1.70	6.92	1.74	6.68	1.79	6.53	1.82	6.53	1.82

## ● Indoor units: 7,000 Btu + 14,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	16.48	2.52	15.96	2.59	15.42	2.67	14.88	2.74	14.55	2.79	14.55	2.79
14	12	19.34	2.52	18.73	2.59	18.09	2.67	17.46	2.74	17.08	2.79	17.08	2.79
23	19	21.88	2.52	21.19	2.59	20.48	2.67	19.76	2.74	19.32	2.79	19.32	2.79
32	28	24.61	2.47	23.83	2.54	23.02	2.61	22.22	2.69	21.73	2.73	21.73	2.73
41	37	27.56	2.54	26.69	2.61	25.78	2.69	24.88	2.76	24.33	2.81	24.33	2.81
47	43	29.39	2.66	28.46	2.73	27.50	2.81	26.54	2.89	25.95	2.94	25.95	2.94
50	47	30.42	2.23	29.46	2.30	28.46	2.36	27.47	2.43	26.86	2.47	26.86	2.47
59	50	30.14	2.10	29.19	2.16	28.20	2.23	27.21	2.29	26.61	2.33	26.61	2.33
68	59	28.66	1.77	27.76	1.82	26.82	1.87	25.88	1.92	25.31	1.96	25.31	1.96
75	65	27.07	1.69	26.21	1.74	25.33	1.79	24.44	1.84	23.90	1.87	23.90	1.87

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	4.83	2.52	4.68	2.59	4.52	2.67	4.36	2.74	4.26	2.79	4.26	2.79
-10.0	-11.1	5.67	2.52	5.49	2.59	5.30	2.67	5.12	2.74	5.00	2.79	5.00	2.79
-5.0	-7.2	6.41	2.52	6.21	2.59	6.00	2.67	5.79	2.74	5.66	2.79	5.66	2.79
0.0	-2.2	7.21	2.47	6.98	2.54	6.75	2.61	6.51	2.69	6.37	2.73	6.37	2.73
5.0	2.8	8.08	2.54	7.82	2.61	7.56	2.69	7.29	2.76	7.13	2.81	7.13	2.81
8.3	6.1	8.61	2.66	8.34	2.73	8.06	2.81	7.78	2.89	7.61	2.94	7.61	2.94
10.0	8.3	8.92	2.23	8.63	2.30	8.34	2.36	8.05	2.43	7.87	2.47	7.87	2.47
15.0	10.0	8.83	2.10	8.55	2.16	8.26	2.23	7.98	2.29	7.80	2.33	7.80	2.33
20.0	15.0	8.40	1.77	8.14	1.82	7.86	1.87	7.59	1.92	7.42	1.96	7.42	1.96
23.9	18.3	7.93	1.69	7.68	1.74	7.42	1.79	7.16	1.84	7.01	1.87	7.01	1.87

## ● Indoor units: 7,000 Btu + 18,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	16.91	2.52	16.37	2.59	15.82	2.67	15.27	2.74	14.93	2.79
	14	12	19.83	2.63	19.21	2.71	18.56	2.79	17.91	2.86	17.51	2.91
	23	19	22.39	2.70	21.68	2.77	20.95	2.85	20.22	2.93	19.77	2.98
	32	28	25.29	2.70	24.49	2.77	23.66	2.85	22.83	2.93	22.33	2.98
	41	37	28.18	2.70	27.29	2.77	26.37	2.85	25.44	2.93	24.88	2.98
	47	43	29.93	2.77	28.98	2.85	28.00	2.93	27.02	3.00	26.43	3.00
	50	47	30.91	2.72	29.94	2.80	28.93	2.88	27.91	2.96	27.30	3.00
	59	50	30.77	2.25	29.80	2.31	28.79	2.38	27.78	2.45	27.17	2.49
68	59	29.85	1.89	28.91	1.94	27.93	2.00	26.95	2.06	26.36	2.09	
75	65	29.96	1.87	29.01	1.92	28.03	1.98	27.05	2.03	26.45	2.07	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	4.96	2.52	4.80	2.59	4.64	2.67	4.47	2.74	4.38	2.79
	-10.0	-11.1	5.81	2.63	5.63	2.71	5.44	2.79	5.25	2.86	5.13	2.91
	-5.0	-7.2	6.56	2.70	6.36	2.77	6.14	2.85	5.93	2.93	5.80	2.98
	0.0	-2.2	7.41	2.70	7.18	2.77	6.93	2.85	6.69	2.93	6.54	2.98
	5.0	2.8	8.26	2.70	8.00	2.77	7.73	2.85	7.46	2.93	7.29	2.98
	8.3	6.1	8.77	2.77	8.49	2.85	8.21	2.93	7.92	3.00	7.74	3.00
	10.0	8.3	9.06	2.72	8.77	2.80	8.48	2.88	8.18	2.96	8.00	3.00
	15.0	10.0	9.02	2.25	8.73	2.31	8.44	2.38	8.14	2.45	7.96	2.49
20.0	15.0	8.75	1.89	8.47	1.94	8.19	2.00	7.90	2.06	7.73	2.09	
23.9	18.3	8.78	1.87	8.50	1.92	8.22	1.98	7.93	2.03	7.75	2.07	

## ● Indoor units: 9,000 Btu + 9,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	15.61	2.49	15.12	2.56	14.61	2.64	14.10	2.71	13.79	2.76
	14	12	18.36	2.63	17.78	2.71	17.17	2.78	16.57	2.86	16.21	2.91
	23	19	20.21	2.59	19.57	2.67	18.91	2.74	18.25	2.82	17.85	2.87
	32	28	22.62	2.52	21.91	2.59	21.17	2.66	20.43	2.74	19.98	2.78
	41	37	25.05	2.44	24.26	2.51	23.44	2.58	22.62	2.66	22.12	2.70
	47	43	26.72	2.54	25.88	2.61	25.00	2.69	24.13	2.77	23.59	2.81
	50	47	28.02	2.54	27.14	2.61	26.22	2.68	25.30	2.76	24.74	2.80
	59	50	28.33	2.21	27.44	2.27	26.51	2.34	25.58	2.40	25.02	2.44
68	59	25.14	1.85	24.35	1.91	23.52	1.96	22.70	2.02	22.20	2.05	
75	65	24.63	1.51	23.86	1.55	23.05	1.60	22.24	1.64	21.75	1.67	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	4.58	2.49	4.43	2.56	4.28	2.64	4.13	2.71	4.04	2.76
	-10.0	-11.1	5.38	2.63	5.21	2.71	5.03	2.78	4.86	2.86	4.75	2.91
	-5.0	-7.2	5.92	2.59	5.74	2.67	5.54	2.74	5.35	2.82	5.23	2.87
	0.0	-2.2	6.63	2.52	6.42	2.59	6.20	2.66	5.99	2.74	5.85	2.78
	5.0	2.8	7.34	2.44	7.11	2.51	6.87	2.58	6.63	2.66	6.48	2.70
	8.3	6.1	7.83	2.54	7.58	2.61	7.33	2.69	7.07	2.77	6.91	2.81
	10.0	8.3	8.21	2.54	7.95	2.61	7.68	2.68	7.42	2.76	7.25	2.80
	15.0	10.0	8.30	2.21	8.04	2.27	7.77	2.34	7.50	2.40	7.33	2.44
20.0	15.0	7.37	1.85	7.14	1.91	6.89	1.96	6.65	2.02	6.51	2.05	
23.9	18.3	7.22	1.51	6.99	1.55	6.76	1.60	6.52	1.64	6.38	1.67	

OUTDOOR UNIT  
UOMH24FXZJ

## ● Indoor units: 9,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	5	3	15.92	2.52	15.41	2.59	14.89	2.67	14.37	2.74	14.05	2.79	
	14	12	18.72	2.54	18.13	2.61	17.52	2.69	16.90	2.76	16.53	2.81	
	23	19	20.73	2.54	20.08	2.61	19.40	2.69	18.72	2.76	18.31	2.81	
	32	28	23.36	2.51	22.62	2.58	21.86	2.65	21.09	2.73	20.63	2.77	
	41	37	26.15	2.48	25.33	2.55	24.47	2.62	23.62	2.70	23.10	2.74	
	47	43	27.89	2.58	27.01	2.65	26.10	2.73	25.19	2.81	24.63	2.85	
	50	47	28.86	2.55	27.95	2.63	27.01	2.70	26.06	2.78	25.49	2.82	
	59	50	29.06	2.12	28.14	2.18	27.19	2.24	26.24	2.30	25.66	2.34	
	68	59	25.42	1.78	24.62	1.83	23.78	1.88	22.95	1.94	22.45	1.97	
	75	65	25.69	1.66	24.88	1.71	24.04	1.76	23.20	1.81	22.69	1.84	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	-15.0	-16.1	4.66	2.52	4.52	2.59	4.36	2.67	4.21	2.74	4.12	2.79	
	-10.0	-11.1	5.49	2.54	5.31	2.61	5.13	2.69	4.95	2.76	4.85	2.81	
	-5.0	-7.2	6.08	2.54	5.88	2.61	5.69	2.69	5.49	2.76	5.37	2.81	
	0.0	-2.2	6.85	2.51	6.63	2.58	6.41	2.65	6.18	2.73	6.05	2.77	
	5.0	2.8	7.67	2.48	7.42	2.55	7.17	2.62	6.92	2.70	6.77	2.74	
	8.3	6.1	8.18	2.58	7.92	2.65	7.65	2.73	7.38	2.81	7.22	2.85	
	10.0	8.3	8.46	2.55	8.19	2.63	7.92	2.70	7.64	2.78	7.47	2.82	
	15.0	10.0	8.52	2.12	8.25	2.18	7.97	2.24	7.69	2.30	7.52	2.34	
	20.0	15.0	7.45	1.78	7.21	1.83	6.97	1.88	6.73	1.94	6.58	1.97	
	23.9	18.3	7.53	1.66	7.29	1.71	7.05	1.76	6.80	1.81	6.65	1.84	

## ● Indoor units: 9,000 Btu + 14,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	5	3	16.54	2.52	16.02	2.59	15.48	2.67	14.94	2.74	14.61	2.79	
	14	12	19.42	2.54	18.81	2.61	18.17	2.69	17.54	2.76	17.15	2.81	
	23	19	22.01	2.54	21.31	2.61	20.59	2.69	19.87	2.76	19.43	2.81	
	32	28	24.78	2.47	24.00	2.54	23.19	2.61	22.38	2.68	21.88	2.73	
	41	37	27.69	2.53	26.82	2.60	25.91	2.68	25.00	2.75	24.45	2.80	
	47	43	29.44	2.67	28.51	2.75	27.55	2.83	26.59	2.91	26.00	2.96	
	50	47	30.63	2.28	29.66	2.35	28.66	2.42	27.65	2.48	27.04	2.53	
	59	50	30.50	2.12	29.54	2.18	28.54	2.24	27.54	2.31	26.93	2.34	
	68	59	29.56	1.78	28.63	1.83	27.66	1.89	26.69	1.94	26.10	1.97	
	75	65	27.86	1.71	26.98	1.76	26.07	1.81	25.15	1.86	24.60	1.89	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	-15.0	-16.1	4.85	2.52	4.70	2.59	4.54	2.67	4.38	2.74	4.28	2.79	
	-10.0	-11.1	5.69	2.54	5.51	2.61	5.33	2.69	5.14	2.76	5.03	2.81	
	-5.0	-7.2	6.45	2.54	6.25	2.61	6.03	2.69	5.82	2.76	5.70	2.81	
	0.0	-2.2	7.26	2.47	7.03	2.54	6.80	2.61	6.56	2.68	6.41	2.73	
	5.0	2.8	8.12	2.53	7.86	2.60	7.59	2.68	7.33	2.75	7.17	2.80	
	8.3	6.1	8.63	2.67	8.36	2.75	8.07	2.83	7.79	2.91	7.62	2.96	
	10.0	8.3	8.98	2.28	8.69	2.35	8.40	2.42	8.10	2.48	7.93	2.53	
	15.0	10.0	8.94	2.12	8.66	2.18	8.36	2.24	8.07	2.31	7.89	2.34	
	20.0	15.0	8.66	1.78	8.39	1.83	8.11	1.89	7.82	1.94	7.65	1.97	
	23.9	18.3	8.17	1.71	7.91	1.76	7.64	1.81	7.37	1.86	7.21	1.89	

OUTDOOR UNIT  
UOMH24FXZJ

## ● Indoor units: 9,000 Btu + 18,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	17.30	2.52	16.75	2.59	16.19	2.67	15.62	2.74	15.28	2.79
14	12	20.31	2.63	19.67	2.71	19.01	2.79	18.34	2.86	17.94	2.91	
23	19	22.96	2.70	22.23	2.78	21.48	2.86	20.73	2.94	20.27	2.99	
32	28	26.12	2.70	25.29	2.78	24.44	2.86	23.58	2.94	23.06	2.99	
41	37	29.06	2.70	28.14	2.78	27.24	2.86	26.24	2.94	25.66	2.99	
47	43	30.99	2.77	30.02	2.85	29.00	2.93	27.99	3.00	27.37	3.00	
50	47	32.04	2.73	31.03	2.81	29.98	2.89	28.93	2.97	28.30	3.00	
59	50	31.74	2.26	30.74	2.32	29.70	2.39	28.66	2.46	28.03	2.50	
68	59	30.93	1.90	29.96	1.95	28.94	2.01	27.93	2.06	27.32	2.10	
75	65	31.01	1.87	30.03	1.93	29.02	1.98	28.00	2.04	27.38	2.07	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	5.07	2.52	4.91	2.59	4.74	2.67	4.58	2.74	4.48	2.79
-10.0	-11.1	5.95	2.63	5.77	2.71	5.57	2.79	5.38	2.86	5.26	2.91	
-5.0	-7.2	6.73	2.70	6.52	2.78	6.30	2.86	6.07	2.94	5.94	2.99	
0.0	-2.2	7.65	2.70	7.41	2.78	7.16	2.86	6.91	2.94	6.76	2.99	
5.0	2.8	8.52	2.70	8.25	2.78	7.97	2.86	7.69	2.94	7.52	2.99	
8.3	6.1	9.08	2.77	8.80	2.85	8.50	2.93	8.20	3.00	8.02	3.00	
10.0	8.3	9.39	2.73	9.09	2.81	8.79	2.89	8.48	2.97	8.29	3.00	
15.0	10.0	9.30	2.26	9.01	2.32	8.70	2.39	8.40	2.46	8.21	2.50	
20.0	15.0	9.07	1.90	8.78	1.95	8.48	2.01	8.19	2.06	8.01	2.10	
23.9	18.3	9.09	1.87	8.80	1.93	8.50	1.98	8.21	2.04	8.03	2.07	

## ● Indoor units: 12,000 Btu + 12,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	16.62	2.70	16.10	2.78	15.55	2.86	15.01	2.94	14.68	2.99
14	12	19.57	2.70	18.95	2.78	18.31	2.86	17.67	2.94	17.28	2.99	
23	19	21.69	2.70	21.00	2.78	20.29	2.86	19.58	2.94	19.15	2.99	
32	28	24.46	2.69	23.69	2.76	22.89	2.84	22.09	2.92	21.60	2.97	
41	37	27.48	2.67	26.61	2.75	25.71	2.82	24.81	2.90	24.26	2.95	
47	43	29.28	2.77	28.36	2.85	27.40	2.93	26.44	3.00	25.86	3.00	
50	47	30.51	2.73	29.55	2.81	28.55	2.89	27.55	2.97	26.94	3.00	
59	50	30.51	2.26	29.55	2.32	28.55	2.39	27.55	2.46	26.95	2.50	
68	59	29.41	1.90	28.48	1.95	27.52	2.01	26.56	2.06	25.97	2.10	
75	65	26.96	1.78	26.11	1.83	25.23	1.89	24.35	1.94	23.81	1.97	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	4.87	2.70	4.72	2.78	4.56	2.86	4.40	2.94	4.30	2.99
-10.0	-11.1	5.74	2.70	5.55	2.78	5.37	2.86	5.18	2.94	5.06	2.99	
-5.0	-7.2	6.36	2.70	6.16	2.78	5.95	2.86	5.74	2.94	5.61	2.99	
0.0	-2.2	7.17	2.69	6.94	2.76	6.71	2.84	6.47	2.92	6.33	2.97	
5.0	2.8	8.05	2.67	7.80	2.75	7.53	2.82	7.27	2.90	7.11	2.95	
8.3	6.1	8.58	2.77	8.31	2.85	8.03	2.93	7.75	3.00	7.58	3.00	
10.0	8.3	8.94	2.73	8.66	2.81	8.37	2.89	8.07	2.97	7.90	3.00	
15.0	10.0	8.94	2.26	8.66	2.32	8.37	2.39	8.08	2.46	7.90	2.50	
20.0	15.0	8.62	1.90	8.35	1.95	8.07	2.01	7.78	2.06	7.61	2.10	
23.9	18.3	7.90	1.78	7.65	1.83	7.39	1.89	7.14	1.94	6.98	1.97	

## ● Indoor units: 12,000 Btu + 14,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	17.49	2.46	16.94	2.53	16.37	2.60	15.79	2.68	15.44	2.72	15.44	2.72
14	12	20.57	2.57	19.92	2.64	19.25	2.72	18.57	2.79	18.17	2.84	18.17	2.84
23	19	23.32	2.63	22.58	2.70	21.82	2.78	21.05	2.86	20.59	2.91	20.59	2.91
32	28	26.45	2.63	25.61	2.71	24.74	2.79	23.88	2.87	23.35	2.91	23.35	2.91
41	37	29.51	2.64	28.58	2.71	27.61	2.79	26.65	2.87	26.06	2.92	26.06	2.92
47	43	31.47	2.77	30.48	2.85	29.45	2.93	28.42	3.00	27.79	3.00	27.79	3.00
50	47	32.56	2.30	31.53	2.37	30.47	2.44	29.40	2.51	28.75	2.55	28.75	2.55
59	50	32.47	2.19	31.44	2.26	30.38	2.32	29.32	2.39	28.67	2.43	28.67	2.43
68	59	31.43	1.84	30.44	1.90	29.41	1.95	28.38	2.01	27.76	2.04	27.76	2.04
75	65	30.88	1.90	29.91	1.95	28.90	2.01	27.88	2.06	27.27	2.10	27.27	2.10

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	5.13	2.46	4.96	2.53	4.80	2.60	4.63	2.68	4.53	2.72	4.53	2.72
-10.0	-11.1	6.03	2.57	5.84	2.64	5.64	2.72	5.44	2.79	5.32	2.84	5.32	2.84
-5.0	-7.2	6.83	2.63	6.62	2.70	6.39	2.78	6.17	2.86	6.03	2.91	6.03	2.91
0.0	-2.2	7.75	2.63	7.51	2.71	7.25	2.79	7.00	2.87	6.84	2.91	6.84	2.91
5.0	2.8	8.65	2.64	8.38	2.71	8.09	2.79	7.81	2.87	7.64	2.92	7.64	2.92
8.3	6.1	9.22	2.77	8.93	2.85	8.63	2.93	8.33	3.00	8.15	3.00	8.15	3.00
10.0	8.3	9.54	2.30	9.24	2.37	8.93	2.44	8.62	2.51	8.43	2.55	8.43	2.55
15.0	10.0	9.52	2.19	9.22	2.26	8.90	2.32	8.59	2.39	8.40	2.43	8.40	2.43
20.0	15.0	9.21	1.84	8.92	1.90	8.62	1.95	8.32	2.01	8.14	2.04	8.14	2.04
23.9	18.3	9.05	1.90	8.77	1.95	8.47	2.01	8.17	2.06	7.99	2.10	7.99	2.10

## ● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	16.48	2.40	15.96	2.46	15.42	2.54	14.88	2.61	14.55	2.65	14.55	2.65
14	12	19.17	2.50	18.57	2.57	17.94	2.65	17.31	2.72	16.93	2.77	16.93	2.77
23	19	21.72	2.61	21.03	2.68	20.32	2.76	19.61	2.84	19.18	2.88	19.18	2.88
32	28	24.86	2.78	24.08	2.86	23.26	2.94	22.45	3.00	21.96	3.00	21.96	3.00
41	37	28.16	2.66	27.27	2.73	26.35	2.81	25.43	2.89	24.87	2.94	24.87	2.94
47	43	30.03	2.68	29.08	2.76	28.10	2.84	27.12	2.92	26.52	2.97	26.52	2.97
50	47	31.15	2.71	30.17	2.79	29.15	2.87	28.13	2.95	27.51	3.00	27.51	3.00
59	50	32.65	2.71	31.62	2.79	30.55	2.87	29.48	2.95	28.83	3.00	28.83	3.00
68	59	29.96	2.10	29.01	2.16	28.03	2.22	27.05	2.28	26.45	2.32	26.45	2.32
75	65	27.94	1.64	27.05	1.69	26.14	1.74	25.22	1.78	24.67	1.81	24.67	1.81

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	4.83	2.40	4.68	2.46	4.52	2.54	4.36	2.61	4.26	2.65	4.26	2.65
-10.0	-11.1	5.62	2.50	5.44	2.57	5.26	2.65	5.07	2.72	4.96	2.77	4.96	2.77
-5.0	-7.2	6.37	2.61	6.16	2.68	5.96	2.76	5.75	2.84	5.62	2.88	5.62	2.88
0.0	-2.2	7.29	2.78	7.06	2.86	6.82	2.94	6.58	3.00	6.43	3.00	6.43	3.00
5.0	2.8	8.25	2.66	7.99	2.73	7.72	2.81	7.45	2.89	7.29	2.94	7.29	2.94
8.3	6.1	8.80	2.68	8.52	2.76	8.24	2.84	7.95	2.92	7.77	2.97	7.77	2.97
10.0	8.3	9.13	2.71	8.84	2.79	8.54	2.87	8.24	2.95	8.06	3.00	8.06	3.00
15.0	10.0	9.57	2.71	9.27	2.79	8.95	2.87	8.64	2.95	8.45	3.00	8.45	3.00
20.0	15.0	8.78	2.10	8.50	2.16	8.21	2.22	7.93	2.28	7.75	2.32	7.75	2.32
23.9	18.3	8.19	1.64	7.93	1.69	7.66	1.74	7.39	1.78	7.23	1.81	7.23	1.81



## ● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	17.47	2.33	16.92	2.40	16.35	2.47	15.78	2.54	15.43	2.58	
	14	12	20.33	2.45	19.69	2.52	19.02	2.59	18.36	2.67	17.95	2.71	
	23	19	23.03	2.54	22.30	2.61	21.55	2.69	20.80	2.76	20.34	2.81	
	32	28	26.37	2.71	25.54	2.79	24.67	2.87	23.81	2.95	23.28	3.00	
	41	37	29.86	2.71	28.92	2.79	27.94	2.87	26.96	2.95	26.37	3.00	
	47	43	31.85	2.77	30.84	2.85	29.80	2.93	28.76	3.00	28.12	3.00	
	50	47	33.04	2.71	32.00	2.79	30.91	2.87	29.83	2.95	29.17	3.00	
	59	50	34.63	2.67	33.53	2.75	32.40	2.83	31.27	2.91	30.58	2.96	
68	59	31.77	2.03	30.77	2.09	29.72	2.15	28.68	2.21	28.05	2.24		
75	65	29.61	1.70	28.68	1.75	27.71	1.80	26.74	1.85	26.15	1.88		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	5.12	2.33	4.96	2.40	4.79	2.47	4.62	2.54	4.52	2.58	
	-10.0	-11.1	5.96	2.45	5.77	2.52	5.58	2.59	5.38	2.67	5.26	2.71	
	-5.0	-7.2	6.75	2.54	6.54	2.61	6.32	2.69	6.10	2.76	5.96	2.81	
	0.0	-2.2	7.73	2.71	7.48	2.79	7.23	2.87	6.98	2.95	6.82	3.00	
	5.0	2.8	8.75	2.71	8.48	2.79	8.19	2.87	7.90	2.95	7.73	3.00	
	8.3	6.1	9.33	2.77	9.04	2.85	8.73	2.93	8.43	3.00	8.24	3.00	
	10.0	8.3	9.68	2.71	9.38	2.79	9.06	2.87	8.74	2.95	8.55	3.00	
	15.0	10.0	10.15	2.67	9.83	2.75	9.50	2.83	9.16	2.91	8.96	2.96	
20.0	15.0	9.31	2.03	9.02	2.09	8.71	2.15	8.41	2.21	8.22	2.24		
23.9	18.3	8.68	1.70	8.40	1.75	8.12	1.80	7.84	1.85	7.66	1.88		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	17.59	2.28	17.03	2.34	16.46	2.41	15.88	2.48	15.53	2.52	
	14	12	20.47	2.39	19.82	2.46	19.15	2.53	18.48	2.60	18.07	2.65	
	23	19	23.19	2.48	22.45	2.55	21.70	2.63	20.94	2.70	20.47	2.74	
	32	28	26.54	2.68	25.71	2.76	24.84	2.84	23.97	2.92	23.44	2.97	
	41	37	30.06	2.68	29.11	2.76	28.13	2.84	27.14	2.92	26.55	2.97	
	47	43	32.06	2.70	31.05	2.78	30.00	2.86	28.95	2.94	28.31	2.99	
	50	47	33.26	2.68	32.21	2.76	31.12	2.84	30.03	2.92	29.37	2.97	
	59	50	34.86	2.60	33.76	2.67	32.62	2.75	31.48	2.82	30.78	2.87	
68	59	31.98	1.98	30.97	2.04	29.92	2.10	28.88	2.15	28.24	2.19		
75	65	32.45	1.77	31.43	1.82	30.36	1.87	29.30	1.93	28.66	1.96		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	5.16	2.28	4.99	2.34	4.82	2.41	4.65	2.48	4.55	2.52	
	-10.0	-11.1	6.00	2.39	5.81	2.46	5.61	2.53	5.42	2.60	5.30	2.65	
	-5.0	-7.2	6.80	2.48	6.58	2.55	6.36	2.63	6.14	2.70	6.00	2.74	
	0.0	-2.2	7.78	2.68	7.53	2.76	7.28	2.84	7.02	2.92	6.87	2.97	
	5.0	2.8	8.81	2.68	8.53	2.76	8.24	2.84	7.96	2.92	7.78	2.97	
	8.3	6.1	9.40	2.70	9.10	2.78	8.79	2.86	8.48	2.94	8.30	2.99	
	10.0	8.3	9.75	2.68	9.44	2.76	9.12	2.84	8.80	2.92	8.61	2.97	
	15.0	10.0	10.22	2.60	9.89	2.67	9.56	2.75	9.23	2.82	9.02	2.87	
20.0	15.0	9.37	1.98	9.08	2.04	8.77	2.10	8.46	2.15	8.28	2.19		
23.9	18.3	9.51	1.77	9.21	1.82	8.90	1.87	8.59	1.93	8.40	1.96		

OUTDOOR UNIT  
UOMH24FXZJ

## ● Indoor units: 7,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	17.59	2.33	17.03	2.40	16.46	2.47	15.88	2.54	15.53	2.58	
	14	12	20.47	2.45	19.82	2.52	19.15	2.59	18.48	2.67	18.07	2.71	
	23	19	23.19	2.54	22.45	2.61	21.70	2.69	20.94	2.76	20.47	2.81	
	32	28	26.54	2.71	25.71	2.79	24.84	2.87	23.97	2.95	23.44	3.00	
	41	37	30.06	2.71	29.11	2.79	28.13	2.87	27.14	2.95	26.55	3.00	
	47	43	32.06	2.77	31.05	2.85	30.00	2.93	28.95	3.00	28.31	3.00	
	50	47	33.26	2.71	32.21	2.79	31.12	2.87	30.03	2.95	29.37	3.00	
	59	50	34.86	2.67	33.76	2.75	32.62	2.83	31.48	2.91	30.78	2.96	
	68	59	31.98	2.03	30.97	2.09	29.92	2.15	28.88	2.21	28.24	2.24	
75	65	32.09	1.77	31.08	1.82	30.03	1.87	28.98	1.92	28.34	1.96		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW		kW		kW		kW		kW		
	-15.0	-16.1	5.16	2.33	4.99	2.40	4.82	2.47	4.65	2.54	4.55	2.58	
	-10.0	-11.1	6.00	2.45	5.81	2.52	5.61	2.59	5.42	2.67	5.30	2.71	
	-5.0	-7.2	6.80	2.54	6.58	2.61	6.36	2.69	6.14	2.76	6.00	2.81	
	0.0	-2.2	7.78	2.71	7.53	2.79	7.28	2.87	7.02	2.95	6.87	3.00	
	5.0	2.8	8.81	2.71	8.53	2.79	8.24	2.87	7.96	2.95	7.78	3.00	
	8.3	6.1	9.40	2.77	9.10	2.85	8.79	2.93	8.48	3.00	8.30	3.00	
	10.0	8.3	9.75	2.71	9.44	2.79	9.12	2.87	8.80	2.95	8.61	3.00	
	15.0	10.0	10.22	2.67	9.89	2.75	9.56	2.83	9.23	2.91	9.02	2.96	
	20.0	15.0	9.37	2.03	9.08	2.09	8.77	2.15	8.46	2.21	8.28	2.24	
23.9	18.3	9.41	1.77	9.11	1.82	8.80	1.87	8.49	1.92	8.31	1.96		


## ● Indoor units: 9,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	17.59	2.33	17.03	2.40	16.46	2.47	15.88	2.54	15.53	2.58	
	14	12	20.47	2.45	19.82	2.52	19.15	2.59	18.48	2.67	18.07	2.71	
	23	19	23.19	2.54	22.45	2.61	21.70	2.69	20.94	2.76	20.47	2.81	
	32	28	26.54	2.71	25.71	2.79	24.84	2.87	23.97	2.95	23.44	3.00	
	41	37	30.06	2.71	29.11	2.79	28.13	2.87	27.14	2.95	26.55	3.00	
	47	43	32.06	2.77	31.05	2.85	30.00	2.93	28.95	3.00	28.31	3.00	
	50	47	33.26	2.71	32.21	2.79	31.12	2.87	30.03	2.95	29.37	3.00	
	59	50	34.86	2.67	33.76	2.75	32.62	2.83	31.48	2.91	30.78	2.96	
	68	59	31.98	2.03	30.97	2.09	29.92	2.15	28.88	2.21	28.24	2.24	
75	65	32.09	1.78	31.07	1.83	30.02	1.88	28.97	1.93	28.33	1.96		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW		kW		kW		kW		kW		
	-15.0	-16.1	5.16	2.33	4.99	2.40	4.82	2.47	4.65	2.54	4.55	2.58	
	-10.0	-11.1	6.00	2.45	5.81	2.52	5.61	2.59	5.42	2.67	5.30	2.71	
	-5.0	-7.2	6.80	2.54	6.58	2.61	6.36	2.69	6.14	2.76	6.00	2.81	
	0.0	-2.2	7.78	2.71	7.53	2.79	7.28	2.87	7.02	2.95	6.87	3.00	
	5.0	2.8	8.81	2.71	8.53	2.79	8.24	2.87	7.96	2.95	7.78	3.00	
	8.3	6.1	9.40	2.77	9.10	2.85	8.79	2.93	8.48	3.00	8.30	3.00	
	10.0	8.3	9.75	2.71	9.44	2.79	9.12	2.87	8.80	2.95	8.61	3.00	
	15.0	10.0	10.22	2.67	9.89	2.75	9.56	2.83	9.23	2.91	9.02	2.96	
	20.0	15.0	9.37	2.03	9.08	2.09	8.77	2.15	8.46	2.21	8.28	2.24	
23.9	18.3	9.40	1.78	9.11	1.83	8.80	1.88	8.49	1.93	8.30	1.96		

OUTDOOR UNIT  
UOMH24FXZJ

# 7. Capacity compensation rate for pipe length and height difference

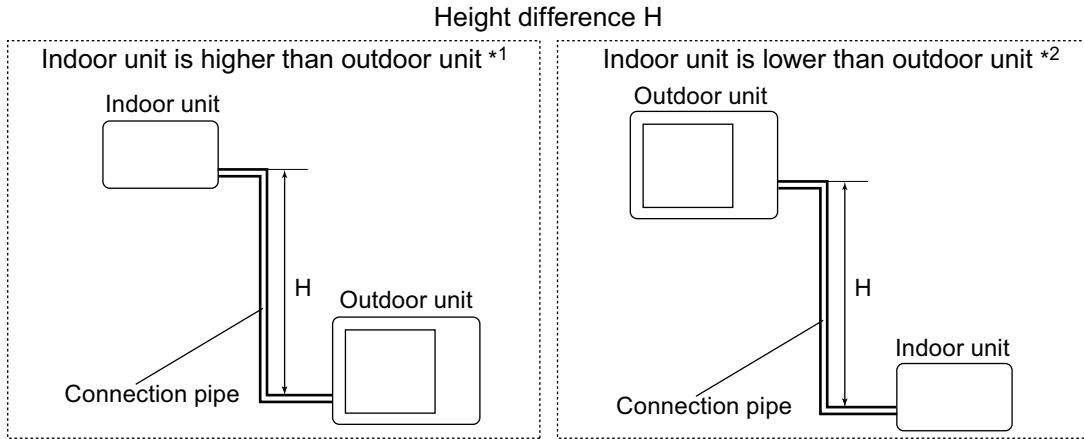

## 7-1. Model: UOMH24AFXZJ

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

### ■ Indoor unit: 7,000 Btu

COOLING		Pipe length							
		m	ft	5	7.5	10	15	20	25
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.956	0.942	0.928
		10	33	-	-	0.977	0.963	0.950	0.936
		7.5	25	-	0.988	0.981	0.967	0.953	0.940
		5	16	0.995	0.992	0.985	0.971	0.957	0.943
		0	0	1.003	1.000	0.993	0.979	0.965	0.951
	Indoor unit is lower than outdoor unit *2	-5	-16	1.003	1.000	0.993	0.979	0.965	0.951
		-7.5	-25	-	1.000	0.993	0.979	0.965	0.951
		-10	-33	-	-	0.993	0.979	0.965	0.951
		-15	-49	-	-	-	0.979	0.965	0.951

HEATING		Pipe length							
		m	ft	5	7.5	10	15	20	25
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.977	0.958	0.939
		10	33	-	-	0.993	0.977	0.958	0.939
		7.5	25	-	1.000	0.993	0.977	0.958	0.939
		5	16	0.990	1.000	0.993	0.977	0.958	0.939
		0	0	0.990	1.000	0.993	0.977	0.958	0.939
	Indoor unit is lower than outdoor unit *2	-5	-16	0.985	0.995	0.988	0.972	0.953	0.934
		-7.5	-25	-	0.993	0.986	0.970	0.951	0.932
		-10	-33	-	-	0.983	0.967	0.948	0.930
		-15	-49	-	-	-	0.962	0.944	0.925

OUTDOOR UNIT  
UOMH24AFXZJ

## ■ Indoor unit: 9,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.956	0.942	0.928
		10	33	-	-	0.977	0.963	0.950	0.936
		7.5	25	-	0.988	0.981	0.967	0.953	0.940
		5	16	0.999	0.992	0.985	0.971	0.957	0.943
	0	0	1.007	1.000	0.993	0.979	0.965	0.951	
Indoor unit is lower than outdoor unit *2	-5	-16	1.007	1.000	0.993	0.979	0.965	0.951	
	-7.5	-25	-	1.000	0.993	0.979	0.965	0.951	
	-10	-33	-	-	0.993	0.979	0.965	0.951	
	-15	-49	-	-	-	0.979	0.965	0.951	

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.977	0.958	0.939
		10	33	-	-	0.993	0.977	0.958	0.939
		7.5	25	-	1.000	0.993	0.977	0.958	0.939
		5	16	0.993	1.000	0.993	0.977	0.958	0.939
	0	0	0.993	1.000	0.993	0.977	0.958	0.939	
Indoor unit is lower than outdoor unit *2	-5	-16	0.988	0.995	0.988	0.972	0.953	0.934	
	-7.5	-25	-	0.993	0.986	0.970	0.951	0.932	
	-10	-33	-	-	0.983	0.967	0.948	0.930	
	-15	-49	-	-	-	0.962	0.944	0.925	

## ■ Indoor unit: 12,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.933	0.899	0.859
		10	33	-	-	0.970	0.940	0.906	0.866
		7.5	25	-	0.988	0.974	0.944	0.910	0.869
		5	16	1.006	0.992	0.978	0.948	0.913	0.873
	0	0	1.014	1.000	0.986	0.956	0.921	0.880	
Indoor unit is lower than outdoor unit *2	-5	-16	1.014	1.000	0.986	0.956	0.921	0.880	
	-7.5	-25	-	1.000	0.986	0.956	0.921	0.880	
	-10	-33	-	-	0.986	0.956	0.921	0.880	
	-15	-49	-	-	-	0.956	0.921	0.880	

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.975	0.957	0.940
		10	33	-	-	0.990	0.975	0.957	0.940
		7.5	25	-	1.000	0.990	0.975	0.957	0.940
		5	16	0.995	1.000	0.990	0.975	0.957	0.940
	0	0	0.995	1.000	0.990	0.975	0.957	0.940	
Indoor unit is lower than outdoor unit *2	-5	-16	0.990	0.995	0.985	0.970	0.952	0.936	
	-7.5	-25	-	0.993	0.983	0.968	0.950	0.934	
	-10	-33	-	-	0.980	0.965	0.947	0.931	
	-15	-49	-	-	-	0.960	0.943	0.926	

## ■ Indoor unit: 14,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.969	0.962	0.953
		10	33	-	-	0.982	0.977	0.970	0.961
		7.5	25	-	0.988	0.986	0.981	0.973	0.965
		5	16	0.994	0.992	0.990	0.985	0.977	0.968
	Indoor unit is lower than outdoor unit *2	0	0	1.002	1.000	0.998	0.993	0.985	0.976
		-5	-16	1.002	1.000	0.998	0.993	0.985	0.976
		-7.5	-25	-	1.000	0.998	0.993	0.985	0.976
		-10	-33	-	-	0.998	0.993	0.985	0.976
		-15	-49	-	-	-	0.993	0.985	0.976

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.967	0.943	0.917
		10	33	-	-	0.990	0.967	0.943	0.917
		7.5	25	-	1.000	0.990	0.967	0.943	0.917
		5	16	1.010	1.000	0.990	0.967	0.943	0.917
	Indoor unit is lower than outdoor unit *2	0	0	1.010	1.000	0.990	0.967	0.943	0.917
		-5	-16	1.005	0.995	0.985	0.962	0.938	0.912
		-7.5	-25	-	0.993	0.983	0.960	0.936	0.911
		-10	-33	-	-	0.980	0.957	0.934	0.908
		-15	-49	-	-	-	0.952	0.929	0.903

## ■ Indoor unit: 18,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.977	0.968	0.953
		10	33	-	-	0.986	0.985	0.976	0.960
		7.5	25	-	0.988	0.990	0.989	0.980	0.964
		5	16	0.989	0.992	0.994	0.993	0.984	0.968
	Indoor unit is lower than outdoor unit *2	0	0	0.997	1.000	1.002	1.002	0.992	0.976
		-5	-16	0.997	1.000	1.002	1.002	0.992	0.976
		-7.5	-25	-	1.000	1.002	1.002	0.992	0.976
		-10	-33	-	-	1.002	1.002	0.992	0.976
		-15	-49	-	-	-	1.002	0.992	0.976

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.964	0.939	0.913
		10	33	-	-	0.988	0.964	0.939	0.913
		7.5	25	-	1.000	0.988	0.964	0.939	0.913
		5	16	1.008	1.000	0.988	0.964	0.939	0.913
	Indoor unit is lower than outdoor unit *2	0	0	1.008	1.000	0.988	0.964	0.939	0.913
		-5	-16	1.003	0.995	0.983	0.959	0.934	0.908
		-7.5	-25	-	0.993	0.981	0.957	0.932	0.907
		-10	-33	-	-	0.978	0.954	0.930	0.904
		-15	-49	-	-	-	0.950	0.925	0.899

## 8. Additional charge calculation

### 8-1. Model: UOMH24AFXZJ

Refrigerant type		R410A
Refrigerant amount	lb oz	4 lb 14 oz
	g	2,200

#### ■ Refrigerant charge

Total pipe length	ft	98 or less	131	164 (Max.)	0.21 oz/ft (20 g/m)
	m	30 or less	40	50 (Max.)	
Additional charge	lb oz	0	7.1 oz	14.1 oz	
	g	0	200	400	

---

## 9. Airflow

---

### 9-1. Model: UOMH24AFXZJ

#### ● Cooling

m <sup>3</sup> /h	3,300
l/s	917
CFM	1,942

#### ● Heating


m <sup>3</sup> /h	3,300
l/s	917
CFM	1,942

# 10. Operation noise (sound pressure)


## 10-1. Noise level curve

■ Model: UOMH24AFXZJ

● Cooling

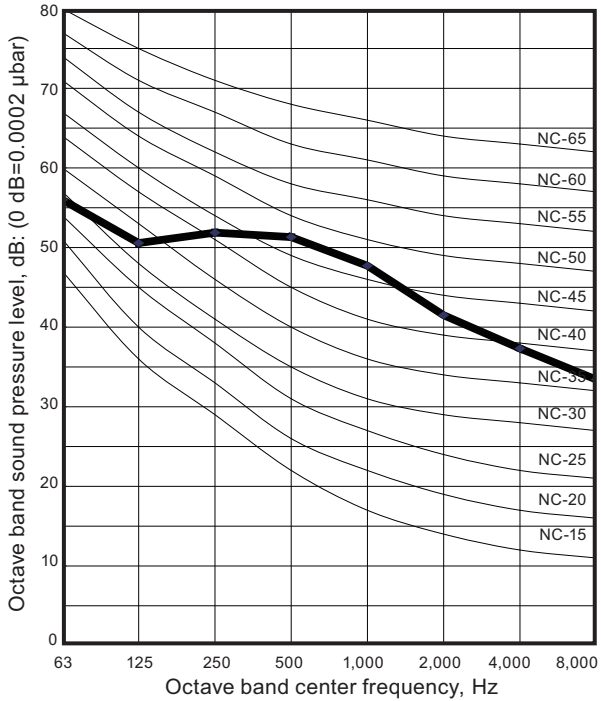


● Heating

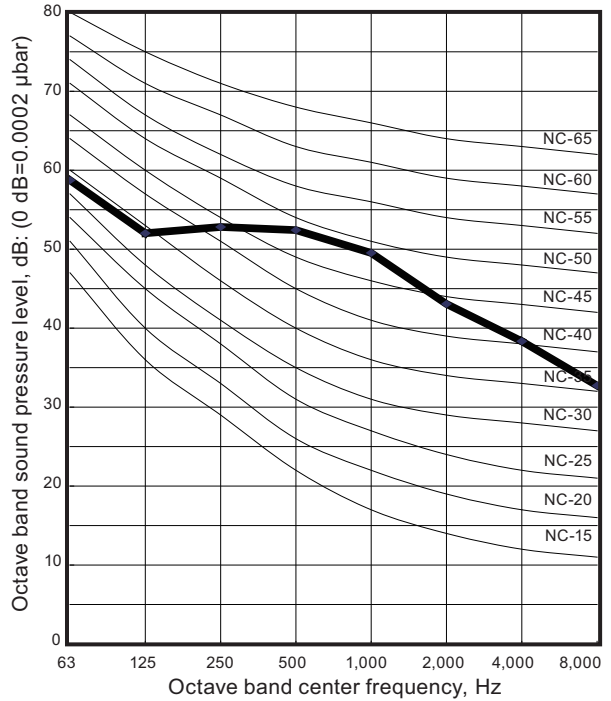

OUTDOOR UNIT  
UOMH24AFXZJ

## 10-2. Sound level check point

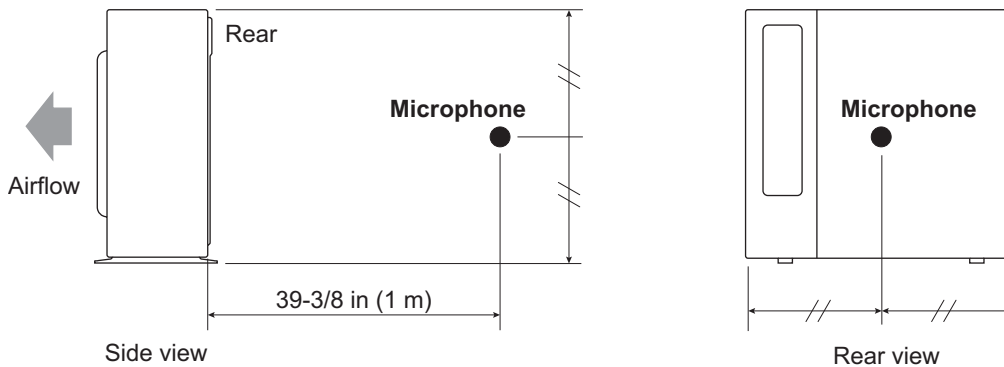

**NOTE:** Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.



## 11. Electrical characteristics

Model name			UOMH24AFXZJ
Power supply	Voltage	V	208/230 ~
	Frequency	Hz	60
MCA *1		A	17
Starting current		A	9.0
Wiring spec. *2	MAX. CKT. BKR *3	A	20
	Power cable	AWG	12

\*1: Minimum Circuit Ampacity (Calculation based on UL1995)

\*2: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005.  
As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.





\*3: Maximum Circuit Breaker

## 12. Safety devices

Type of protection	Protection form		Model
			UOMH24AFXZJ
Circuit protection	Current fuse (Main PCB)		250 V, 5 A 250 V, 3.15 A
	Current fuse (Near the terminal)		250 V, 10 A
Fan motor protection	Temperature thermistor	Activate	302 ±27 °F (150 ±15 °C) Fan motor stop
		Reset	248 ±27 °F (120 ±15 °C) Fan motor restart
Compressor protection	Temperature thermistor	Activate	230 ±4 °F (110 ±2 °C) Compressor stop
		Reset	176 ±4 °F (80 ±2 °C) Compressor restart
Refrigerant circuit protection	Pressure switch 1	Activate	609 ±15 PSI (4.2 ±0.1 MPa)
		Reset	464 ±22 PSI (3.2 ±0.15 MPa)

\*Pressure switch 2: For control device. (Refer to the wiring diagram.)

## 13. Accessories

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Drain pipe		1
Drain cap		5	Adapter assembly, 1/2 (12.7)→3/8 (9.52) [in (mm)]	 Washer Adapter	2

## 14. Outdoor unit installation precautions

**NOTE:** The information listed below are general precautions.  
Some models also include items that do not apply.

### 14-1. Place where prohibited for use

- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places not affected by heat radiation from other heat sources.
- Places where the air is not stagnant.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are product.

### 14-2. Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the outdoor unit.
- To allow maintenance after refrigerant piping, drain piping, and electric wiring connection and installation, provide an installation service space.  
\*Installation service space is shown in "[Installation space](#)" on page 110.
- Be careful when installing the set at the following places.

Condition	Contents	Countermeasures (Reference)
When installed near adjacent houses.	Perform installation work so that operating sound does not disturb the neighbors.	<ol style="list-style-type: none"><li>1. Install a soundproof barrier.</li><li>2. Change the installation site.</li></ol>
When there is the possibility of strong wind.	<ul style="list-style-type: none"><li>• If the outdoor unit is exposed to strong wind, capacity may drop, frost may form during heating, and operation may be stopped by high pressure rise. In addition, when a very strong wind blows, the fan may be damaged.</li><li>• When a very strong wind blows, there is the possibility of the outdoor unit being toppled over if held only by foundation bolts.</li></ul>	<ol style="list-style-type: none"><li>1. Install the outdoor unit with keeping a sufficient distance between the outlet side of the unit and a facing wall or fence.</li><li>2. Make the outlet direction and wind direction perpendicular.</li><li>3. Fasten the outdoor unit using toppling prevention hardware (purchased locally).</li></ol>
When snow accumulates.	If the outdoor unit is covered by accumulated snow, it may not be able to operate.	<ol style="list-style-type: none"><li>1. Make the foundation as high as possible.</li><li>2. Perform snow prevention work.</li></ol>
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.

# **Part 4. OUTDOOR UNIT (4 ROOMS TYPE)**

---

**MULTI TYPE:  
UOMH36AFXZJ**

# 1. Specifications

## 1-1. Model: UOMH36AFXZJ

Type				Inverter heat pump	
Model name				UOMH36AFXZJ	
Power source				1Ø 208/230 V 60 Hz	
Available voltage range				187—264V	
Connectable indoor unit		Number		2 to 4	
		Total capacity range		27,000 to 39,000 Btu/h	
Combination of indoor unit				UIWH09AVFJ × 4	
Capacity	Cooling	Rated	Btu/h	35,200	
			kW	10.3	
		Min.—Max.	Btu/h	11,000—38,000	
	Heating	Rated	kW	3.2—11.1	
			Btu/h	36,400	
		Min.—Max.	Btu/h	11,000—42,000	
				kW	3.2—12.3
Input power	Cooling	Rated	kW	3.52	
				Max.	4.10
	Heating	Rated		3.00	
				Max.	3.70
Current	Cooling	Rated	A	15.4	
	Heating		A	13.1	
EER	Cooling	Rated	Btu/W	10.0	
SEER *1	Cooling		-	18.0	
COP	Heating	Rated	W/W	3.56	
HSPF *1	Heating		-	9.4	
Starting current				A	17.1
Maximum operating current *2				A	20.3
Fan	Type × Q'ty		Propeller × 1		
	Airflow rate	Cooling	CFM (m <sup>3</sup> /h)	2,119 (3,600)	
		Heating		2,237 (3,800)	
	Motor	Type × Quantity		DC motor × 1	
Output		W	100		
Sound pressure level	Cooling	Rated	dB (A)	53	
	Heating			55	
Heat exchanger	Dimension (H × W × D)		in (mm)	31-13/32 × 35-7/16 × 1-7/16 (798 × 900 × 36.38)	
	Fin pitch		FPI	20	
	Rows × Stages		2 × 38		
	Pipe type (Material)		Grooved H-pin (Copper)		
	Fin		Type (Material)	Corrugate (Aluminum)	
				Surface treatment	Corrosion resistance (Blue Fin)
Compressor	Type × Quantity		DC twin rotary × 1		
	Motor output		W	2,100	
Refrigerant	Type		R410A		
	Charge		lb (g)	7 lb 1 oz (3,200)	
Refrigerant oil	Type		RB68		
	Amount		in <sup>3</sup> (cm <sup>3</sup> )	48.8 (800)	
Enclosure	Material		Painted galvanized steel		
	Color		Beige (Approximate color of MUNSELL 10YR 7.5/1.0NN)		
Dimensions	Net	(H × W × D)	in (mm)	32-11/16 × 35-7/16 × 13 (830 × 900 × 330)	
	Gross			39-3/8 × 41-5/16 × 17-1/2 (1,000 × 1,050 × 445)	
Weight	Net		lb (kg)	149 (68)	
	Gross			168 (76)	
Connection pipe	Size	Liquid	in (mm)	Ø1/4 (Ø6.35) × 4	
		Gas		Ø3/8 (Ø9.52) × 3 + Ø1/2 (Ø12.7) × 1	
	Method		Flare		
	Pre-charge length (Total)		164 (50)		
	Max. length (Total)		230 (70)		
	Max. length (Each)		82 (25)		
	Min. length (Total)		66 (20)		
	Min. length (Each)		16 (5)		
	Max. height difference between outdoor unit and each indoor units		49 (15)		
	Max. height difference between indoor units		33 (10)		
Operation range	Cooling	°F (°C)		14 to 115 (-10 to 46)	
	Heating			5 to 75 (-15 to 24)	


### NOTES:

- Specifications are based on the following conditions:
  - Power source of specifications: 230 V
  - Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
  - Cooling: Indoor temperature of 80 °FDB (26.7 °CDB)/67 °FWB (19.4 °CWB), and outdoor temperature of 95 °FDB (35 °CDB)/75 °FWB (23.9 °CWB).
  - Heating: Indoor temperature of 70 °FDB (21.1 °CDB)/60 °FWB (15.6 °CWB), and outdoor temperature of 47 °FDB (8.3 °CDB)/43 °FWB (6.1 °CWB).
  - \*1: Test conditions are based on AHRI 210/240.
  - \*2: The maximum current is the maximum value when the operated within the operation range.
- For other combination, refer to the combination table.
- The protective function might work when using it outside the operation range.

## 2. Dimensions

### 2-1. Model: UOMH36AFXZJ

Unit: in (mm)

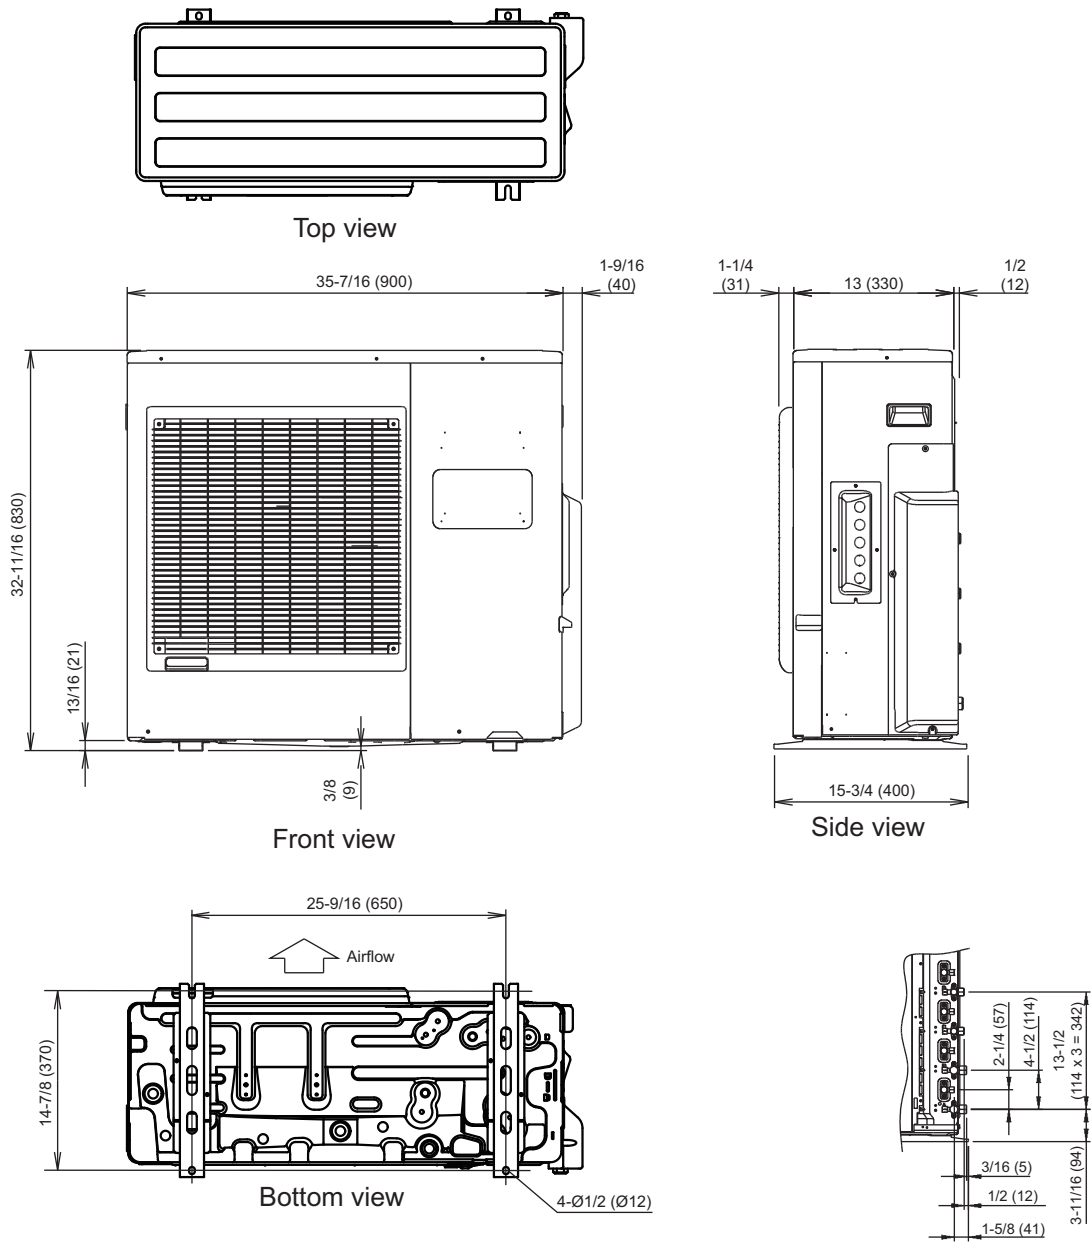

OUTDOOR UNIT  
UOMH36AFXZJ

# 3. Installation space

## 3-1. Model: UOMH36AFXZJ

### ■ Space requirement


Provide sufficient installation space for product safety.

#### ● Single outdoor unit installation


- When the upper space is open:

Unit: in (mm)


When there are obstacles at the rear only.

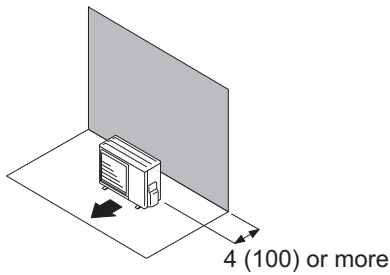


When there are obstacles at the rear and sides.

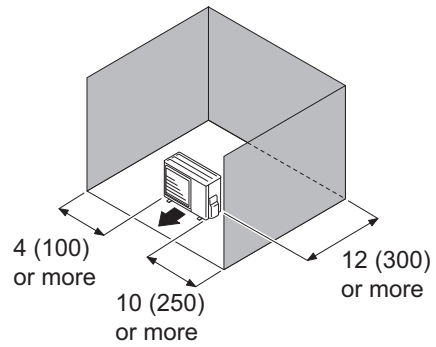

When there are obstacles at the front only.

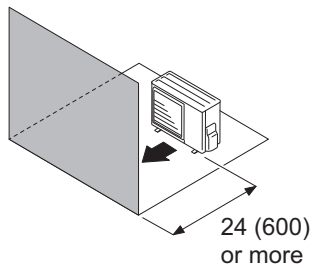


When there are obstacles at the front and rear.

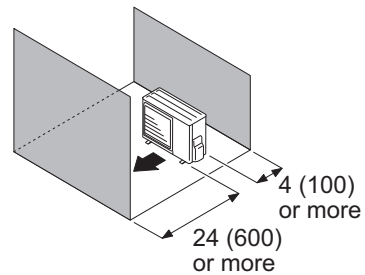


- When there is an obstruction in the upper space:

Unit: in (mm)

When there are obstacles at the rear and above.

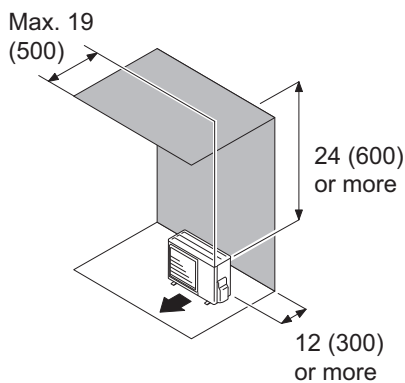

When there are obstacles at the rear, sides, and above.

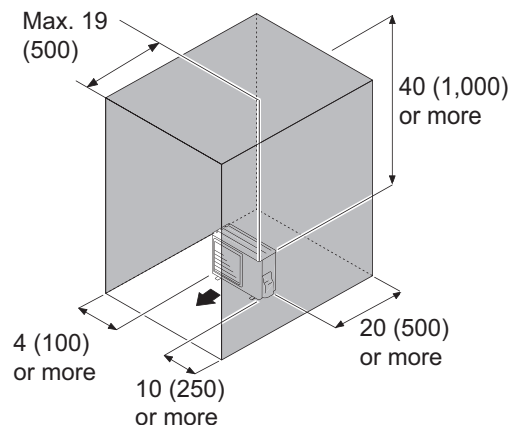





## ● Multiple outdoor unit installation

- When the upper space is open:


Unit: in (mm)

When there are obstacles at the rear only.

When there are obstacles at the front only.

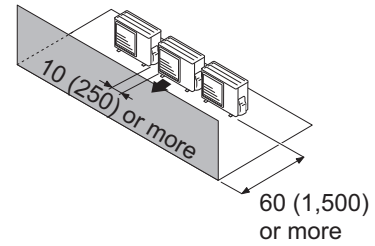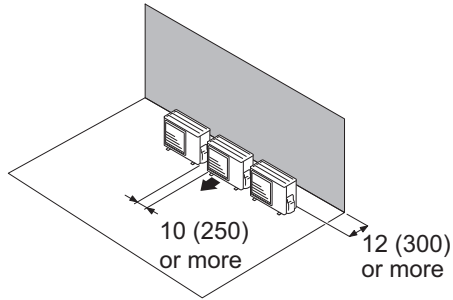


When there are obstacles at the front and rear.

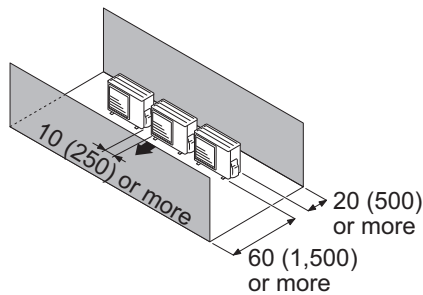

- When there is an obstruction in the upper space:

Unit: in (mm)


When there are obstacles at the rear and above.

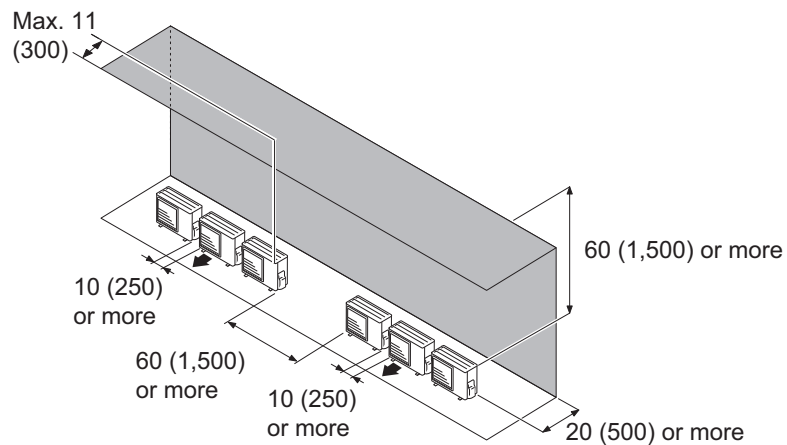



## ● Outdoor unit installation in multi-row

Unit: in (mm)

Single parallel unit arrangement

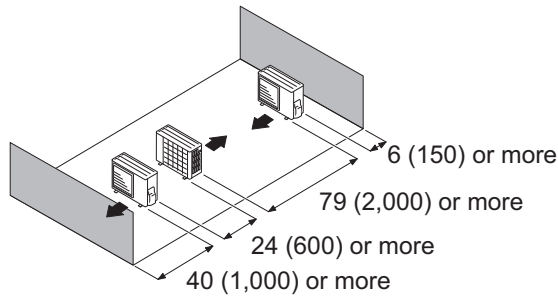

Multiple parallel unit arrangement

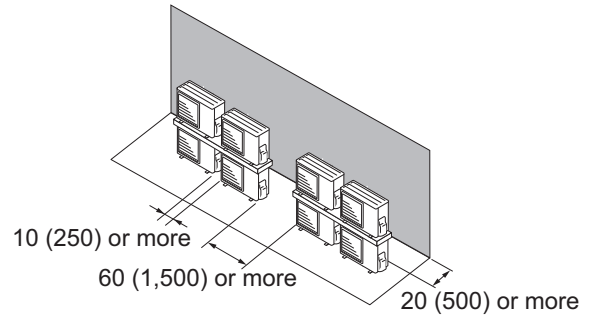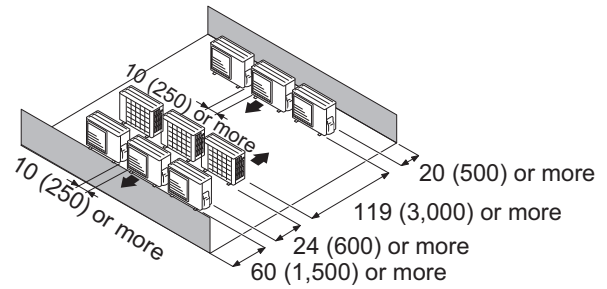


### NOTES:

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- Height above the floor level should be 2 in (50 mm) or more.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.


### ⚠ CAUTION

- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 32 °F (0 °C) or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.



# 4. Refrigerant circuit

## 4-1. Model: UOMH36AFXZJ

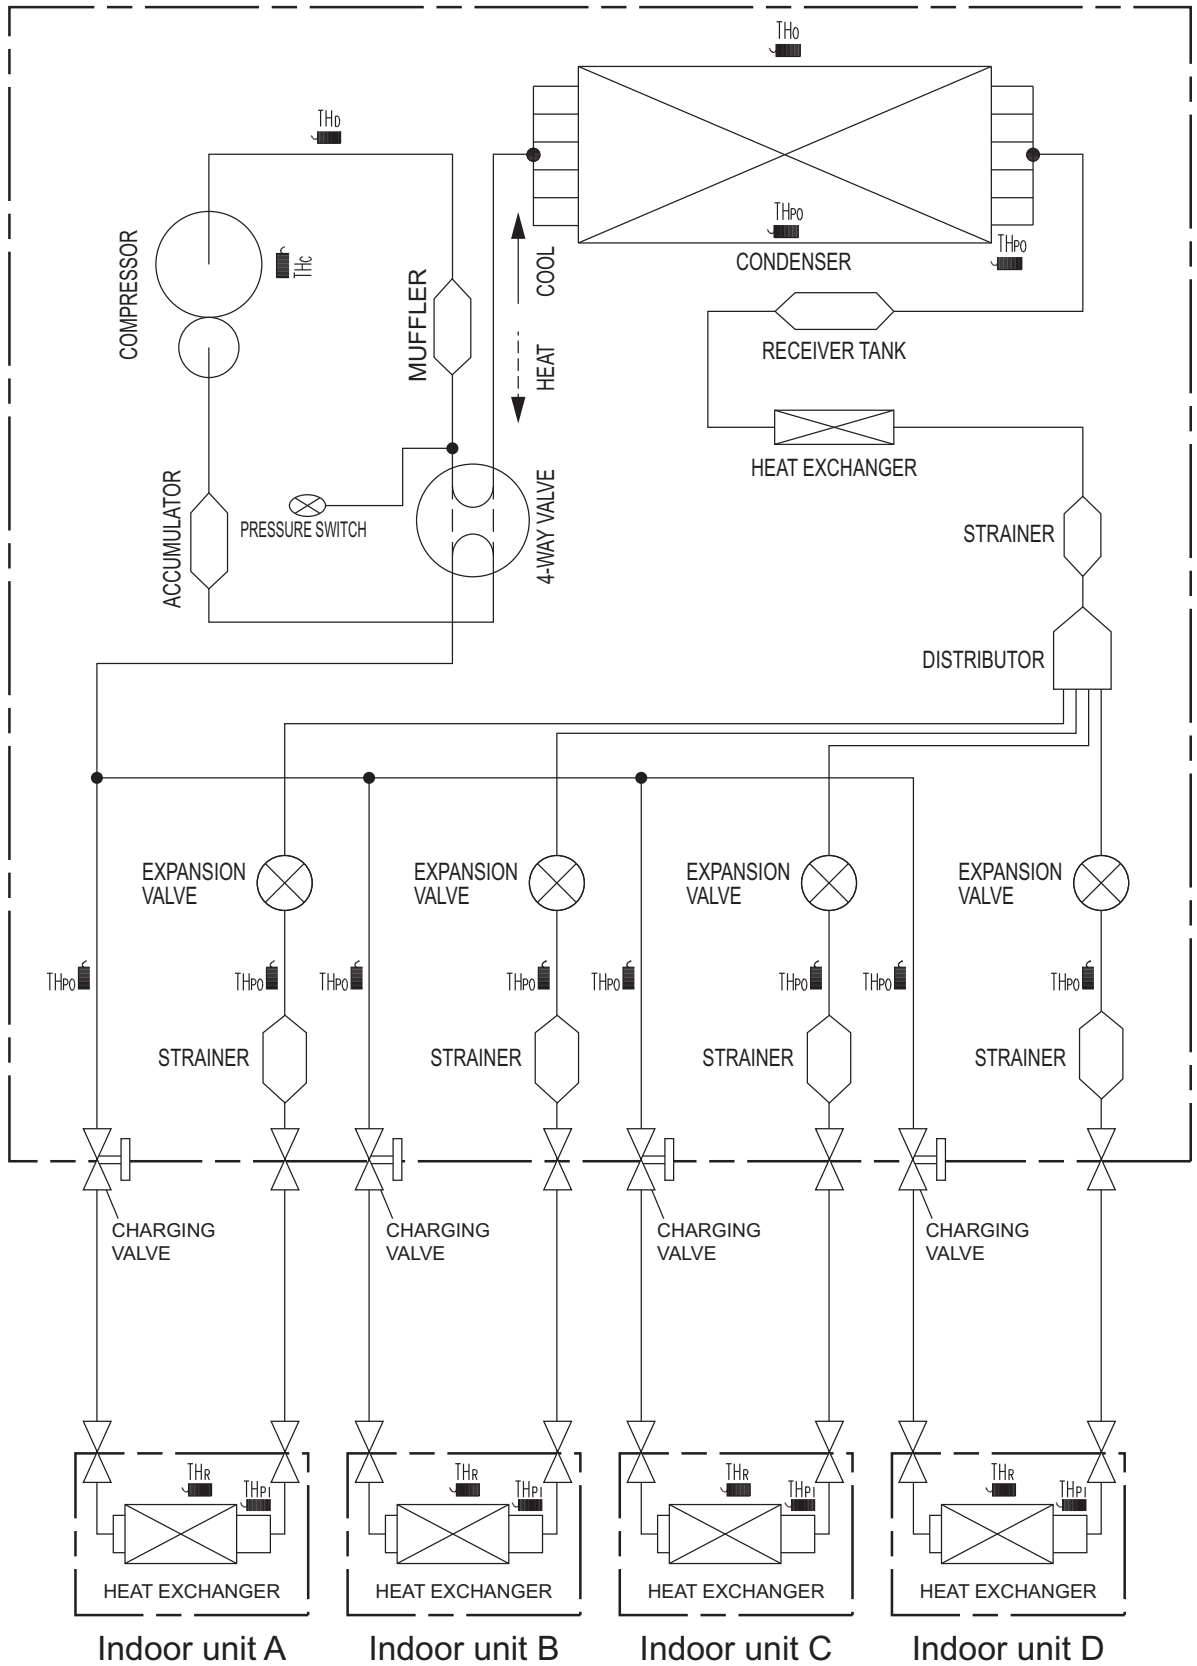


OUTDOOR UNIT  
UOMH36AFXZJ

$TH_d$  : THERMISTOR (DISCHARGE TEMP.)  
 $TH_o$  : THERMISTOR (OUTDOOR TEMP.)  
 $TH_{po}$  : THERMISTOR (PIPE TEMP.)  
 $TH_c$  : THERMISTOR (COMPRESSER TEMP.)

$TH_r$  : THERMISTOR (ROOM TEMP.)  
 $TH_{pi}$  : THERMISTOR (PIPE TEMP.)

# 5. Wiring diagram

## 5-1. Model: UOMH36AFXZJ

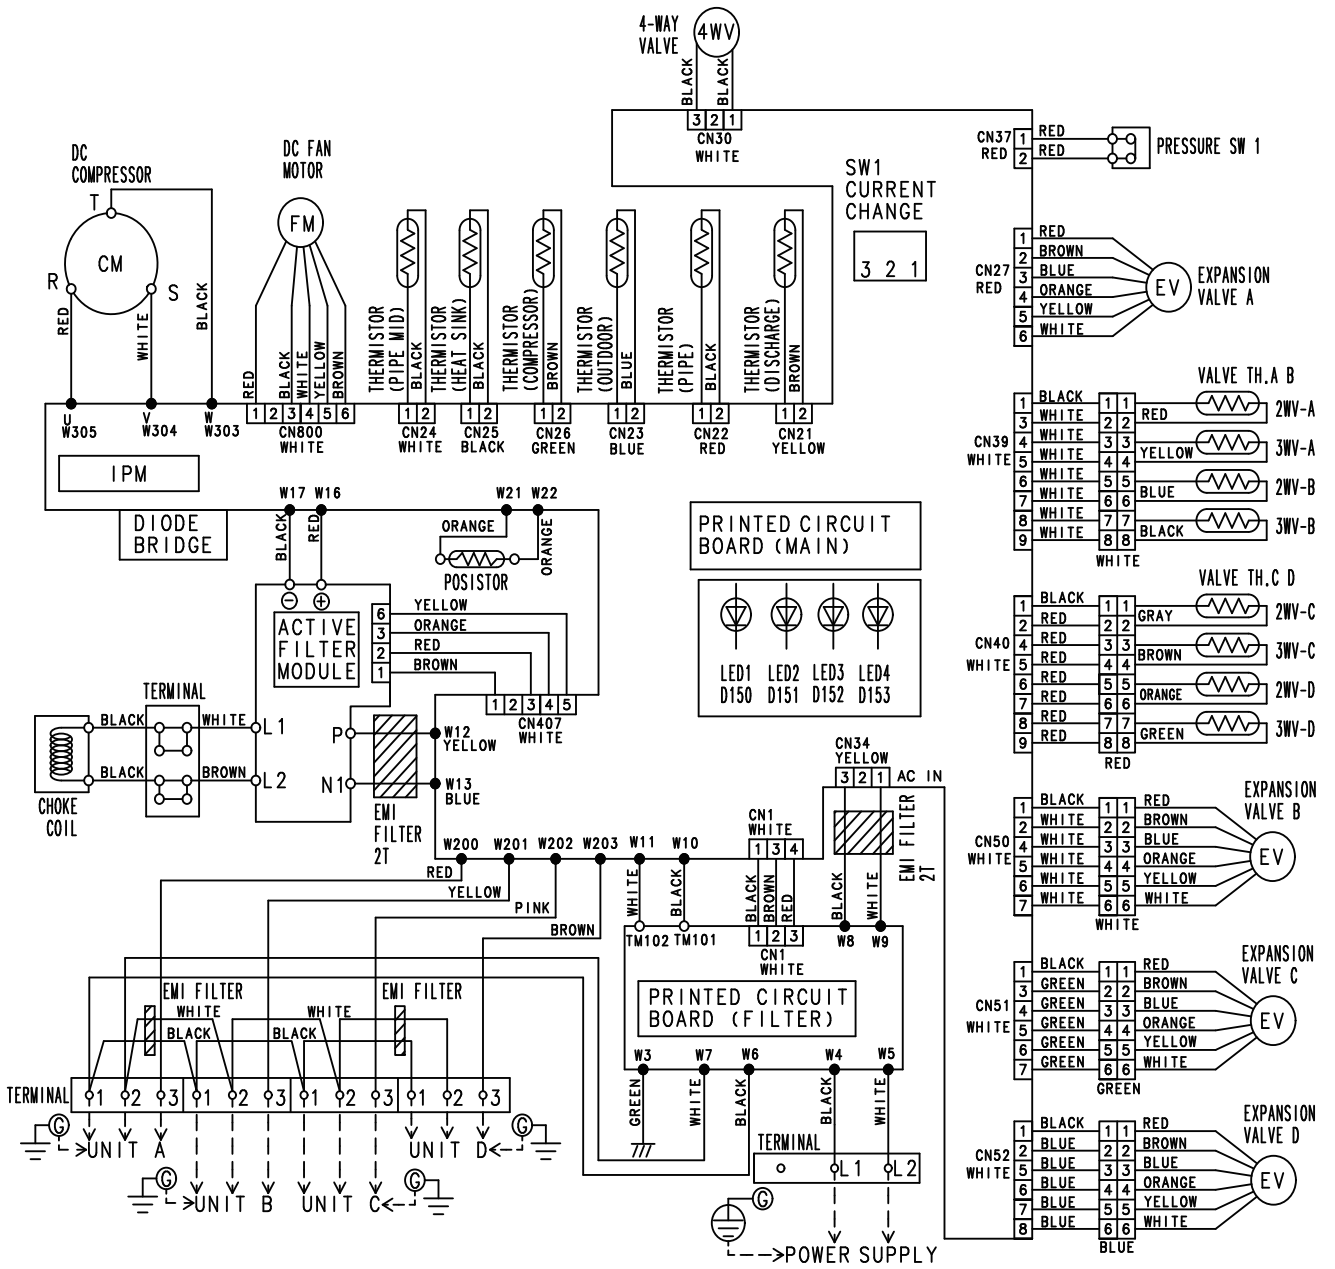

OUTDOOR UNIT  
UOMH36AFXZJ

## 6. Capacity table

### 6-1. Combinations

#### ■ Model: UOMH36AFXZJ

#### ● Cooling

Combination of indoor unit					Rated capacity for each indoor unit (kBtu/h)				Maximum capacity for each indoor unit (kBtu/h)				Total capacity (kBtu/h)			Input power (kW)		
Room 1	Room 2	Room 3	Room 4	Total	Room 1	Room 2	Room 3	Room 4	Room 1	Room 2	Room 3	Room 4	Min.	Rated	Max.	Min.	Rated	Max.
18	18	-	-	36*1	16.70	16.70	-	-	18.00	18.00	-	-	11.00	33.40	36.00	0.92	3.51	4.08
7	7	15	-	29	7.00	7.00	15.00	-	8.00	8.00	16.70	-	11.00	29.00	32.70	0.98	3.02	3.70
7	7	18	-	32	7.00	7.00	18.00	-	7.90	7.90	19.60	-	11.00	32.00	35.40	0.98	3.36	4.01
7	7	24	-	38	6.50	6.50	22.20	-	6.80	6.80	23.40	-	11.00	35.20	37.00	0.98	3.70	4.19
7	9	12	-	28	7.00	9.00	12.00	-	8.00	10.20	13.50	-	11.00	28.00	31.70	0.98	2.95	3.60
7	9	15	-	31	7.00	9.00	15.00	-	8.00	10.20	16.70	-	11.00	31.00	34.90	0.98	3.26	3.95
7	9	18	-	34	6.90	8.80	17.80	-	7.50	9.80	19.10	-	11.00	33.50	36.40	0.98	3.52	4.12
7	12	12	-	31	7.00	12.00	12.00	-	8.00	13.50	13.50	-	11.00	31.00	35.00	0.98	3.26	3.97
7	12	15	-	34	6.90	11.80	14.80	-	7.40	12.60	16.00	-	11.00	33.50	36.00	0.98	3.52	4.08
7	12	18	-	37	6.70	11.40	17.10	-	7.00	12.00	18.00	-	11.00	35.20	37.00	0.98	3.70	4.19
9	9	9	-	27	9.00	9.00	9.00	-	10.20	10.20	10.20	-	11.00	27.00	30.60	0.98	2.84	3.47
9	9	12	-	30	9.00	9.00	12.00	-	10.20	10.20	13.50	-	11.00	30.00	33.90	0.98	3.15	3.84
9	9	15	-	33	8.80	8.80	14.80	-	9.90	9.90	16.30	-	11.00	32.40	36.10	0.98	3.40	4.09
9	9	18	-	36	8.80	8.80	17.60	-	9.20	9.20	18.60	-	11.00	35.20	37.00	0.98	3.70	4.19
9	12	12	-	33	8.80	11.80	11.80	-	9.90	13.10	13.10	-	11.00	32.40	36.10	0.98	3.40	4.09
9	12	15	-	36	8.90	11.70	14.60	-	9.30	12.30	15.40	-	11.00	35.20	37.00	0.98	3.70	4.19
9	12	18	-	39	8.20	10.80	16.20	-	8.50	11.40	17.10	-	11.00	35.20	37.00	0.98	3.70	4.19
12	12	12	-	36	11.70	11.70	11.80	-	12.30	12.30	12.30	-	11.00	35.20	36.90	0.98	3.70	4.18
12	12	15	-	39	10.80	10.80	13.60	-	11.40	11.40	14.20	-	11.00	35.20	37.00	0.98	3.70	4.19
7	7	7	7	28	7.00	7.00	7.00	7.00	8.00	8.00	8.00	8.00	11.00	28.00	32.00	1.17	2.80	3.41
7	7	7	9	30	7.00	7.00	7.00	9.00	8.00	8.00	8.00	10.20	11.00	30.00	34.20	1.17	3.00	3.65
7	7	7	12	33	6.90	6.90	6.90	11.80	7.70	7.70	7.70	13.00	11.00	32.50	36.10	1.17	3.25	3.90
7	7	7	15	36	6.90	6.90	6.90	14.50	7.50	7.50	7.50	15.50	11.00	35.20	38.00	1.17	3.52	4.10
7	7	7	18*2	39	6.30	6.30	6.30	16.30	6.80	6.80	6.80	17.60	11.00	35.20	38.00	1.17	3.52	4.10
7	7	9	9	32	7.00	7.00	9.00	9.00	7.80	7.80	10.00	10.00	11.00	32.00	35.60	1.17	3.20	3.78
7	7	9	12	35	6.90	6.90	8.90	11.80	7.50	7.50	9.70	12.90	11.00	34.50	37.60	1.17	3.45	4.06
7	7	9	15	38	6.50	6.50	8.40	13.80	7.00	7.00	9.00	15.00	11.00	35.20	38.00	1.17	3.52	4.10
7	7	12	12	38	6.50	6.50	11.10	11.10	7.00	7.00	12.00	12.00	11.00	35.20	38.00	1.17	3.52	4.10
7	9	9	9	34	6.90	8.90	8.90	8.90	7.70	9.90	9.90	9.90	11.00	33.60	37.40	1.17	3.36	4.04
7	9	9	12	37	6.70	8.60	8.60	11.30	7.20	9.20	9.20	12.40	11.00	35.20	38.00	1.17	3.52	4.10
9	9	9	9	36	8.80	8.80	8.80	8.80	9.50	9.50	9.50	9.50	11.00	35.20	38.00	1.17	3.52	4.10

OUTDOOR UNIT  
UOMH36AFXZJ

#### NOTES:

- \*1: Optional kit RXK9FZ1818 shall be necessary for the dual zone system “18 + 18”.
- \*2: Wall mounted type UIWH18AVFJ cannot be connected in this combination.
- Specifications are based on the following conditions.
  - Power source of specifications: 230 V
  - 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h, 15: 14,000 Btu/h, 18: 18,000 Btu/h, 24: 24,000 Btu/h
  - 3 or more indoor units should be connected. (Only the combinations of the “18 + 18” can be connected by using the optional kit RXK9FZ1818.)
  - Cooling: Indoor temperature of 80 °FDB (26.7 °CDB)/67 °FWB (19.4 °CWB), and outdoor temperature of 95 °FDB (35 °CDB)/75 °FWB (23.9 °CWB).
  - Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
  - The total ability of connected indoor units is from 27,000 Btu up to 39,000 Btu.

# Model: UOMH36AFXZJ

## ● Heating

Combination of indoor unit					Rated capacity for each indoor unit (kBtu/h)				Maximum capacity for each indoor unit (kBtu/h)				Total capacity (kBtu/h)			Input power (kW)		
Room 1	Room 2	Room 3	Room 4	Total	Room 1	Room 2	Room 3	Room 4	Room 1	Room 2	Room 3	Room 4	Min.	Rated	Max.	Min.	Rated	Max.
18	18	-	-	36*1	17.30	17.30	-	-	20.00	20.00	-	-	11.00	34.60	40.00	1.02	2.99	3.70
7	7	15	-	29	7.20	7.20	15.50	-	8.80	8.80	18.50	-	11.00	29.90	36.10	0.87	2.57	3.34
7	7	18	-	32	7.20	7.20	18.60	-	8.70	8.70	21.70	-	11.00	33.00	39.10	0.87	2.86	3.62
7	7	24	-	38	6.70	6.70	23.00	-	7.50	7.50	26.00	-	11.00	36.40	41.00	0.87	3.15	3.79
7	9	12	-	28	7.20	9.30	12.40	-	8.80	11.30	14.90	-	11.00	28.90	35.00	0.87	2.50	3.24
7	9	15	-	31	7.20	9.30	15.50	-	8.80	11.30	18.50	-	11.00	32.00	38.60	0.87	2.77	3.57
7	9	18	-	34	7.10	9.10	18.40	-	8.30	10.80	21.10	-	11.00	34.60	40.20	0.87	2.99	3.72
7	12	12	-	31	7.20	12.40	12.40	-	8.80	14.90	14.90	-	11.00	32.00	38.60	0.87	2.77	3.57
7	12	15	-	34	7.10	12.20	15.30	-	8.20	13.90	17.70	-	11.00	34.60	39.80	0.87	2.99	3.68
7	12	18	-	37	6.90	11.80	17.70	-	7.70	13.30	20.00	-	11.00	36.40	41.00	0.87	3.15	3.79
9	9	9	-	27	9.30	9.30	9.30	-	11.30	11.30	11.30	-	11.00	27.90	33.90	0.87	2.41	3.14
9	9	12	-	30	9.30	9.30	12.40	-	11.30	11.30	14.90	-	11.00	31.00	37.50	0.87	2.68	3.47
9	9	15	-	33	9.10	9.10	15.30	-	10.90	10.90	18.00	-	11.00	33.50	39.80	0.87	2.90	3.68
9	9	18	-	36	9.10	9.10	18.20	-	10.20	10.20	20.60	-	11.00	36.40	41.00	0.87	3.15	3.79
9	12	12	-	33	9.10	12.20	12.20	-	10.90	14.50	14.50	-	11.00	33.50	39.90	0.87	2.90	3.69
9	12	15	-	36	9.20	12.10	15.10	-	10.30	13.60	17.00	-	11.00	36.40	40.90	0.87	3.15	3.78
9	12	18	-	39	8.50	11.20	16.70	-	9.40	12.60	19.00	-	11.00	36.40	41.00	0.97	3.15	3.79
12	12	12	-	36	12.10	12.10	12.20	-	13.60	13.60	13.60	-	11.00	36.40	40.80	0.87	3.15	3.77
12	12	15	-	39	11.20	11.20	14.00	-	12.60	12.60	15.80	-	11.00	36.40	41.00	0.87	3.15	3.79
7	7	7	7	28	7.20	7.20	7.20	7.20	8.80	8.80	8.80	8.80	11.00	28.80	35.20	0.87	2.37	3.07
7	7	7	9	30	7.20	7.20	7.20	9.30	8.80	8.80	8.80	11.30	11.00	30.90	37.70	0.87	2.55	3.29
7	7	7	12	33	7.10	7.10	7.10	12.20	8.50	8.50	8.50	14.40	11.00	33.50	39.90	0.87	2.76	3.52
7	7	7	15	36	7.10	7.10	7.10	15.00	8.30	8.30	8.30	17.10	11.00	36.30	42.00	0.87	2.99	3.70
7	7	7	18*2	39	6.50	6.50	6.50	16.90	7.50	7.50	7.50	19.50	11.00	36.40	42.00	0.87	3.00	3.70
7	7	9	9	32	7.20	7.20	9.30	9.30	8.60	8.60	11.10	11.10	11.00	33.00	39.40	0.87	2.72	3.44
7	7	9	12	35	7.10	7.10	9.20	12.20	8.30	8.30	10.70	14.30	11.00	35.60	41.60	0.87	2.93	3.66
7	7	9	15	38	6.70	6.70	8.70	14.30	7.70	7.70	10.00	16.60	11.00	36.40	42.00	0.87	3.00	3.70
7	7	12	12	38	6.70	6.70	11.50	11.50	7.70	7.70	13.30	13.30	11.00	36.40	42.00	0.87	3.00	3.70
7	9	9	9	34	7.10	9.20	9.20	9.20	8.50	10.90	10.90	10.90	11.00	34.70	41.20	0.87	2.86	3.63
7	9	9	12	37	6.90	8.90	8.90	11.70	8.00	10.20	10.20	13.60	11.00	36.40	42.00	0.87	3.00	3.70
9	9	9	9	36	9.10	9.10	9.10	9.10	10.50	10.50	10.50	10.50	11.00	36.40	42.00	0.87	3.00	3.70

OUTDOOR UNIT  
UOMH36AFXZJ

### NOTES:

- \*1: Optional kit RXK9FZ1818 shall be necessary for the dual zone system “18 + 18”.
- \*2: Wall mounted type UIWH18AVFJ cannot be connected in this combination.
- Specifications are based on the following conditions.
  - Power source of specifications: 230 V
  - 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h, 15: 14,000 Btu/h, 18: 18,000 Btu/h, 24: 24,000 Btu/h
  - 3 or more indoor units should be connected. (Only the combinations of the “18 + 18” can be connected by using the optional kit RXK9FZ1818.)
  - Heating: Indoor temperature of 70 °FDB (21.1 °CDB)/ 60 °FWB (15.6 °CWB), and outdoor temperature of 47 °FDB (8.3 °CDB) / 43 °FWB (6.1 °CWB).
  - Pipe length: 24.6 ft (7.5 m), Height difference: 0 ft (0 m) [Outdoor unit—Indoor unit]
  - The total ability of connected indoor units is from 27,000 Btu up to 39,000 Btu.

## 6-2. Cooling capacity

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

### ■ Model: UOMH36AFXZJ

- TC: Total Capacity, SHC: Sensible Heat Capacity, IP: Input Power
- The data is based on the following conditions:  
Pipe length: 7.5 m, Height difference: 0 m [Outdoor unit—Indoor unit]

### ● Indoor units: 7,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	7.01	5.62	0.31	7.92	5.67	0.32	8.35	6.19	0.32	8.94	6.50	0.32	9.55	6.65	0.33	9.85	7.39	0.33
	23	6.82	5.55	0.36	7.71	5.60	0.37	8.12	6.12	0.37	8.70	6.42	0.38	9.30	6.57	0.38	9.58	7.30	0.38
	32	6.80	5.49	0.42	7.69	5.54	0.42	8.10	6.05	0.43	8.68	6.35	0.43	9.28	6.49	0.44	9.56	7.22	0.44
	41	6.66	5.45	0.51	7.52	5.49	0.52	7.93	6.00	0.53	8.49	6.30	0.53	9.08	6.44	0.54	9.36	7.16	0.54
	50	6.65	5.44	0.51	7.52	5.48	0.52	7.92	5.99	0.52	8.48	6.29	0.53	9.07	6.43	0.54	9.35	7.15	0.54
	59	6.59	5.43	0.51	7.44	5.47	0.52	7.85	5.98	0.52	8.40	6.27	0.53	8.98	6.42	0.53	9.26	7.13	0.54
	67	7.06	5.55	0.62	7.98	5.60	0.63	8.41	6.12	0.63	9.01	6.42	0.64	9.63	6.57	0.65	9.93	7.30	0.65
	77	7.54	5.68	0.77	8.52	5.73	0.79	8.98	6.26	0.79	9.61	6.57	0.80	10.28	6.72	0.81	10.60	7.47	0.82
87	7.45	5.68	0.94	8.42	5.73	0.95	8.88	6.26	0.96	9.51	6.56	0.97	10.16	6.72	0.98	10.47	7.46	0.99	
95	7.37	5.67	1.10	8.32	5.72	1.12	8.78	6.25	1.13	9.40	6.56	1.14	10.04	6.71	1.15	10.35	7.46	1.16	
104	5.83	5.01	0.86	6.59	5.05	0.87	6.95	5.51	0.88	7.44	5.79	0.89	7.96	5.92	0.90	8.20	6.58	0.90	
115	4.30	3.93	0.62	4.86	4.20	0.63	5.12	4.59	0.63	5.49	4.81	0.64	5.87	4.92	0.65	6.05	5.47	0.65	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
	-10.0	2.05	1.65	0.31	2.32	1.66	0.32	2.45	1.81	0.32	2.62	1.90	0.32	2.80	1.95	0.33	2.89	2.16	0.33
	-5.0	2.00	1.63	0.36	2.26	1.64	0.37	2.38	1.79	0.37	2.55	1.88	0.38	2.72	1.93	0.38	2.81	2.14	0.38
	0.0	1.99	1.61	0.42	2.25	1.62	0.42	2.38	1.77	0.43	2.54	1.86	0.43	2.72	1.90	0.44	2.80	2.11	0.44
	5.0	1.95	1.60	0.51	2.21	1.61	0.52	2.32	1.76	0.53	2.49	1.85	0.53	2.66	1.89	0.54	2.74	2.10	0.54
	10.0	1.95	1.59	0.51	2.20	1.61	0.52	2.32	1.76	0.52	2.49	1.84	0.53	2.66	1.88	0.54	2.74	2.09	0.54
	15.0	1.93	1.59	0.51	2.18	1.60	0.52	2.30	1.75	0.52	2.46	1.84	0.53	2.63	1.88	0.53	2.71	2.09	0.54
	19.4	2.07	1.63	0.62	2.34	1.64	0.63	2.47	1.79	0.63	2.64	1.88	0.64	2.82	1.93	0.65	2.91	2.14	0.65
	25.0	2.21	1.67	0.77	2.50	1.68	0.79	2.63	1.83	0.79	2.82	1.93	0.80	3.01	1.97	0.81	3.11	2.19	0.82
30.6	2.18	1.66	0.94	2.47	1.68	0.95	2.60	1.83	0.96	2.79	1.92	0.97	2.98	1.97	0.98	3.07	2.19	0.99	
35.0	2.16	1.66	1.10	2.44	1.68	1.12	2.57	1.83	1.13	2.75	1.92	1.14	2.94	1.97	1.15	3.03	2.19	1.16	
40.0	1.71	1.47	0.86	1.93	1.48	0.87	2.04	1.62	0.88	2.18	1.70	0.89	2.33	1.74	0.90	2.40	1.93	0.90	
46.1	1.26	1.15	0.62	1.42	1.23	0.63	1.50	1.34	0.63	1.61	1.41	0.64	1.72	1.44	0.65	1.77	1.60	0.65	

OUTDOOR UNIT  
UOMH36AFXZJ

# ● Indoor units: 9,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
	14	8.79	6.85	0.35	9.94	6.91	0.36	10.47	7.55	0.36	11.21	7.92	0.37	11.99	8.10	0.37	12.36	9.00	0.37
23	8.56	6.77	0.41	9.67	6.83	0.42	10.19	7.46	0.42	10.91	7.83	0.43	11.67	8.01	0.43	12.03	8.90	0.43	
32	8.54	6.69	0.47	9.65	6.75	0.48	10.17	7.37	0.48	10.89	7.73	0.49	11.64	7.91	0.49	12.00	8.79	0.49	
41	8.35	6.64	0.58	9.44	6.70	0.59	9.95	7.31	0.59	10.66	7.67	0.60	11.39	7.85	0.61	11.74	8.73	0.61	
50	8.34	6.63	0.58	9.43	6.69	0.59	9.94	7.30	0.59	10.64	7.66	0.60	11.38	7.84	0.60	11.73	8.71	0.61	
59	8.26	6.61	0.57	9.34	6.67	0.58	9.85	7.29	0.59	10.54	7.65	0.59	11.27	7.82	0.60	11.62	8.70	0.60	
67	8.86	6.77	0.69	10.01	6.83	0.71	10.56	7.46	0.71	11.30	7.83	0.72	12.08	8.01	0.73	12.46	8.90	0.73	
77	9.46	6.93	0.87	10.69	6.99	0.89	11.27	7.63	0.90	12.06	8.01	0.91	12.90	8.19	0.92	13.30	9.10	0.92	
87	9.35	6.92	1.05	10.57	6.98	1.07	11.14	7.62	1.08	11.93	8.00	1.09	12.75	8.19	1.11	13.14	9.10	1.11	
95	9.24	6.92	1.24	10.45	6.98	1.26	11.01	7.62	1.27	11.79	8.00	1.28	12.60	8.18	1.30	12.99	9.09	1.30	
104	7.32	6.10	0.96	8.27	6.15	0.98	8.72	6.72	0.99	9.34	7.05	1.00	9.98	7.22	1.01	10.29	8.02	1.02	
115	5.40	4.79	0.69	6.10	5.12	0.71	6.43	5.59	0.71	6.89	5.87	0.72	7.36	6.00	0.73	7.59	6.67	0.73	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW		kW	kW		kW	kW		kW	kW		kW	kW		kW	kW		kW
	-10.0	2.58	2.01	0.35	2.91	2.02	0.36	3.07	2.21	0.36	3.29	2.32	0.37	3.51	2.37	0.37	3.62	2.64	0.37
-5.0	2.51	1.98	0.41	2.83	2.00	0.42	2.99	2.19	0.42	3.20	2.29	0.43	3.42	2.35	0.43	3.52	2.61	0.43	
0.0	2.50	1.96	0.47	2.83	1.98	0.48	2.98	2.16	0.48	3.19	2.27	0.49	3.41	2.32	0.49	3.52	2.58	0.49	
5.0	2.45	1.95	0.58	2.77	1.96	0.59	2.92	2.14	0.59	3.12	2.25	0.60	3.34	2.30	0.61	3.44	2.56	0.61	
10.0	2.45	1.94	0.58	2.76	1.96	0.59	2.91	2.14	0.59	3.12	2.25	0.60	3.33	2.30	0.60	3.44	2.55	0.61	
15.0	2.42	1.94	0.57	2.74	1.96	0.58	2.89	2.14	0.59	3.09	2.24	0.59	3.30	2.29	0.60	3.40	2.55	0.60	
19.4	2.60	1.98	0.69	2.94	2.00	0.71	3.09	2.19	0.71	3.31	2.29	0.72	3.54	2.35	0.73	3.65	2.61	0.73	
25.0	2.77	2.03	0.87	3.13	2.05	0.89	3.30	2.24	0.90	3.54	2.35	0.91	3.78	2.40	0.92	3.90	2.67	0.92	
30.6	2.74	2.03	1.05	3.10	2.05	1.07	3.27	2.23	1.08	3.50	2.34	1.09	3.74	2.40	1.11	3.85	2.67	1.11	
35.0	2.71	2.03	1.24	3.06	2.04	1.26	3.23	2.23	1.27	3.46	2.34	1.28	3.69	2.40	1.30	3.81	2.66	1.30	
40.0	2.15	1.79	0.96	2.42	1.80	0.98	2.56	1.97	0.99	2.74	2.07	1.00	2.93	2.11	1.01	3.02	2.35	1.02	
46.1	1.58	1.40	0.69	1.79	1.50	0.71	1.88	1.64	0.71	2.02	1.72	0.72	2.16	1.76	0.73	2.22	1.95	0.73	

# ● Indoor units: 12,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
	14	10.08	7.87	0.39	11.39	7.94	0.40	12.01	8.68	0.40	12.86	9.10	0.41	13.75	9.31	0.41	14.17	10.35	0.42
23	9.81	7.78	0.46	11.09	7.85	0.47	11.69	8.57	0.47	12.51	9.00	0.48	13.38	9.21	0.48	13.79	10.23	0.48	
32	9.79	7.69	0.52	11.06	7.76	0.53	11.66	8.47	0.54	12.48	8.89	0.54	13.34	9.10	0.55	13.76	10.11	0.55	
41	9.58	7.63	0.65	10.82	7.70	0.66	11.41	8.41	0.67	12.22	8.82	0.67	13.06	9.03	0.68	13.46	10.03	0.68	
50	9.57	7.62	0.65	10.81	7.69	0.66	11.40	8.39	0.66	12.20	8.81	0.67	13.04	9.01	0.68	13.45	10.02	0.68	
59	9.48	7.61	0.64	10.71	7.67	0.65	11.29	8.38	0.66	12.09	8.79	0.67	12.92	9.00	0.67	13.32	10.00	0.68	
67	10.16	7.78	0.78	11.48	7.85	0.79	12.10	8.58	0.80	12.96	9.00	0.81	13.85	9.21	0.81	14.28	10.23	0.82	
77	10.84	7.96	0.98	12.26	8.03	0.99	12.92	8.77	1.00	13.83	9.20	1.01	14.79	9.42	1.03	15.24	10.47	1.03	
87	10.72	7.96	1.18	12.12	8.03	1.20	12.77	8.77	1.21	13.68	9.20	1.22	14.62	9.41	1.24	15.07	10.46	1.25	
95	10.60	7.95	1.38	11.98	8.02	1.41	12.63	8.76	1.42	13.52	9.19	1.44	14.45	9.41	1.45	14.90	10.45	1.46	
104	8.39	7.01	1.08	9.49	7.07	1.10	10.00	7.73	1.11	10.71	8.11	1.12	11.44	8.30	1.13	11.80	9.22	1.14	
115	6.19	5.50	0.78	6.99	5.88	0.79	7.37	6.43	0.80	7.89	6.74	0.81	8.44	6.90	0.82	8.70	7.67	0.82	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW		kW	kW		kW	kW		kW	kW		kW	kW		kW	kW		kW
	-10.0	2.95	2.31	0.39	3.34	2.33	0.40	3.52	2.54	0.40	3.77	2.67	0.41	4.03	2.73	0.41	4.15	3.03	0.42
-5.0	2.87	2.28	0.46	3.25	2.30	0.47	3.43	2.51	0.47	3.67	2.64	0.48	3.92	2.70	0.48	4.04	3.00	0.48	
0.0	2.87	2.25	0.52	3.24	2.27	0.53	3.42	2.48	0.54	3.66	2.61	0.54	3.91	2.67	0.55	4.03	2.96	0.55	
5.0	2.81	2.24	0.65	3.17	2.26	0.66	3.34	2.46	0.67	3.58	2.59	0.67	3.83	2.65	0.68	3.95	2.94	0.68	
10.0	2.80	2.23	0.65	3.17	2.25	0.66	3.34	2.46	0.66	3.58	2.58	0.67	3.82	2.64	0.68	3.94	2.94	0.68	
15.0	2.78	2.23	0.64	3.14	2.25	0.65	3.31	2.46	0.66	3.54	2.58	0.67	3.79	2.64	0.67	3.90	2.93	0.68	
19.4	2.98	2.28	0.78	3.37	2.30	0.79	3.55	2.51	0.80	3.80	2.64	0.81	4.06	2.70	0.81	4.19	3.00	0.82	
25.0	3.18	2.33	0.98	3.59	2.35	0.99	3.79	2.57	1.00	4.05	2.70	1.01	4.33	2.76	1.03	4.47	3.07	1.03	
30.6	3.14	2.33	1.18	3.55	2.35	1.20	3.74	2.57	1.21	4.01	2.70	1.22	4.28	2.76	1.24	4.42	3.07	1.25	
35.0	3.11	2.33	1.38	3.51	2.35	1.41	3.70	2.57	1.42	3.96	2.69	1.44	4.24	2.76	1.45	4.37	3.06	1.46	
40.0	2.46	2.06	1.08	2.78	2.07	1.10	2.93	2.26	1.11	3.14	2.38	1.12	3.35	2.43	1.13	3.46	2.70	1.14	
46.1	1.81	1.61	0.78	2.05	1.72	0.79	2.16	1.88	0.80	2.31	1.98	0.81	2.47	2.02	0.82	2.55	2.25	0.82	

OUTDOOR UNIT UOMH36AFXZJ



## ● Indoor units: 14,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
	14	13.71	11.30	0.55	15.50	11.40	0.56	16.34	12.45	0.57	17.49	13.06	0.57	18.70	13.36	0.58	19.28	14.85	0.58
	23	13.34	11.17	0.64	15.08	11.26	0.66	15.90	12.30	0.66	17.02	12.91	0.67	18.19	13.21	0.68	18.76	14.68	0.68
	32	13.31	11.04	0.73	15.05	11.13	0.75	15.86	12.16	0.75	16.98	12.76	0.76	18.15	13.05	0.77	18.71	14.51	0.78
	41	13.03	10.95	0.91	14.73	11.05	0.93	15.52	12.07	0.93	16.62	12.66	0.94	17.77	12.95	0.95	18.32	14.40	0.96
	50	13.01	10.93	0.90	14.71	11.03	0.92	15.50	12.04	0.93	16.60	12.64	0.94	17.75	12.93	0.95	18.29	14.37	0.95
	59	12.89	10.91	0.90	14.57	11.01	0.91	15.36	12.02	0.92	16.44	12.62	0.93	17.58	12.91	0.94	18.12	14.35	0.95
	67	13.82	11.17	1.09	15.62	11.27	1.11	16.47	12.30	1.12	17.63	12.91	1.13	18.85	13.21	1.14	19.43	14.68	1.15
	77	14.75	11.42	1.37	16.67	11.52	1.39	17.57	12.59	1.40	18.82	13.21	1.42	20.11	13.51	1.44	20.74	15.02	1.44
87	14.58	11.42	1.65	16.48	11.52	1.68	17.37	12.58	1.70	18.60	13.20	1.72	19.89	13.50	1.74	20.50	15.01	1.75	
95	14.42	11.41	1.94	16.29	11.51	1.97	17.18	12.57	1.99	18.39	13.19	2.01	19.66	13.50	2.04	20.26	15.00	2.05	
104	11.42	10.06	1.51	12.90	10.15	1.54	13.60	11.09	1.55	14.56	11.63	1.57	15.57	11.90	1.59	16.05	13.23	1.60	
115	8.42	7.89	1.09	9.51	8.44	1.11	10.03	9.22	1.12	10.74	9.68	1.13	11.48	9.90	1.14	11.83	11.00	1.15	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	4.02	3.31	0.55	4.54	3.34	0.56	4.79	3.65	0.57	5.13	3.83	0.57	5.48	3.92	0.58	5.65	4.35	0.58
	-5.0	3.91	3.27	0.64	4.42	3.30	0.66	4.66	3.61	0.66	4.99	3.78	0.67	5.33	3.87	0.68	5.50	4.30	0.68
	0.0	3.90	3.23	0.73	4.41	3.26	0.75	4.65	3.56	0.75	4.98	3.74	0.76	5.32	3.83	0.77	5.48	4.25	0.78
	5.0	3.82	3.21	0.91	4.32	3.24	0.93	4.55	3.54	0.93	4.87	3.71	0.94	5.21	3.80	0.95	5.37	4.22	0.96
	10.0	3.81	3.20	0.90	4.31	3.23	0.92	4.54	3.53	0.93	4.87	3.70	0.94	5.20	3.79	0.95	5.36	4.21	0.95
	15.0	3.78	3.20	0.90	4.27	3.23	0.91	4.50	3.52	0.92	4.82	3.70	0.93	5.15	3.78	0.94	5.31	4.20	0.95
	19.4	4.05	3.27	1.09	4.58	3.30	1.11	4.83	3.61	1.12	5.17	3.78	1.13	5.52	3.87	1.14	5.69	4.30	1.15
	25.0	4.32	3.35	1.37	4.89	3.38	1.39	5.15	3.69	1.40	5.51	3.87	1.42	5.90	3.96	1.44	6.08	4.40	1.44
30.6	4.27	3.35	1.65	4.83	3.38	1.68	5.09	3.69	1.70	5.45	3.87	1.72	5.83	3.96	1.74	6.01	4.40	1.75	
35.0	4.23	3.34	1.94	4.78	3.37	1.97	5.03	3.68	1.99	5.39	3.87	2.01	5.76	3.96	2.04	5.94	4.40	2.05	
40.0	3.35	2.95	1.51	3.78	2.98	1.54	3.99	3.25	1.55	4.27	3.41	1.57	4.56	3.49	1.59	4.70	3.88	1.60	
46.1	2.47	2.31	1.09	2.79	2.47	1.11	2.94	2.70	1.12	3.15	2.84	1.13	3.36	2.90	1.14	3.47	3.22	1.15	

## ● Indoor units: 18,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW	kBTu/h		kW
	14	15.50	12.07	0.62	17.51	12.18	0.63	18.46	13.30	0.64	19.77	13.95	0.65	21.13	14.28	0.65	21.78	15.87	0.66
	23	15.08	11.93	0.72	17.04	12.03	0.74	17.97	13.14	0.74	19.23	13.79	0.75	20.56	14.11	0.76	21.20	15.68	0.76
	32	15.05	11.79	0.83	17.00	11.89	0.84	17.92	12.99	0.85	19.19	13.63	0.86	20.51	13.95	0.87	21.15	15.50	0.87
	41	14.73	11.70	1.02	16.64	11.80	1.04	17.54	12.89	1.05	18.78	13.53	1.06	20.08	13.84	1.07	20.70	15.38	1.08
	50	14.71	11.68	1.02	16.62	11.78	1.04	17.52	12.87	1.04	18.76	13.50	1.06	20.05	13.82	1.07	20.67	15.35	1.07
	59	14.57	11.66	1.01	16.46	11.76	1.03	17.35	12.84	1.04	18.58	13.48	1.05	19.86	13.79	1.06	20.48	15.33	1.07
	67	15.62	11.93	1.22	17.65	12.04	1.25	18.61	13.15	1.26	19.92	13.79	1.27	21.30	14.11	1.28	21.96	15.69	1.29
	77	16.67	12.20	1.54	18.84	12.31	1.57	19.86	13.45	1.58	21.26	14.11	1.60	22.73	14.44	1.62	23.43	16.04	1.63
87	16.48	12.20	1.86	18.63	12.30	1.90	19.64	13.44	1.91	21.02	14.10	1.93	22.47	14.43	1.95	23.17	16.03	1.97	
95	16.29	12.19	2.18	18.41	12.30	2.22	19.41	13.43	2.24	20.78	14.09	2.27	22.22	14.42	2.29	22.90	16.02	2.30	
104	12.90	10.75	1.70	14.58	10.85	1.73	15.37	11.85	1.75	16.46	12.43	1.77	17.59	12.72	1.79	18.14	14.13	1.80	
115	9.51	8.43	1.23	10.75	9.02	1.25	11.33	9.85	1.26	12.14	10.34	1.27	12.97	10.58	1.29	13.37	11.75	1.29	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	4.54	3.54	0.62	5.13	3.57	0.63	5.41	3.90	0.64	5.79	4.09	0.65	6.19	4.18	0.65	6.38	4.65	0.66
	-5.0	4.42	3.50	0.72	4.99	3.53	0.74	5.27	3.85	0.74	5.64	4.04	0.75	6.03	4.14	0.76	6.21	4.60	0.76
	0.0	4.41	3.46	0.83	4.98	3.49	0.84	5.25	3.81	0.85	5.62	3.99	0.86	6.01	4.09	0.87	6.20	4.54	0.87
	5.0	4.32	3.43	1.02	4.88	3.46	1.04	5.14	3.78	1.05	5.50	3.96	1.06	5.88	4.06	1.07	6.07	4.51	1.08
	10.0	4.31	3.42	1.02	4.87	3.45	1.04	5.14	3.77	1.04	5.50	3.96	1.06	5.88	4.05	1.07	6.06	4.50	1.07
	15.0	4.27	3.42	1.01	4.82	3.45	1.03	5.09	3.76	1.04	5.45	3.95	1.05	5.82	4.04	1.06	6.00	4.49	1.07
	19.4	4.58	3.50	1.22	5.17	3.53	1.25	5.45	3.85	1.26	5.84	4.04	1.27	6.24	4.14	1.28	6.43	4.60	1.29
	25.0	4.89	3.58	1.54	5.52	3.61	1.57	5.82	3.94	1.58	6.23	4.14	1.60	6.66	4.23	1.62	6.87	4.70	1.63
30.6	4.83	3.57	1.86	5.46	3.61	1.90	5.75	3.94	1.91	6.16	4.13	1.93	6.59	4.23	1.95	6.79	4.70	1.97	
35.0	4.78	3.57	2.18	5.40	3.60	2.22	5.69	3.94	2.24	6.09	4.13	2.27	6.51	4.23	2.29	6.71	4.70	2.30	
40.0	3.78	3.15	1.70	4.27	3.18	1.73	4.51	3.47	1.75	4.82	3.64	1.77	5.16	3.73	1.79	5.32	4.14	1.80	
46.1	2.79	2.47	1.23	3.15	2.64	1.25	3.32	2.89	1.26	3.56	3.03	1.27	3.80	3.10	1.29	3.92	3.44	1.29	

OUTDOOR UNIT  
UOMH36AFXJ

# ● Indoor units: 24,000 Btu

		Indoor temperature																							
		64			70			75			80			85			90								
		54			60			63			67			71			73								
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP						
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
14	19.11	12.55	0.81	21.60	12.66	0.82	22.77	13.82	0.83	24.38	14.51	0.84	26.06	14.84	0.85	26.86	16.49	0.85	26.86	16.49	0.85				
23	18.60	12.40	0.94	21.02	12.51	0.96	22.15	13.66	0.97	23.72	14.34	0.98	25.36	14.67	0.99	26.14	16.30	0.99	26.14	16.30	0.99				
32	18.55	12.26	1.08	20.97	12.36	1.09	22.10	13.50	1.10	23.67	14.17	1.12	25.30	14.50	1.13	26.08	16.11	1.13	26.08	16.11	1.13				
41	18.16	12.16	1.33	20.52	12.27	1.35	21.63	13.40	1.37	23.16	14.06	1.38	24.76	14.39	1.40	25.53	15.99	1.40	25.53	15.99	1.40				
50	18.14	12.14	1.32	20.50	12.25	1.35	21.61	13.38	1.36	23.13	14.04	1.37	24.73	14.36	1.39	25.49	15.96	1.40	25.49	15.96	1.40				
59	17.96	12.12	1.32	20.30	12.22	1.34	21.40	13.35	1.35	22.91	14.01	1.36	24.49	14.33	1.38	25.25	15.93	1.39	25.25	15.93	1.39				
67	19.26	12.40	1.59	21.77	12.51	1.62	22.95	13.66	1.63	24.57	14.34	1.65	26.26	14.67	1.67	27.07	16.30	1.68	27.07	16.30	1.68				
77	20.56	12.69	2.00	23.23	12.80	2.04	24.49	13.98	2.06	26.22	14.67	2.08	28.03	15.01	2.10	28.90	16.68	2.11	28.90	16.68	2.11				
87	20.33	12.68	2.42	22.97	12.79	2.46	24.21	13.97	2.48	25.93	14.66	2.51	27.71	15.00	2.54	28.57	16.67	2.55	28.57	16.67	2.55				
95	20.09	12.67	2.84	22.71	12.78	2.89	23.94	13.96	2.91	25.63	14.65	2.94	27.40	14.99	2.98	28.24	16.66	2.99	28.24	16.66	2.99				
104	15.91	11.18	2.22	17.98	11.27	2.26	18.96	12.31	2.27	20.30	12.92	2.30	21.70	13.22	2.33	22.37	14.69	2.34	22.37	14.69	2.34				
115	11.73	8.77	1.59	13.26	9.38	1.62	13.98	10.24	1.63	14.97	10.74	1.65	16.00	10.99	1.67	16.49	12.22	1.68	16.49	12.22	1.68				

		Indoor temperature																			
		17.8			21.1			23.9			26.7			29.4			32.2				
		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	°CWB	kW			kW			kW			kW			kW			kW				
-10.0	5.60	3.68	0.81	6.33	3.71	0.82	6.67	4.05	0.83	7.14	4.25	0.84	7.64	4.35	0.85	7.87	4.83	0.85	7.87	4.83	0.85
-5.0	5.45	3.63	0.94	6.16	3.67	0.96	6.49	4.00	0.97	6.95	4.20	0.98	7.43	4.30	0.99	7.66	4.78	0.99	7.66	4.78	0.99
0.0	5.44	3.59	1.08	6.15	3.62	1.09	6.48	3.96	1.10	6.94	4.15	1.12	7.41	4.25	1.13	7.64	4.72	1.13	7.64	4.72	1.13
5.0	5.32	3.56	1.33	6.01	3.60	1.35	6.34	3.93	1.37	6.79	4.12	1.38	7.26	4.22	1.40	7.48	4.69	1.40	7.48	4.69	1.40
10.0	5.32	3.56	1.32	6.01	3.59	1.35	6.33	3.92	1.36	6.78	4.11	1.37	7.25	4.21	1.39	7.47	4.68	1.40	7.47	4.68	1.40
15.0	5.27	3.55	1.32	5.95	3.58	1.34	6.27	3.91	1.35	6.72	4.11	1.36	7.18	4.20	1.38	7.40	4.67	1.39	7.40	4.67	1.39
19.4	5.65	3.64	1.59	6.38	3.67	1.62	6.73	4.00	1.63	7.20	4.20	1.65	7.70	4.30	1.67	7.94	4.78	1.68	7.94	4.78	1.68
25.0	6.03	3.72	2.00	6.81	3.75	2.04	7.18	4.10	2.06	7.69	4.30	2.08	8.22	4.40	2.10	8.47	4.89	2.11	8.47	4.89	2.11
30.6	5.96	3.72	2.42	6.73	3.75	2.46	7.10	4.09	2.48	7.60	4.30	2.51	8.12	4.40	2.54	8.37	4.88	2.55	8.37	4.88	2.55
35.0	5.89	3.71	2.84	6.65	3.75	2.89	7.02	4.09	2.91	7.51	4.29	2.94	8.03	4.39	2.98	8.28	4.88	2.99	8.28	4.88	2.99
40.0	4.66	3.28	2.22	5.27	3.30	2.26	5.56	3.61	2.27	5.95	3.79	2.30	6.36	3.87	2.33	6.56	4.31	2.34	6.56	4.31	2.34
46.1	3.44	2.57	1.59	3.89	2.75	1.62	4.10	3.00	1.63	4.39	3.15	1.65	4.69	3.22	1.67	4.83	3.58	1.68	4.83	3.58	1.68

# ● Indoor units: 7,000 Btu + 7,000 Btu + 14,000 Btu

		Indoor temperature																							
		64			70			75			80			85			90								
		54			60			63			67			71			73								
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP						
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
14	24.39	21.41	1.02	27.56	21.59	1.03	29.05	23.59	1.04	31.10	24.75	1.05	33.25	25.32	1.07	34.28	28.14	1.07	34.28	28.14	1.07				
23	23.73	21.16	1.18	26.82	21.34	1.20	28.27	23.31	1.21	30.27	24.46	1.23	32.35	25.03	1.24	33.35	27.82	1.25	33.35	27.82	1.25				
32	23.67	20.91	1.35	26.75	21.09	1.37	28.20	23.04	1.39	30.20	24.17	1.40	32.28	24.73	1.42	33.28	27.49	1.43	33.28	27.49	1.43				
41	23.17	20.75	1.67	26.19	20.93	1.70	27.60	22.86	1.72	29.55	23.99	1.73	31.59	24.54	1.75	32.57	27.28	1.76	32.57	27.28	1.76				
50	23.14	20.71	1.66	26.15	20.90	1.69	27.57	22.82	1.71	29.52	23.95	1.72	31.56	24.50	1.74	32.53	27.23	1.75	32.53	27.23	1.75				
59	22.92	20.68	1.65	25.90	20.86	1.68	27.31	22.78	1.70	29.24	23.90	1.71	31.25	24.46	1.73	32.22	27.18	1.74	32.22	27.18	1.74				
67	24.58	21.16	2.00	27.78	21.35	2.03	29.28	23.31	2.05	31.35	24.46	2.07	33.51	25.03	2.10	34.55	27.82	2.11	34.55	27.82	2.11				
77	26.23	21.65	2.52	29.65	21.84	2.56	31.25	23.85	2.58	33.46	25.02	2.61	35.77	25.60	2.64	36.87	28.46	2.66	36.87	28.46	2.66				
87	25.93	21.63	3.04	29.31	21.82	3.10	30.90	23.83	3.12	33.08	25.01	3.16	35.36	25.59	3.19	36.45	28.44	3.21	36.45	28.44	3.21				
95	25.64	21.62	3.57	28.97	21.81	3.63	30.54	23.82	3.66	32.70	24.99	3.70	34.96	25.57	3.74	36.04	28.42	3.76	36.04	28.42	3.76				
104	20.30	19.07	2.78	22.95	19.23	2.83	24.19	21.01	2.86	25.90	22.04	2.89	27.69	22.55	2.92	28.54	25.07	2.94	28.54	25.07	2.94				
115	14.97	14.96	2.00	16.92	16.00	2.04	17.84	17.47	2.05	19.10	18.33	2.08	20.41	18.76	2.10	21.04	20.85	2.11	21.04	20.85	2.11				

		Indoor temperature																				
		17.8			21.1			23.9			26.7			29.4			32.2					
		12.2			15.6			17.2			19.4			21.7			22.8					
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP			
	°CWB	kW			kW			kW			kW			kW			kW					
-10.0	7.15	6.27	1.02	8.08	6.33	1.03	8.51	6.91	1.04	9.12	7.25	1.05	9.74	7.42	1.07	10.05	8.25	1.07	10.05	8.25	1.07	
-5.0	6.95	6.20	1.18	7.86	6.26	1.20	8.29	6.83	1.21	8.87	7.17	1.23	9.48	7.34	1.24	9.78	8.15	1.25	9.78	8.15	1.25	
0.0	6.94	6.13	1.35	7.84	6.18	1.37	8.27	6.75	1.39	8.85	7.09	1.40	9.46	7.25	1.42	9.75	8.06	1.43	9.75	8.06	1.43	
5.0	6.79	6.08	1.67	7.67	6.13	1.70	8.09	6.70	1.72	8.66	7.03	1.73	9.26	7.19	1.75	9.55	7.99	1.76	9.55	7.99	1.76	
10.0	6.78	6.07	1.66	7.67	6.12	1.69	8.08	6.69	1.71	8.65	7.02	1.72	9.25	7.18	1.74	9.53	7.98	1.75	9.53	7.98	1.75	
15.0	6.72	6.06	1.65	7.59	6.11	1.68	8.00	6.68	1.70	8.57	7.01	1.71	9.16	7.17	1.73	9.44	7.97	1.74	9.44	7.97	1.74	
19.4	7.20	6.20	2.00	8.14	6.26	2.03	8.58	6.83	2.05	9.19	7.17	2.07	9.82	7.34	2.10	10.13	8.15	2.11	10.13	8.15	2.11	
25.0	7.69	6.34	2.52	8.69	6.40	2.56	9.16	6.99	2.58	9.81	7.33	2.61	10.48	7.50	2.64	10.81	8.34	2.66	10.81	8.34	2.66	
30.6	7.60	6.34	3.04	8.59	6.40	3.10	9.06	6.98	3.12	9.70	7.33	3.16	10.36	7.50	3.19	10.68	8.33	3.21	10.68	8.33	3.21	
35.0	7.51	6.34	3.57	8.49	6.39	3.63	8.95	6.98	3.66	9.58	7.33	3.70	10.25	7.49	3.74	10.56	8.33	3.76	10.56	8.33	3.76	
40.0	5.95	5.59	2.78	6.73	5.64	2.83	7.09	6.16	2.86	7.59	6.46	2.89										

## ● Indoor units: 7,000 Btu + 7,000 Btu + 18,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
14	26.40	23.18	1.18	29.83	23.38	1.20	31.45	25.53	1.21	33.67	26.79	1.22	36.00	27.41	1.23	37.11	30.47	1.24	
23	25.69	22.91	1.37	29.03	23.11	1.39	30.60	25.24	1.41	32.77	26.48	1.42	35.03	27.09	1.44	36.11	30.11	1.44	
32	25.63	22.64	1.56	28.96	22.83	1.59	30.53	24.94	1.60	32.69	26.17	1.62	34.95	26.78	1.64	36.02	29.76	1.65	
41	25.08	22.46	1.93	28.35	22.66	1.97	29.88	24.75	1.98	31.99	25.97	2.01	34.20	26.57	2.03	35.26	29.53	2.04	
50	25.05	22.43	1.92	28.31	22.62	1.96	29.85	24.71	1.97	31.96	25.93	1.99	34.16	26.53	2.02	35.22	29.48	2.03	
59	24.81	22.38	1.91	28.04	22.58	1.95	29.56	24.66	1.96	31.65	25.88	1.98	33.84	26.48	2.01	34.88	29.43	2.02	
67	26.61	22.91	2.31	30.07	23.11	2.35	31.70	25.24	2.37	33.94	26.48	2.40	36.28	27.10	2.43	37.40	30.12	2.44	
77	28.40	23.43	2.91	32.09	23.64	2.96	33.83	25.82	2.99	36.22	27.09	3.02	38.72	27.72	3.06	39.92	30.81	3.07	
87	28.08	23.42	3.52	31.73	23.62	3.58	33.45	25.80	3.61	35.81	27.07	3.65	38.28	27.70	3.69	39.46	30.79	3.71	
95	27.75	23.40	4.13	31.36	23.61	4.20	33.06	25.78	4.23	35.40	27.06	4.28	37.84	27.68	4.33	39.01	30.77	4.35	
104	21.98	20.64	3.22	24.84	20.82	3.28	26.19	22.74	3.30	28.04	23.86	3.34	29.97	24.42	3.38	30.90	27.14	3.40	
115	16.21	16.19	2.32	18.32	17.32	2.36	19.31	18.91	2.38	20.67	19.85	2.40	22.10	20.31	2.43	22.78	22.57	2.44	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW			kW			kW			kW			kW			kW		
-10.0	7.74	6.79	1.18	8.74	6.85	1.20	9.22	7.48	1.21	9.87	7.85	1.22	10.55	8.03	1.23	10.88	8.93	1.24	
-5.0	7.53	6.71	1.37	8.51	6.77	1.39	8.97	7.40	1.41	9.60	7.76	1.42	10.27	7.94	1.44	10.58	8.83	1.44	
0.0	7.51	6.63	1.56	8.49	6.69	1.59	8.95	7.31	1.60	9.58	7.67	1.62	10.24	7.85	1.64	10.56	8.72	1.65	
5.0	7.35	6.58	1.93	8.31	6.64	1.97	8.76	7.25	1.98	9.38	7.61	2.01	10.02	7.79	2.03	10.33	8.66	2.04	
10.0	7.34	6.57	1.92	8.30	6.63	1.96	8.75	7.24	1.97	9.37	7.60	1.99	10.01	7.77	2.02	10.32	8.64	2.03	
15.0	7.27	6.56	1.91	8.22	6.62	1.95	8.66	7.23	1.96	9.28	7.58	1.98	9.92	7.76	2.01	10.22	8.62	2.02	
19.4	7.80	6.71	2.31	8.81	6.77	2.35	9.29	7.40	2.37	9.95	7.76	2.40	10.63	7.94	2.43	10.96	8.83	2.44	
25.0	8.32	6.87	2.91	9.41	6.93	2.96	9.92	7.57	2.99	10.62	7.94	3.02	11.35	8.12	3.06	11.70	9.03	3.07	
30.6	8.23	6.86	3.52	9.30	6.92	3.58	9.80	7.56	3.61	10.50	7.93	3.65	11.22	8.12	3.69	11.57	9.02	3.71	
35.0	8.13	6.86	4.13	9.19	6.92	4.20	9.69	7.56	4.23	10.38	7.93	4.28	11.09	8.11	4.33	11.43	9.02	4.35	
40.0	6.44	6.05	3.22	7.28	6.10	3.28	7.67	6.67	3.30	8.22	6.99	3.34	8.78	7.16	3.38	9.06	7.95	3.40	
46.1	4.75	4.75	2.32	5.37	5.08	2.36	5.66	5.54	2.38	6.06	5.82	2.40	6.48	5.95	2.43	6.68	6.61	2.44	

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 7,000 Btu + 7,000 Btu + 24,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
14	27.59	24.22	1.23	31.18	24.43	1.25	32.87	26.69	1.26	35.19	28.00	1.28	37.62	28.65	1.29	38.78	31.84	1.30	
23	26.85	23.94	1.43	30.34	24.15	1.46	31.99	26.38	1.47	34.25	27.68	1.49	36.61	28.32	1.50	37.74	31.47	1.51	
32	26.79	23.66	1.64	30.27	23.87	1.66	31.91	26.07	1.68	34.17	27.35	1.70	36.53	27.99	1.72	37.65	31.10	1.73	
41	26.22	23.48	2.02	29.63	23.68	2.06	31.23	25.87	2.08	33.44	27.14	2.10	35.75	27.77	2.12	36.85	30.87	2.14	
50	26.19	23.44	2.01	29.59	23.64	2.05	31.20	25.82	2.07	33.40	27.10	2.09	35.71	27.72	2.11	36.81	30.81	2.12	
59	25.94	23.40	2.00	29.31	23.60	2.04	30.90	25.77	2.05	33.08	27.05	2.08	35.36	27.67	2.10	36.46	30.76	2.11	
67	27.81	23.94	2.42	31.43	24.15	2.46	33.13	26.38	2.48	35.47	27.68	2.51	37.92	28.32	2.54	39.09	31.48	2.55	
77	29.68	24.49	3.05	33.54	24.71	3.10	35.36	26.98	3.13	37.86	28.32	3.16	40.47	28.97	3.20	41.72	32.20	3.22	
87	29.35	24.48	3.68	33.16	24.69	3.75	34.96	26.97	3.78	37.43	28.30	3.82	40.01	28.95	3.87	41.25	32.18	3.89	
95	29.01	24.46	4.32	32.78	24.68	4.39	34.56	26.95	4.43	37.00	28.28	4.48	39.55	28.93	4.53	40.77	32.16	4.56	
104	22.97	21.58	3.37	25.96	21.76	3.43	27.37	23.77	3.46	29.30	24.94	3.50	31.33	25.52	3.54	32.29	28.36	3.56	
115	16.94	16.93	2.42	19.14	18.10	2.47	20.18	19.77	2.49	21.61	20.74	2.51	23.10	21.22	2.54	23.81	23.59	2.56	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW			kW			kW			kW			kW			kW		
-10.0	8.09	7.10	1.23	9.14	7.16	1.25	9.63	7.82	1.26	10.31	8.21	1.28	11.03	8.40	1.29	11.37	9.33	1.30	
-5.0	7.87	7.02	1.43	8.89	7.08	1.46	9.37	7.73	1.47	10.04	8.11	1.49	10.73	8.30	1.50	11.06	9.22	1.51	
0.0	7.85	6.93	1.64	8.87	6.99	1.66	9.35	7.64	1.68	10.01	8.02	1.70	10.71	8.20	1.72	11.04	9.12	1.73	
5.0	7.68	6.88	2.02	8.68	6.94	2.06	9.15	7.58	2.08	9.80	7.96	2.10	10.48	8.14	2.12	10.80	9.05	2.14	
10.0	7.67	6.87	2.01	8.67	6.93	2.05	9.14	7.57	2.07	9.79	7.94	2.09	10.46	8.13	2.11	10.79	9.03	2.12	
15.0	7.60	6.86	2.00	8.59	6.92	2.04	9.06	7.55	2.05	9.70	7.93	2.08	10.36	8.11	2.10	10.68	9.01	2.11	
19.4	8.15	7.02	2.42	9.21	7.08	2.46	9.71	7.73	2.48	10.40	8.11	2.51	11.11	8.30	2.54	11.46	9.23	2.55	
25.0	8.70	7.18	3.05	9.83	7.24	3.10	10.36	7.91	3.13	11.10	8.30	3.16	11.86	8.49	3.20	12.23	9.44	3.22	
30.6	8.60	7.17	3.68	9.72	7.24	3.75	10.25	7.90	3.78	10.97	8.29	3.82	11.73	8.49	3.87	12.09	9.43	3.89	
35.0	8.50	7.17	4.32	9.61	7.23	4.39	10.13	7.90	4.43	10.84	8.29	4.48	11.59	8.48	4.53	11.95	9.42	4.56	
40.0	6.73	6.32	3.37	7.61	6.38	3.43	8.02	6.97	3.46	8.59	7.31	3.50	9.18	7.48	3.54	9.46	8.31	3.56	
46.1	4.96	4.96	2.42	5.61	5.30	2.47	5.91	5.79	2.49	6.33	6.08	2.51	6.77	6.22	2.54	6.98	6.91	2.56	

## ● Indoor units: 7,000 Btu + 9,000 Btu + 12,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h			kW			kBtu/h			kW			kBtu/h			kW		
14	23.64	20.75	1.06	26.72	20.93	1.08	28.16	22.86	1.09	30.15	23.99	1.10	32.23	24.55	1.11	33.23	27.28	1.12	
23	23.00	20.51	1.23	26.00	20.69	1.25	27.40	22.60	1.26	29.34	23.71	1.28	31.37	24.26	1.29	32.33	26.96	1.30	
32	22.95	20.27	1.41	25.94	20.45	1.43	27.34	22.33	1.44	29.27	23.43	1.46	31.29	23.98	1.48	32.26	26.65	1.48	
41	22.46	20.12	1.74	25.38	20.29	1.77	26.76	22.16	1.78	28.65	23.26	1.80	30.63	23.79	1.83	31.57	26.44	1.84	
50	22.44	20.08	1.73	25.35	20.26	1.76	26.73	22.12	1.77	28.62	23.22	1.79	30.59	23.75	1.81	31.54	26.40	1.82	
59	22.22	20.04	1.72	25.11	20.22	1.75	26.47	22.08	1.76	28.34	23.17	1.78	30.30	23.71	1.80	31.23	26.35	1.81	
67	23.83	20.51	2.08	26.93	20.69	2.12	28.38	22.60	2.13	30.39	23.72	2.16	32.49	24.27	2.18	33.49	26.97	2.19	
77	25.43	20.98	2.62	28.74	21.17	2.67	30.30	23.12	2.69	32.44	24.26	2.72	34.68	24.82	2.75	35.75	27.59	2.76	
87	25.14	20.97	3.17	28.41	21.15	3.22	29.95	23.10	3.25	32.07	24.24	3.28	34.28	24.81	3.32	35.34	27.57	3.34	
95	24.85	20.96	3.71	28.09	21.14	3.78	29.61	23.09	3.81	31.70	24.23	3.85	33.89	24.79	3.89	34.93	27.55	3.92	
104	19.68	18.48	2.90	22.24	18.65	2.95	23.45	20.37	2.97	25.11	21.37	3.01	26.84	21.86	3.04	27.67	24.30	3.06	
115	14.51	14.50	2.08	16.40	15.51	2.12	17.29	16.94	2.14	18.51	17.77	2.16	19.79	18.18	2.19	20.40	20.21	2.20	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
-10.0	6.93	6.08	1.06	7.83	6.14	1.08	8.25	6.70	1.09	8.84	7.03	1.10	9.45	7.19	1.11	9.74	8.00	1.12	
-5.0	6.74	6.01	1.23	7.62	6.06	1.25	8.03	6.62	1.26	8.60	6.95	1.28	9.19	7.11	1.29	9.48	7.90	1.30	
0.0	6.73	5.94	1.41	7.60	5.99	1.43	8.01	6.55	1.44	8.58	6.87	1.46	9.17	7.03	1.48	9.45	7.81	1.48	
5.0	6.58	5.90	1.74	7.44	5.95	1.77	7.84	6.50	1.78	8.40	6.82	1.80	8.98	6.97	1.83	9.25	7.75	1.84	
10.0	6.58	5.89	1.73	7.43	5.94	1.76	7.83	6.48	1.77	8.39	6.80	1.79	8.97	6.96	1.81	9.24	7.74	1.82	
15.0	6.51	5.87	1.72	7.36	5.93	1.75	7.76	6.47	1.76	8.31	6.79	1.78	8.88	6.95	1.80	9.15	7.72	1.81	
19.4	6.98	6.01	2.08	7.89	6.06	2.12	8.32	6.62	2.13	8.91	6.95	2.16	9.52	7.11	2.18	9.82	7.90	2.19	
25.0	7.45	6.15	2.62	8.42	6.20	2.67	8.88	6.78	2.69	9.51	7.11	2.72	10.16	7.27	2.75	10.48	8.08	2.76	
30.6	7.37	6.15	3.17	8.33	6.20	3.22	8.78	6.77	3.25	9.40	7.11	3.28	10.05	7.27	3.32	10.36	8.08	3.34	
35.0	7.28	6.14	3.71	8.23	6.20	3.78	8.68	6.77	3.81	9.29	7.10	3.85	9.93	7.27	3.89	10.24	8.07	3.92	
40.0	5.77	5.42	2.90	6.52	5.47	2.95	6.87	5.97	2.97	7.36	6.26	3.01	7.87	6.41	3.04	8.11	7.12	3.06	
46.1	4.25	4.25	2.08	4.81	4.54	2.12	5.07	4.96	2.14	5.43	5.21	2.16	5.80	5.33	2.19	5.98	5.92	2.20	

## ● Indoor units: 7,000 Btu + 9,000 Btu + 14,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h			kW			kBtu/h			kW			kBtu/h			kW		
14	26.03	22.85	1.09	29.41	23.05	1.10	31.01	25.17	1.11	33.20	26.41	1.13	35.49	27.03	1.14	36.58	30.04	1.15	
23	25.33	22.58	1.26	28.62	22.78	1.29	30.17	24.88	1.30	32.30	26.11	1.31	34.53	26.71	1.33	35.60	29.69	1.33	
32	25.27	22.32	1.44	28.55	22.51	1.47	30.10	24.59	1.48	32.23	25.80	1.50	34.45	26.40	1.51	35.52	29.34	1.52	
41	24.73	22.15	1.78	27.95	22.34	1.82	29.46	24.40	1.83	31.54	25.60	1.85	33.72	26.20	1.87	34.76	29.11	1.88	
50	24.70	22.11	1.77	27.91	22.30	1.81	29.43	24.36	1.82	31.50	25.56	1.84	33.68	26.15	1.86	34.72	29.06	1.87	
59	24.46	22.07	1.76	27.65	22.26	1.80	29.15	24.31	1.81	31.20	25.51	1.83	33.36	26.10	1.85	34.39	29.01	1.86	
67	26.23	22.58	2.13	29.64	22.78	2.17	31.25	24.88	2.19	33.46	26.11	2.21	35.77	26.71	2.24	36.87	29.69	2.25	
77	28.00	23.10	2.69	31.64	23.30	2.74	33.35	25.45	2.76	35.71	26.71	2.79	38.18	27.33	2.82	39.35	30.37	2.84	
87	27.68	23.09	3.25	31.28	23.29	3.31	32.98	25.44	3.33	35.31	26.69	3.37	37.74	27.31	3.41	38.91	30.35	3.43	
95	27.36	23.07	3.81	30.92	23.27	3.87	32.60	25.42	3.91	34.90	26.67	3.95	37.31	27.29	4.00	38.46	30.33	4.02	
104	21.67	20.35	2.97	24.49	20.53	3.02	25.82	22.42	3.05	27.64	23.53	3.08	29.55	24.07	3.12	30.46	26.75	3.14	
115	15.98	15.97	2.14	18.06	17.07	2.17	19.04	18.65	2.19	20.38	19.57	2.22	21.79	20.02	2.24	22.46	22.25	2.25	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
-10.0	7.63	6.70	1.09	8.62	6.75	1.10	9.09	7.38	1.11	9.73	7.74	1.13	10.40	7.92	1.14	10.72	8.80	1.15	
-5.0	7.42	6.62	1.26	8.39	6.68	1.29	8.84	7.29	1.30	9.47	7.65	1.31	10.12	7.83	1.33	10.43	8.70	1.33	
0.0	7.41	6.54	1.44	8.37	6.60	1.47	8.82	7.21	1.48	9.45	7.56	1.50	10.10	7.74	1.51	10.41	8.60	1.52	
5.0	7.25	6.49	1.78	8.19	6.55	1.82	8.63	7.15	1.83	9.24	7.50	1.85	9.88	7.68	1.87	10.19	8.53	1.88	
10.0	7.24	6.48	1.77	8.18	6.54	1.81	8.62	7.14	1.82	9.23	7.49	1.84	9.87	7.66	1.86	10.18	8.52	1.87	
15.0	7.17	6.47	1.76	8.10	6.52	1.80	8.54	7.13	1.81	9.15	7.48	1.83	9.78	7.65	1.85	10.08	8.50	1.86	
19.4	7.69	6.62	2.13	8.69	6.68	2.17	9.16	7.29	2.19	9.81	7.65	2.21	10.48	7.83	2.24	10.81	8.70	2.25	
25.0	8.21	6.77	2.69	9.27	6.83	2.74	9.78	7.46	2.76	10.47	7.83	2.79	11.19	8.01	2.82	11.53	8.90	2.84	
30.6	8.11	6.77	3.25	9.17	6.83	3.31	9.66	7.45	3.33	10.35	7.82	3.37	11.06	8.00	3.41	11.40	8.90	3.43	
35.0	8.02	6.76	3.81	9.06	6.82	3.87	9.55	7.45	3.91	10.23	7.82	3.95	10.93	8.00	4.00	11.27	8.89	4.02	
40.0	6.35	5.96	2.97	7.18	6.02	3.02	7.57	6.57	3.05	8.10	6.90	3.08	8.66	7.06	3.12	8.93	7.84	3.14	
46.1	4.68	4.68	2.14	5.29	5.00	2.17	5.58	5.46	2.19	5.97	5.73	2.22	6.39	5.87	2.24	6.58	6.52	2.25	

OUTDOOR UNIT  
 UOMH36AFXZJ

## ● Indoor units: 7,000 Btu + 9,000 Btu + 18,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW
	14	27.14	23.83	1.21	30.68	24.04	1.23	32.34	26.25	1.24	34.62	27.55	1.26	37.01	28.19	1.27	38.15	31.33	1.28
	23	26.41	23.55	1.41	29.85	23.76	1.44	31.47	25.95	1.45	33.69	27.23	1.46	36.02	27.86	1.48	37.13	30.96	1.49
	32	26.35	23.28	1.61	29.78	23.48	1.64	31.40	25.64	1.65	33.61	26.91	1.67	35.93	27.53	1.69	37.04	30.60	1.70
	41	25.79	23.10	1.99	29.15	23.30	2.03	30.73	25.45	2.04	32.90	26.70	2.07	35.17	27.32	2.09	36.25	30.37	2.10
	50	25.76	23.06	1.98	29.11	23.26	2.02	30.69	25.40	2.03	32.86	26.66	2.06	35.13	27.28	2.08	36.21	30.31	2.09
	59	25.52	23.02	1.97	28.84	23.22	2.00	30.40	25.36	2.02	32.55	26.61	2.04	34.79	27.22	2.07	35.87	30.26	2.08
	67	27.36	23.56	2.38	30.92	23.76	2.43	32.59	25.95	2.45	34.90	27.23	2.47	37.30	27.86	2.50	38.46	30.97	2.51
	77	29.20	24.10	3.00	33.00	24.31	3.05	34.79	26.55	3.08	37.25	27.86	3.11	39.82	28.50	3.15	41.05	31.68	3.17
	87	28.87	24.08	3.63	32.63	24.29	3.69	34.39	26.53	3.72	36.82	27.84	3.76	39.36	28.48	3.80	40.58	31.66	3.83
95	28.54	24.06	4.25	32.25	24.27	4.33	34.00	26.51	4.36	36.40	27.82	4.41	38.91	28.46	4.46	40.11	31.64	4.48	
104	22.60	21.23	3.32	25.54	21.41	3.38	26.93	23.38	3.40	28.83	24.54	3.44	30.82	25.11	3.48	31.77	27.90	3.50	
115	16.67	16.65	2.39	18.83	17.81	2.43	19.85	19.45	2.45	21.26	20.41	2.48	22.72	20.88	2.50	23.43	23.20	2.52	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	7.96	6.98	1.21	8.99	7.05	1.23	9.48	7.69	1.24	10.15	8.07	1.26	10.85	8.26	1.27	11.18	9.18	1.28
	-5.0	7.74	6.90	1.41	8.75	6.96	1.44	9.22	7.61	1.45	9.87	7.98	1.46	10.56	8.17	1.48	10.88	9.07	1.49
	0.0	7.72	6.82	1.61	8.73	6.88	1.64	9.20	7.52	1.65	9.85	7.89	1.67	10.53	8.07	1.69	10.86	8.97	1.70
	5.0	7.56	6.77	1.99	8.54	6.83	2.03	9.01	7.46	2.04	9.64	7.83	2.07	10.31	8.01	2.09	10.63	8.90	2.10
	10.0	7.55	6.76	1.98	8.53	6.82	2.02	8.99	7.45	2.03	9.63	7.81	2.06	10.29	7.99	2.08	10.61	8.88	2.09
	15.0	7.48	6.75	1.97	8.45	6.80	2.00	8.91	7.43	2.02	9.54	7.80	2.04	10.20	7.98	2.07	10.51	8.87	2.08
	19.4	8.02	6.90	2.38	9.06	6.96	2.43	9.55	7.61	2.45	10.23	7.98	2.47	10.93	8.17	2.50	11.27	9.08	2.51
	25.0	8.56	7.06	3.00	9.67	7.12	3.05	10.20	7.78	3.08	10.92	8.16	3.11	11.67	8.35	3.15	12.03	9.28	3.17
	30.6	8.46	7.06	3.63	9.56	7.12	3.69	10.08	7.78	3.72	10.79	8.16	3.76	11.54	8.35	3.80	11.89	9.28	3.83
35.0	8.36	7.05	4.25	9.45	7.11	4.33	9.96	7.77	4.36	10.67	8.15	4.41	11.40	8.34	4.46	11.76	9.27	4.48	
40.0	6.62	6.22	3.32	7.49	6.28	3.38	7.89	6.85	3.40	8.45	7.19	3.44	9.03	7.36	3.48	9.31	8.18	3.50	
46.1	4.88	4.88	2.39	5.52	5.22	2.43	5.82	5.70	2.45	6.23	5.98	2.48	6.66	6.12	2.50	6.87	6.80	2.52	

OUTDOOR UNIT UOMH36AFXJ

## ● Indoor units: 7,000 Btu + 12,000 Btu + 12,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW
	14	26.10	22.91	1.17	29.50	23.11	1.19	31.09	25.24	1.20	33.29	26.49	1.21	35.59	27.10	1.22	36.69	30.12	1.23
	23	25.40	22.65	1.36	28.70	22.85	1.38	30.26	24.95	1.39	32.40	26.18	1.41	34.63	26.79	1.42	35.70	29.77	1.43
	32	25.34	22.38	1.55	28.64	22.58	1.58	30.19	24.66	1.59	32.32	25.87	1.61	34.55	26.47	1.62	35.62	29.42	1.63
	41	24.80	22.21	1.92	28.03	22.40	1.95	29.55	24.47	1.97	31.63	25.68	1.99	33.82	26.27	2.01	34.86	29.20	2.02
	50	24.77	22.17	1.90	27.99	22.37	1.94	29.51	24.43	1.95	31.60	25.63	1.98	33.78	26.23	2.00	34.82	29.15	2.01
	59	24.53	22.13	1.89	27.73	22.32	1.93	29.23	24.38	1.94	31.29	25.59	1.96	33.45	26.18	1.99	34.49	29.09	2.00
	67	26.31	22.65	2.29	29.73	22.85	2.33	31.34	24.95	2.35	33.55	26.19	2.38	35.87	26.79	2.40	36.98	29.78	2.42
	77	28.08	23.17	2.89	31.73	23.37	2.94	33.45	25.53	2.96	35.81	26.78	2.99	38.29	27.40	3.03	39.47	30.46	3.04
	87	27.76	23.15	3.49	31.37	23.36	3.55	33.07	25.51	3.58	35.41	26.77	3.62	37.85	27.39	3.66	39.02	30.44	3.68
95	27.44	23.14	4.09	31.01	23.34	4.16	32.69	25.49	4.19	35.00	26.75	4.24	37.42	27.37	4.29	38.57	30.42	4.31	
104	21.73	20.41	3.19	24.56	20.59	3.25	25.89	22.49	3.27	27.72	23.60	3.31	29.63	24.14	3.35	30.55	26.83	3.37	
115	16.02	16.01	2.29	18.11	17.12	2.33	19.09	18.70	2.35	20.44	19.62	2.38	21.85	20.08	2.41	22.52	22.31	2.42	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	7.65	6.72	1.17	8.64	6.77	1.19	9.11	7.40	1.20	9.76	7.76	1.21	10.43	7.94	1.22	10.75	8.83	1.23
	-5.0	7.44	6.64	1.36	8.41	6.70	1.38	8.87	7.31	1.39	9.49	7.67	1.41	10.15	7.85	1.42	10.46	8.73	1.43
	0.0	7.43	6.56	1.55	8.39	6.62	1.58	8.85	7.23	1.59	9.47	7.58	1.61	10.13	7.76	1.62	10.44	8.62	1.63
	5.0	7.27	6.51	1.92	8.21	6.57	1.95	8.66	7.17	1.97	9.27	7.53	1.99	9.91	7.70	2.01	10.22	8.56	2.02
	10.0	7.26	6.50	1.90	8.20	6.56	1.94	8.65	7.16	1.95	9.26	7.51	1.98	9.90	7.69	2.00	10.20	8.54	2.01
	15.0	7.19	6.49	1.89	8.13	6.54	1.93	8.57	7.15	1.94	9.17	7.50	1.96	9.80	7.67	1.99	10.11	8.53	2.00
	19.4	7.71	6.64	2.29	8.71	6.70	2.33	9.19	7.31	2.35	9.83	7.67	2.38	10.51	7.85	2.40	10.84	8.73	2.42
	25.0	8.23	6.79	2.89	9.30	6.85	2.94	9.80	7.48	2.96	10.50	7.85	2.99	11.22	8.03	3.03	11.57	8.93	3.04
	30.6	8.14	6.79	3.49	9.19	6.85	3.55	9.69	7.48	3.58	10.38	7.85	3.62	11.09	8.03	3.66	11.44	8.92	3.68
35.0	8.04	6.78	4.09	9.09	6.84	4.16	9.58	7.47	4.19	10.26	7.84	4.24	10.97	8.02	4.29	11.30	8.92	4.31	
40.0	6.37	5.98	3.19	7.20	6.03	3.25	7.59	6.59	3.27	8.12	6.92	3.31	8.68	7.08	3.35	8.95	7.86	3.37	
46.1	4.70	4.69	2.29	5.31	5.02	2.33	5.60	5.48	2.35	5.99	5.75	2.38	6.40	5.88	2.41	6.60	6.54	2.42	

# ● Indoor units: 7,000 Btu + 12,000 Btu + 14,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	26.85	23.57	1.12	30.34	23.77	1.14	31.98	25.97	1.15	34.24	27.25	1.16	36.61	27.88	1.18	37.74	30.98	1.18
	23	26.12	23.29	1.31	29.52	23.50	1.33	31.12	25.66	1.34	33.32	26.93	1.35	35.62	27.55	1.37	36.72	30.62	1.38
	32	26.06	23.02	1.49	29.45	23.22	1.52	31.05	25.36	1.53	33.24	26.61	1.55	35.54	27.23	1.56	36.64	30.26	1.57
	41	25.51	22.84	1.84	28.83	23.04	1.88	30.39	25.17	1.89	32.54	26.41	1.91	34.78	27.02	1.93	35.86	30.03	1.94
	50	25.48	22.81	1.83	28.79	23.00	1.87	30.35	25.13	1.88	32.50	26.37	1.90	34.74	26.98	1.92	35.81	29.98	1.93
	59	25.24	22.76	1.82	28.52	22.96	1.85	30.06	25.08	1.87	32.19	26.32	1.89	34.41	26.93	1.91	35.47	29.92	1.92
	67	27.06	23.30	2.20	30.58	23.50	2.24	32.23	25.67	2.26	34.51	26.93	2.29	36.89	27.56	2.31	38.03	30.63	2.33
	77	28.88	23.83	2.78	32.64	24.04	2.83	34.41	26.25	2.85	36.84	27.55	2.88	39.38	28.19	2.91	40.59	31.33	2.93
	87	28.55	23.82	3.35	32.27	24.02	3.41	34.02	26.24	3.44	36.42	27.53	3.48	38.93	28.17	3.52	40.13	31.31	3.54
	95	28.22	23.80	3.93	31.90	24.01	4.00	33.62	26.22	4.04	36.00	27.52	4.08	38.48	28.15	4.13	39.67	31.29	4.15
	104	22.35	20.99	3.07	25.26	21.18	3.12	26.63	23.13	3.15	28.51	24.27	3.18	30.48	24.83	3.22	31.42	27.60	3.24
115	16.48	16.47	2.21	18.63	17.61	2.25	19.64	19.23	2.26	21.02	20.18	2.29	22.47	20.65	2.32	23.17	22.95	2.33	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW					
	-10.0	7.87	6.91	1.12	8.89	6.97	1.14	9.37	7.61	1.15	10.04	7.99	1.16	10.73	8.17	1.18	11.06	9.08	1.18
	-5.0	7.66	6.83	1.31	8.65	6.89	1.33	9.12	7.52	1.34	9.77	7.89	1.35	10.44	8.08	1.37	10.76	8.97	1.38
	0.0	7.64	6.75	1.49	8.63	6.81	1.52	9.10	7.43	1.53	9.74	7.80	1.55	10.42	7.98	1.56	10.74	8.87	1.57
	5.0	7.48	6.70	1.84	8.45	6.75	1.88	8.91	7.38	1.89	9.54	7.74	1.91	10.19	7.92	1.93	10.51	8.80	1.94
	10.0	7.47	6.68	1.83	8.44	6.74	1.87	8.90	7.36	1.88	9.52	7.73	1.90	10.18	7.91	1.92	10.50	8.79	1.93
	15.0	7.40	6.67	1.82	8.36	6.73	1.85	8.81	7.35	1.87	9.43	7.71	1.89	10.08	7.89	1.91	10.40	8.77	1.92
	19.4	7.93	6.83	2.20	8.96	6.89	2.24	9.45	7.52	2.26	10.12	7.89	2.29	10.81	8.08	2.31	11.15	8.98	2.33
	25.0	8.46	6.98	2.78	9.57	7.05	2.83	10.08	7.69	2.85	10.80	8.07	2.88	11.54	8.26	2.91	11.90	9.18	2.93
	30.6	8.37	6.98	3.35	9.46	7.04	3.41	9.97	7.69	3.44	10.67	8.07	3.48	11.41	8.26	3.52	11.76	9.18	3.54
	35.0	8.27	6.98	3.93	9.35	7.04	4.00	9.85	7.68	4.04	10.55	8.06	4.08	11.28	8.25	4.13	11.63	9.17	4.15
	40.0	6.55	6.15	3.07	7.40	6.21	3.12	7.80	6.78	3.15	8.36	7.11	3.18	8.93	7.28	3.22	9.21	8.09	3.24
46.1	4.83	4.83	2.21	5.46	5.16	2.25	5.75	5.64	2.26	6.16	5.92	2.29	6.59	6.05	2.32	6.79	6.73	2.33	

OUTDOOR UNIT UOMH36AFXZJ

# ● Indoor units: 7,000 Btu + 12,000 Btu + 18,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	27.59	24.22	1.23	31.18	24.43	1.25	32.87	26.69	1.26	35.19	28.00	1.28	37.62	28.65	1.29	38.78	31.84	1.30
	23	26.85	23.94	1.43	30.34	24.15	1.46	31.99	26.38	1.47	34.25	27.68	1.49	36.61	28.32	1.50	37.74	31.47	1.51
	32	26.79	23.66	1.64	30.27	23.87	1.66	31.91	26.07	1.68	34.17	27.35	1.70	36.53	27.99	1.72	37.65	31.10	1.73
	41	26.22	23.48	2.02	29.63	23.68	2.06	31.23	25.87	2.08	33.44	27.14	2.10	35.75	27.77	2.12	36.85	30.87	2.14
	50	26.19	23.44	2.01	29.59	23.64	2.05	31.20	25.82	2.07	33.40	27.10	2.09	35.71	27.72	2.11	36.81	30.81	2.12
	59	25.94	23.40	2.00	29.31	23.60	2.04	30.90	25.77	2.05	33.08	27.05	2.08	35.36	27.67	2.10	36.46	30.76	2.11
	67	27.81	23.94	2.42	31.43	24.15	2.46	33.13	26.38	2.48	35.47	27.68	2.51	37.92	28.32	2.54	39.09	31.48	2.55
	77	29.68	24.49	3.05	33.54	24.71	3.10	35.36	26.98	3.13	37.86	28.32	3.16	40.47	28.97	3.20	41.72	32.20	3.22
	87	29.35	24.48	3.68	33.16	24.69	3.75	34.96	26.97	3.78	37.43	28.30	3.82	40.01	28.95	3.87	41.25	32.18	3.89
	95	29.01	24.46	4.32	32.78	24.68	4.39	34.56	26.95	4.43	37.00	28.28	4.48	39.55	28.93	4.53	40.77	32.16	4.56
	104	22.97	21.58	3.37	25.96	21.76	3.43	27.37	23.77	3.46	29.30	24.94	3.50	31.33	25.52	3.54	32.29	28.36	3.56
115	16.94	16.93	2.42	19.14	18.10	2.47	20.18	19.77	2.49	21.61	20.74	2.51	23.10	21.22	2.54	23.81	23.59	2.56	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW					
	-10.0	8.09	7.10	1.23	9.14	7.16	1.25	9.63	7.82	1.26	10.31	8.21	1.28	11.03	8.40	1.29	11.37	9.33	1.30
	-5.0	7.87	7.02	1.43	8.89	7.08	1.46	9.37	7.73	1.47	10.04	8.11	1.49	10.73	8.30	1.50	11.06	9.22	1.51
	0.0	7.85	6.93	1.64	8.87	6.99	1.66	9.35	7.64	1.68	10.01	8.02	1.70	10.71	8.20	1.72	11.04	9.12	1.73
	5.0	7.68	6.88	2.02	8.68	6.94	2.06	9.15	7.58	2.08	9.80	7.96	2.10	10.48	8.14	2.12	10.80	9.05	2.14
	10.0	7.67	6.87	2.01	8.67	6.93	2.05	9.14	7.57	2.07	9.79	7.94	2.09	10.46	8.13	2.11	10.79	9.03	2.12
	15.0	7.60	6.86	2.00	8.59	6.92	2.04	9.06	7.55	2.05	9.70	7.93	2.08	10.36	8.11	2.10	10.68	9.01	2.11
	19.4	8.15	7.02	2.42	9.21	7.08	2.46	9.71	7.73	2.48	10.40	8.11	2.51	11.11	8.30	2.54	11.46	9.23	2.55
	25.0	8.70	7.18	3.05	9.83	7.24	3.10	10.36	7.91	3.13	11.10	8.30	3.16	11.86	8.49	3.20	12.23	9.44	3.22
	30.6	8.60	7.17	3.68	9.72	7.24	3.75	10.25	7.90	3.78	10.97	8.29	3.82	11.73	8.49	3.87	12.09	9.43	3.89
	35.0	8.50	7.17	4.32	9.61	7.23	4.39	10.13	7.90	4.43	10.84	8.29	4.48	11.59	8.48	4.53	11.95	9.42	4.56
	40.0	6.73	6.32	3.37	7.61	6.38	3.43	8.02	6.97	3.46	8.59	7.31	3.50	9.18	7.48	3.54	9.46	8.31	3.56
46.1	4.96	4.96	2.42	5.61	5.30	2.47	5.91	5.79	2.49	6.33	6.08	2.51	6.77	6.22	2.54	6.98	6.91	2.56	

## ● Indoor units: 9,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature																		
		64			70			75			80			85			90			
		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
14	22.82	20.03	1.02	25.79	20.21	1.03	27.19	22.07	1.04	29.11	23.16	1.05	31.11	23.70	1.07	32.07	26.34	1.07		
23	22.21	19.80	1.18	25.09	19.97	1.20	26.45	21.81	1.21	28.32	22.89	1.23	30.28	23.42	1.24	31.21	26.03	1.25		
32	22.15	19.57	1.35	25.04	19.74	1.37	26.39	21.56	1.39	28.26	22.62	1.40	30.21	23.15	1.42	31.14	25.72	1.43		
41	21.68	19.42	1.67	24.50	19.59	1.70	25.83	21.39	1.72	27.66	22.45	1.73	29.56	22.97	1.75	30.48	25.53	1.76		
50	21.66	19.38	1.66	24.47	19.55	1.69	25.80	21.36	1.71	27.62	22.41	1.72	29.53	22.93	1.74	30.44	25.48	1.75		
59	21.45	19.35	1.65	24.24	19.52	1.68	25.55	21.32	1.70	27.36	22.37	1.71	29.25	22.89	1.73	30.15	25.44	1.74		
67	23.00	19.80	2.00	25.99	19.98	2.03	27.40	21.82	2.05	29.34	22.89	2.07	31.36	23.42	2.10	32.33	26.03	2.11		
77	24.55	20.26	2.52	27.74	20.43	2.56	29.25	22.32	2.58	31.31	23.42	2.61	33.47	23.96	2.64	34.51	26.63	2.66		
87	24.27	20.24	3.04	27.43	20.42	3.10	28.91	22.30	3.12	30.96	23.40	3.16	33.09	23.94	3.19	34.11	26.61	3.21		
95	23.99	20.23	3.57	27.11	20.41	3.63	28.58	22.29	3.66	30.60	23.39	3.70	32.71	23.93	3.74	33.72	26.59	3.76		
104	19.00	17.84	2.78	21.47	18.00	2.83	22.64	19.66	2.86	24.23	20.63	2.89	25.91	21.11	2.92	26.71	23.46	2.94		
115	14.01	14.00	2.00	15.83	14.97	2.04	16.69	16.35	2.05	17.87	17.16	2.08	19.10	17.55	2.10	19.69	19.51	2.11		

		Indoor temperature																		
		17.8			21.1			23.9			26.7			29.4			32.2			
		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
	°CWB	kW			kW			kW			kW			kW			kW			
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
-10.0	6.69	5.87	1.02	7.56	5.92	1.03	7.97	6.47	1.04	8.53	6.79	1.05	9.12	6.94	1.07	9.40	7.72	1.07		
-5.0	6.51	5.80	1.18	7.35	5.85	1.20	7.75	6.39	1.21	8.30	6.71	1.23	8.87	6.86	1.24	9.15	7.63	1.25		
0.0	6.49	5.73	1.35	7.34	5.78	1.37	7.74	6.32	1.39	8.28	6.63	1.40	8.85	6.78	1.42	9.13	7.54	1.43		
5.0	6.35	5.69	1.67	7.18	5.74	1.70	7.57	6.27	1.72	8.11	6.58	1.73	8.66	6.73	1.75	8.93	7.48	1.76		
10.0	6.35	5.68	1.66	7.17	5.73	1.69	7.56	6.26	1.71	8.10	6.57	1.72	8.65	6.72	1.74	8.92	7.47	1.75		
15.0	6.29	5.67	1.65	7.10	5.72	1.68	7.49	6.25	1.70	8.02	6.56	1.71	8.57	6.71	1.73	8.84	7.45	1.74		
19.4	6.74	5.80	2.00	7.62	5.85	2.03	8.03	6.39	2.05	8.60	6.71	2.07	9.19	6.86	2.10	9.47	7.63	2.11		
25.0	7.19	5.94	2.52	8.13	5.99	2.56	8.57	6.54	2.58	9.18	6.86	2.61	9.81	7.02	2.64	10.11	7.80	2.66		
30.6	7.11	5.93	3.04	8.04	5.98	3.10	8.47	6.54	3.12	9.07	6.86	3.16	9.70	7.02	3.19	10.00	7.80	3.21		
35.0	7.03	5.93	3.57	7.95	5.98	3.63	8.38	6.53	3.66	8.97	6.85	3.70	9.59	7.01	3.74	9.88	7.79	3.76		
40.0	5.57	5.23	2.78	6.29	5.28	2.83	6.63	5.76	2.86	7.10	6.05	2.89	7.59	6.19	2.92	7.83	6.87	2.94		
46.1	4.11	4.10	2.00	4.64	4.39	2.04	4.89	4.79	2.05	5.24	5.03	2.08	5.60	5.14	2.10	5.77	5.72	2.11		

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 9,000 Btu + 9,000 Btu + 12,000 Btu

		Indoor temperature																		
		64			70			75			80			85			90			
		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
14	25.28	22.19	1.13	28.57	22.39	1.15	30.12	24.45	1.16	32.25	25.66	1.17	34.47	26.25	1.18	35.53	29.18	1.19		
23	24.60	21.94	1.31	27.80	22.13	1.34	29.31	24.17	1.35	31.38	25.36	1.36	33.54	25.95	1.38	34.58	28.84	1.38		
32	24.54	21.68	1.50	27.74	21.87	1.52	29.24	23.88	1.54	31.31	25.06	1.55	33.47	25.64	1.57	34.50	28.50	1.58		
41	24.02	21.51	1.85	27.15	21.70	1.89	28.62	23.70	1.90	30.64	24.87	1.92	32.75	25.45	1.94	33.76	28.28	1.95		
50	23.99	21.48	1.84	27.11	21.66	1.87	28.58	23.66	1.89	30.60	24.83	1.91	32.71	25.40	1.93	33.72	28.23	1.94		
59	23.76	21.44	1.83	26.86	21.62	1.86	28.31	23.62	1.88	30.31	24.78	1.90	32.40	25.35	1.92	33.40	28.18	1.93		
67	25.48	21.94	2.22	28.79	22.13	2.25	30.35	24.17	2.27	32.50	25.36	2.30	34.74	25.95	2.32	35.81	28.84	2.34		
77	27.20	22.44	2.79	30.73	22.64	2.84	32.40	24.72	2.86	34.69	25.94	2.89	37.08	26.54	2.93	38.23	29.50	2.94		
87	26.89	22.43	3.37	30.38	22.62	3.43	32.03	24.71	3.46	34.29	25.93	3.50	36.66	26.53	3.54	37.79	29.48	3.56		
95	26.58	22.41	3.95	30.04	22.61	4.02	31.66	24.69	4.05	33.90	25.91	4.10	36.24	26.51	4.15	37.36	29.46	4.17		
104	21.05	19.77	3.09	23.79	19.94	3.14	25.08	21.78	3.17	26.85	22.85	3.20	28.70	23.38	3.24	29.59	25.99	3.25		
115	15.52	15.51	2.22	17.54	16.58	2.26	18.49	18.11	2.28	19.80	19.01	2.30	21.16	19.44	2.33	21.82	21.61	2.34		

		Indoor temperature																		
		17.8			21.1			23.9			26.7			29.4			32.2			
		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
	°CWB	kW			kW			kW			kW			kW			kW			
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
-10.0	7.41	6.50	1.13	8.37	6.56	1.15	8.83	7.17	1.16	9.45	7.52	1.17	10.10	7.69	1.18	10.41	8.55	1.19		
-5.0	7.21	6.43	1.31	8.15	6.49	1.34	8.59	7.08	1.35	9.20	7.43	1.36	9.83	7.60	1.38	10.13	8.45	1.38		
0.0	7.19	6.35	1.50	8.13	6.41	1.52	8.57	7.00	1.54	9.18	7.35	1.55	9.81	7.51	1.57	10.11	8.35	1.58		
5.0	7.04	6.30	1.85	7.96	6.36	1.89	8.39	6.95	1.90	8.98	7.29	1.92	9.60	7.46	1.94	9.90	8.29	1.95		
10.0	7.03	6.29	1.84	7.95	6.35	1.87	8.38	6.93	1.89	8.97	7.28	1.91	9.59	7.44	1.93	9.88	8.27	1.94		
15.0	6.96	6.28	1.83	7.87	6.34	1.86	8.30	6.92	1.88	8.88	7.26	1.90	9.50	7.43	1.92	9.79	8.26	1.93		
19.4	7.47	6.43	2.22	8.44	6.49	2.25	8.90	7.08	2.27	9.53	7.43	2.30	10.18	7.61	2.32	10.50	8.45	2.34		
25.0	7.97	6.58	2.79	9.01	6.63	2.84	9.50	7.25	2.86	10.17	7.60	2.89	10.87	7.78	2.93	11.20	8.65	2.94		
30.6	7.88	6.57	3.37	8.91	6.63	3.43	9.39	7.24	3.46	10.05	7.60	3.50	10.74	7.77	3.54	11.08	8.64	3.56		
35.0	7.79	6.57	3.95	8.80	6.63	4.02	9.28	7.24	4.05	9.94	7.59	4.10	10.62	7.77	4.15	10.95	8.63	4.17		
40.0	6.17	5.79	3.09	6.97	5.84	3.14	7.35	6.38	3.17	7.87	6.70	3.20	8.41	6.85	3.24	8.67	7.62	3.25		
46.1	4.55	4.55	2.22	5.14	4.86	2.26	5.42	5.31	2.28	5.80	5.57	2.30	6.20	5.70	2.33	6.39	6.33	2.34		

## ● Indoor units: 9,000 Btu + 9,000 Btu + 14,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kW			kW			kW			kW			kW			kW		
		kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h
14	26.92	23.63	1.12	30.42	23.84	1.14	32.07	26.04	1.15	34.34	27.32	1.17	36.71	27.95	1.18	37.84	31.07	1.19	
23	26.20	23.36	1.31	29.60	23.56	1.33	31.21	25.73	1.34	33.41	27.01	1.36	35.72	27.63	1.37	36.82	30.71	1.38	
32	26.14	23.08	1.49	29.54	23.29	1.52	31.14	25.43	1.53	33.34	26.69	1.55	35.64	27.31	1.57	36.74	30.35	1.58	
41	25.58	22.91	1.85	28.91	23.11	1.88	30.47	25.24	1.90	32.63	26.48	1.92	34.88	27.10	1.94	35.96	30.12	1.95	
50	25.55	22.87	1.84	28.87	23.07	1.87	30.44	25.19	1.89	32.59	26.44	1.91	34.84	27.05	1.93	35.91	30.06	1.94	
59	25.31	22.83	1.83	28.60	23.03	1.86	30.15	25.15	1.87	32.28	26.39	1.90	34.50	27.00	1.92	35.57	30.01	1.93	
67	27.13	23.36	2.21	30.66	23.57	2.25	32.32	25.74	2.27	34.61	27.01	2.29	37.00	27.63	2.32	38.14	30.71	2.33	
77	28.96	23.90	2.78	32.73	24.11	2.83	34.50	26.33	2.86	36.94	27.63	2.89	39.49	28.27	2.92	40.71	31.41	2.94	
87	28.63	23.88	3.36	32.36	24.09	3.42	34.11	26.31	3.45	36.52	27.61	3.49	39.04	28.25	3.53	40.24	31.39	3.55	
95	28.30	23.87	3.94	31.98	24.07	4.01	33.72	26.29	4.05	36.10	27.59	4.09	38.59	28.23	4.14	39.78	31.37	4.16	
104	22.42	21.05	3.08	25.33	21.23	3.13	26.70	23.19	3.16	28.59	24.34	3.19	30.56	24.90	3.23	31.51	27.67	3.25	
115	16.53	16.51	2.21	18.68	17.66	2.25	19.69	19.29	2.27	21.08	20.24	2.30	22.54	20.71	2.32	23.23	23.01	2.33	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h
-10.0	7.89	6.93	1.12	8.92	6.99	1.14	9.40	7.63	1.15	10.06	8.01	1.17	10.76	8.19	1.18	11.09	9.11	1.19	
-5.0	7.68	6.85	1.31	8.68	6.91	1.33	9.15	7.54	1.34	9.79	7.91	1.36	10.47	8.10	1.37	10.79	9.00	1.38	
0.0	7.66	6.77	1.49	8.66	6.82	1.52	9.13	7.45	1.53	9.77	7.82	1.55	10.44	8.00	1.57	10.77	8.89	1.58	
5.0	7.50	6.71	1.85	8.47	6.77	1.88	8.93	7.40	1.90	9.56	7.76	1.92	10.22	7.94	1.94	10.54	8.83	1.95	
10.0	7.49	6.70	1.84	8.46	6.76	1.87	8.92	7.38	1.89	9.55	7.75	1.91	10.21	7.93	1.93	10.53	8.81	1.94	
15.0	7.42	6.69	1.83	8.38	6.75	1.86	8.84	7.37	1.87	9.46	7.73	1.90	10.11	7.91	1.92	10.42	8.79	1.93	
19.4	7.95	6.85	2.21	8.99	6.91	2.25	9.47	7.54	2.27	10.14	7.92	2.29	10.84	8.10	2.32	11.18	9.00	2.33	
25.0	8.49	7.00	2.78	9.59	7.06	2.83	10.11	7.72	2.86	10.83	8.10	2.89	11.57	8.28	2.92	11.93	9.21	2.94	
30.6	8.39	7.00	3.36	9.48	7.06	3.42	10.00	7.71	3.45	10.70	8.09	3.49	11.44	8.28	3.53	11.80	9.20	3.55	
35.0	8.29	6.99	3.94	9.37	7.06	4.01	9.88	7.71	4.05	10.58	8.09	4.09	11.31	8.27	4.14	11.66	9.20	4.16	
40.0	6.57	6.17	3.08	7.42	6.22	3.13	7.83	6.80	3.16	8.38	7.13	3.19	8.96	7.30	3.23	9.23	8.11	3.25	
46.1	4.84	4.84	2.21	5.47	5.18	2.25	5.77	5.65	2.27	6.18	5.93	2.30	6.61	6.07	2.32	6.81	6.74	2.33	

## ● Indoor units: 9,000 Btu + 9,000 Btu + 18,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kW			kW			kW			kW			kW			kW		
		kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h
14	27.59	24.22	1.23	31.18	24.43	1.25	32.87	26.69	1.26	35.19	28.00	1.28	37.62	28.65	1.29	38.78	31.84	1.30	
23	26.85	23.94	1.43	30.34	24.15	1.46	31.99	26.38	1.47	34.25	27.68	1.49	36.61	28.32	1.50	37.74	31.47	1.51	
32	26.79	23.66	1.64	30.27	23.87	1.66	31.91	26.07	1.68	34.17	27.35	1.70	36.53	27.99	1.72	37.65	31.10	1.73	
41	26.22	23.48	2.02	29.63	23.68	2.06	31.23	25.87	2.08	33.44	27.14	2.10	35.75	27.77	2.12	36.85	30.87	2.14	
50	26.19	23.44	2.01	29.59	23.64	2.05	31.20	25.82	2.07	33.40	27.10	2.09	35.71	27.72	2.11	36.81	30.81	2.12	
59	25.94	23.40	2.00	29.31	23.60	2.04	30.90	25.77	2.05	33.08	27.05	2.08	35.36	27.67	2.10	36.46	30.76	2.11	
67	27.81	23.94	2.42	31.43	24.15	2.46	33.13	26.38	2.48	35.47	27.68	2.51	37.92	28.32	2.54	39.09	31.48	2.55	
77	29.68	24.49	3.05	33.54	24.71	3.10	35.36	26.98	3.13	37.86	28.32	3.16	40.47	28.97	3.20	41.72	32.20	3.22	
87	29.35	24.48	3.68	33.16	24.69	3.75	34.96	26.97	3.78	37.43	28.30	3.82	40.01	28.95	3.87	41.25	32.18	3.89	
95	29.01	24.46	4.32	32.78	24.68	4.39	34.56	26.95	4.43	37.00	28.28	4.48	39.55	28.93	4.53	40.77	32.16	4.56	
104	22.97	21.58	3.37	25.96	21.76	3.43	27.37	23.77	3.46	29.30	24.94	3.50	31.33	25.52	3.54	32.29	28.36	3.56	
115	16.94	16.93	2.42	19.14	18.10	2.47	20.18	19.77	2.49	21.61	20.74	2.51	23.10	21.22	2.54	23.81	23.59	2.56	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h	kBtu/h
-10.0	8.09	7.10	1.23	9.14	7.16	1.25	9.63	7.82	1.26	10.31	8.21	1.28	11.03	8.40	1.29	11.37	9.33	1.30	
-5.0	7.87	7.02	1.43	8.89	7.08	1.46	9.37	7.73	1.47	10.04	8.11	1.49	10.73	8.30	1.50	11.06	9.22	1.51	
0.0	7.85	6.93	1.64	8.87	6.99	1.66	9.35	7.64	1.68	10.01	8.02	1.70	10.71	8.20	1.72	11.04	9.12	1.73	
5.0	7.68	6.88	2.02	8.68	6.94	2.06	9.15	7.58	2.08	9.80	7.96	2.10	10.48	8.14	2.12	10.80	9.05	2.14	
10.0	7.67	6.87	2.01	8.67	6.93	2.05	9.14	7.57	2.07	9.79	7.94	2.09	10.46	8.13	2.11	10.79	9.03	2.12	
15.0	7.60	6.86	2.00	8.59	6.92	2.04	9.06	7.55	2.05	9.70	7.93	2.08	10.36	8.11	2.10	10.68	9.01	2.11	
19.4	8.15	7.02	2.42	9.21	7.08	2.46	9.71	7.73	2.48	10.40	8.11	2.51	11.11	8.30	2.54	11.46	9.23	2.55	
25.0	8.70	7.18	3.05	9.83	7.24	3.10	10.36	7.91	3.13	11.10	8.30	3.16	11.86	8.49	3.20	12.23	9.44	3.22	
30.6	8.60	7.17	3.68	9.72	7.24	3.75	10.25	7.90	3.78	10.97	8.29	3.82	11.73	8.49	3.87	12.09	9.43	3.89	
35.0	8.50	7.17	4.32	9.61	7.23	4.39	10.13	7.90	4.43	10.84	8.29	4.48	11.59	8.48	4.53	11.95	9.42	4.56	
40.0	6.73	6.32	3.37	7.61	6.38	3.43	8.02	6.97	3.46	8.59	7.31	3.50	9.18	7.48	3.54	9.46	8.31	3.56	
46.1	4.96	4.96	2.42	5.61	5.30	2.47	5.91	5.79	2.49	6.33	6.08	2.51	6.77	6.22	2.54	6.98	6.91	2.56	

OUTDOOR UNIT  
UOMH36AFXZJ



## ● Indoor units: 9,000 Btu + 12,000 Btu + 12,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW
	14	26.92	23.63	1.20	30.42	23.84	1.22	32.07	26.04	1.23	34.34	27.32	1.25	36.71	27.95	1.26	37.84	31.07	1.27
	23	26.20	23.36	1.40	29.60	23.56	1.42	31.21	25.73	1.43	33.41	27.01	1.45	35.72	27.63	1.47	36.82	30.71	1.48
	32	26.14	23.08	1.60	29.54	23.29	1.62	31.14	25.43	1.64	33.34	26.69	1.66	35.64	27.31	1.67	36.74	30.35	1.68
	41	25.58	22.91	1.97	28.91	23.11	2.01	30.47	25.24	2.03	32.63	26.48	2.05	34.88	27.10	2.07	35.96	30.12	2.08
	50	25.55	22.87	1.96	28.87	23.07	2.00	30.44	25.19	2.01	32.59	26.44	2.04	34.84	27.05	2.06	35.91	30.06	2.07
	59	25.31	22.83	1.95	28.60	23.03	1.99	30.15	25.15	2.00	32.28	26.39	2.03	34.50	27.00	2.05	35.57	30.01	2.06
	67	27.13	23.36	2.36	30.66	23.57	2.40	32.32	25.74	2.42	34.61	27.01	2.45	37.00	27.63	2.48	38.14	30.71	2.49
	77	28.96	23.90	2.97	32.73	24.11	3.03	34.50	26.33	3.05	36.94	27.63	3.09	39.49	28.27	3.12	40.71	31.41	3.14
87	28.63	23.88	3.59	32.36	24.09	3.66	34.11	26.31	3.69	36.52	27.61	3.73	39.04	28.25	3.77	40.24	31.39	3.79	
95	28.30	23.87	4.21	31.98	24.07	4.29	33.72	26.29	4.32	36.10	27.59	4.37	38.59	28.23	4.42	39.78	31.37	4.44	
104	22.42	21.05	3.29	25.33	21.23	3.35	26.70	23.19	3.37	28.59	24.34	3.41	30.56	24.90	3.45	31.51	27.67	3.47	
115	16.53	16.51	2.36	18.68	17.66	2.41	19.69	19.29	2.43	21.08	20.24	2.45	22.54	20.71	2.48	23.23	23.01	2.49	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW		kW	kW		kW	kW		kW	kW		kW	kW		kW	kW		kW
	-10.0	7.89	6.93	1.20	8.92	6.99	1.22	9.40	7.63	1.23	10.06	8.01	1.25	10.76	8.19	1.26	11.09	9.11	1.27
	-5.0	7.68	6.85	1.40	8.68	6.91	1.42	9.15	7.54	1.43	9.79	7.91	1.45	10.47	8.10	1.47	10.79	9.00	1.48
	0.0	7.66	6.77	1.60	8.66	6.82	1.62	9.13	7.45	1.64	9.77	7.82	1.66	10.44	8.00	1.67	10.77	8.89	1.68
	5.0	7.50	6.71	1.97	8.47	6.77	2.01	8.93	7.40	2.03	9.56	7.76	2.05	10.22	7.94	2.07	10.54	8.83	2.08
	10.0	7.49	6.70	1.96	8.46	6.76	2.00	8.92	7.38	2.01	9.55	7.75	2.04	10.21	7.93	2.06	10.53	8.81	2.07
	15.0	7.42	6.69	1.95	8.38	6.75	1.99	8.84	7.37	2.00	9.46	7.73	2.03	10.11	7.91	2.05	10.42	8.79	2.06
	19.4	7.95	6.85	2.36	8.99	6.91	2.40	9.47	7.54	2.42	10.14	7.92	2.45	10.84	8.10	2.48	11.18	9.00	2.49
	25.0	8.49	7.00	2.97	9.59	7.06	3.03	10.11	7.72	3.05	10.83	8.10	3.09	11.57	8.28	3.12	11.93	9.21	3.14
30.6	8.39	7.00	3.59	9.48	7.06	3.66	10.00	7.71	3.69	10.70	8.09	3.73	11.44	8.28	3.77	11.80	9.20	3.79	
35.0	8.29	6.99	4.21	9.37	7.06	4.29	9.88	7.71	4.32	10.58	8.09	4.37	11.31	8.27	4.42	11.66	9.20	4.44	
40.0	6.57	6.17	3.29	7.42	6.22	3.35	7.83	6.80	3.37	8.38	7.13	3.41	8.96	7.30	3.45	9.23	8.11	3.47	
46.1	4.84	4.84	2.36	5.47	5.18	2.41	5.77	5.65	2.43	6.18	5.93	2.45	6.61	6.07	2.48	6.81	6.74	2.49	

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 9,000 Btu + 12,000 Btu + 14,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW
	14	27.59	24.22	1.15	31.18	24.43	1.17	32.87	26.69	1.18	35.19	28.00	1.19	37.62	28.65	1.21	38.78	31.84	1.22
	23	26.85	23.94	1.34	30.34	24.15	1.36	31.99	26.38	1.38	34.25	27.68	1.39	36.61	28.32	1.41	37.74	31.47	1.41
	32	26.79	23.66	1.53	30.27	23.87	1.56	31.91	26.07	1.57	34.17	27.35	1.59	36.53	27.99	1.61	37.65	31.10	1.61
	41	26.22	23.48	1.89	29.63	23.68	1.93	31.23	25.87	1.94	33.44	27.14	1.96	35.75	27.77	1.99	36.85	30.87	2.00
	50	26.19	23.44	1.88	29.59	23.64	1.92	31.20	25.82	1.93	33.40	27.10	1.95	35.71	27.72	1.98	36.81	30.81	1.99
	59	25.94	23.40	1.87	29.31	23.60	1.90	30.90	25.77	1.92	33.08	27.05	1.94	35.36	27.67	1.96	36.46	30.76	1.97
	67	27.81	23.94	2.26	31.43	24.15	2.30	33.13	26.38	2.32	35.47	27.68	2.35	37.92	28.32	2.38	39.09	31.48	2.39
	77	29.68	24.49	2.85	33.54	24.71	2.90	35.36	26.98	2.93	37.86	28.32	2.96	40.47	28.97	2.99	41.72	32.20	3.01
87	29.35	24.48	3.45	33.16	24.69	3.51	34.96	26.97	3.53	37.43	28.30	3.57	40.01	28.95	3.62	41.25	32.18	3.63	
95	29.01	24.46	4.04	32.78	24.68	4.11	34.56	26.95	4.14	37.00	28.28	4.19	39.55	28.93	4.24	40.77	32.16	4.26	
104	22.97	21.58	3.15	25.96	21.76	3.21	27.37	23.77	3.23	29.30	24.94	3.27	31.33	25.52	3.31	32.29	28.36	3.33	
115	16.94	16.93	2.27	19.14	18.10	2.31	20.18	19.77	2.33	21.61	20.74	2.35	23.10	21.22	2.38	23.81	23.59	2.39	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW		kW	kW		kW	kW		kW	kW		kW	kW		kW	kW		kW
	-10.0	8.09	7.10	1.15	9.14	7.16	1.17	9.63	7.82	1.18	10.31	8.21	1.19	11.03	8.40	1.21	11.37	9.33	1.22
	-5.0	7.87	7.02	1.34	8.89	7.08	1.36	9.37	7.73	1.38	10.04	8.11	1.39	10.73	8.30	1.41	11.06	9.22	1.41
	0.0	7.85	6.93	1.53	8.87	6.99	1.56	9.35	7.64	1.57	10.01	8.02	1.59	10.71	8.20	1.61	11.04	9.12	1.61
	5.0	7.68	6.88	1.89	8.68	6.94	1.93	9.15	7.58	1.94	9.80	7.96	1.96	10.48	8.14	1.99	10.80	9.05	2.00
	10.0	7.67	6.87	1.88	8.67	6.93	1.92	9.14	7.57	1.93	9.79	7.94	1.95	10.46	8.13	1.98	10.79	9.03	1.99
	15.0	7.60	6.86	1.87	8.59	6.92	1.90	9.06	7.55	1.92	9.70	7.93	1.94	10.36	8.11	1.96	10.68	9.01	1.97
	19.4	8.15	7.02	2.26	9.21	7.08	2.30	9.71	7.73	2.32	10.40	8.11	2.35	11.11	8.30	2.38	11.46	9.23	2.39
	25.0	8.70	7.18	2.85	9.83	7.24	2.90	10.36	7.91	2.93	11.10	8.30	2.96	11.86	8.49	2.99	12.23	9.44	3.01
30.6	8.60	7.17	3.45	9.72	7.24	3.51	10.25	7.90	3.53	10.97	8.29	3.57	11.73	8.49	3.62	12.09	9.43	3.63	
35.0	8.50	7.17	4.04	9.61	7.23	4.11	10.13	7.90	4.14	10.84	8.29	4.19	11.59	8.48	4.24	11.95	9.42	4.26	
40.0	6.73	6.32	3.15	7.61	6.38	3.21	8.02	6.97	3.23	8.59	7.31	3.27	9.18	7.48	3.31	9.46	8.31	3.33	
46.1	4.96	4.96	2.27	5.61	5.30	2.31	5.91	5.79	2.33	6.33	6.08	2.35	6.77	6.22	2.38	6.98	6.91	2.39	

## ● Indoor units: 9,000 Btu + 12,000 Btu + 18,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h			kW			kBtu/h			kW			kBtu/h			kW		
14	27.59	24.22	1.23	31.18	24.43	1.25	32.87	26.69	1.26	35.19	28.00	1.28	37.62	28.65	1.29	38.78	31.84	1.30	
23	26.85	23.94	1.43	30.34	24.15	1.46	31.99	26.38	1.47	34.25	27.68	1.49	36.61	28.32	1.50	37.74	31.47	1.51	
32	26.79	23.66	1.64	30.27	23.87	1.66	31.91	26.07	1.68	34.17	27.35	1.70	36.53	27.99	1.72	37.65	31.10	1.73	
41	26.22	23.48	2.02	29.63	23.68	2.06	31.23	25.87	2.08	33.44	27.14	2.10	35.75	27.77	2.12	36.85	30.87	2.14	
50	26.19	23.44	2.01	29.59	23.64	2.05	31.20	25.82	2.07	33.40	27.10	2.09	35.71	27.72	2.11	36.81	30.81	2.12	
59	25.94	23.40	2.00	29.31	23.60	2.04	30.90	25.77	2.05	33.08	27.05	2.08	35.36	27.67	2.10	36.46	30.76	2.11	
67	27.81	23.94	2.42	31.43	24.15	2.46	33.13	26.38	2.48	35.47	27.68	2.51	37.92	28.32	2.54	39.09	31.48	2.55	
77	29.68	24.49	3.05	33.54	24.71	3.10	35.36	26.98	3.13	37.86	28.32	3.16	40.47	28.97	3.20	41.72	32.20	3.22	
87	29.35	24.48	3.68	33.16	24.69	3.75	34.96	26.97	3.78	37.43	28.30	3.82	40.01	28.95	3.87	41.25	32.18	3.89	
95	29.01	24.46	4.32	32.78	24.68	4.39	34.56	26.95	4.43	37.00	28.28	4.48	39.55	28.93	4.53	40.77	32.16	4.56	
104	22.97	21.58	3.37	25.96	21.76	3.43	27.37	23.77	3.46	29.30	24.94	3.50	31.33	25.52	3.54	32.29	28.36	3.56	
115	16.94	16.93	2.42	19.14	18.10	2.47	20.18	19.77	2.49	21.61	20.74	2.51	23.10	21.22	2.54	23.81	23.59	2.56	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW					
-10.0	8.09	7.10	1.23	9.14	7.16	1.25	9.63	7.82	1.26	10.31	8.21	1.28	11.03	8.40	1.29	11.37	9.33	1.30	
-5.0	7.87	7.02	1.43	8.89	7.08	1.46	9.37	7.73	1.47	10.04	8.11	1.49	10.73	8.30	1.50	11.06	9.22	1.51	
0.0	7.85	6.93	1.64	8.87	6.99	1.66	9.35	7.64	1.68	10.01	8.02	1.70	10.71	8.20	1.72	11.04	9.12	1.73	
5.0	7.68	6.88	2.02	8.68	6.94	2.06	9.15	7.58	2.08	9.80	7.96	2.10	10.48	8.14	2.12	10.80	9.05	2.14	
10.0	7.67	6.87	2.01	8.67	6.93	2.05	9.14	7.57	2.07	9.79	7.94	2.09	10.46	8.13	2.11	10.79	9.03	2.12	
15.0	7.60	6.86	2.00	8.59	6.92	2.04	9.06	7.55	2.05	9.70	7.93	2.08	10.36	8.11	2.10	10.68	9.01	2.11	
19.4	8.15	7.02	2.42	9.21	7.08	2.46	9.71	7.73	2.48	10.40	8.11	2.51	11.11	8.30	2.54	11.46	9.23	2.55	
25.0	8.70	7.18	3.05	9.83	7.24	3.10	10.36	7.91	3.13	11.10	8.30	3.16	11.86	8.49	3.20	12.23	9.44	3.22	
30.6	8.60	7.17	3.68	9.72	7.24	3.75	10.25	7.90	3.78	10.97	8.29	3.82	11.73	8.49	3.87	12.09	9.43	3.89	
35.0	8.50	7.17	4.32	9.61	7.23	4.39	10.13	7.90	4.43	10.84	8.29	4.48	11.59	8.48	4.53	11.95	9.42	4.56	
40.0	6.73	6.32	3.37	7.61	6.38	3.43	8.02	6.97	3.46	8.59	7.31	3.50	9.18	7.48	3.54	9.46	8.31	3.56	
46.1	4.96	4.96	2.42	5.61	5.30	2.47	5.91	5.79	2.49	6.33	6.08	2.51	6.77	6.22	2.54	6.98	6.91	2.56	

## ● Indoor units: 12,000 Btu + 12,000 Btu + 12,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu/h			kW			kBtu/h			kW			kBtu/h			kW		
14	27.52	24.16	1.23	31.10	24.37	1.25	32.78	26.61	1.26	35.10	27.93	1.27	37.52	28.57	1.29	38.68	31.76	1.30	
23	26.78	23.88	1.43	30.26	24.09	1.46	31.90	26.31	1.47	34.15	27.60	1.48	36.51	28.24	1.50	37.64	31.39	1.51	
32	26.72	23.60	1.63	30.19	23.80	1.66	31.83	26.00	1.67	34.08	27.28	1.69	36.43	27.91	1.71	37.55	31.02	1.72	
41	26.15	23.42	2.02	29.55	23.62	2.06	31.15	25.80	2.07	33.35	27.07	2.10	35.65	27.70	2.12	36.75	30.78	2.13	
50	26.12	23.38	2.01	29.51	23.58	2.04	31.11	25.75	2.06	33.31	27.02	2.08	35.61	27.65	2.11	36.71	30.73	2.12	
59	25.87	23.33	2.00	29.23	23.54	2.03	30.82	25.71	2.05	32.99	26.97	2.07	35.27	27.60	2.10	36.36	30.67	2.11	
67	27.73	23.88	2.42	31.34	24.09	2.46	33.04	26.31	2.48	35.38	27.61	2.51	37.82	28.25	2.53	38.98	31.39	2.55	
77	29.60	24.43	3.04	33.45	24.64	3.10	35.27	26.91	3.12	37.76	28.24	3.16	40.36	28.89	3.19	41.61	32.11	3.21	
87	29.27	24.41	3.68	33.07	24.62	3.74	34.87	26.89	3.77	37.33	28.22	3.81	39.90	28.87	3.86	41.14	32.09	3.88	
95	28.93	24.40	4.31	32.69	24.61	4.39	34.46	26.88	4.42	36.90	28.20	4.47	39.45	28.86	4.52	40.66	32.07	4.55	
104	22.91	21.52	3.36	25.89	21.71	3.42	27.30	23.71	3.45	29.22	24.88	3.49	31.24	25.45	3.53	32.21	28.29	3.55	
115	16.89	16.88	2.42	19.09	18.05	2.46	20.13	19.71	2.48	21.55	20.69	2.51	23.04	21.17	2.54	23.75	23.52	2.55	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW					
-10.0	8.06	7.08	1.23	9.11	7.14	1.25	9.61	7.80	1.26	10.29	8.19	1.27	11.00	8.37	1.29	11.34	9.31	1.30	
-5.0	7.85	7.00	1.43	8.87	7.06	1.46	9.35	7.71	1.47	10.01	8.09	1.48	10.70	8.28	1.50	11.03	9.20	1.51	
0.0	7.83	6.92	1.63	8.85	6.98	1.66	9.33	7.62	1.67	9.99	8.00	1.69	10.68	8.18	1.71	11.01	9.09	1.72	
5.0	7.66	6.86	2.02	8.66	6.92	2.06	9.13	7.56	2.07	9.77	7.93	2.10	10.45	8.12	2.12	10.77	9.02	2.13	
10.0	7.65	6.85	2.01	8.65	6.91	2.04	9.12	7.55	2.06	9.76	7.92	2.08	10.44	8.10	2.11	10.76	9.01	2.12	
15.0	7.58	6.84	2.00	8.57	6.90	2.03	9.03	7.53	2.05	9.67	7.91	2.07	10.34	8.09	2.10	10.66	8.99	2.11	
19.4	8.13	7.00	2.42	9.19	7.06	2.46	9.68	7.71	2.48	10.37	8.09	2.51	11.08	8.28	2.53	11.43	9.20	2.55	
25.0	8.68	7.16	3.04	9.80	7.22	3.10	10.34	7.89	3.12	11.07	8.28	3.16	11.83	8.47	3.19	12.20	9.41	3.21	
30.6	8.58	7.15	3.68	9.69	7.22	3.74	10.22	7.88	3.77	10.94	8.27	3.81	11.70	8.46	3.86	12.06	9.41	3.88	
35.0	8.48	7.15	4.31	9.58	7.21	4.39	10.10	7.88	4.42	10.81	8.27	4.47	11.56	8.46	4.52	11.92	9.40	4.55	
40.0	6.72	6.31	3.36	7.59	6.36	3.42	8.00	6.95	3.45	8.57	7.29	3.49	9.16	7.46	3.53	9.44	8.29	3.55	
46.1	4.95	4.95	2.42	5.60	5.29	2.46	5.90	5.78	2.48	6.32	6.06	2.51	6.75	6.20	2.54	6.96	6.89	2.55	

● Indoor units: 12,000 Btu + 12,000 Btu + 14,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	27.59	24.22	1.15	31.18	24.43	1.17	32.87	26.69	1.18	35.19	28.00	1.19	37.62	28.65	1.21	38.78	31.84	1.22
	23	26.85	23.94	1.34	30.34	24.15	1.36	31.99	26.38	1.38	34.25	27.68	1.39	36.61	28.32	1.41	37.74	31.47	1.41
	32	26.79	23.66	1.53	30.27	23.87	1.56	31.91	26.07	1.57	34.17	27.35	1.59	36.53	27.99	1.61	37.65	31.10	1.61
	41	26.22	23.48	1.89	29.63	23.68	1.93	31.23	25.87	1.94	33.44	27.14	1.96	35.75	27.77	1.99	36.85	30.87	2.00
	50	26.19	23.44	1.88	29.59	23.64	1.92	31.20	25.82	1.93	33.40	27.10	1.95	35.71	27.72	1.98	36.81	30.81	1.99
	59	25.94	23.40	1.87	29.31	23.60	1.90	30.90	25.77	1.92	33.08	27.05	1.94	35.36	27.67	1.96	36.46	30.76	1.97
	67	27.81	23.94	2.26	31.43	24.15	2.30	33.13	26.38	2.32	35.47	27.68	2.35	37.92	28.32	2.38	39.09	31.48	2.39
	77	29.68	24.49	2.85	33.54	24.71	2.90	35.36	26.98	2.93	37.86	28.32	2.96	40.47	28.97	2.99	41.72	32.20	3.01
87	29.35	24.48	3.45	33.16	24.69	3.51	34.96	26.97	3.53	37.43	28.30	3.57	40.01	28.95	3.62	41.25	32.18	3.63	
95	29.01	24.46	4.04	32.78	24.68	4.11	34.56	26.95	4.14	37.00	28.28	4.19	39.55	28.93	4.24	40.77	32.16	4.26	
104	22.97	21.58	3.15	25.96	21.76	3.21	27.37	23.77	3.23	29.30	24.94	3.27	31.33	25.52	3.31	32.29	28.36	3.33	
115	16.94	16.93	2.27	19.14	18.10	2.31	20.18	19.77	2.33	21.61	20.74	2.35	23.10	21.22	2.38	23.81	23.59	2.39	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
	-10.0	8.09	7.10	1.15	9.14	7.16	1.17	9.63	7.82	1.18	10.31	8.21	1.19	11.03	8.40	1.21	11.37	9.33	1.22
	-5.0	7.87	7.02	1.34	8.89	7.08	1.36	9.37	7.73	1.38	10.04	8.11	1.39	10.73	8.30	1.41	11.06	9.22	1.41
	0.0	7.85	6.93	1.53	8.87	6.99	1.56	9.35	7.64	1.57	10.01	8.02	1.59	10.71	8.20	1.61	11.04	9.12	1.61
	5.0	7.68	6.88	1.89	8.68	6.94	1.93	9.15	7.58	1.94	9.80	7.96	1.96	10.48	8.14	1.99	10.80	9.05	2.00
	10.0	7.67	6.87	1.88	8.67	6.93	1.92	9.14	7.57	1.93	9.79	7.94	1.95	10.46	8.13	1.98	10.79	9.03	1.99
	15.0	7.60	6.86	1.87	8.59	6.92	1.90	9.06	7.55	1.92	9.70	7.93	1.94	10.36	8.11	1.96	10.68	9.01	1.97
	19.4	8.15	7.02	2.26	9.21	7.08	2.30	9.71	7.73	2.32	10.40	8.11	2.35	11.11	8.30	2.38	11.46	9.23	2.39
	25.0	8.70	7.18	2.85	9.83	7.24	2.90	10.36	7.91	2.93	11.10	8.30	2.96	11.86	8.49	2.99	12.23	9.44	3.01
30.6	8.60	7.17	3.45	9.72	7.24	3.51	10.25	7.90	3.53	10.97	8.29	3.57	11.73	8.49	3.62	12.09	9.43	3.63	
35.0	8.50	7.17	4.04	9.61	7.23	4.11	10.13	7.90	4.14	10.84	8.29	4.19	11.59	8.48	4.24	11.95	9.42	4.26	
40.0	6.73	6.32	3.15	7.61	6.38	3.21	8.02	6.97	3.23	8.59	7.31	3.27	9.18	7.48	3.31	9.46	8.31	3.33	
46.1	4.96	4.96	2.27	5.61	5.30	2.31	5.91	5.79	2.33	6.33	6.08	2.35	6.77	6.22	2.38	6.98	6.91	2.39	

OUTDOOR UNIT UOMH36AFXJ

● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 7,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	23.86	20.95	1.00	26.97	21.13	1.02	28.43	23.08	1.03	30.44	24.22	1.04	32.54	24.78	1.05	33.54	27.54	1.06
	23	23.22	20.71	1.16	26.24	20.89	1.19	27.66	22.81	1.20	29.62	23.94	1.21	31.66	24.49	1.22	32.64	27.22	1.23
	32	23.17	20.46	1.33	26.18	20.64	1.35	27.60	22.54	1.36	29.55	23.66	1.38	31.59	24.20	1.39	32.56	26.90	1.40
	41	22.67	20.31	1.64	25.62	20.48	1.67	27.01	22.37	1.69	28.92	23.48	1.71	30.92	24.02	1.73	31.87	26.69	1.74
	50	22.65	20.27	1.64	25.59	20.45	1.66	26.98	22.33	1.68	28.89	23.44	1.70	30.88	23.98	1.72	31.83	26.65	1.73
	59	22.43	20.23	1.63	25.35	20.41	1.65	26.72	22.29	1.67	28.61	23.39	1.69	30.59	23.93	1.71	31.53	26.60	1.72
	67	24.05	20.71	1.97	27.18	20.89	2.00	28.65	22.81	2.02	30.68	23.94	2.04	32.79	24.49	2.06	33.81	27.22	2.08
	77	25.67	21.18	2.48	29.01	21.37	2.52	30.58	23.34	2.54	32.74	24.49	2.57	35.00	25.06	2.60	36.08	27.85	2.61
87	25.38	21.17	2.99	28.68	21.35	3.05	30.24	23.32	3.07	32.37	24.47	3.10	34.61	25.04	3.14	35.67	27.83	3.16	
95	25.09	21.16	3.51	28.35	21.34	3.57	29.89	23.31	3.60	32.00	24.46	3.64	34.21	25.02	3.68	35.26	27.81	3.70	
104	19.87	18.66	2.74	22.45	18.82	2.79	23.67	20.56	2.81	25.34	21.57	2.84	27.09	22.07	2.87	27.93	24.53	2.89	
115	14.65	14.64	1.97	16.56	15.65	2.00	17.45	17.10	2.02	18.69	17.94	2.04	19.98	18.36	2.07	20.59	20.40	2.08	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
	-10.0	6.99	6.14	1.00	7.90	6.19	1.02	8.33	6.76	1.03	8.92	7.10	1.04	9.54	7.26	1.05	9.83	8.07	1.06
	-5.0	6.81	6.07	1.16	7.69	6.12	1.19	8.11	6.69	1.20	8.68	7.02	1.21	9.28	7.18	1.22	9.57	7.98	1.23
	0.0	6.79	6.00	1.33	7.67	6.05	1.35	8.09	6.61	1.36	8.66	6.93	1.38	9.26	7.09	1.39	9.54	7.88	1.40
	5.0	6.65	5.95	1.64	7.51	6.00	1.67	7.92	6.56	1.69	8.48	6.88	1.71	9.06	7.04	1.73	9.34	7.82	1.74
	10.0	6.64	5.94	1.64	7.50	5.99	1.66	7.91	6.55	1.68	8.47	6.87	1.70	9.05	7.03	1.72	9.33	7.81	1.73
	15.0	6.57	5.93	1.63	7.43	5.98	1.65	7.83	6.53	1.67	8.39	6.86	1.69	8.96	7.01	1.71	9.24	7.80	1.72
	19.4	7.05	6.07	1.97	7.97	6.12	2.00	8.40	6.69	2.02	8.99	7.02	2.04	9.61	7.18	2.06	9.91	7.98	2.08
	25.0	7.52	6.21	2.48	8.50	6.26	2.52	8.96	6.84	2.54	9.60	7.18	2.57	10.26	7.34	2.60	10.58	8.16	2.61
30.6	7.44	6.20	2.99	8.41	6.26	3.05	8.86	6.84	3.07	9.49	7.17	3.10	10.14	7.34	3.14	10.46	8.16	3.16	
35.0	7.35	6.20	3.51	8.31	6.25	3.57	8.76	6.83	3.60	9.38	7.17	3.64	10.03	7.33	3.68	10.34	8.15	3.70	
40.0	5.82	5.47	2.74	6.58	5.52	2.79	6.94	6.03	2.81	7.43	6.32	2.84	7.94	6.47	2.87	8.19	7.19	2.89	
46.1	4.29	4.29	1.97	4.85	4.59	2.00	5.12	5.01	2.02	5.48	5.26	2.04	5.85	5.38	2.07	6.04	5.98	2.08	

## ● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 9,000 Btu

		Indoor temperature																						
°FDB		64			70			75			80			85			90							
°FWB		54			60			63			67			71			73							
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP					
	kBtu/h			kW			kBtu/h			kW			kBtu/h			kW			kBtu/h			kW		
	14	25.50	22.39	1.07	28.82	22.59	1.09	30.38	24.67	1.10	32.53	25.88	1.11	34.77	26.48	1.12	35.85	29.43	1.13					
	23	24.82	22.13	1.25	28.05	22.32	1.27	29.57	24.38	1.28	31.65	25.58	1.29	33.84	26.18	1.31	34.88	29.09	1.32					
	32	24.76	21.87	1.42	27.98	22.06	1.45	29.50	24.09	1.46	31.58	25.28	1.48	33.76	25.87	1.49	34.80	28.75	1.50					
	41	24.23	21.70	1.76	27.39	21.89	1.79	28.87	23.91	1.81	30.91	25.09	1.83	33.04	25.67	1.85	34.06	28.53	1.86					
	50	24.20	21.67	1.75	27.35	21.85	1.78	28.84	23.87	1.80	30.87	25.05	1.82	33.00	25.63	1.84	34.02	28.48	1.85					
	59	23.97	21.62	1.74	27.09	21.81	1.77	28.56	23.82	1.79	30.58	25.00	1.81	32.69	25.58	1.83	33.70	28.43	1.84					
	67	25.71	22.13	2.11	29.05	22.33	2.14	30.62	24.38	2.16	32.79	25.59	2.19	35.05	26.18	2.21	36.13	29.09	2.22					
	77	27.44	22.64	2.65	31.01	22.84	2.70	32.69	24.94	2.72	35.00	26.17	2.75	37.41	26.78	2.79	38.57	29.76	2.80					
	87	27.12	22.62	3.21	30.65	22.82	3.26	32.31	24.93	3.29	34.60	26.16	3.33	36.98	26.76	3.36	38.13	29.74	3.38					
	95	26.81	22.61	3.76	30.30	22.81	3.83	31.94	24.91	3.86	34.20	26.14	3.90	36.56	26.74	3.94	37.69	29.72	3.97					
	104	21.24	19.94	2.93	24.00	20.12	2.99	25.30	21.97	3.01	27.09	23.06	3.04	28.96	23.59	3.08	29.85	26.22	3.10					
	115	15.66	15.65	2.11	17.70	16.73	2.15	18.65	18.27	2.16	19.97	19.17	2.19	21.35	19.62	2.21	22.01	21.80	2.23					

		Indoor temperature																			
°CDB		17.8			21.1			23.9			26.7			29.4			32.2				
°CWB		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	kW			kW			kW			kW			kW			kW			kW		
	-10.0	7.47	6.56	1.07	8.45	6.62	1.09	8.90	7.23	1.10	9.53	7.59	1.11	10.19	7.76	1.12	10.51	8.63	1.13		
	-5.0	7.27	6.49	1.25	8.22	6.54	1.27	8.67	7.15	1.28	9.28	7.50	1.29	9.92	7.67	1.31	10.22	8.53	1.32		
	0.0	7.26	6.41	1.42	8.20	6.47	1.45	8.65	7.06	1.46	9.26	7.41	1.48	9.89	7.58	1.49	10.20	8.43	1.50		
	5.0	7.10	6.36	1.76	8.03	6.42	1.79	8.46	7.01	1.81	9.06	7.35	1.83	9.68	7.52	1.85	9.98	8.36	1.86		
	10.0	7.09	6.35	1.75	8.02	6.41	1.78	8.45	7.00	1.80	9.05	7.34	1.82	9.67	7.51	1.84	9.97	8.35	1.85		
	15.0	7.03	6.34	1.74	7.94	6.39	1.77	8.37	6.98	1.79	8.96	7.33	1.81	9.58	7.50	1.83	9.88	8.33	1.84		
	19.4	7.53	6.49	2.11	8.51	6.54	2.14	8.98	7.15	2.16	9.61	7.50	2.19	10.27	7.67	2.21	10.59	8.53	2.22		
	25.0	8.04	6.64	2.65	9.09	6.69	2.70	9.58	7.31	2.72	10.26	7.67	2.75	10.96	7.85	2.79	11.30	8.72	2.80		
	30.6	7.95	6.63	3.21	8.98	6.69	3.26	9.47	7.31	3.29	10.14	7.67	3.33	10.84	7.84	3.36	11.17	8.72	3.38		
	35.0	7.86	6.63	3.76	8.88	6.68	3.83	9.36	7.30	3.86	10.02	7.66	3.90	10.72	7.84	3.94	11.05	8.71	3.97		
	40.0	6.22	5.84	2.93	7.03	5.90	2.99	7.41	6.44	3.01	7.94	6.76	3.04	8.49	6.91	3.08	8.75	7.68	3.10		
	46.1	4.59	4.59	2.11	5.19	4.90	2.15	5.47	5.36	2.16	5.85	5.62	2.19	6.26	5.75	2.21	6.45	6.39	2.23		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 12,000 Btu

		Indoor temperature																						
°FDB		64			70			75			80			85			90							
°FWB		54			60			63			67			71			73							
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP					
	kBtu/h			kW			kBtu/h			kW			kBtu/h			kW			kBtu/h			kW		
	14	26.92	23.63	1.14	30.42	23.84	1.16	32.07	26.04	1.17	34.34	27.32	1.19	36.71	27.95	1.20	37.84	31.07	1.21					
	23	26.20	23.36	1.33	29.60	23.56	1.35	31.21	25.73	1.37	33.41	27.01	1.38	35.72	27.63	1.40	36.82	30.71	1.40					
	32	26.14	23.08	1.52	29.54	23.29	1.55	31.14	25.43	1.56	33.34	26.69	1.58	35.64	27.31	1.59	36.74	30.35	1.60					
	41	25.58	22.91	1.88	28.91	23.11	1.91	30.47	25.24	1.93	32.63	26.48	1.95	34.88	27.10	1.97	35.96	30.12	1.98					
	50	25.55	22.87	1.87	28.87	23.07	1.90	30.44	25.19	1.92	32.59	26.44	1.94	34.84	27.05	1.96	35.91	30.06	1.97					
	59	25.31	22.83	1.86	28.60	23.03	1.89	30.15	25.15	1.91	32.28	26.39	1.93	34.50	27.00	1.95	35.57	30.01	1.96					
	67	27.13	23.36	2.25	30.66	23.57	2.29	32.32	25.74	2.31	34.61	27.01	2.33	37.00	27.63	2.36	38.14	30.71	2.37					
	77	28.96	23.90	2.83	32.73	24.11	2.88	34.50	26.33	2.90	36.94	27.63	2.94	39.49	28.27	2.97	40.71	31.41	2.99					
	87	28.63	23.88	3.42	32.36	24.09	3.48	34.11	26.31	3.51	36.52	27.61	3.55	39.04	28.25	3.59	40.24	31.39	3.61					
	95	28.30	23.87	4.01	31.98	24.07	4.08	33.72	26.29	4.11	36.10	27.59	4.16	38.59	28.23	4.21	39.78	31.37	4.23					
	104	22.42	21.05	3.13	25.33	21.23	3.19	26.70	23.19	3.21	28.59	24.34	3.25	30.56	24.90	3.28	31.51	27.67	3.30					
	115	16.53	16.51	2.25	18.68	17.66	2.29	19.69	19.29	2.31	21.08	20.24	2.33	22.54	20.71	2.36	23.23	23.01	2.37					

		Indoor temperature																			
°CDB		17.8			21.1			23.9			26.7			29.4			32.2				
°CWB		12.2			15.6			17.2			19.4			21.7			22.8				
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
	kW			kW			kW			kW			kW			kW			kW		
	-10.0	7.89	6.93	1.14	8.92	6.99	1.16	9.40	7.63	1.17	10.06	8.01	1.19	10.76	8.19	1.20	11.09	9.11	1.21		
	-5.0	7.68	6.85	1.33	8.68	6.91	1.35	9.15	7.54	1.37	9.79	7.91	1.38	10.47	8.10	1.40	10.79	9.00	1.40		
	0.0	7.66	6.77	1.52	8.66	6.82	1.55	9.13	7.45	1.56	9.77	7.82	1.58	10.44	8.00	1.59	10.77	8.89	1.60		
	5.0	7.50	6.71	1.88	8.47	6.77	1.91	8.93	7.40	1.93	9.56	7.76	1.95	10.22	7.94	1.97	10.54	8.83	1.98		
	10.0	7.49	6.70	1.87	8.46	6.76	1.90	8.92	7.38	1.92	9.55	7.75	1.94	10.21	7.93	1.96	10.53	8.81	1.97		
	15.0	7.42	6.69	1.86	8.38	6.75	1.89	8.84	7.37	1.91	9.46	7.73	1.93	10.11	7.91	1.95	10.42	8.79	1.96		
	19.4	7.95	6.85	2.25	8.99	6.91	2.29	9.47	7.54	2.31	10.14	7.92	2.33	10.84	8.10	2.36	11.18	9.00	2.37		
	25.0	8.49	7.00	2.83	9.59	7.06	2.88	10.11	7.72	2.90	10.83	8.10	2.94	11.57	8.28	2.97	11.93	9.21	2.99		
	30.6	8.39	7.00	3.42	9.48	7.06	3.48	10.00	7.71	3.51	10.70	8.09	3.55	11.44	8.28	3.59	11.80	9.20	3.61		
	35.0	8.29	6.99	4.01	9.37	7.06	4.08	9.88	7.71	4.11	10.58	8.09	4.16	11.31	8.27	4.21	11.66	9.20	4.23		
	40.0	6.57	6.17	3.13	7.42	6.22	3.19	7.83	6.80	3.21	8.38	7.13	3.25	8.96	7.30	3.28	9.23	8.11	3.30		
	46.1	4.84	4.84	2.25	5.47	5.18	2.29	5.77	5.65	2.31	6.18	5.93	2.33	6.61	6.07	2.36	6.81	6.74	2.37		

**OUTDOOR UNIT**  
**UOMH36AFXZJ**

## ● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 14,000 Btu

		Indoor temperature																		
°FDB		64			70			75			80			85			90			
°FWB		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	
14	28.34	24.88	1.13	32.02	25.09	1.15	33.76	27.41	1.16	36.14	28.76	1.17	38.64	29.43	1.18	39.83	32.70	1.19		
23	27.57	24.59	1.31	31.16	24.80	1.34	32.85	27.09	1.35	35.17	28.43	1.36	37.60	29.08	1.38	38.76	32.32	1.38		
32	27.51	24.30	1.50	31.09	24.51	1.52	32.78	26.77	1.54	35.09	28.09	1.55	37.51	28.74	1.57	38.67	31.94	1.58		
41	26.93	24.11	1.85	30.43	24.32	1.89	32.08	26.57	1.90	34.34	27.88	1.92	36.71	28.52	1.94	37.85	31.70	1.95		
50	26.89	24.07	1.84	30.39	24.28	1.87	32.04	26.52	1.89	34.30	27.83	1.91	36.67	28.47	1.93	37.80	31.65	1.94		
59	26.64	24.03	1.83	30.10	24.24	1.86	31.73	26.47	1.88	33.98	27.78	1.90	36.32	28.42	1.92	37.44	31.59	1.93		
67	28.56	24.59	2.22	32.28	24.81	2.25	34.03	27.09	2.27	36.43	28.43	2.30	38.94	29.09	2.32	40.15	32.33	2.34		
77	30.48	25.15	2.79	34.45	25.37	2.84	36.32	27.71	2.86	38.88	29.08	2.89	41.57	29.75	2.93	42.85	33.07	2.94		
87	30.14	25.14	3.37	34.06	25.36	3.43	35.90	27.70	3.46	38.44	29.06	3.50	41.09	29.73	3.54	42.36	33.05	3.56		
95	29.79	25.12	3.95	33.67	25.34	4.02	35.49	27.68	4.05	38.00	29.04	4.10	40.62	29.72	4.15	41.88	33.03	4.17		
104	23.59	22.16	3.09	26.66	22.35	3.14	28.11	24.41	3.17	30.10	25.62	3.20	32.17	26.21	3.24	33.17	29.13	3.25		
115	17.40	17.38	2.22	19.66	18.59	2.26	20.73	20.30	2.28	22.19	21.30	2.30	23.72	21.80	2.33	24.45	24.22	2.34		

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
-10.0	8.31	7.29	1.13	9.39	7.35	1.15	9.89	8.03	1.16	10.59	8.43	1.17	11.32	8.62	1.18	11.67	9.58	1.19		
-5.0	8.08	7.21	1.31	9.13	7.27	1.34	9.63	7.94	1.35	10.31	8.33	1.36	11.02	8.52	1.38	11.36	9.47	1.38		
0.0	8.06	7.12	1.50	9.11	7.18	1.52	9.61	7.85	1.54	10.28	8.23	1.55	10.99	8.42	1.57	11.33	9.36	1.58		
5.0	7.89	7.07	1.85	8.92	7.13	1.89	9.40	7.79	1.90	10.07	8.17	1.92	10.76	8.36	1.94	11.09	9.29	1.95		
10.0	7.88	7.06	1.84	8.91	7.12	1.87	9.39	7.77	1.89	10.05	8.16	1.91	10.75	8.35	1.93	11.08	9.27	1.94		
15.0	7.81	7.04	1.83	8.82	7.10	1.86	9.30	7.76	1.88	9.96	8.14	1.90	10.64	8.33	1.92	10.97	9.26	1.93		
19.4	8.37	7.21	2.22	9.46	7.27	2.25	9.97	7.94	2.27	10.68	8.33	2.30	11.41	8.53	2.32	11.77	9.47	2.34		
25.0	8.93	7.37	2.79	10.10	7.44	2.84	10.64	8.12	2.86	11.40	8.52	2.89	12.18	8.72	2.93	12.56	9.69	2.94		
30.6	8.83	7.37	3.37	9.98	7.43	3.43	10.52	8.12	3.46	11.27	8.52	3.50	12.04	8.71	3.54	12.42	9.69	3.56		
35.0	8.73	7.36	3.95	9.87	7.43	4.02	10.40	8.11	4.05	11.14	8.51	4.10	11.91	8.71	4.15	12.27	9.68	4.17		
40.0	6.92	6.49	3.09	7.81	6.55	3.14	8.24	7.15	3.17	8.82	7.51	3.20	9.43	7.68	3.24	9.72	8.54	3.25		
46.1	5.10	5.09	2.22	5.76	5.45	2.26	6.07	5.95	2.28	6.50	6.24	2.30	6.95	6.39	2.33	7.17	7.10	2.34		

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 18,000 Btu

		Indoor temperature																		
°FDB		64			70			75			80			85			90			
°FWB		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	kBtu/h		kW	
14	28.34	24.88	1.20	32.02	25.09	1.23	33.76	27.41	1.24	36.14	28.76	1.25	38.64	29.43	1.26	39.83	32.70	1.27		
23	27.57	24.59	1.40	31.16	24.80	1.43	32.85	27.09	1.44	35.17	28.43	1.45	37.60	29.08	1.47	38.76	32.32	1.48		
32	27.51	24.30	1.60	31.09	24.51	1.63	32.78	26.77	1.64	35.09	28.09	1.66	37.51	28.74	1.68	38.67	31.94	1.69		
41	26.93	24.11	1.98	30.43	24.32	2.01	32.08	26.57	2.03	34.34	27.88	2.05	36.71	28.52	2.08	37.85	31.70	2.09		
50	26.89	24.07	1.97	30.39	24.28	2.00	32.04	26.52	2.02	34.30	27.83	2.04	36.67	28.47	2.06	37.80	31.65	2.08		
59	26.64	24.03	1.96	30.10	24.24	1.99	31.73	26.47	2.01	33.98	27.78	2.03	36.32	28.42	2.05	37.44	31.59	2.06		
67	28.56	24.59	2.37	32.28	24.81	2.41	34.03	27.09	2.43	36.43	28.43	2.46	38.94	29.09	2.48	40.15	32.33	2.50		
77	30.48	25.15	2.98	34.45	25.37	3.03	36.32	27.71	3.06	38.88	29.08	3.09	41.57	29.75	3.13	42.85	33.07	3.14		
87	30.14	25.14	3.60	34.06	25.36	3.67	35.90	27.70	3.70	38.44	29.06	3.74	41.09	29.73	3.78	42.36	33.05	3.80		
95	29.79	25.12	4.22	33.67	25.34	4.30	35.49	27.68	4.33	38.00	29.04	4.38	40.62	29.72	4.43	41.88	33.03	4.45		
104	23.59	22.16	3.30	26.66	22.35	3.35	28.11	24.41	3.38	30.10	25.62	3.42	32.17	26.21	3.46	33.17	29.13	3.48		
115	17.40	17.38	2.37	19.66	18.59	2.41	20.73	20.30	2.43	22.19	21.30	2.46	23.72	21.80	2.49	24.45	24.22	2.50		

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
-10.0	8.31	7.29	1.20	9.39	7.35	1.23	9.89	8.03	1.24	10.59	8.43	1.25	11.32	8.62	1.26	11.67	9.58	1.27		
-5.0	8.08	7.21	1.40	9.13	7.27	1.43	9.63	7.94	1.44	10.31	8.33	1.45	11.02	8.52	1.47	11.36	9.47	1.48		
0.0	8.06	7.12	1.60	9.11	7.18	1.63	9.61	7.85	1.64	10.28	8.23	1.66	10.99	8.42	1.68	11.33	9.36	1.69		
5.0	7.89	7.07	1.98	8.92	7.13	2.01	9.40	7.79	2.03	10.07	8.17	2.05	10.76	8.36	2.08	11.09	9.29	2.09		
10.0	7.88	7.06	1.97	8.91	7.12	2.00	9.39	7.77	2.02	10.05	8.16	2.04	10.75	8.35	2.06	11.08	9.27	2.08		
15.0	7.81	7.04	1.96	8.82	7.10	1.99	9.30	7.76	2.01	9.96	8.14	2.03	10.64	8.33	2.05	10.97	9.26	2.06		
19.4	8.37	7.21	2.37	9.46	7.27	2.41	9.97	7.94	2.43	10.68	8.33	2.46	11.41	8.53	2.48	11.77	9.47	2.50		
25.0	8.93	7.37	2.98	10.10	7.44	3.03	10.64	8.12	3.06	11.40	8.52	3.09	12.18	8.72	3.13	12.56	9.69	3.14		
30.6	8.83	7.37	3.60	9.98	7.43	3.67	10.52	8.12	3.70	11.27	8.52	3.74	12.04	8.71	3.78	12.42	9.69	3.80		
35.0	8.73	7.36	4.22	9.87	7.43	4.30	10.40	8.11	4.33	11.14	8.51	4.38	11.91	8.71	4.43	12.27	9.68	4.45		
40.0	6.92	6.49	3.30	7.81	6.55	3.35	8.24	7.15	3.38	8.82	7.51	3.42	9.43	7.68	3.46	9.72	8.54	3.48		
46.1	5.10	5.09	2.37	5.76	5.45	2.41	6.07	5.95	2.43	6.50	6.24	2.46	6.95	6.39	2.49	7.17	7.10	2.50		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature																		
°FDB		64			70			75			80			85			90			
°FWB		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBtu/h			kW			kBtu/h			kW			kBtu/h			kW			
14	26.55	23.31	1.11	30.00	23.51	1.13	31.63	25.68	1.14	33.86	26.94	1.15	36.20	27.57	1.16	37.32	30.64	1.17		
23	25.83	23.04	1.29	29.19	23.24	1.31	30.78	25.38	1.32	32.95	26.63	1.34	35.22	27.25	1.35	36.31	30.28	1.36		
32	25.77	22.76	1.47	29.13	22.96	1.50	30.71	25.08	1.51	32.88	26.32	1.53	35.14	26.93	1.54	36.23	29.93	1.55		
41	25.23	22.59	1.82	28.51	22.79	1.85	30.05	24.89	1.87	32.18	26.12	1.89	34.40	26.72	1.91	35.46	29.70	1.92		
50	25.20	22.55	1.81	28.47	22.75	1.84	30.02	24.85	1.86	32.14	26.07	1.88	34.35	26.68	1.90	35.41	29.65	1.91		
59	24.96	22.51	1.80	28.20	22.71	1.83	29.73	24.80	1.85	31.83	26.02	1.87	34.03	26.63	1.89	35.08	29.59	1.90		
67	26.76	23.04	2.18	30.24	23.24	2.22	31.88	25.38	2.23	34.13	26.63	2.26	36.48	27.25	2.29	37.61	30.29	2.30		
77	28.56	23.57	2.74	32.28	23.77	2.79	34.02	25.96	2.81	36.43	27.24	2.85	38.94	27.87	2.88	40.14	30.98	2.89		
87	28.24	23.55	3.31	31.91	23.76	3.37	33.64	25.95	3.40	36.01	27.23	3.44	38.50	27.86	3.48	39.69	30.96	3.50		
95	27.91	23.54	3.88	31.54	23.74	3.95	33.25	25.93	3.99	35.60	27.21	4.03	38.06	27.84	4.08	39.23	30.94	4.10		
104	22.10	20.76	3.03	24.98	20.94	3.09	26.33	22.87	3.11	28.19	24.00	3.15	30.14	24.55	3.18	31.07	27.29	3.20		
115	16.30	16.29	2.18	18.42	17.41	2.22	19.42	19.02	2.24	20.79	19.96	2.26	22.22	20.42	2.29	22.91	22.69	2.30		

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
-10.0	7.78	6.83	1.11	8.79	6.89	1.13	9.27	7.53	1.14	9.92	7.90	1.15	10.61	8.08	1.16	10.94	8.98	1.17		
-5.0	7.57	6.75	1.29	8.56	6.81	1.31	9.02	7.44	1.32	9.66	7.81	1.34	10.32	7.99	1.35	10.64	8.88	1.36		
0.0	7.55	6.67	1.47	8.54	6.73	1.50	9.00	7.35	1.51	9.64	7.71	1.53	10.30	7.89	1.54	10.62	8.77	1.55		
5.0	7.39	6.62	1.82	8.36	6.68	1.85	8.81	7.29	1.87	9.43	7.65	1.89	10.08	7.83	1.91	10.39	8.70	1.92		
10.0	7.38	6.61	1.81	8.35	6.67	1.84	8.80	7.28	1.86	9.42	7.64	1.88	10.07	7.82	1.90	10.38	8.69	1.91		
15.0	7.31	6.60	1.80	8.27	6.66	1.83	8.71	7.27	1.85	9.33	7.63	1.87	9.97	7.80	1.89	10.28	8.67	1.90		
19.4	7.84	6.75	2.18	8.86	6.81	2.22	9.34	7.44	2.23	10.00	7.81	2.26	10.69	7.99	2.29	11.02	8.88	2.30		
25.0	8.37	6.91	2.74	9.46	6.97	2.79	9.97	7.61	2.81	10.68	7.98	2.85	11.41	8.17	2.88	11.77	9.08	2.89		
30.6	8.28	6.90	3.31	9.35	6.96	3.37	9.86	7.60	3.40	10.56	7.98	3.44	11.28	8.16	3.48	11.63	9.07	3.50		
35.0	8.18	6.90	3.88	9.24	6.96	3.95	9.75	7.60	3.99	10.43	7.97	4.03	11.15	8.16	4.08	11.50	9.07	4.10		
40.0	6.48	6.08	3.03	7.32	6.14	3.09	7.72	6.70	3.11	8.26	7.03	3.15	8.83	7.20	3.18	9.11	8.00	3.20		
46.1	4.78	4.77	2.18	5.40	5.10	2.22	5.69	5.57	2.24	6.09	5.85	2.26	6.51	5.98	2.29	6.71	6.65	2.30		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu + 12,000 Btu

		Indoor temperature																		
°FDB		64			70			75			80			85			90			
°FWB		54			60			63			67			71			73			
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBtu/h			kW			kBtu/h			kW			kBtu/h			kW			
14	28.04	24.62	1.19	31.69	24.83	1.21	33.40	27.12	1.22	35.76	28.46	1.23	38.23	29.12	1.25	39.41	32.36	1.26		
23	27.28	24.33	1.39	30.83	24.54	1.41	32.50	26.80	1.42	34.80	28.13	1.44	37.20	28.78	1.45	38.35	31.98	1.46		
32	27.22	24.04	1.58	30.76	24.25	1.61	32.43	26.49	1.62	34.72	27.80	1.64	37.12	28.44	1.66	38.26	31.61	1.67		
41	26.64	23.86	1.96	30.11	24.07	1.99	31.74	26.29	2.01	33.98	27.58	2.03	36.33	28.22	2.05	37.45	31.37	2.06		
50	26.61	23.82	1.95	30.07	24.03	1.98	31.70	26.24	2.00	33.94	27.54	2.02	36.28	28.17	2.04	37.40	31.31	2.05		
59	26.36	23.77	1.93	29.79	23.98	1.97	31.40	26.19	1.98	33.62	27.49	2.01	35.94	28.12	2.03	37.05	31.25	2.04		
67	28.26	24.33	2.34	31.94	24.54	2.38	33.67	26.81	2.40	36.05	28.13	2.43	38.53	28.78	2.46	39.72	31.99	2.47		
77	30.16	24.89	2.95	34.09	25.11	3.00	35.94	27.42	3.02	38.47	28.77	3.06	41.13	29.44	3.09	42.40	32.72	3.11		
87	29.82	24.87	3.56	33.70	25.09	3.62	35.53	27.40	3.65	38.04	28.76	3.69	40.66	29.42	3.74	41.92	32.70	3.76		
95	29.48	24.86	4.17	33.31	25.08	4.25	35.12	27.39	4.28	37.60	28.74	4.33	40.19	29.40	4.38	41.44	32.68	4.40		
104	23.35	21.93	3.26	26.38	22.12	3.32	27.81	24.16	3.34	29.78	25.35	3.38	31.83	25.93	3.42	32.82	28.82	3.44		
115	17.21	17.20	2.34	19.45	18.39	2.38	20.51	20.09	2.40	21.96	21.08	2.43	23.47	21.57	2.46	24.20	23.97	2.47		

		Indoor temperature																		
°CDB		17.8			21.1			23.9			26.7			29.4			32.2			
°CWB		12.2			15.6			17.2			19.4			21.7			22.8			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			
-10.0	8.22	7.21	1.19	9.29	7.28	1.21	9.79	7.95	1.22	10.48	8.34	1.23	11.21	8.53	1.25	11.55	9.48	1.26		
-5.0	8.00	7.13	1.39	9.04	7.19	1.41	9.53	7.86	1.42	10.20	8.24	1.44	10.90	8.43	1.45	11.24	9.37	1.46		
0.0	7.98	7.05	1.58	9.02	7.11	1.61	9.50	7.76	1.62	10.18	8.15	1.64	10.88	8.34	1.66	11.21	9.26	1.67		
5.0	7.81	6.99	1.96	8.82	7.05	1.99	9.30	7.70	2.01	9.96	8.08	2.03	10.65	8.27	2.05	10.98	9.19	2.06		
10.0	7.80	6.98	1.95	8.81	7.04	1.98	9.29	7.69	2.00	9.95	8.07	2.02	10.63	8.26	2.04	10.96	9.18	2.05		
15.0	7.72	6.97	1.93	8.73	7.03	1.97	9.20	7.68	1.98	9.85	8.06	2.01	10.53	8.24	2.03	10.86	9.16	2.04		
19.4	8.28	7.13	2.34	9.36	7.19	2.38	9.87	7.86	2.40	10.56	8.24	2.43	11.29	8.44	2.46	11.64	9.37	2.47		
25.0	8.84	7.29	2.95	9.99	7.36	3.00	10.53	8.04	3.02	11.28	8.43	3.06	12.05	8.63	3.09	12.43	9.59	3.11		
30.6	8.74	7.29	3.56	9.88	7.35	3.62	10.41	8.03	3.65	11.15	8.43	3.69	11.92	8.62	3.74	12.29	9.58	3.76		
35.0	8.64	7.29	4.17	9.76	7.35	4.25	10.29	8.03	4.28	11.02	8.42	4.33	11.78	8.62	4.38	12.14	9.58	4.40		
40.0	6.84	6.43	3.26	7.73	6.48	3.32	8.15	7.08	3.34	8.73	7.43	3.38	9.33	7.60	3.42	9.62	8.45	3.44		
46.1	5.05	5.04	2.34	5.70	5.39	2.38	6.01	5.89	2.40	6.44	6.18	2.43	6.88	6.32	2.46	7.09	7.03	2.47		

OUTDOOR UNIT UOMH36AFXZJ

● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu + 14,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
14	28.34	24.88	1.13	32.02	25.09	1.15	33.76	27.41	1.16	36.14	28.76	1.17	38.64	29.43	1.18	39.83	32.70	1.19	
23	27.57	24.59	1.31	31.16	24.80	1.34	32.85	27.09	1.35	35.17	28.43	1.36	37.60	29.08	1.38	38.76	32.32	1.38	
32	27.51	24.30	1.50	31.09	24.51	1.52	32.78	26.77	1.54	35.09	28.09	1.55	37.51	28.74	1.57	38.67	31.94	1.58	
41	26.93	24.11	1.85	30.43	24.32	1.89	32.08	26.57	1.90	34.34	27.88	1.92	36.71	28.52	1.94	37.85	31.70	1.95	
50	26.89	24.07	1.84	30.39	24.28	1.87	32.04	26.52	1.89	34.30	27.83	1.91	36.67	28.47	1.93	37.80	31.65	1.94	
59	26.64	24.03	1.83	30.10	24.24	1.86	31.73	26.47	1.88	33.98	27.78	1.90	36.32	28.42	1.92	37.44	31.59	1.93	
67	28.56	24.59	2.22	32.28	24.81	2.25	34.03	27.09	2.27	36.43	28.43	2.30	38.94	29.09	2.32	40.15	32.33	2.34	
77	30.48	25.15	2.79	34.45	25.37	2.84	36.32	27.71	2.86	38.88	29.08	2.89	41.57	29.75	2.93	42.85	33.07	2.94	
87	30.14	25.14	3.37	34.06	25.36	3.43	35.90	27.70	3.46	38.44	29.06	3.50	41.09	29.73	3.54	42.36	33.05	3.56	
95	29.79	25.12	3.95	33.67	25.34	4.02	35.49	27.68	4.05	38.00	29.04	4.10	40.62	29.72	4.15	41.88	33.03	4.17	
104	23.59	22.16	3.09	26.66	22.35	3.14	28.11	24.41	3.17	30.10	25.62	3.20	32.17	26.21	3.24	33.17	29.13	3.25	
115	17.40	17.38	2.22	19.66	18.59	2.26	20.73	20.30	2.28	22.19	21.30	2.30	23.72	21.80	2.33	24.45	24.22	2.34	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW			kW			kW			kW			kW			kW		
-10.0	8.31	7.29	1.13	9.39	7.35	1.15	9.89	8.03	1.16	10.59	8.43	1.17	11.32	8.62	1.18	11.67	9.58	1.19	
-5.0	8.08	7.21	1.31	9.13	7.27	1.34	9.63	7.94	1.35	10.31	8.33	1.36	11.02	8.52	1.38	11.36	9.47	1.38	
0.0	8.06	7.12	1.50	9.11	7.18	1.52	9.61	7.85	1.54	10.28	8.23	1.55	10.99	8.42	1.57	11.33	9.36	1.58	
5.0	7.89	7.07	1.85	8.92	7.13	1.89	9.40	7.79	1.90	10.07	8.17	1.92	10.76	8.36	1.94	11.09	9.29	1.95	
10.0	7.88	7.06	1.84	8.91	7.12	1.87	9.39	7.77	1.89	10.05	8.16	1.91	10.75	8.35	1.93	11.08	9.27	1.94	
15.0	7.81	7.04	1.83	8.82	7.10	1.86	9.30	7.76	1.88	9.96	8.14	1.90	10.64	8.33	1.92	10.97	9.26	1.93	
19.4	8.37	7.21	2.22	9.46	7.27	2.25	9.97	7.94	2.27	10.68	8.33	2.30	11.41	8.53	2.32	11.77	9.47	2.34	
25.0	8.93	7.37	2.79	10.10	7.44	2.84	10.64	8.12	2.86	11.40	8.52	2.89	12.18	8.72	2.93	12.56	9.69	2.94	
30.6	8.83	7.37	3.37	9.98	7.43	3.43	10.52	8.12	3.46	11.27	8.52	3.50	12.04	8.71	3.54	12.42	9.69	3.56	
35.0	8.73	7.36	3.95	9.87	7.43	4.02	10.40	8.11	4.05	11.14	8.51	4.10	11.91	8.71	4.15	12.27	9.68	4.17	
40.0	6.92	6.49	3.09	7.81	6.55	3.14	8.24	7.15	3.17	8.82	7.51	3.20	9.43	7.68	3.24	9.72	8.54	3.25	
46.1	5.10	5.09	2.22	5.76	5.45	2.26	6.07	5.95	2.28	6.50	6.24	2.30	6.95	6.39	2.33	7.17	7.10	2.34	

OUTDOOR UNIT  
UOMH36AFXJ

● Indoor units: 7,000 Btu + 7,000 Btu + 12,000 Btu + 12,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
14	28.34	24.88	1.20	32.02	25.09	1.23	33.76	27.41	1.24	36.14	28.76	1.25	38.64	29.43	1.26	39.83	32.70	1.27	
23	27.57	24.59	1.40	31.16	24.80	1.43	32.85	27.09	1.44	35.17	28.43	1.45	37.60	29.08	1.47	38.76	32.32	1.48	
32	27.51	24.30	1.60	31.09	24.51	1.63	32.78	26.77	1.64	35.09	28.09	1.66	37.51	28.74	1.68	38.67	31.94	1.69	
41	26.93	24.11	1.98	30.43	24.32	2.01	32.08	26.57	2.03	34.34	27.88	2.05	36.71	28.52	2.08	37.85	31.70	2.09	
50	26.89	24.07	1.97	30.39	24.28	2.00	32.04	26.52	2.02	34.30	27.83	2.04	36.67	28.47	2.06	37.80	31.65	2.08	
59	26.64	24.03	1.96	30.10	24.24	1.99	31.73	26.47	2.01	33.98	27.78	2.03	36.32	28.42	2.05	37.44	31.59	2.06	
67	28.56	24.59	2.37	32.28	24.81	2.41	34.03	27.09	2.43	36.43	28.43	2.46	38.94	29.09	2.48	40.15	32.33	2.50	
77	30.48	25.15	2.98	34.45	25.37	3.03	36.32	27.71	3.06	38.88	29.08	3.09	41.57	29.75	3.13	42.85	33.07	3.14	
87	30.14	25.14	3.60	34.06	25.36	3.67	35.90	27.70	3.70	38.44	29.06	3.74	41.09	29.73	3.78	42.36	33.05	3.80	
95	29.79	25.12	4.22	33.67	25.34	4.30	35.49	27.68	4.33	38.00	29.04	4.38	40.62	29.72	4.43	41.88	33.03	4.45	
104	23.59	22.16	3.30	26.66	22.35	3.35	28.11	24.41	3.38	30.10	25.62	3.42	32.17	26.21	3.46	33.17	29.13	3.48	
115	17.40	17.38	2.37	19.66	18.59	2.41	20.73	20.30	2.43	22.19	21.30	2.46	23.72	21.80	2.49	24.45	24.22	2.50	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW			kW			kW			kW			kW			kW		
-10.0	8.31	7.29	1.20	9.39	7.35	1.23	9.89	8.03	1.24	10.59	8.43	1.25	11.32	8.62	1.26	11.67	9.58	1.27	
-5.0	8.08	7.21	1.40	9.13	7.27	1.43	9.63	7.94	1.44	10.31	8.33	1.45	11.02	8.52	1.47	11.36	9.47	1.48	
0.0	8.06	7.12	1.60	9.11	7.18	1.63	9.61	7.85	1.64	10.28	8.23	1.66	10.99	8.42	1.68	11.33	9.36	1.69	
5.0	7.89	7.07	1.98	8.92	7.13	2.01	9.40	7.79	2.03	10.07	8.17	2.05	10.76	8.36	2.08	11.09	9.29	2.09	
10.0	7.88	7.06	1.97	8.91	7.12	2.00	9.39	7.77	2.02	10.05	8.16	2.04	10.75	8.35	2.06	11.08	9.27	2.08	
15.0	7.81	7.04	1.96	8.82	7.10	1.99	9.30	7.76	2.01	9.96	8.14	2.03	10.64	8.33	2.05	10.97	9.26	2.06	
19.4	8.37	7.21	2.37	9.46	7.27	2.41	9.97	7.94	2.43	10.68	8.33	2.46	11.41	8.53	2.48	11.77	9.47	2.50	
25.0	8.93	7.37	2.98	10.10	7.44	3.03	10.64	8.12	3.06	11.40	8.52	3.09	12.18	8.72	3.13	12.56	9.69	3.14	
30.6	8.83	7.37	3.60	9.98	7.43	3.67	10.52	8.12	3.70	11.27	8.52	3.74	12.04	8.71	3.78	12.42	9.69	3.80	
35.0	8.73	7.36	4.22	9.87	7.43	4.30	10.40	8.11	4.33	11.14	8.51	4.38	11.91	8.71	4.43	12.27	9.68	4.45	
40.0	6.92	6.49	3.30	7.81	6.55	3.35	8.24	7.15	3.38	8.82	7.51	3.42	9.43	7.68	3.46	9.72	8.54	3.48	
46.1	5.10	5.09	2.37	5.76	5.45	2.41	6.07	5.95	2.43	6.50	6.24	2.46	6.95	6.39	2.49	7.17	7.10	2.50	

● Indoor units: 7,000 Btu + 9,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	27.89	24.48	1.18	31.52	24.70	1.21	33.23	26.97	1.22	35.57	28.31	1.23	38.03	28.96	1.24	39.20	32.19	1.25
	23	27.14	24.20	1.38	30.67	24.41	1.40	32.33	26.66	1.42	34.62	27.98	1.43	37.01	28.62	1.45	38.15	31.81	1.46
	32	27.08	23.92	1.57	30.60	24.12	1.60	32.26	26.35	1.61	34.54	27.65	1.63	36.92	28.29	1.65	38.06	31.44	1.66
	41	26.50	23.73	1.95	29.95	23.94	1.98	31.57	26.15	2.00	33.80	27.44	2.02	36.13	28.07	2.04	37.25	31.20	2.05
	50	26.47	23.69	1.94	29.91	23.90	1.97	31.53	26.10	1.99	33.76	27.39	2.01	36.09	28.02	2.03	37.21	31.15	2.04
	59	26.22	23.65	1.93	29.63	23.86	1.96	31.23	26.05	1.98	33.44	27.34	2.00	35.75	27.97	2.02	36.85	31.09	2.03
	67	28.11	24.20	2.33	31.77	24.41	2.37	33.49	26.66	2.39	35.85	27.98	2.42	38.33	28.63	2.44	39.51	31.82	2.46
	77	30.00	24.76	2.93	33.91	24.97	2.99	35.74	27.28	3.01	38.27	28.62	3.04	40.91	29.28	3.08	42.17	32.55	3.09
87	29.66	24.74	3.54	33.52	24.96	3.61	35.34	27.26	3.64	37.83	28.60	3.68	40.45	29.27	3.72	41.69	32.52	3.74	
95	29.32	24.73	4.15	33.14	24.94	4.23	34.93	27.24	4.26	37.40	28.59	4.31	39.98	29.25	4.36	41.21	32.50	4.38	
104	23.22	21.81	3.24	26.24	22.00	3.30	27.67	24.03	3.33	29.62	25.21	3.36	31.66	25.80	3.40	32.64	28.67	3.42	
115	17.12	17.11	2.33	19.35	18.29	2.37	20.40	19.98	2.39	21.84	20.97	2.42	23.35	21.45	2.45	24.07	23.84	2.46	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	8.17	7.18	1.18	9.24	7.24	1.21	9.74	7.91	1.22	10.43	8.30	1.23	11.15	8.49	1.24	11.49	9.43	1.25
	-5.0	7.95	7.09	1.38	8.99	7.15	1.40	9.48	7.81	1.42	10.15	8.20	1.43	10.85	8.39	1.45	11.18	9.32	1.46
	0.0	7.94	7.01	1.57	8.97	7.07	1.60	9.45	7.72	1.61	10.12	8.10	1.63	10.82	8.29	1.65	11.15	9.21	1.66
	5.0	7.77	6.96	1.95	8.78	7.02	1.98	9.25	7.66	2.00	9.91	8.04	2.02	10.59	8.23	2.04	10.92	9.14	2.05
	10.0	7.76	6.94	1.94	8.77	7.00	1.97	9.24	7.65	1.99	9.89	8.03	2.01	10.58	8.21	2.03	10.90	9.13	2.04
	15.0	7.68	6.93	1.93	8.68	6.99	1.96	9.15	7.64	1.98	9.80	8.01	2.00	10.48	8.20	2.02	10.80	9.11	2.03
	19.4	8.24	7.09	2.33	9.31	7.16	2.37	9.81	7.81	2.39	10.51	8.20	2.42	11.23	8.39	2.44	11.58	9.32	2.46
	25.0	8.79	7.26	2.93	9.94	7.32	2.99	10.48	7.99	3.01	11.22	8.39	3.04	11.99	8.58	3.08	12.36	9.54	3.09
30.6	8.69	7.25	3.54	9.82	7.31	3.61	10.36	7.99	3.64	11.09	8.38	3.68	11.85	8.58	3.72	12.22	9.53	3.74	
35.0	8.59	7.25	4.15	9.71	7.31	4.23	10.24	7.98	4.26	10.96	8.38	4.31	11.72	8.57	4.36	12.08	9.53	4.38	
40.0	6.81	6.39	3.24	7.69	6.45	3.30	8.11	7.04	3.33	8.68	7.39	3.36	9.28	7.56	3.40	9.57	8.40	3.42	
46.1	5.02	5.01	2.33	5.67	5.36	2.37	5.98	5.86	2.39	6.40	6.15	2.42	6.84	6.29	2.45	7.05	6.99	2.46	

OUTDOOR UNIT  
UOMH36AFXZJ

● Indoor units: 7,000 Btu + 9,000 Btu + 9,000 Btu + 12,000 Btu

		Indoor temperature																	
°FDB		64			70			75			80			85			90		
°FWB		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBTu/h			kW			kBTu/h			kW			kBTu/h			kW		
	14	28.34	24.88	1.20	32.02	25.09	1.23	33.76	27.41	1.24	36.14	28.76	1.25	38.64	29.43	1.26	39.83	32.70	1.27
	23	27.57	24.59	1.40	31.16	24.80	1.43	32.85	27.09	1.44	35.17	28.43	1.45	37.60	29.08	1.47	38.76	32.32	1.48
	32	27.51	24.30	1.60	31.09	24.51	1.63	32.78	26.77	1.64	35.09	28.09	1.66	37.51	28.74	1.68	38.67	31.94	1.69
	41	26.93	24.11	1.98	30.43	24.32	2.01	32.08	26.57	2.03	34.34	27.88	2.05	36.71	28.52	2.08	37.85	31.70	2.09
	50	26.89	24.07	1.97	30.39	24.28	2.00	32.04	26.52	2.02	34.30	27.83	2.04	36.67	28.47	2.06	37.80	31.65	2.08
	59	26.64	24.03	1.96	30.10	24.24	1.99	31.73	26.47	2.01	33.98	27.78	2.03	36.32	28.42	2.05	37.44	31.59	2.06
	67	28.56	24.59	2.37	32.28	24.81	2.41	34.03	27.09	2.43	36.43	28.43	2.46	38.94	29.09	2.48	40.15	32.33	2.50
	77	30.48	25.15	2.98	34.45	25.37	3.03	36.32	27.71	3.06	38.88	29.08	3.09	41.57	29.75	3.13	42.85	33.07	3.14
87	30.14	25.14	3.60	34.06	25.36	3.67	35.90	27.70	3.70	38.44	29.06	3.74	41.09	29.73	3.78	42.36	33.05	3.80	
95	29.79	25.12	4.22	33.67	25.34	4.30	35.49	27.68	4.33	38.00	29.04	4.38	40.62	29.72	4.43	41.88	33.03	4.45	
104	23.59	22.16	3.30	26.66	22.35	3.35	28.11	24.41	3.38	30.10	25.62	3.42	32.17	26.21	3.46	33.17	29.13	3.48	
115	17.40	17.38	2.37	19.66	18.59	2.41	20.73	20.30	2.43	22.19	21.30	2.46	23.72	21.80	2.49	24.45	24.22	2.50	

		Indoor temperature																	
°CDB		17.8			21.1			23.9			26.7			29.4			32.2		
°CWB		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW			kW			kW			kW			kW			kW		
	-10.0	8.31	7.29	1.20	9.39	7.35	1.23	9.89	8.03	1.24	10.59	8.43	1.25	11.32	8.62	1.26	11.67	9.58	1.27
	-5.0	8.08	7.21	1.40	9.13	7.27	1.43	9.63	7.94	1.44	10.31	8.33	1.45	11.02	8.52	1.47	11.36	9.47	1.48
	0.0	8.06	7.12	1.60	9.11	7.18	1.63	9.61	7.85	1.64	10.28	8.23	1.66	10.99	8.42	1.68	11.33	9.36	1.69
	5.0	7.89	7.07	1.98	8.92	7.13	2.01	9.40	7.79	2.03	10.07	8.17	2.05	10.76	8.36	2.08	11.09	9.29	2.09
	10.0	7.88	7.06	1.97	8.91	7.12	2.00	9.39	7.77	2.02	10.05	8.16	2.04	10.75	8.35	2.06	11.08	9.27	2.08
	15.0	7.81	7.04	1.96	8.82	7.10	1.99	9.30	7.76	2.01	9.96	8.14	2.03	10.64	8.33	2.05	10.97	9.26	2.06
	19.4	8.37	7.21	2.37	9.46	7.27	2.41	9.97	7.94	2.43	10.68	8.33	2.46	11.41	8.53	2.48	11.77	9.47	2.50
	25.0	8.93	7.37	2.98	10.10	7.44	3.03	10.64	8.12	3.06	11.40	8.52	3.09	12.18	8.72	3.13	12.56	9.69	3.14
30.6	8.83	7.37	3.60	9.98	7.43	3.67	10.52	8.12	3.70	11.27	8.52	3.74	12.04	8.71	3.78	12.42	9.69	3.80	
35.0	8.73	7.36	4.22	9.87	7.43	4.30	10.40	8.11	4.33	11.14	8.51	4.38	11.91	8.71	4.43	12.27	9.68	4.45	
40.0	6.92	6.49	3.30	7.81	6.55	3.35	8.24	7.15	3.38	8.82	7.51	3.42	9.43	7.68	3.46	9.72	8.54	3.48	
46.1	5.10	5.09	2.37	5.76	5.45	2.41	6.07	5.95	2.43	6.50	6.24	2.46	6.95	6.39	2.49	7.17	7.10	2.50	



## ● Indoor units: 9,000 Btu + 9,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
14	28.34	24.88	1.20	32.02	25.09	1.23	33.76	27.41	1.24	36.14	28.76	1.25	38.64	29.43	1.26	39.83	32.70	1.27	
23	27.57	24.59	1.40	31.16	24.80	1.43	32.85	27.09	1.44	35.17	28.43	1.45	37.60	29.08	1.47	38.76	32.32	1.48	
32	27.51	24.30	1.60	31.09	24.51	1.63	32.78	26.77	1.64	35.09	28.09	1.66	37.51	28.74	1.68	38.67	31.94	1.69	
41	26.93	24.11	1.98	30.43	24.32	2.01	32.08	26.57	2.03	34.34	27.88	2.05	36.71	28.52	2.08	37.85	31.70	2.09	
50	26.89	24.07	1.97	30.39	24.28	2.00	32.04	26.52	2.02	34.30	27.83	2.04	36.67	28.47	2.06	37.80	31.65	2.08	
59	26.64	24.03	1.96	30.10	24.24	1.99	31.73	26.47	2.01	33.98	27.78	2.03	36.32	28.42	2.05	37.44	31.59	2.06	
67	28.56	24.59	2.37	32.28	24.81	2.41	34.03	27.09	2.43	36.43	28.43	2.46	38.94	29.09	2.48	40.15	32.33	2.50	
77	30.48	25.15	2.98	34.45	25.37	3.03	36.32	27.71	3.06	38.88	29.08	3.09	41.57	29.75	3.13	42.85	33.07	3.14	
87	30.14	25.14	3.60	34.06	25.36	3.67	35.90	27.70	3.70	38.44	29.06	3.74	41.09	29.73	3.78	42.36	33.05	3.80	
95	29.79	25.12	4.22	33.67	25.34	4.30	35.49	27.68	4.33	38.00	29.04	4.38	40.62	29.72	4.43	41.88	33.03	4.45	
104	23.59	22.16	3.30	26.66	22.35	3.35	28.11	24.41	3.38	30.10	25.62	3.42	32.17	26.21	3.46	33.17	29.13	3.48	
115	17.40	17.38	2.37	19.66	18.59	2.41	20.73	20.30	2.43	22.19	21.30	2.46	23.72	21.80	2.49	24.45	24.22	2.50	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW			kW			kW			kW			kW			kW		
-10.0	8.31	7.29	1.20	9.39	7.35	1.23	9.89	8.03	1.24	10.59	8.43	1.25	11.32	8.62	1.26	11.67	9.58	1.27	
-5.0	8.08	7.21	1.40	9.13	7.27	1.43	9.63	7.94	1.44	10.31	8.33	1.45	11.02	8.52	1.47	11.36	9.47	1.48	
0.0	8.06	7.12	1.60	9.11	7.18	1.63	9.61	7.85	1.64	10.28	8.23	1.66	10.99	8.42	1.68	11.33	9.36	1.69	
5.0	7.89	7.07	1.98	8.92	7.13	2.01	9.40	7.79	2.03	10.07	8.17	2.05	10.76	8.36	2.08	11.09	9.29	2.09	
10.0	7.88	7.06	1.97	8.91	7.12	2.00	9.39	7.77	2.02	10.05	8.16	2.04	10.75	8.35	2.06	11.08	9.27	2.08	
15.0	7.81	7.04	1.96	8.82	7.10	1.99	9.30	7.76	2.01	9.96	8.14	2.03	10.64	8.33	2.05	10.97	9.26	2.06	
19.4	8.37	7.21	2.37	9.46	7.27	2.41	9.97	7.94	2.43	10.68	8.33	2.46	11.41	8.53	2.48	11.77	9.47	2.50	
25.0	8.93	7.37	2.98	10.10	7.44	3.03	10.64	8.12	3.06	11.40	8.52	3.09	12.18	8.72	3.13	12.56	9.69	3.14	
30.6	8.83	7.37	3.60	9.98	7.43	3.67	10.52	8.12	3.70	11.27	8.52	3.74	12.04	8.71	3.78	12.42	9.69	3.80	
35.0	8.73	7.36	4.22	9.87	7.43	4.30	10.40	8.11	4.33	11.14	8.51	4.38	11.91	8.71	4.43	12.27	9.68	4.45	
40.0	6.92	6.49	3.30	7.81	6.55	3.35	8.24	7.15	3.38	8.82	7.51	3.42	9.43	7.68	3.46	9.72	8.54	3.48	
46.1	5.10	5.09	2.37	5.76	5.45	2.41	6.07	5.95	2.43	6.50	6.24	2.46	6.95	6.39	2.49	7.17	7.10	2.50	

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 18,000 Btu + 18,000 Btu (with optional kit RXK9FZ1818)

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°FWB	kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h			kBTu/h		
		kW			kW			kW			kW			kW			kW		
14	26.85	23.57	1.20	30.34	23.77	1.22	31.98	25.97	1.23	34.24	27.25	1.24	36.61	27.88	1.26	37.74	30.98	1.26	
23	26.12	23.29	1.40	29.52	23.50	1.42	31.12	25.66	1.43	33.32	26.93	1.45	35.62	27.55	1.46	36.72	30.62	1.47	
32	26.06	23.02	1.59	29.45	23.22	1.62	31.05	25.36	1.63	33.24	26.61	1.65	35.54	27.23	1.67	36.64	30.26	1.68	
41	25.51	22.84	1.97	28.83	23.04	2.00	30.39	25.17	2.02	32.54	26.41	2.04	34.78	27.02	2.07	35.86	30.03	2.08	
50	25.48	22.81	1.96	28.79	23.00	1.99	30.35	25.13	2.01	32.50	26.37	2.03	34.74	26.98	2.06	35.81	29.98	2.07	
59	25.24	22.76	1.95	28.52	22.96	1.98	30.06	25.08	2.00	32.19	26.32	2.02	34.41	26.93	2.04	35.47	29.92	2.05	
67	27.06	23.30	2.36	30.58	23.50	2.40	32.23	25.67	2.42	34.51	26.93	2.44	36.89	27.56	2.47	38.03	30.63	2.49	
77	28.88	23.83	2.97	32.64	24.04	3.02	34.41	26.25	3.04	36.84	27.55	3.08	39.38	28.19	3.11	40.59	31.33	3.13	
87	28.55	23.82	3.59	32.27	24.02	3.65	34.02	26.24	3.68	36.42	27.53	3.72	38.93	28.17	3.76	40.13	31.31	3.78	
95	28.22	23.80	4.20	31.90	24.01	4.28	33.62	26.22	4.31	36.00	27.52	4.36	38.48	28.15	4.41	39.67	31.29	4.43	
104	22.35	20.99	3.28	25.26	21.18	3.34	26.63	23.13	3.37	28.51	24.27	3.40	30.48	24.83	3.44	31.42	27.60	3.46	
115	16.48	16.47	2.36	18.63	17.61	2.40	19.64	19.23	2.42	21.02	20.18	2.45	22.47	20.65	2.48	23.17	22.95	2.49	

		Indoor temperature																	
		17.8			21.1			23.9			26.7			29.4			32.2		
		12.2			15.6			17.2			19.4			21.7			22.8		
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
	°CWB	kW			kW			kW			kW			kW			kW		
		kW			kW			kW			kW			kW			kW		
-10.0	7.87	6.91	1.20	8.89	6.97	1.22	9.37	7.61	1.23	10.04	7.99	1.24	10.73	8.17	1.26	11.06	9.08	1.26	
-5.0	7.66	6.83	1.40	8.65	6.89	1.42	9.12	7.52	1.43	9.77	7.89	1.45	10.44	8.08	1.46	10.76	8.97	1.47	
0.0	7.64	6.75	1.59	8.63	6.81	1.62	9.10	7.43	1.63	9.74	7.80	1.65	10.42	7.98	1.67	10.74	8.87	1.68	
5.0	7.48	6.70	1.97	8.45	6.75	2.00	8.91	7.38	2.02	9.54	7.74	2.04	10.19	7.92	2.07	10.51	8.80	2.08	
10.0	7.47	6.68	1.96	8.44	6.74	1.99	8.90	7.36	2.01	9.52	7.73	2.03	10.18	7.91	2.06	10.50	8.79	2.07	
15.0	7.40	6.67	1.95	8.36	6.73	1.98	8.81	7.35	2.00	9.43	7.71	2.02	10.08	7.89	2.04	10.40	8.77	2.05	
19.4	7.93	6.83	2.36	8.96	6.89	2.40	9.45	7.52	2.42	10.12	7.89	2.44	10.81	8.08	2.47	11.15	9.98	2.49	
25.0	8.46	6.98	2.97	9.57	7.05	3.02	10.08	7.69	3.04	10.80	8.07	3.08	11.54	8.26	3.11	11.90	9.18	3.13	
30.6	8.37	6.98	3.59	9.46	7.04	3.65	9.97	7.69	3.68	10.67	8.07	3.72	11.41	8.26	3.76	11.76	9.18	3.78	
35.0	8.27	6.98	4.20	9.35	7.04	4.28	9.85	7.68	4.31	10.55	8.06	4.36	11.28	8.25	4.41	11.63	9.17	4.43	
40.0	6.55	6.15	3.28	7.40	6.21	3.34	7.80	6.78	3.37	8.36	7.11	3.40	8.93	7.28	3.44	9.21	8.09	3.46	
46.1	4.83	4.83	2.36	5.46	5.16	2.40	5.75	5.64	2.42	6.16	5.92	2.45	6.59	6.05	2.48	6.79	6.73	2.49	

# 6-3. Heating capacity

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

## ■ Model: UOMH36AFXZJ

- TC: Total Capacity, IP: Input Power
- The data is based on the following conditions:  
Pipe length: 7.5 m, Height difference: 0 m [Outdoor unit—Indoor unit]

## ● Indoor units: 7,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	7.26	1.21	7.08	1.24	6.91	1.26	6.74	1.29	6.56	1.31
	14	12	8.83	1.23	8.62	1.26	8.41	1.28	8.20	1.31	7.99	1.33
	23	19	10.19	1.25	9.95	1.27	9.71	1.30	9.46	1.33	9.22	1.35
	32	28	10.84	1.18	10.58	1.20	10.32	1.23	10.06	1.25	9.81	1.28
	41	37	11.36	1.16	11.09	1.19	10.82	1.21	10.55	1.24	10.28	1.26
	47	43	11.99	1.22	11.71	1.25	11.42	1.28	11.14	1.30	10.85	1.33
	50	47	12.19	1.22	11.90	1.25	11.61	1.27	11.32	1.30	11.03	1.32
	59	50	12.78	1.21	12.47	1.23	12.17	1.26	11.86	1.28	11.56	1.31
68	59	12.99	1.04	12.68	1.06	12.37	1.09	12.06	1.11	11.75	1.13	
75	65	13.71	1.04	13.39	1.06	13.06	1.08	12.73	1.10	12.41	1.12	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	2.13	1.21	2.08	1.24	2.03	1.26	1.97	1.29	1.92	1.31
	-10.0	-11.1	2.59	1.23	2.53	1.26	2.46	1.28	2.40	1.31	2.34	1.33
	-5.0	-7.2	2.99	1.25	2.92	1.27	2.84	1.30	2.77	1.33	2.70	1.35
	0.0	-2.2	3.18	1.18	3.10	1.20	3.03	1.23	2.95	1.25	2.87	1.28
	5.0	2.8	3.33	1.16	3.25	1.19	3.17	1.21	3.09	1.24	3.01	1.26
	8.3	6.1	3.52	1.22	3.43	1.25	3.35	1.28	3.26	1.30	3.18	1.33
	10.0	8.3	3.57	1.22	3.49	1.25	3.40	1.27	3.32	1.30	3.23	1.32
	15.0	10.0	3.74	1.21	3.66	1.23	3.57	1.26	3.48	1.28	3.39	1.31
20.0	15.0	3.81	1.04	3.72	1.06	3.63	1.09	3.54	1.11	3.44	1.13	
23.9	18.3	4.02	1.04	3.92	1.06	3.83	1.08	3.73	1.10	3.64	1.12	

OUTDOOR UNIT  
UOMH36AFXZJ

## ● Indoor units: 9,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	8.82	1.35	8.61	1.38	8.40	1.40	8.19	1.43	7.98	1.46
	14	12	10.74	1.37	10.48	1.40	10.23	1.43	9.97	1.45	9.71	1.48
	23	19	12.39	1.39	12.10	1.42	11.80	1.45	11.51	1.47	11.21	1.50
	32	28	13.18	1.31	12.87	1.34	12.55	1.36	12.24	1.39	11.92	1.42
	41	37	13.81	1.29	13.48	1.32	13.16	1.35	12.83	1.38	12.50	1.40
	47	43	14.58	1.36	14.24	1.39	13.89	1.42	13.54	1.45	13.19	1.47
	50	47	14.82	1.36	14.47	1.38	14.12	1.41	13.76	1.44	13.41	1.47
	59	50	15.54	1.34	15.17	1.37	14.80	1.40	14.43	1.43	14.06	1.46
68	59	15.79	1.16	15.42	1.18	15.04	1.21	14.67	1.23	14.29	1.26	
75	65	16.68	1.15	16.28	1.18	15.88	1.20	15.48	1.23	15.09	1.25	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	2.59	1.35	2.52	1.38	2.46	1.40	2.40	1.43	2.34	1.46
	-10.0	-11.1	3.15	1.37	3.07	1.40	3.00	1.43	2.92	1.45	2.85	1.48
	-5.0	-7.2	3.63	1.39	3.55	1.42	3.46	1.45	3.37	1.47	3.29	1.50
	0.0	-2.2	3.86	1.31	3.77	1.34	3.68	1.36	3.59	1.39	3.49	1.42
	5.0	2.8	4.05	1.29	3.95	1.32	3.86	1.35	3.76	1.38	3.66	1.40
	8.3	6.1	4.27	1.36	4.17	1.39	4.07	1.42	3.97	1.45	3.87	1.47
	10.0	8.3	4.34	1.36	4.24	1.38	4.14	1.41	4.03	1.44	3.93	1.47
	15.0	10.0	4.55	1.34	4.45	1.37	4.34	1.40	4.23	1.43	4.12	1.46
20.0	15.0	4.63	1.16	4.52	1.18	4.41	1.21	4.30	1.23	4.19	1.26	
23.9	18.3	4.89	1.15	4.77	1.18	4.65	1.20	4.54	1.23	4.42	1.25	

## ● Indoor units: 12,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	10.73	1.75	10.47	1.78	10.22	1.82	9.96	1.86	9.71	1.89
	14	12	13.06	1.77	12.75	1.81	12.44	1.85	12.13	1.88	11.82	1.92
	23	19	15.07	1.80	14.71	1.84	14.36	1.87	14.00	1.91	13.64	1.95
	32	28	16.03	1.69	15.65	1.73	15.27	1.77	14.88	1.80	14.50	1.84
	41	37	16.80	1.68	16.40	1.71	16.00	1.75	15.60	1.78	15.20	1.82
	47	43	17.74	1.76	17.31	1.80	16.89	1.84	16.47	1.87	16.05	1.91
	50	47	18.03	1.76	17.60	1.79	17.17	1.83	16.74	1.87	16.31	1.90
	59	50	18.90	1.74	18.45	1.78	18.00	1.81	17.55	1.85	17.10	1.89
68	59	19.21	1.50	18.75	1.53	18.30	1.56	17.84	1.59	17.38	1.63	
75	65	20.28	1.49	19.80	1.53	19.31	1.56	18.83	1.59	18.35	1.62	

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1	3.14	1.75	3.07	1.78	3.00	1.82	2.92	1.86	2.85	1.89
	-10.0	-11.1	3.83	1.77	3.74	1.81	3.65	1.85	3.55	1.88	3.46	1.92
	-5.0	-7.2	4.42	1.80	4.31	1.84	4.21	1.87	4.10	1.91	4.00	1.95
	0.0	-2.2	4.70	1.69	4.59	1.73	4.47	1.77	4.36	1.80	4.25	1.84
	5.0	2.8	4.92	1.68	4.81	1.71	4.69	1.75	4.57	1.78	4.45	1.82
	8.3	6.1	5.20	1.76	5.07	1.80	4.95	1.84	4.83	1.87	4.70	1.91
	10.0	8.3	5.28	1.76	5.16	1.79	5.03	1.83	4.91	1.87	4.78	1.90
	15.0	10.0	5.54	1.74	5.41	1.78	5.27	1.81	5.14	1.85	5.01	1.89
20.0	15.0	5.63	1.50	5.50	1.53	5.36	1.56	5.23	1.59	5.09	1.63	
23.9	18.3	5.94	1.49	5.80	1.53	5.66	1.56	5.52	1.59	5.38	1.62	

# ● Indoor units: 14,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	14.59	1.92	14.24	1.96	13.90	2.00	13.55	2.04	13.20	2.08	13.20	2.08
14	12	17.76	1.95	17.34	1.99	16.91	2.03	16.49	2.07	16.07	2.11	16.07	2.11
23	19	20.50	1.98	20.01	2.02	19.52	2.06	19.03	2.10	18.54	2.14	18.54	2.14
32	28	21.80	1.86	21.28	1.90	20.76	1.94	20.24	1.98	19.72	2.02	19.72	2.02
41	37	22.85	1.84	22.30	1.88	21.76	1.92	21.21	1.96	20.67	2.00	20.67	2.00
47	43	24.12	1.94	23.54	1.98	22.97	2.02	22.40	2.06	21.82	2.10	21.82	2.10
50	47	24.51	1.93	23.93	1.97	23.35	2.01	22.76	2.05	22.18	2.09	22.18	2.09
59	50	25.69	1.91	25.08	1.95	24.47	1.99	23.86	2.03	23.25	2.07	23.25	2.07
68	59	26.12	1.65	25.50	1.68	24.88	1.72	24.26	1.75	23.63	1.79	23.63	1.79
75	65	27.58	1.64	26.92	1.68	26.26	1.71	25.61	1.75	24.95	1.78	24.95	1.78

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	4.28	1.92	4.17	1.96	4.07	2.00	3.97	2.04	3.87	2.08	3.87	2.08
-10.0	-11.1	5.20	1.95	5.08	1.99	4.96	2.03	4.83	2.07	4.71	2.11	4.71	2.11
-5.0	-7.2	6.01	1.98	5.86	2.02	5.72	2.06	5.58	2.10	5.44	2.14	5.44	2.14
0.0	-2.2	6.39	1.86	6.24	1.90	6.08	1.94	5.93	1.98	5.78	2.02	5.78	2.02
5.0	2.8	6.70	1.84	6.54	1.88	6.38	1.92	6.22	1.96	6.06	2.00	6.06	2.00
8.3	6.1	7.07	1.94	6.90	1.98	6.73	2.02	6.56	2.06	6.40	2.10	6.40	2.10
10.0	8.3	7.18	1.93	7.01	1.97	6.84	2.01	6.67	2.05	6.50	2.09	6.50	2.09
15.0	10.0	7.53	1.91	7.35	1.95	7.17	1.99	6.99	2.03	6.81	2.07	6.81	2.07
20.0	15.0	7.66	1.65	7.47	1.68	7.29	1.72	7.11	1.75	6.93	1.79	6.93	1.79
23.9	18.3	8.08	1.64	7.89	1.68	7.70	1.71	7.51	1.75	7.31	1.78	7.31	1.78

# ● Indoor units: 18,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	16.07	2.44	15.68	2.50	15.30	2.55	14.92	2.60	14.54	2.65	14.54	2.65
14	12	19.55	2.48	19.09	2.53	18.62	2.58	18.16	2.63	17.69	2.69	17.69	2.69
23	19	22.57	2.52	22.03	2.57	21.49	2.62	20.96	2.67	20.42	2.72	20.42	2.72
32	28	24.00	2.37	23.43	2.42	22.86	2.47	22.29	2.52	21.71	2.57	21.71	2.57
41	37	25.16	2.35	24.56	2.39	23.96	2.44	23.36	2.49	22.76	2.54	22.76	2.54
47	43	26.56	2.47	25.93	2.52	25.29	2.57	24.66	2.62	24.03	2.67	24.03	2.67
50	47	26.99	2.46	26.35	2.51	25.71	2.56	25.06	2.61	24.42	2.66	24.42	2.66
59	50	28.29	2.43	27.62	2.49	26.95	2.54	26.27	2.59	25.60	2.64	25.60	2.64
68	59	28.76	2.10	28.08	2.14	27.39	2.19	26.71	2.23	26.02	2.27	26.02	2.27
75	65	30.37	2.09	29.64	2.13	28.92	2.18	28.20	2.22	27.47	2.26	27.47	2.26

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	4.71	2.44	4.60	2.50	4.48	2.55	4.37	2.60	4.26	2.65	4.26	2.65
-10.0	-11.1	5.73	2.48	5.59	2.53	5.46	2.58	5.32	2.63	5.19	2.69	5.19	2.69
-5.0	-7.2	6.61	2.52	6.46	2.57	6.30	2.62	6.14	2.67	5.98	2.72	5.98	2.72
0.0	-2.2	7.03	2.37	6.87	2.42	6.70	2.47	6.53	2.52	6.36	2.57	6.36	2.57
5.0	2.8	7.37	2.35	7.20	2.39	7.02	2.44	6.85	2.49	6.67	2.54	6.67	2.54
8.3	6.1	7.78	2.47	7.60	2.52	7.41	2.57	7.23	2.62	7.04	2.67	7.04	2.67
10.0	8.3	7.91	2.46	7.72	2.51	7.53	2.56	7.35	2.61	7.16	2.66	7.16	2.66
15.0	10.0	8.29	2.43	8.09	2.49	7.90	2.54	7.70	2.59	7.50	2.64	7.50	2.64
20.0	15.0	8.43	2.10	8.23	2.14	8.03	2.19	7.83	2.23	7.63	2.27	7.63	2.27
23.9	18.3	8.90	2.09	8.69	2.13	8.48	2.18	8.26	2.22	8.05	2.26	8.05	2.26

OUTDOOR UNIT  
UOMH36AFXZJ

## ● Indoor units: 24,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	19.70	3.20	19.23	3.27	18.76	3.33	18.29	3.40	17.82	3.47	
14	12	23.97	3.25	23.40	3.31	22.83	3.38	22.26	3.45	21.69	3.52		
23	19	27.67	3.29	27.01	3.36	26.35	3.43	25.69	3.50	25.03	3.57		
32	28	29.42	3.10	28.72	3.17	28.02	3.23	27.32	3.30	26.62	3.36		
41	37	30.84	3.07	30.11	3.14	29.37	3.20	28.64	3.26	27.90	3.33		
47	43	32.56	3.23	31.78	3.30	31.01	3.36	30.23	3.43	29.46	3.50		
50	47	33.09	3.22	32.30	3.29	31.52	3.35	30.73	3.42	29.94	3.49		
59	50	34.69	3.19	33.86	3.25	33.03	3.32	32.21	3.39	31.38	3.45		
68	59	35.26	2.75	34.42	2.81	33.58	2.86	32.74	2.92	31.91	2.98		
75	65	37.23	2.74	36.34	2.79	35.46	2.85	34.57	2.91	33.68	2.96		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	5.77	3.20	5.64	3.27	5.50	3.33	5.36	3.40	5.22	3.47	
-10.0	-11.1	7.03	3.25	6.86	3.31	6.69	3.38	6.52	3.45	6.36	3.52		
-5.0	-7.2	8.11	3.29	7.92	3.36	7.72	3.43	7.53	3.50	7.34	3.57		
0.0	-2.2	8.62	3.10	8.42	3.17	8.21	3.23	8.01	3.30	7.80	3.36		
5.0	2.8	9.04	3.07	8.82	3.14	8.61	3.20	8.39	3.26	8.18	3.33		
8.3	6.1	9.54	3.23	9.32	3.30	9.09	3.36	8.86	3.43	8.63	3.50		
10.0	8.3	9.70	3.22	9.47	3.29	9.24	3.35	9.01	3.42	8.77	3.49		
15.0	10.0	10.17	3.19	9.92	3.25	9.68	3.32	9.44	3.39	9.20	3.45		
20.0	15.0	10.34	2.75	10.09	2.81	9.84	2.86	9.60	2.92	9.35	2.98		
23.9	18.3	10.91	2.74	10.65	2.79	10.39	2.85	10.13	2.91	9.87	2.96		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 14,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	22.93	3.18	22.38	3.24	21.84	3.31	21.29	3.38	20.75	3.44	
14	12	27.91	3.22	27.24	3.29	26.58	3.36	25.92	3.43	25.25	3.49		
23	19	32.21	3.27	31.45	3.34	30.68	3.41	29.91	3.47	29.14	3.54		
32	28	34.25	3.08	33.44	3.15	32.62	3.21	31.81	3.28	30.99	3.34		
41	37	35.90	3.05	35.05	3.11	34.19	3.18	33.34	3.24	32.48	3.30		
47	43	37.91	3.21	37.00	3.27	36.10	3.34	35.20	3.41	34.30	3.47		
50	47	38.52	3.20	37.61	3.26	36.69	3.33	35.77	3.40	34.86	3.46		
59	50	40.38	3.17	39.42	3.23	38.46	3.30	37.50	3.36	36.54	3.43		
68	59	41.05	2.73	40.08	2.79	39.10	2.84	38.12	2.90	37.14	2.96		
75	65	43.34	2.72	42.31	2.77	41.28	2.83	40.24	2.89	39.21	2.94		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	6.72	3.18	6.56	3.24	6.40	3.31	6.24	3.38	6.08	3.44	
-10.0	-11.1	8.18	3.22	7.98	3.29	7.79	3.36	7.60	3.43	7.40	3.49		
-5.0	-7.2	9.44	3.27	9.22	3.34	8.99	3.41	8.77	3.47	8.54	3.54		
0.0	-2.2	10.04	3.08	9.80	3.15	9.56	3.21	9.32	3.28	9.08	3.34		
5.0	2.8	10.52	3.05	10.27	3.11	10.02	3.18	9.77	3.24	9.52	3.30		
8.3	6.1	11.11	3.21	10.84	3.27	10.58	3.34	10.32	3.41	10.05	3.47		
10.0	8.3	11.29	3.20	11.02	3.26	10.75	3.33	10.48	3.40	10.22	3.46		
15.0	10.0	11.84	3.17	11.55	3.23	11.27	3.30	10.99	3.36	10.71	3.43		
20.0	15.0	12.03	2.73	11.75	2.79	11.46	2.84	11.17	2.90	10.89	2.96		
23.9	18.3	12.70	2.72	12.40	2.77	12.10	2.83	11.80	2.89	11.49	2.94		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 18,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	24.84	3.58	24.24	3.65	23.65	3.73	23.06	3.80	22.47	3.88		
14	12	30.23	3.63	29.51	3.71	28.79	3.78	28.07	3.86	27.35	3.93		
23	19	34.89	3.68	34.06	3.76	33.23	3.84	32.40	3.91	31.57	3.99		
32	28	37.10	3.47	36.22	3.54	35.33	3.62	34.45	3.69	33.57	3.76		
41	37	38.89	3.43	37.96	3.51	37.04	3.58	36.11	3.65	35.18	3.72		
47	43	41.06	3.61	40.08	3.68	39.10	3.76	38.12	3.84	37.15	3.91		
50	47	41.73	3.60	40.73	3.67	39.74	3.75	38.75	3.82	37.75	3.90		
59	50	43.74	3.56	42.70	3.64	41.65	3.71	40.61	3.79	39.57	3.86		
68	59	44.46	3.07	43.41	3.14	42.35	3.20	41.29	3.27	40.23	3.33		
75	65	46.94	3.06	45.82	3.12	44.71	3.19	43.59	3.25	42.47	3.32		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	7.28	3.58	7.11	3.65	6.93	3.73	6.76	3.80	6.59	3.88		
-10.0	-11.1	8.86	3.63	8.65	3.71	8.44	3.78	8.23	3.86	8.02	3.93		
-5.0	-7.2	10.23	3.68	9.98	3.76	9.74	3.84	9.49	3.91	9.25	3.99		
0.0	-2.2	10.87	3.47	10.61	3.54	10.36	3.62	10.10	3.69	9.84	3.76		
5.0	2.8	11.40	3.43	11.13	3.51	10.85	3.58	10.58	3.65	10.31	3.72		
8.3	6.1	12.03	3.61	11.75	3.68	11.46	3.76	11.17	3.84	10.89	3.91		
10.0	8.3	12.23	3.60	11.94	3.67	11.65	3.75	11.36	3.82	11.06	3.90		
15.0	10.0	12.82	3.56	12.51	3.64	12.21	3.71	11.90	3.79	11.60	3.86		
20.0	15.0	13.03	3.07	12.72	3.14	12.41	3.20	12.10	3.27	11.79	3.33		
23.9	18.3	13.76	3.06	13.43	3.12	13.10	3.19	12.78	3.25	12.45	3.32		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 24,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	26.04	3.76	25.42	3.84	24.80	3.92	24.18	3.99	23.56	4.07		
14	12	31.70	3.81	30.94	3.89	30.19	3.97	29.43	4.05	28.68	4.13		
23	19	36.58	3.87	35.71	3.95	34.84	4.03	33.97	4.11	33.10	4.19		
32	28	38.90	3.65	37.98	3.72	37.05	3.80	36.12	3.87	35.20	3.95		
41	37	40.78	3.61	39.81	3.68	38.84	3.76	37.86	3.83	36.89	3.91		
47	43	43.05	3.79	42.03	3.87	41.00	3.95	39.98	4.03	38.95	4.11		
50	47	43.75	3.78	42.71	3.86	41.67	3.94	40.63	4.02	39.59	4.10		
59	50	45.86	3.74	44.77	3.82	43.68	3.90	42.59	3.98	41.49	4.06		
68	59	46.63	3.23	45.52	3.30	44.41	3.36	43.30	3.43	42.19	3.50		
75	65	49.22	3.21	48.05	3.28	46.88	3.35	45.71	3.42	44.54	3.48		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	7.63	3.76	7.45	3.84	7.27	3.92	7.09	3.99	6.91	4.07		
-10.0	-11.1	9.29	3.81	9.07	3.89	8.85	3.97	8.63	4.05	8.41	4.13		
-5.0	-7.2	10.72	3.87	10.47	3.95	10.21	4.03	9.96	4.11	9.70	4.19		
0.0	-2.2	11.40	3.65	11.13	3.72	10.86	3.80	10.59	3.87	10.32	3.95		
5.0	2.8	11.95	3.61	11.67	3.68	11.38	3.76	11.10	3.83	10.81	3.91		
8.3	6.1	12.62	3.79	12.32	3.87	12.02	3.95	11.72	4.03	11.42	4.11		
10.0	8.3	12.82	3.78	12.52	3.86	12.21	3.94	11.91	4.02	11.60	4.10		
15.0	10.0	13.44	3.74	13.12	3.82	12.80	3.90	12.48	3.98	12.16	4.06		
20.0	15.0	13.67	3.23	13.34	3.30	13.01	3.36	12.69	3.43	12.36	3.50		
23.9	18.3	14.43	3.21	14.08	3.28	13.74	3.35	13.40	3.42	13.05	3.48		

● Indoor units: 7,000 Btu + 9,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	22.23	3.21	21.70	3.27	21.17	3.34	20.64	3.41	20.11	3.47	
	14	12	27.06	3.25	26.41	3.32	25.77	3.39	25.13	3.46	24.48	3.52	
	23	19	31.23	3.30	30.49	3.37	29.74	3.44	29.00	3.51	28.26	3.57	
	32	28	33.21	3.11	32.42	3.18	31.63	3.24	30.84	3.31	30.05	3.37	
	41	37	34.81	3.08	33.98	3.14	33.15	3.21	32.32	3.27	31.49	3.33	
	47	43	36.75	3.24	35.88	3.30	35.00	3.37	34.13	3.44	33.25	3.50	
	50	47	37.35	3.23	36.46	3.29	35.57	3.36	34.68	3.43	33.79	3.49	
	59	50	39.15	3.19	38.22	3.26	37.29	3.33	36.35	3.39	35.42	3.46	
68	59	39.80	2.75	38.85	2.81	37.91	2.87	36.96	2.93	36.01	2.98		
75	65	42.02	2.74	41.02	2.80	40.02	2.86	39.02	2.91	38.02	2.97		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	6.52	3.21	6.36	3.27	6.21	3.34	6.05	3.41	5.90	3.47	
	-10.0	-11.1	7.93	3.25	7.74	3.32	7.55	3.39	7.36	3.46	7.18	3.52	
	-5.0	-7.2	9.15	3.30	8.94	3.37	8.72	3.44	8.50	3.51	8.28	3.57	
	0.0	-2.2	9.73	3.11	9.50	3.18	9.27	3.24	9.04	3.31	8.81	3.37	
	5.0	2.8	10.20	3.08	9.96	3.14	9.72	3.21	9.47	3.27	9.23	3.33	
	8.3	6.1	10.77	3.24	10.51	3.30	10.26	3.37	10.00	3.44	9.75	3.50	
	10.0	8.3	10.95	3.23	10.69	3.29	10.43	3.36	10.16	3.43	9.90	3.49	
	15.0	10.0	11.47	3.19	11.20	3.26	10.93	3.33	10.65	3.39	10.38	3.46	
20.0	15.0	11.67	2.75	11.39	2.81	11.11	2.87	10.83	2.93	10.55	2.98		
23.9	18.3	12.32	2.74	12.02	2.80	11.73	2.86	11.44	2.91	11.14	2.97		

● Indoor units: 7,000 Btu + 9,000 Btu + 14,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	24.52	3.40	23.93	3.47	23.35	3.54	22.77	3.61	22.18	3.68	
	14	12	29.84	3.45	29.13	3.52	28.42	3.59	27.71	3.66	27.00	3.73	
	23	19	34.44	3.50	33.62	3.57	32.80	3.64	31.98	3.71	31.16	3.79	
	32	28	36.63	3.30	35.75	3.36	34.88	3.43	34.01	3.50	33.14	3.57	
	41	37	38.39	3.26	37.48	3.33	36.56	3.40	35.65	3.46	34.73	3.53	
	47	43	40.53	3.43	39.57	3.50	38.60	3.57	37.64	3.64	36.67	3.71	
	50	47	41.19	3.42	40.21	3.49	39.23	3.56	38.25	3.63	37.27	3.70	
	59	50	43.18	3.38	42.15	3.45	41.12	3.53	40.09	3.60	39.07	3.67	
68	59	43.90	2.92	42.85	2.98	41.81	3.04	40.76	3.10	39.72	3.16		
75	65	46.34	2.91	45.24	2.97	44.14	3.03	43.03	3.09	41.93	3.15		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	7.19	3.40	7.01	3.47	6.84	3.54	6.67	3.61	6.50	3.68	
	-10.0	-11.1	8.75	3.45	8.54	3.52	8.33	3.59	8.12	3.66	7.91	3.73	
	-5.0	-7.2	10.09	3.50	9.85	3.57	9.61	3.64	9.37	3.71	9.13	3.79	
	0.0	-2.2	10.73	3.30	10.48	3.36	10.22	3.43	9.97	3.50	9.71	3.57	
	5.0	2.8	11.25	3.26	10.98	3.33	10.72	3.40	10.45	3.46	10.18	3.53	
	8.3	6.1	11.88	3.43	11.60	3.50	11.31	3.57	11.03	3.64	10.75	3.71	
	10.0	8.3	12.07	3.42	11.79	3.49	11.50	3.56	11.21	3.63	10.92	3.70	
	15.0	10.0	12.65	3.38	12.35	3.45	12.05	3.53	11.75	3.60	11.45	3.67	
20.0	15.0	12.87	2.92	12.56	2.98	12.25	3.04	11.95	3.10	11.64	3.16		
23.9	18.3	13.58	2.91	13.26	2.97	12.94	3.03	12.61	3.09	12.29	3.15		

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 7,000 Btu + 9,000 Btu + 18,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	5	3	25.53	3.68	24.93	3.76	24.32	3.84	23.71	3.91	23.10	3.99	
	14	12	31.08	3.74	30.34	3.81	29.60	3.89	28.86	3.97	28.12	4.05	
	23	19	35.87	3.79	35.02	3.87	34.16	3.95	33.31	4.03	32.45	4.11	
	32	28	38.14	3.57	37.24	3.65	36.33	3.72	35.42	3.80	34.51	3.87	
	41	37	39.98	3.53	39.03	3.61	38.08	3.68	37.13	3.76	36.17	3.83	
	47	43	42.21	3.72	41.21	3.79	40.20	3.87	39.20	3.95	38.19	4.02	
	50	47	42.90	3.70	41.88	3.78	40.86	3.86	39.84	3.94	38.81	4.01	
	59	50	44.97	3.67	43.90	3.75	42.83	3.82	41.76	3.90	40.68	3.97	
	68	59	45.72	3.16	44.63	3.23	43.54	3.30	42.45	3.36	41.36	3.43	
	75	65	48.26	3.15	47.11	3.22	45.96	3.28	44.82	3.35	43.67	3.41	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	-15.0	-16.1	7.48	3.68	7.31	3.76	7.13	3.84	6.95	3.91	6.77	3.99	
	-10.0	-11.1	9.11	3.74	8.89	3.81	8.67	3.89	8.46	3.97	8.24	4.05	
	-5.0	-7.2	10.51	3.79	10.26	3.87	10.01	3.95	9.76	4.03	9.51	4.11	
	0.0	-2.2	11.18	3.57	10.91	3.65	10.65	3.72	10.38	3.80	10.11	3.87	
	5.0	2.8	11.72	3.53	11.44	3.61	11.16	3.68	10.88	3.76	10.60	3.83	
	8.3	6.1	12.37	3.72	12.08	3.79	11.78	3.87	11.49	3.95	11.19	4.02	
	10.0	8.3	12.57	3.70	12.27	3.78	11.97	3.86	11.68	3.94	11.38	4.01	
	15.0	10.0	13.18	3.67	12.87	3.75	12.55	3.82	12.24	3.90	11.92	3.97	
	20.0	15.0	13.40	3.16	13.08	3.23	12.76	3.30	12.44	3.36	12.12	3.43	
	23.9	18.3	14.15	3.15	13.81	3.22	13.47	3.28	13.13	3.35	12.80	3.41	

## ● Indoor units: 7,000 Btu + 12,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	5	3	24.52	3.54	23.93	3.61	23.35	3.69	22.77	3.76	22.18	3.84	
	14	12	29.84	3.59	29.13	3.67	28.42	3.74	27.71	3.82	27.00	3.89	
	23	19	34.44	3.64	33.62	3.72	32.80	3.79	31.98	3.87	31.16	3.95	
	32	28	36.63	3.43	35.75	3.51	34.88	3.58	34.01	3.65	33.14	3.72	
	41	37	38.39	3.40	37.48	3.47	36.56	3.54	35.65	3.61	34.73	3.68	
	47	43	40.53	3.57	39.57	3.65	38.60	3.72	37.64	3.79	36.67	3.87	
	50	47	41.19	3.56	40.21	3.63	39.23	3.71	38.25	3.78	37.27	3.86	
	59	50	43.18	3.53	42.15	3.60	41.12	3.67	40.09	3.75	39.07	3.82	
	68	59	43.90	3.04	42.85	3.10	41.81	3.17	40.76	3.23	39.72	3.29	
	75	65	46.34	3.03	45.24	3.09	44.14	3.15	43.03	3.22	41.93	3.28	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature	-15.0	-16.1	7.19	3.54	7.01	3.61	6.84	3.69	6.67	3.76	6.50	3.84	
	-10.0	-11.1	8.75	3.59	8.54	3.67	8.33	3.74	8.12	3.82	7.91	3.89	
	-5.0	-7.2	10.09	3.64	9.85	3.72	9.61	3.79	9.37	3.87	9.13	3.95	
	0.0	-2.2	10.73	3.43	10.48	3.51	10.22	3.58	9.97	3.65	9.71	3.72	
	5.0	2.8	11.25	3.40	10.98	3.47	10.72	3.54	10.45	3.61	10.18	3.68	
	8.3	6.1	11.88	3.57	11.60	3.65	11.31	3.72	11.03	3.79	10.75	3.87	
	10.0	8.3	12.07	3.56	11.79	3.63	11.50	3.71	11.21	3.78	10.92	3.86	
	15.0	10.0	12.65	3.53	12.35	3.60	12.05	3.67	11.75	3.75	11.45	3.82	
	20.0	15.0	12.87	3.04	12.56	3.10	12.25	3.17	11.95	3.23	11.64	3.29	
	23.9	18.3	13.58	3.03	13.26	3.09	12.94	3.15	12.61	3.22	12.29	3.28	

OUTDOOR UNIT  
UOMH36AFXJ



## ● Indoor units: 7,000 Btu + 12,000 Btu + 14,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	25.28	3.50	24.68	3.58	24.08	3.65	23.48	3.72	22.87	3.79	
	14	12	30.77	3.55	30.04	3.63	29.30	3.70	28.57	3.77	27.84	3.85	
	23	19	35.51	3.60	34.67	3.68	33.82	3.75	32.98	3.83	32.13	3.90	
	32	28	37.76	3.40	36.87	3.47	35.97	3.54	35.07	3.61	34.17	3.68	
	41	37	39.58	3.36	38.64	3.43	37.70	3.50	36.76	3.57	35.81	3.64	
	47	43	41.79	3.53	40.80	3.61	39.80	3.68	38.81	3.75	37.81	3.83	
	50	47	42.47	3.52	41.46	3.60	40.45	3.67	39.44	3.74	38.43	3.82	
	59	50	44.52	3.49	43.46	3.56	42.40	3.63	41.34	3.71	40.28	3.78	
	68	59	45.26	3.01	44.18	3.07	43.11	3.13	42.03	3.20	40.95	3.26	
	75	65	47.78	2.99	46.65	3.06	45.51	3.12	44.37	3.18	43.23	3.24	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW		kW		kW		kW		kW		
	-15.0	-16.1	7.41	3.50	7.23	3.58	7.06	3.65	6.88	3.72	6.70	3.79	
	-10.0	-11.1	9.02	3.55	8.80	3.63	8.59	3.70	8.37	3.77	8.16	3.85	
	-5.0	-7.2	10.41	3.60	10.16	3.68	9.91	3.75	9.66	3.83	9.42	3.90	
	0.0	-2.2	11.07	3.40	10.80	3.47	10.54	3.54	10.28	3.61	10.01	3.68	
	5.0	2.8	11.60	3.36	11.33	3.43	11.05	3.50	10.77	3.57	10.50	3.64	
	8.3	6.1	12.25	3.53	11.96	3.61	11.66	3.68	11.37	3.75	11.08	3.83	
	10.0	8.3	12.45	3.52	12.15	3.60	11.86	3.67	11.56	3.74	11.26	3.82	
	15.0	10.0	13.05	3.49	12.74	3.56	12.43	3.63	12.12	3.71	11.81	3.78	
	20.0	15.0	13.27	3.01	12.95	3.07	12.63	3.13	12.32	3.20	12.00	3.26	
	23.9	18.3	14.00	2.99	13.67	3.06	13.34	3.12	13.00	3.18	12.67	3.24	

## ● Indoor units: 7,000 Btu + 12,000 Btu + 18,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	26.04	3.76	25.42	3.84	24.80	3.92	24.18	3.99	23.56	4.07	
	14	12	31.70	3.81	30.94	3.89	30.19	3.97	29.43	4.05	28.68	4.13	
	23	19	36.58	3.87	35.71	3.95	34.84	4.03	33.97	4.11	33.10	4.19	
	32	28	38.90	3.65	37.98	3.72	37.05	3.80	36.12	3.87	35.20	3.95	
	41	37	40.78	3.61	39.81	3.68	38.84	3.76	37.86	3.83	36.89	3.91	
	47	43	43.05	3.79	42.03	3.87	41.00	3.95	39.98	4.03	38.95	4.11	
	50	47	43.75	3.78	42.71	3.86	41.67	3.94	40.63	4.02	39.59	4.10	
	59	50	45.86	3.74	44.77	3.82	43.68	3.90	42.59	3.98	41.49	4.06	
	68	59	46.63	3.23	45.52	3.30	44.41	3.36	43.30	3.43	42.19	3.50	
	75	65	49.22	3.21	48.05	3.28	46.88	3.35	45.71	3.42	44.54	3.48	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW		kW		kW		kW		kW		
	-15.0	-16.1	7.63	3.76	7.45	3.84	7.27	3.92	7.09	3.99	6.91	4.07	
	-10.0	-11.1	9.29	3.81	9.07	3.89	8.85	3.97	8.63	4.05	8.41	4.13	
	-5.0	-7.2	10.72	3.87	10.47	3.95	10.21	4.03	9.96	4.11	9.70	4.19	
	0.0	-2.2	11.40	3.65	11.13	3.72	10.86	3.80	10.59	3.87	10.32	3.95	
	5.0	2.8	11.95	3.61	11.67	3.68	11.38	3.76	11.10	3.83	10.81	3.91	
	8.3	6.1	12.62	3.79	12.32	3.87	12.02	3.95	11.72	4.03	11.42	4.11	
	10.0	8.3	12.82	3.78	12.52	3.86	12.21	3.94	11.91	4.02	11.60	4.10	
	15.0	10.0	13.44	3.74	13.12	3.82	12.80	3.90	12.48	3.98	12.16	4.06	
	20.0	15.0	13.67	3.23	13.34	3.30	13.01	3.36	12.69	3.43	12.36	3.50	
	23.9	18.3	14.43	3.21	14.08	3.28	13.74	3.35	13.40	3.42	13.05	3.48	

## ● Indoor units: 9,000 Btu + 9,000 Btu + 9,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	21.53	3.10	21.02	3.17	20.51	3.23	20.00	3.30	19.48	3.36		
14	12	26.21	3.15	25.58	3.21	24.96	3.28	24.34	3.34	23.71	3.41		
23	19	30.25	3.19	29.53	3.26	28.81	3.33	28.09	3.39	27.37	3.46		
32	28	32.17	3.01	31.40	3.07	30.63	3.13	29.87	3.20	29.10	3.26		
41	37	33.72	2.98	32.91	3.04	32.11	3.10	31.31	3.16	30.50	3.23		
47	43	35.60	3.13	34.75	3.19	33.90	3.26	33.05	3.33	32.21	3.39		
50	47	36.18	3.12	35.31	3.18	34.45	3.25	33.59	3.31	32.73	3.38		
59	50	37.92	3.09	37.02	3.15	36.11	3.22	35.21	3.28	34.31	3.35		
68	59	38.55	2.66	37.63	2.72	36.72	2.78	35.80	2.83	34.88	2.89		
75	65	40.70	2.65	39.73	2.71	38.76	2.76	37.79	2.82	36.82	2.87		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	6.31	3.10	6.16	3.17	6.01	3.23	5.86	3.30	5.71	3.36		
-10.0	-11.1	7.68	3.15	7.50	3.21	7.32	3.28	7.13	3.34	6.95	3.41		
-5.0	-7.2	8.87	3.19	8.65	3.26	8.44	3.33	8.23	3.39	8.02	3.46		
0.0	-2.2	9.43	3.01	9.20	3.07	8.98	3.13	8.75	3.20	8.53	3.26		
5.0	2.8	9.88	2.98	9.65	3.04	9.41	3.10	9.18	3.16	8.94	3.23		
8.3	6.1	10.43	3.13	10.18	3.19	9.94	3.26	9.69	3.33	9.44	3.39		
10.0	8.3	10.60	3.12	10.35	3.18	10.10	3.25	9.85	3.31	9.59	3.38		
15.0	10.0	11.11	3.09	10.85	3.15	10.58	3.22	10.32	3.28	10.06	3.35		
20.0	15.0	11.30	2.66	11.03	2.72	10.76	2.78	10.49	2.83	10.22	2.89		
23.9	18.3	11.93	2.65	11.64	2.71	11.36	2.76	11.08	2.82	10.79	2.87		

## ● Indoor units: 9,000 Btu + 9,000 Btu + 12,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	23.82	3.44	23.25	3.51	22.69	3.58	22.12	3.65	21.55	3.72		
14	12	28.99	3.49	28.30	3.56	27.61	3.63	26.92	3.70	26.23	3.78		
23	19	33.46	3.53	32.66	3.61	31.87	3.68	31.07	3.76	30.27	3.83		
32	28	35.58	3.33	34.73	3.40	33.89	3.47	33.04	3.54	32.19	3.61		
41	37	37.30	3.30	36.41	3.37	35.52	3.43	34.63	3.50	33.74	3.57		
47	43	39.38	3.47	38.44	3.54	37.50	3.61	36.56	3.68	35.63	3.75		
50	47	40.02	3.45	39.07	3.53	38.11	3.60	37.16	3.67	36.21	3.74		
59	50	41.95	3.42	40.95	3.49	39.95	3.56	38.95	3.64	37.95	3.71		
68	59	42.65	2.95	41.63	3.01	40.61	3.07	39.60	3.14	38.58	3.20		
75	65	45.02	2.94	43.95	3.00	42.88	3.06	41.81	3.12	40.73	3.18		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	6.98	3.44	6.82	3.51	6.65	3.58	6.48	3.65	6.32	3.72		
-10.0	-11.1	8.50	3.49	8.29	3.56	8.09	3.63	7.89	3.70	7.69	3.78		
-5.0	-7.2	9.81	3.53	9.57	3.61	9.34	3.68	9.11	3.76	8.87	3.83		
0.0	-2.2	10.43	3.33	10.18	3.40	9.93	3.47	9.68	3.54	9.44	3.61		
5.0	2.8	10.93	3.30	10.67	3.37	10.41	3.43	10.15	3.50	9.89	3.57		
8.3	6.1	11.54	3.47	11.27	3.54	10.99	3.61	10.72	3.68	10.44	3.75		
10.0	8.3	11.73	3.45	11.45	3.53	11.17	3.60	10.89	3.67	10.61	3.74		
15.0	10.0	12.29	3.42	12.00	3.49	11.71	3.56	11.42	3.64	11.12	3.71		
20.0	15.0	12.50	2.95	12.20	3.01	11.90	3.07	11.61	3.14	11.31	3.20		
23.9	18.3	13.20	2.94	12.88	3.00	12.57	3.06	12.25	3.12	11.94	3.18		

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 9,000 Btu + 9,000 Btu + 14,000 Btu

		Indoor temperature									
		60		65		70		75		78	
Outdoor temperature	°FDB	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	25.28	3.50	24.68	3.58	24.08	3.65	23.48	3.72	22.87	3.79
14	12	30.77	3.55	30.04	3.63	29.30	3.70	28.57	3.77	27.84	3.85
23	19	35.51	3.60	34.67	3.68	33.82	3.75	32.98	3.83	32.13	3.90
32	28	37.76	3.40	36.87	3.47	35.97	3.54	35.07	3.61	34.17	3.68
41	37	39.58	3.36	38.64	3.43	37.70	3.50	36.76	3.57	35.77	3.64
47	43	41.79	3.53	40.80	3.61	39.80	3.68	38.81	3.75	37.81	3.83
50	47	42.47	3.52	41.46	3.60	40.45	3.67	39.44	3.74	38.43	3.82
59	50	44.52	3.49	43.46	3.56	42.40	3.63	41.34	3.71	40.28	3.78
68	59	45.26	3.01	44.18	3.07	43.11	3.13	42.03	3.20	40.95	3.26
75	65	47.78	2.99	46.65	3.06	45.51	3.12	44.37	3.18	43.23	3.24

		Indoor temperature										
		15.6		18.3		21.2		23.9		25.6		
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
-15.0	-16.1	7.41	3.50	7.23	3.58	7.06	3.65	6.88	3.72	6.70	3.79	
-10.0	-11.1	9.02	3.55	8.80	3.63	8.59	3.70	8.37	3.77	8.16	3.85	
-5.0	-7.2	10.41	3.60	10.16	3.68	9.91	3.75	9.66	3.83	9.42	3.90	
0.0	-2.2	11.07	3.40	10.80	3.47	10.54	3.54	10.28	3.61	10.01	3.68	
5.0	2.8	11.60	3.36	11.33	3.43	11.05	3.50	10.77	3.57	10.50	3.64	
8.3	6.1	12.25	3.53	11.96	3.61	11.66	3.68	11.37	3.75	11.08	3.83	
10.0	8.3	12.45	3.52	12.15	3.60	11.86	3.67	11.56	3.74	11.26	3.82	
15.0	10.0	13.05	3.49	12.74	3.56	12.43	3.63	12.12	3.71	11.81	3.78	
20.0	15.0	13.27	3.01	12.95	3.07	12.63	3.13	12.32	3.20	12.00	3.26	
23.9	18.3	14.00	2.99	13.67	3.06	13.34	3.12	13.00	3.18	12.67	3.24	

## ● Indoor units: 9,000 Btu + 9,000 Btu + 18,000 Btu

		Indoor temperature									
		60		65		70		75		78	
Outdoor temperature	°FDB	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	26.04	3.76	25.42	3.84	24.80	3.92	24.18	3.99	23.56	4.07
14	12	31.70	3.81	30.94	3.89	30.19	3.97	29.43	4.05	28.68	4.13
23	19	36.58	3.87	35.71	3.95	34.84	4.03	33.97	4.11	33.10	4.19
32	28	38.90	3.65	37.98	3.72	37.05	3.80	36.12	3.87	35.20	3.95
41	37	40.78	3.61	39.81	3.68	38.84	3.76	37.86	3.83	36.89	3.91
47	43	43.05	3.79	42.03	3.87	41.00	3.95	39.98	4.03	38.95	4.11
50	47	43.75	3.78	42.71	3.86	41.67	3.94	40.63	4.02	39.59	4.10
59	50	45.86	3.74	44.77	3.82	43.68	3.90	42.59	3.98	41.49	4.06
68	59	46.63	3.23	45.52	3.30	44.41	3.36	43.30	3.43	42.19	3.50
75	65	49.22	3.21	48.05	3.28	46.88	3.35	45.71	3.42	44.54	3.48

		Indoor temperature										
		15.6		18.3		21.2		23.9		25.6		
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
-15.0	-16.1	7.63	3.76	7.45	3.84	7.27	3.92	7.09	3.99	6.91	4.07	
-10.0	-11.1	9.29	3.81	9.07	3.89	8.85	3.97	8.63	4.05	8.41	4.13	
-5.0	-7.2	10.72	3.87	10.47	3.95	10.21	4.03	9.96	4.11	9.70	4.19	
0.0	-2.2	11.40	3.65	11.13	3.72	10.86	3.80	10.59	3.87	10.32	3.95	
5.0	2.8	11.95	3.61	11.67	3.68	11.38	3.76	11.10	3.83	10.81	3.91	
8.3	6.1	12.62	3.79	12.32	3.87	12.02	3.95	11.72	4.03	11.42	4.11	
10.0	8.3	12.82	3.78	12.52	3.86	12.21	3.94	11.91	4.02	11.60	4.10	
15.0	10.0	13.44	3.74	13.12	3.82	12.80	3.90	12.48	3.98	12.16	4.06	
20.0	15.0	13.67	3.23	13.34	3.30	13.01	3.36	12.69	3.43	12.36	3.50	
23.9	18.3	14.43	3.21	14.08	3.28	13.74	3.35	13.40	3.42	13.05	3.48	

OUTDOOR UNIT  
UOMH36AFXJ

### ● Indoor units: 9,000 Btu + 12,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	25.34	3.65	24.74	3.73	24.14	3.81	23.53	3.88	22.93	3.96	
	14	12	30.85	3.71	30.11	3.78	29.38	3.86	28.64	3.94	27.91	4.02	
	23	19	35.60	3.76	34.76	3.84	33.91	3.92	33.06	4.00	32.21	4.07	
	32	28	37.86	3.54	36.96	3.62	36.06	3.69	35.16	3.77	34.25	3.84	
	41	37	39.68	3.51	38.74	3.58	37.79	3.65	36.85	3.73	35.90	3.80	
	47	43	41.90	3.69	40.90	3.76	39.90	3.84	38.90	3.92	37.91	3.99	
	50	47	42.58	3.67	41.57	3.75	40.55	3.83	39.54	3.90	38.52	3.98	
	59	50	44.63	3.64	43.57	3.72	42.51	3.79	41.44	3.87	40.38	3.94	
	68	59	45.37	3.14	44.29	3.20	43.21	3.27	42.13	3.34	41.05	3.40	
75	65	47.90	3.13	46.76	3.19	45.62	3.26	44.48	3.32	43.34	3.39		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	
	-15.0	-16.1	7.43	3.65	7.25	3.73	7.07	3.81	6.90	3.88	6.72	3.96	
	-10.0	-11.1	9.04	3.71	8.83	3.78	8.61	3.86	8.39	3.94	8.18	4.02	
	-5.0	-7.2	10.43	3.76	10.19	3.84	9.94	3.92	9.69	4.00	9.44	4.07	
	0.0	-2.2	11.10	3.54	10.83	3.62	10.57	3.69	10.30	3.77	10.04	3.84	
	5.0	2.8	11.63	3.51	11.35	3.58	11.08	3.65	10.80	3.73	10.52	3.80	
	8.3	6.1	12.28	3.69	11.99	3.76	11.69	3.84	11.40	3.92	11.11	3.99	
	10.0	8.3	12.48	3.67	12.18	3.75	11.89	3.83	11.59	3.90	11.29	3.98	
	15.0	10.0	13.08	3.64	12.77	3.72	12.46	3.79	12.15	3.87	11.84	3.94	
	20.0	15.0	13.30	3.14	12.98	3.20	12.67	3.27	12.35	3.34	12.03	3.40	
23.9	18.3	14.04	3.13	13.71	3.19	13.37	3.26	13.04	3.32	12.70	3.39		

### ● Indoor units: 9000 Btu + 12,000 Btu + 14,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	25.98	3.60	25.36	3.67	24.74	3.75	24.12	3.82	23.51	3.90	
	14	12	31.62	3.65	30.87	3.73	30.11	3.80	29.36	3.88	28.61	3.95	
	23	19	36.50	3.70	35.63	3.78	34.76	3.86	33.89	3.93	33.02	4.01	
	32	28	38.81	3.49	37.88	3.56	36.96	3.63	36.04	3.71	35.11	3.78	
	41	37	40.68	3.45	39.71	3.52	38.74	3.60	37.77	3.67	36.80	3.74	
	47	43	42.95	3.63	41.92	3.70	40.90	3.78	39.88	3.86	38.86	3.93	
	50	47	43.65	3.62	42.61	3.69	41.57	3.77	40.53	3.84	39.49	3.92	
	59	50	45.75	3.58	44.66	3.66	43.57	3.73	42.48	3.81	41.39	3.88	
	68	59	46.51	3.09	45.40	3.15	44.30	3.22	43.19	3.28	42.08	3.35	
75	65	49.10	3.08	47.93	3.14	46.77	3.20	45.60	3.27	44.43	3.33		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	
	-15.0	-16.1	7.61	3.60	7.43	3.67	7.25	3.75	7.07	3.82	6.89	3.90	
	-10.0	-11.1	9.27	3.65	9.05	3.73	8.83	3.80	8.61	3.88	8.38	3.95	
	-5.0	-7.2	10.70	3.70	10.44	3.78	10.19	3.86	9.93	3.93	9.68	4.01	
	0.0	-2.2	11.37	3.49	11.10	3.56	10.83	3.63	10.56	3.71	10.29	3.78	
	5.0	2.8	11.92	3.45	11.64	3.52	11.35	3.60	11.07	3.67	10.79	3.74	
	8.3	6.1	12.59	3.63	12.29	3.70	11.99	3.78	11.69	3.86	11.39	3.93	
	10.0	8.3	12.79	3.62	12.49	3.69	12.18	3.77	11.88	3.84	11.57	3.92	
	15.0	10.0	13.41	3.58	13.09	3.66	12.77	3.73	12.45	3.81	12.13	3.88	
	20.0	15.0	13.63	3.09	13.31	3.15	12.98	3.22	12.66	3.28	12.33	3.35	
23.9	18.3	14.39	3.08	14.05	3.14	13.71	3.20	13.36	3.27	13.02	3.33		

OUTDOOR UNIT  
UOMH36AFXJ

● Indoor units: 9,000 Btu + 12,000 Btu + 18,000 Btu

		Indoor temperature										
		60		65		70		75		78		
Outdoor temperature	°FDB	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°FWB	°FWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	26.04	3.76	25.42	3.84	24.80	3.92	24.18	3.99	23.56	4.07
14	12	31.70	3.81	30.94	3.89	30.19	3.97	29.43	4.05	28.68	4.13	
23	19	36.58	3.87	35.71	3.95	34.84	4.03	33.97	4.11	33.10	4.19	
32	28	38.90	3.65	37.98	3.72	37.05	3.80	36.12	3.87	35.20	3.95	
41	37	40.78	3.61	39.81	3.68	38.84	3.76	37.86	3.83	36.89	3.91	
47	43	43.05	3.79	42.03	3.87	41.00	3.95	39.98	4.03	38.95	4.11	
50	47	43.75	3.78	42.71	3.86	41.67	3.94	40.63	4.02	39.59	4.10	
59	50	45.86	3.74	44.77	3.82	43.68	3.90	42.59	3.98	41.49	4.06	
68	59	46.63	3.23	45.52	3.30	44.41	3.36	43.30	3.43	42.19	3.50	
75	65	49.22	3.21	48.05	3.28	46.88	3.35	45.71	3.42	44.54	3.48	

		Indoor temperature										
		15.6		18.3		21.2		23.9		25.6		
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°CWB	°CWB	kW		kW		kW		kW		kW	
	-15.0	-16.1	7.63	3.76	7.45	3.84	7.27	3.92	7.09	3.99	6.91	4.07
-10.0	-11.1	9.29	3.81	9.07	3.89	8.85	3.97	8.63	4.05	8.41	4.13	
-5.0	-7.2	10.72	3.87	10.47	3.95	10.21	4.03	9.96	4.11	9.70	4.19	
0.0	-2.2	11.40	3.65	11.13	3.72	10.86	3.80	10.59	3.87	10.32	3.95	
5.0	2.8	11.95	3.61	11.67	3.68	11.38	3.76	11.10	3.83	10.81	3.91	
8.3	6.1	12.62	3.79	12.32	3.87	12.02	3.95	11.72	4.03	11.42	4.11	
10.0	8.3	12.82	3.78	12.52	3.86	12.21	3.94	11.91	4.02	11.60	4.10	
15.0	10.0	13.44	3.74	13.12	3.82	12.80	3.90	12.48	3.98	12.16	4.06	
20.0	15.0	13.67	3.23	13.34	3.30	13.01	3.36	12.69	3.43	12.36	3.50	
23.9	18.3	14.43	3.21	14.08	3.28	13.74	3.35	13.40	3.42	13.05	3.48	

● Indoor units: 12,000 Btu + 12,000 Btu + 12,000 Btu

		Indoor temperature										
		60		65		70		75		78		
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°FWB	°FWB	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3	25.92	3.74	25.30	3.82	24.68	3.90	24.06	3.97	23.45	4.05
14	12	31.54	3.79	30.79	3.87	30.04	3.95	29.29	4.03	28.54	4.11	
23	19	36.41	3.85	35.54	3.93	34.67	4.01	33.81	4.09	32.94	4.17	
32	28	38.71	3.63	37.79	3.70	36.87	3.78	35.95	3.85	35.03	3.93	
41	37	40.58	3.59	39.61	3.66	38.65	3.74	37.68	3.81	36.71	3.89	
47	43	42.84	3.77	41.82	3.85	40.80	3.93	39.78	4.01	38.76	4.09	
50	47	43.54	3.76	42.50	3.84	41.47	3.92	40.43	4.00	39.39	4.07	
59	50	45.64	3.73	44.55	3.80	43.47	3.88	42.38	3.96	41.29	4.04	
68	59	46.40	3.21	45.29	3.28	44.19	3.35	43.08	3.41	41.98	3.48	
75	65	48.98	3.20	47.82	3.27	46.65	3.33	45.48	3.40	44.32	3.46	

		Indoor temperature										
		15.6		18.3		21.2		23.9		25.6		
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
	°CWB	°CWB	kW		kW		kW		kW		kW	
	-15.0	-16.1	7.60	3.74	7.41	3.82	7.23	3.90	7.05	3.97	6.87	4.05
-10.0	-11.1	9.24	3.79	9.02	3.87	8.80	3.95	8.58	4.03	8.36	4.11	
-5.0	-7.2	10.67	3.85	10.42	3.93	10.16	4.01	9.91	4.09	9.65	4.17	
0.0	-2.2	11.35	3.63	11.08	3.70	10.81	3.78	10.54	3.85	10.27	3.93	
5.0	2.8	11.89	3.59	11.61	3.66	11.33	3.74	11.04	3.81	10.76	3.89	
8.3	6.1	12.56	3.77	12.26	3.85	11.96	3.93	11.66	4.01	11.36	4.09	
10.0	8.3	12.76	3.76	12.46	3.84	12.15	3.92	11.85	4.00	11.55	4.07	
15.0	10.0	13.38	3.73	13.06	3.80	12.74	3.88	12.42	3.96	12.10	4.04	
20.0	15.0	13.60	3.21	13.27	3.28	12.95	3.35	12.63	3.41	12.30	3.48	
23.9	18.3	14.36	3.20	14.01	3.27	13.67	3.33	13.33	3.40	12.99	3.46	

OUTDOOR UNIT  
UOMH36AFXJ

## ● Indoor units: 12,000 Btu + 12,000 Btu + 14,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	26.04	3.61	25.42	3.68	24.80	3.76	24.18	3.83	23.56	3.91	
	14	12	31.70	3.66	30.94	3.74	30.19	3.81	29.43	3.89	28.68	3.96	
	23	19	36.58	3.71	35.71	3.79	34.84	3.87	33.97	3.94	33.10	4.02	
	32	28	38.90	3.50	37.98	3.57	37.05	3.64	36.12	3.72	35.20	3.79	
	41	37	40.78	3.46	39.81	3.53	38.84	3.61	37.86	3.68	36.89	3.75	
	47	43	43.05	3.64	42.03	3.71	41.00	3.79	39.98	3.87	38.95	3.94	
	50	47	43.75	3.63	42.71	3.70	41.67	3.78	40.63	3.85	39.59	3.93	
	59	50	45.86	3.59	44.77	3.67	43.68	3.74	42.59	3.82	41.49	3.89	
	68	59	46.63	3.10	45.52	3.16	44.41	3.23	43.30	3.29	42.19	3.36	
75	65	49.22	3.08	48.05	3.15	46.88	3.21	45.71	3.28	44.54	3.34		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	
	-15.0	-16.1	7.63	3.61	7.45	3.68	7.27	3.76	7.09	3.83	6.91	3.91	
	-10.0	-11.1	9.29	3.66	9.07	3.74	8.85	3.81	8.63	3.89	8.41	3.96	
	-5.0	-7.2	10.72	3.71	10.47	3.79	10.21	3.87	9.96	3.94	9.70	4.02	
	0.0	-2.2	11.40	3.50	11.13	3.57	10.86	3.64	10.59	3.72	10.32	3.79	
	5.0	2.8	11.95	3.46	11.67	3.53	11.38	3.61	11.10	3.68	10.81	3.75	
	8.3	6.1	12.62	3.64	12.32	3.71	12.02	3.79	11.72	3.87	11.42	3.94	
	10.0	8.3	12.82	3.63	12.52	3.70	12.21	3.78	11.91	3.85	11.60	3.93	
	15.0	10.0	13.44	3.59	13.12	3.67	12.80	3.74	12.48	3.82	12.16	3.89	
	20.0	15.0	13.67	3.10	13.34	3.16	13.01	3.23	12.69	3.29	12.36	3.36	
23.9	18.3	14.43	3.08	14.08	3.15	13.74	3.21	13.40	3.28	13.05	3.34		

## ● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 7,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	22.36	3.04	21.83	3.10	21.29	3.16	20.76	3.23	20.23	3.29	
	14	12	27.21	3.08	26.56	3.14	25.92	3.21	25.27	3.27	24.62	3.34	
	23	19	31.41	3.12	30.66	3.19	29.91	3.25	29.17	3.32	28.42	3.38	
	32	28	33.40	2.94	32.60	3.01	31.81	3.07	31.01	3.13	30.22	3.19	
	41	37	35.01	2.91	34.17	2.97	33.34	3.04	32.51	3.10	31.67	3.16	
	47	43	36.96	3.06	36.08	3.13	35.20	3.19	34.32	3.25	33.44	3.32	
	50	47	37.56	3.05	36.67	3.12	35.77	3.18	34.88	3.24	33.99	3.31	
	59	50	39.37	3.02	38.44	3.09	37.50	3.15	36.56	3.21	35.62	3.28	
	68	59	40.03	2.61	39.08	2.66	38.12	2.72	37.17	2.77	36.22	2.83	
75	65	42.26	2.60	41.25	2.65	40.25	2.70	39.24	2.76	38.24	2.81		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	
	-15.0	-16.1	6.55	3.04	6.40	3.10	6.24	3.16	6.08	3.23	5.93	3.29	
	-10.0	-11.1	7.98	3.08	7.79	3.14	7.60	3.21	7.41	3.27	7.22	3.34	
	-5.0	-7.2	9.21	3.12	8.99	3.19	8.77	3.25	8.55	3.32	8.33	3.38	
	0.0	-2.2	9.79	2.94	9.56	3.01	9.32	3.07	9.09	3.13	8.86	3.19	
	5.0	2.8	10.26	2.91	10.02	2.97	9.77	3.04	9.53	3.10	9.28	3.16	
	8.3	6.1	10.83	3.06	10.57	3.13	10.32	3.19	10.06	3.25	9.80	3.32	
	10.0	8.3	11.01	3.05	10.75	3.12	10.49	3.18	10.22	3.24	9.96	3.31	
	15.0	10.0	11.54	3.02	11.27	3.09	10.99	3.15	10.72	3.21	10.44	3.28	
	20.0	15.0	11.73	2.61	11.45	2.66	11.17	2.72	10.89	2.77	10.61	2.83	
23.9	18.3	12.39	2.60	12.09	2.65	11.80	2.70	11.50	2.76	11.21	2.81		

OUTDOOR UNIT  
UOMH36AFXJ

● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 9,000 Btu

		Indoor temperature											
		60		65		70		75		78			
Outdoor temperature	°FDB	kBTu/h		kW		kBTu/h		kW		kBTu/h		kW	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
	5	3	23.95	3.25	23.38	3.32	22.81	3.39	22.24	3.46	21.67	3.53	
14	12	29.15	3.30	28.45	3.37	27.76	3.44	27.06	3.51	26.37	3.58		
23	19	33.64	3.35	32.84	3.42	32.04	3.49	31.24	3.56	30.44	3.63		
32	28	35.77	3.16	34.92	3.22	34.07	3.29	33.22	3.35	32.36	3.42		
41	37	37.49	3.12	36.60	3.19	35.71	3.25	34.82	3.32	33.92	3.38		
47	43	39.59	3.28	38.64	3.35	37.70	3.42	36.76	3.49	35.82	3.56		
50	47	40.23	3.27	39.27	3.34	38.32	3.41	37.36	3.48	36.40	3.55		
59	50	42.17	3.24	41.17	3.31	40.16	3.38	39.16	3.44	38.15	3.51		
68	59	42.87	2.80	41.85	2.85	40.83	2.91	39.81	2.97	38.79	3.03		
75	65	45.26	2.78	44.18	2.84	43.11	2.90	42.03	2.96	40.95	3.02		

		Indoor temperature									
		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	kW		kW		kW		kW		kW	
	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
	-15.0	-16.1	7.02	3.25	6.85	3.32	6.68	3.39	6.52	3.46	6.35
-10.0	-11.1	8.54	3.30	8.34	3.37	8.14	3.44	7.93	3.51	7.73	3.58
-5.0	-7.2	9.86	3.35	9.62	3.42	9.39	3.49	9.15	3.56	8.92	3.63
0.0	-2.2	10.48	3.16	10.23	3.22	9.98	3.29	9.74	3.35	9.49	3.42
5.0	2.8	10.99	3.12	10.73	3.19	10.47	3.25	10.20	3.32	9.94	3.38
8.3	6.1	11.60	3.28	11.33	3.35	11.05	3.42	10.77	3.49	10.50	3.56
10.0	8.3	11.79	3.27	11.51	3.34	11.23	3.41	10.95	3.48	10.67	3.55
15.0	10.0	12.36	3.24	12.07	3.31	11.77	3.38	11.48	3.44	11.18	3.51
20.0	15.0	12.57	2.80	12.27	2.85	11.97	2.91	11.67	2.97	11.37	3.03
23.9	18.3	13.27	2.78	12.95	2.84	12.63	2.90	12.32	2.96	12.00	3.02

● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 12,000 Btu

		Indoor temperature											
		60		65		70		75		78			
Outdoor temperature	°FDB	kBTu/h		kW		kBTu/h		kW		kBTu/h		kW	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
	5	3	25.34	3.48	24.74	3.56	24.14	3.63	23.53	3.70	22.93	3.77	
14	12	30.85	3.53	30.11	3.61	29.38	3.68	28.64	3.75	27.91	3.83		
23	19	35.60	3.58	34.76	3.66	33.91	3.73	33.06	3.81	32.21	3.88		
32	28	37.86	3.38	36.96	3.45	36.06	3.52	35.16	3.59	34.25	3.66		
41	37	39.68	3.34	38.74	3.41	37.79	3.48	36.85	3.55	35.90	3.62		
47	43	41.90	3.51	40.90	3.59	39.90	3.66	38.90	3.73	37.91	3.81		
50	47	42.58	3.50	41.57	3.58	40.55	3.65	39.54	3.72	38.52	3.79		
59	50	44.63	3.47	43.57	3.54	42.51	3.61	41.44	3.69	40.38	3.76		
68	59	45.37	2.99	44.29	3.05	43.21	3.12	42.13	3.18	41.05	3.24		
75	65	47.90	2.98	46.76	3.04	45.62	3.10	44.48	3.16	43.34	3.23		

		Indoor temperature									
		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	kW		kW		kW		kW		kW	
	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
	-15.0	-16.1	7.43	3.48	7.25	3.56	7.07	3.63	6.90	3.70	6.72
-10.0	-11.1	9.04	3.53	8.83	3.61	8.61	3.68	8.39	3.75	8.18	3.83
-5.0	-7.2	10.43	3.58	10.19	3.66	9.94	3.73	9.69	3.81	9.44	3.88
0.0	-2.2	11.10	3.38	10.83	3.45	10.57	3.52	10.30	3.59	10.04	3.66
5.0	2.8	11.63	3.34	11.35	3.41	11.08	3.48	10.80	3.55	10.52	3.62
8.3	6.1	12.28	3.51	11.99	3.59	11.69	3.66	11.40	3.73	11.11	3.81
10.0	8.3	12.48	3.50	12.18	3.58	11.89	3.65	11.59	3.72	11.29	3.79
15.0	10.0	13.08	3.47	12.77	3.54	12.46	3.61	12.15	3.69	11.84	3.76
20.0	15.0	13.30	2.99	12.98	3.05	12.67	3.12	12.35	3.18	12.03	3.24
23.9	18.3	14.04	2.98	13.71	3.04	13.37	3.10	13.04	3.16	12.70	3.23

OUTDOOR UNIT  
UOMH36AFXJ

● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 14,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	26.68	3.52	26.04	3.59	25.41	3.67	24.77	3.74	24.14	3.81	
	14	12	32.47	3.57	31.70	3.65	30.92	3.72	30.15	3.80	29.38	3.87	
	23	19	37.48	3.62	36.58	3.70	35.69	3.77	34.80	3.85	33.91	3.93	
	32	28	39.85	3.42	38.90	3.49	37.95	3.56	37.01	3.63	36.06	3.70	
	41	37	41.77	3.38	40.78	3.45	39.78	3.52	38.79	3.59	37.79	3.66	
	47	43	44.10	3.55	43.05	3.63	42.00	3.70	40.95	3.77	39.90	3.85	
	50	47	44.82	3.54	43.75	3.61	42.69	3.69	41.62	3.76	40.55	3.84	
	59	50	46.98	3.51	45.86	3.58	44.74	3.65	43.63	3.73	42.51	3.80	
	68	59	47.76	3.02	46.63	3.09	45.49	3.15	44.35	3.21	43.21	3.28	
	75	65	50.42	3.01	49.22	3.07	48.02	3.14	46.82	3.20	45.62	3.26	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature				kW		kW		kW		kW		kW	
	-15.0	-16.1	7.82	3.52	7.63	3.59	7.45	3.67	7.26	3.74	7.07	3.81	
	-10.0	-11.1	9.52	3.57	9.29	3.65	9.06	3.72	8.84	3.80	8.61	3.87	
	-5.0	-7.2	10.98	3.62	10.72	3.70	10.46	3.77	10.20	3.85	9.94	3.93	
	0.0	-2.2	11.68	3.42	11.40	3.49	11.12	3.56	10.85	3.63	10.57	3.70	
	5.0	2.8	12.24	3.38	11.95	3.45	11.66	3.52	11.37	3.59	11.08	3.66	
	8.3	6.1	12.92	3.55	12.62	3.63	12.31	3.70	12.00	3.77	11.69	3.85	
	10.0	8.3	13.14	3.54	12.82	3.61	12.51	3.69	12.20	3.76	11.89	3.84	
	15.0	10.0	13.77	3.51	13.44	3.58	13.11	3.65	12.79	3.73	12.46	3.80	
	20.0	15.0	14.00	3.02	13.67	3.09	13.33	3.15	13.00	3.21	12.67	3.28	
	23.9	18.3	14.78	3.01	14.43	3.07	14.07	3.14	13.72	3.20	13.37	3.26	

● Indoor units: 7,000 Btu + 7,000 Btu + 7,000 Btu + 18,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	26.68	3.66	26.04	3.74	25.41	3.82	24.77	3.89	24.14	3.97	
	14	12	32.47	3.72	31.70	3.79	30.92	3.87	30.15	3.95	29.38	4.03	
	23	19	37.48	3.77	36.58	3.85	35.69	3.93	34.80	4.01	33.91	4.08	
	32	28	39.85	3.55	38.90	3.63	37.95	3.70	37.01	3.78	36.06	3.85	
	41	37	41.77	3.52	40.78	3.59	39.78	3.66	38.79	3.74	37.79	3.81	
	47	43	44.10	3.70	43.05	3.77	42.00	3.85	40.95	3.93	39.90	4.00	
	50	47	44.82	3.68	43.75	3.76	42.69	3.84	41.62	3.92	40.55	3.99	
	59	50	46.98	3.65	45.86	3.73	44.74	3.80	43.63	3.88	42.51	3.95	
	68	59	47.76	3.15	46.63	3.21	45.49	3.28	44.35	3.34	43.21	3.41	
	75	65	50.42	3.13	49.22	3.20	48.02	3.26	46.82	3.33	45.62	3.39	

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
Outdoor temperature				kW		kW		kW		kW		kW	
	-15.0	-16.1	7.82	3.66	7.63	3.74	7.45	3.82	7.26	3.89	7.07	3.97	
	-10.0	-11.1	9.52	3.72	9.29	3.79	9.06	3.87	8.84	3.95	8.61	4.03	
	-5.0	-7.2	10.98	3.77	10.72	3.85	10.46	3.93	10.20	4.01	9.94	4.08	
	0.0	-2.2	11.68	3.55	11.40	3.63	11.12	3.70	10.85	3.78	10.57	3.85	
	5.0	2.8	12.24	3.52	11.95	3.59	11.66	3.66	11.37	3.74	11.08	3.81	
	8.3	6.1	12.92	3.70	12.62	3.77	12.31	3.85	12.00	3.93	11.69	4.00	
	10.0	8.3	13.14	3.68	12.82	3.76	12.51	3.84	12.20	3.92	11.89	3.99	
	15.0	10.0	13.77	3.65	13.44	3.73	13.11	3.80	12.79	3.88	12.46	3.95	
	20.0	15.0	14.00	3.15	13.67	3.21	13.33	3.28	13.00	3.34	12.67	3.41	
	23.9	18.3	14.78	3.13	14.43	3.20	14.07	3.26	13.72	3.33	13.37	3.39	

OUTDOOR UNIT UOMH36AFXJ



## ● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3		25.03	3.41	24.43	3.48	23.84	3.55	23.24	3.62	22.64
14	12		30.46	3.46	29.73	3.53	29.01	3.60	28.28	3.67	27.56	3.74
23	19		35.16	3.51	34.32	3.58	33.48	3.65	32.65	3.72	31.81	3.80
32	28		37.38	3.30	36.49	3.37	35.60	3.44	34.71	3.51	33.82	3.58
41	37		39.19	3.27	38.25	3.34	37.32	3.41	36.39	3.47	35.45	3.54
47	43		41.37	3.44	40.39	3.51	39.40	3.58	38.42	3.65	37.43	3.72
50	47		42.05	3.43	41.04	3.50	40.04	3.57	39.04	3.64	38.04	3.71
59	50		44.07	3.39	43.02	3.46	41.97	3.54	40.92	3.61	39.88	3.68
68	59		44.81	2.93	43.74	2.99	42.67	3.05	41.61	3.11	40.54	3.17
75	65		47.30	2.91	46.18	2.97	45.05	3.03	43.92	3.10	42.80	3.16

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1		7.33	3.41	7.16	3.48	6.99	3.55	6.81	3.62	6.64
-10.0	-11.1		8.93	3.46	8.71	3.53	8.50	3.60	8.29	3.67	8.08	3.74
-5.0	-7.2		10.30	3.51	10.06	3.58	9.81	3.65	9.57	3.72	9.32	3.80
0.0	-2.2		10.96	3.30	10.70	3.37	10.44	3.44	10.17	3.51	9.91	3.58
5.0	2.8		11.48	3.27	11.21	3.34	10.94	3.41	10.66	3.47	10.39	3.54
8.3	6.1		12.12	3.44	11.84	3.51	11.55	3.58	11.26	3.65	10.97	3.72
10.0	8.3		12.32	3.43	12.03	3.50	11.74	3.57	11.44	3.64	11.15	3.71
15.0	10.0		12.92	3.39	12.61	3.46	12.30	3.54	11.99	3.61	11.69	3.68
20.0	15.0		13.13	2.93	12.82	2.99	12.51	3.05	12.19	3.11	11.88	3.17
23.9	18.3		13.86	2.91	13.53	2.97	13.20	3.03	12.87	3.10	12.54	3.16

## ● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu + 12,000 Btu

		Indoor temperature										
		°FDB	60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
	5	3		26.42	3.63	25.80	3.70	25.17	3.78	24.54	3.85	23.91
14	12		32.16	3.68	31.39	3.75	30.63	3.83	29.86	3.91	29.10	3.98
23	19		37.12	3.73	36.24	3.81	35.35	3.89	34.47	3.96	33.58	4.04
32	28		39.47	3.52	38.53	3.59	37.59	3.66	36.65	3.74	35.71	3.81
41	37		41.37	3.48	40.39	3.55	39.40	3.63	38.42	3.70	37.43	3.77
47	43		43.68	3.66	42.64	3.73	41.60	3.81	40.56	3.89	39.52	3.96
50	47		44.39	3.65	43.34	3.72	42.28	3.80	41.22	3.87	40.17	3.95
59	50		46.53	3.61	45.43	3.69	44.32	3.76	43.21	3.84	42.10	3.91
68	59		47.31	3.11	46.18	3.18	45.06	3.24	43.93	3.31	42.80	3.37
75	65		49.94	3.10	48.75	3.17	47.57	3.23	46.38	3.29	45.19	3.36

		Indoor temperature										
		°CDB	15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
	-15.0	-16.1		7.74	3.63	7.56	3.70	7.38	3.78	7.19	3.85	7.01
-10.0	-11.1		9.43	3.68	9.20	3.75	8.98	3.83	8.75	3.91	8.53	3.98
-5.0	-7.2		10.88	3.73	10.62	3.81	10.36	3.89	10.10	3.96	9.84	4.04
0.0	-2.2		11.57	3.52	11.29	3.59	11.02	3.66	10.74	3.74	10.47	3.81
5.0	2.8		12.13	3.48	11.84	3.55	11.55	3.63	11.26	3.70	10.97	3.77
8.3	6.1		12.80	3.66	12.50	3.73	12.19	3.81	11.89	3.89	11.58	3.96
10.0	8.3		13.01	3.65	12.70	3.72	12.39	3.80	12.08	3.87	11.77	3.95
15.0	10.0		13.64	3.61	13.31	3.69	12.99	3.76	12.66	3.84	12.34	3.91
20.0	15.0		13.87	3.11	13.54	3.18	13.20	3.24	12.87	3.31	12.54	3.37
23.9	18.3		14.64	3.10	14.29	3.17	13.94	3.23	13.59	3.29	13.24	3.36

● Indoor units: 7,000 Btu + 7,000 Btu + 9,000 Btu + 14,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	26.68	3.52	26.04	3.59	25.41	3.67	24.77	3.74	24.14	3.81		
14	12	32.47	3.57	31.70	3.65	30.92	3.72	30.15	3.80	29.38	3.87		
23	19	37.48	3.62	36.58	3.70	35.69	3.77	34.80	3.85	33.91	3.93		
32	28	39.85	3.42	38.90	3.49	37.95	3.56	37.01	3.63	36.06	3.70		
41	37	41.77	3.38	40.78	3.45	39.78	3.52	38.79	3.59	37.79	3.66		
47	43	44.10	3.55	43.05	3.63	42.00	3.70	40.95	3.77	39.90	3.85		
50	47	44.82	3.54	43.75	3.61	42.69	3.69	41.62	3.76	40.55	3.84		
59	50	46.98	3.51	45.86	3.58	44.74	3.65	43.63	3.73	42.51	3.80		
68	59	47.76	3.02	46.63	3.09	45.49	3.15	44.35	3.21	43.21	3.28		
75	65	50.42	3.01	49.22	3.07	48.02	3.14	46.82	3.20	45.62	3.26		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	7.82	3.52	7.63	3.59	7.45	3.67	7.26	3.74	7.07	3.81		
-10.0	-11.1	9.52	3.57	9.29	3.65	9.06	3.72	8.84	3.80	8.61	3.87		
-5.0	-7.2	10.98	3.62	10.72	3.70	10.46	3.77	10.20	3.85	9.94	3.93		
0.0	-2.2	11.68	3.42	11.40	3.49	11.12	3.56	10.85	3.63	10.57	3.70		
5.0	2.8	12.24	3.38	11.95	3.45	11.66	3.52	11.37	3.59	11.08	3.66		
8.3	6.1	12.92	3.55	12.62	3.63	12.31	3.70	12.00	3.77	11.69	3.85		
10.0	8.3	13.14	3.54	12.82	3.61	12.51	3.69	12.20	3.76	11.89	3.84		
15.0	10.0	13.77	3.51	13.44	3.58	13.11	3.65	12.79	3.73	12.46	3.80		
20.0	15.0	14.00	3.02	13.67	3.09	13.33	3.15	13.00	3.21	12.67	3.28		
23.9	18.3	14.78	3.01	14.43	3.07	14.07	3.14	13.72	3.20	13.37	3.26		

● Indoor units: 7,000 Btu + 7,000 Btu + 12,000 Btu + 12,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	26.68	3.66	26.04	3.74	25.41	3.82	24.77	3.89	24.14	3.97		
14	12	32.47	3.72	31.70	3.79	30.92	3.87	30.15	3.95	29.38	4.03		
23	19	37.48	3.77	36.58	3.85	35.69	3.93	34.80	4.01	33.91	4.08		
32	28	39.85	3.55	38.90	3.63	37.95	3.70	37.01	3.78	36.06	3.85		
41	37	41.77	3.52	40.78	3.59	39.78	3.66	38.79	3.74	37.79	3.81		
47	43	44.10	3.70	43.05	3.77	42.00	3.85	40.95	3.93	39.90	4.00		
50	47	44.82	3.68	43.75	3.76	42.69	3.84	41.62	3.92	40.55	3.99		
59	50	46.98	3.65	45.86	3.73	44.74	3.80	43.63	3.88	42.51	3.95		
68	59	47.76	3.15	46.63	3.21	45.49	3.28	44.35	3.34	43.21	3.41		
75	65	50.42	3.13	49.22	3.20	48.02	3.26	46.82	3.33	45.62	3.39		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	7.82	3.66	7.63	3.74	7.45	3.82	7.26	3.89	7.07	3.97		
-10.0	-11.1	9.52	3.72	9.29	3.79	9.06	3.87	8.84	3.95	8.61	4.03		
-5.0	-7.2	10.98	3.77	10.72	3.85	10.46	3.93	10.20	4.01	9.94	4.08		
0.0	-2.2	11.68	3.55	11.40	3.63	11.12	3.70	10.85	3.78	10.57	3.85		
5.0	2.8	12.24	3.52	11.95	3.59	11.66	3.66	11.37	3.74	11.08	3.81		
8.3	6.1	12.92	3.70	12.62	3.77	12.31	3.85	12.00	3.93	11.69	4.00		
10.0	8.3	13.14	3.68	12.82	3.76	12.51	3.84	12.20	3.92	11.89	3.99		
15.0	10.0	13.77	3.65	13.44	3.73	13.11	3.80	12.79	3.88	12.46	3.95		
20.0	15.0	14.00	3.15	13.67	3.21	13.33	3.28	13.00	3.34	12.67	3.41		
23.9	18.3	14.78	3.13	14.43	3.20	14.07	3.26	13.72	3.33	13.37	3.39		

OUTDOOR UNIT  
UOMH36AFXJ

● Indoor units: 7,000 Btu + 9,000 Btu + 9,000 Btu + 9,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	26.17	3.60	25.55	3.67	24.92	3.75	24.30	3.82	23.68	3.90	
14	12	31.85	3.65	31.09	3.73	30.33	3.80	29.58	3.88	28.82	3.95		
23	19	36.76	3.70	35.89	3.78	35.01	3.86	34.14	3.93	33.26	4.01		
32	28	39.09	3.49	38.16	3.56	37.23	3.63	36.30	3.71	35.37	3.78		
41	37	40.98	3.45	40.00	3.52	39.02	3.60	38.05	3.67	37.07	3.74		
47	43	43.26	3.63	42.23	3.70	41.20	3.78	40.17	3.86	39.14	3.93		
50	47	43.97	3.62	42.92	3.69	41.87	3.77	40.83	3.84	39.78	3.92		
59	50	46.09	3.58	44.99	3.66	43.89	3.73	42.79	3.81	41.70	3.88		
68	59	46.85	3.09	45.74	3.15	44.62	3.22	43.51	3.28	42.39	3.35		
75	65	49.46	3.08	48.29	3.14	47.11	3.20	45.93	3.27	44.75	3.33		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	7.67	3.60	7.49	3.67	7.30	3.75	7.12	3.82	6.94	3.90	
-10.0	-11.1	9.34	3.65	9.11	3.73	8.89	3.80	8.67	3.88	8.45	3.95		
-5.0	-7.2	10.77	3.70	10.52	3.78	10.26	3.86	10.00	3.93	9.75	4.01		
0.0	-2.2	11.46	3.49	11.18	3.56	10.91	3.63	10.64	3.71	10.37	3.78		
5.0	2.8	12.01	3.45	11.72	3.52	11.44	3.60	11.15	3.67	10.87	3.74		
8.3	6.1	12.68	3.63	12.38	3.70	12.08	3.78	11.77	3.86	11.47	3.93		
10.0	8.3	12.89	3.62	12.58	3.69	12.27	3.77	11.97	3.84	11.66	3.92		
15.0	10.0	13.51	3.58	13.19	3.66	12.86	3.73	12.54	3.81	12.22	3.88		
20.0	15.0	13.73	3.09	13.40	3.15	13.08	3.22	12.75	3.28	12.42	3.35		
23.9	18.3	14.50	3.08	14.15	3.14	13.81	3.20	13.46	3.27	13.12	3.33		

● Indoor units: 7,000 Btu + 9,000 Btu + 9,000 Btu + 12,000 Btu

		Indoor temperature											
		°FDB		60		65		70		75		78	
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	5	3	26.68	3.66	26.04	3.74	25.41	3.82	24.77	3.89	24.14	3.97	
14	12	32.47	3.72	31.70	3.79	30.92	3.87	30.15	3.95	29.38	4.03		
23	19	37.48	3.77	36.58	3.85	35.69	3.93	34.80	4.01	33.91	4.08		
32	28	39.85	3.55	38.90	3.63	37.95	3.70	37.01	3.78	36.06	3.85		
41	37	41.77	3.52	40.78	3.59	39.78	3.66	38.79	3.74	37.79	3.81		
47	43	44.10	3.70	43.05	3.77	42.00	3.85	40.95	3.93	39.90	4.00		
50	47	44.82	3.68	43.75	3.76	42.69	3.84	41.62	3.92	40.55	3.99		
59	50	46.98	3.65	45.86	3.73	44.74	3.80	43.63	3.88	42.51	3.95		
68	59	47.76	3.15	46.63	3.21	45.49	3.28	44.35	3.34	43.21	3.41		
75	65	50.42	3.13	49.22	3.20	48.02	3.26	46.82	3.33	45.62	3.39		

		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		kW		
	-15.0	-16.1	7.82	3.66	7.63	3.74	7.45	3.82	7.26	3.89	7.07	3.97	
-10.0	-11.1	9.52	3.72	9.29	3.79	9.06	3.87	8.84	3.95	8.61	4.03		
-5.0	-7.2	10.98	3.77	10.72	3.85	10.46	3.93	10.20	4.01	9.94	4.08		
0.0	-2.2	11.68	3.55	11.40	3.63	11.12	3.70	10.85	3.78	10.57	3.85		
5.0	2.8	12.24	3.52	11.95	3.59	11.66	3.66	11.37	3.74	11.08	3.81		
8.3	6.1	12.92	3.70	12.62	3.77	12.31	3.85	12.00	3.93	11.69	4.00		
10.0	8.3	13.14	3.68	12.82	3.76	12.51	3.84	12.20	3.92	11.89	3.99		
15.0	10.0	13.77	3.65	13.44	3.73	13.11	3.80	12.79	3.88	12.46	3.95		
20.0	15.0	14.00	3.15	13.67	3.21	13.33	3.28	13.00	3.34	12.67	3.41		
23.9	18.3	14.78	3.13	14.43	3.20	14.07	3.26	13.72	3.33	13.37	3.39		

OUTDOOR UNIT  
UOMH36AFXJ

● Indoor units: 9,000 Btu + 9,000 Btu + 9,000 Btu + 9,000 Btu

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	26.68	3.66	26.04	3.74	25.41	3.82	24.77	3.89	24.14	3.97		
14	12	32.47	3.72	31.70	3.79	30.92	3.87	30.15	3.95	29.38	4.03		
23	19	37.48	3.77	36.58	3.85	35.69	3.93	34.80	4.01	33.91	4.08		
32	28	39.85	3.55	38.90	3.63	37.95	3.70	37.01	3.78	36.06	3.85		
41	37	41.77	3.52	40.78	3.59	39.78	3.66	38.79	3.74	37.79	3.81		
47	43	44.10	3.70	43.05	3.77	42.00	3.85	40.95	3.93	39.90	4.00		
50	47	44.82	3.68	43.75	3.76	42.69	3.84	41.62	3.92	40.55	3.99		
59	50	46.98	3.65	45.86	3.73	44.74	3.80	43.63	3.88	42.51	3.95		
68	59	47.76	3.15	46.63	3.21	45.49	3.28	44.35	3.34	43.21	3.41		
75	65	50.42	3.13	49.22	3.20	48.02	3.26	46.82	3.33	45.62	3.39		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	7.82	3.66	7.63	3.74	7.45	3.82	7.26	3.89	7.07	3.97		
-10.0	-11.1	9.52	3.72	9.29	3.79	9.06	3.87	8.84	3.95	8.61	4.03		
-5.0	-7.2	10.98	3.77	10.72	3.85	10.46	3.93	10.20	4.01	9.94	4.08		
0.0	-2.2	11.68	3.55	11.40	3.63	11.12	3.70	10.85	3.78	10.57	3.85		
5.0	2.8	12.24	3.52	11.95	3.59	11.66	3.66	11.37	3.74	11.08	3.81		
8.3	6.1	12.92	3.70	12.62	3.77	12.31	3.85	12.00	3.93	11.69	4.00		
10.0	8.3	13.14	3.68	12.82	3.76	12.51	3.84	12.20	3.92	11.89	3.99		
15.0	10.0	13.77	3.65	13.44	3.73	13.11	3.80	12.79	3.88	12.46	3.95		
20.0	15.0	14.00	3.15	13.67	3.21	13.33	3.28	13.00	3.34	12.67	3.41		
23.9	18.3	14.78	3.13	14.43	3.20	14.07	3.26	13.72	3.33	13.37	3.39		


● Indoor units: 18,000 Btu + 18,000 Btu (with optional kit RXK9FZ1818)

Outdoor temperature		Indoor temperature											
		°FDB		60		65		70		75		78	
		°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW
5	3	25.41	3.66	24.80	3.74	24.20	3.82	23.59	3.89	22.99	3.97		
14	12	30.92	3.72	30.19	3.79	29.45	3.87	28.71	3.95	27.98	4.03		
23	19	35.69	3.77	34.84	3.85	33.99	3.93	33.14	4.01	32.29	4.08		
32	28	37.95	3.55	37.05	3.63	36.15	3.70	35.24	3.78	34.34	3.85		
41	37	39.78	3.52	38.84	3.59	37.89	3.66	36.94	3.74	35.99	3.81		
47	43	42.00	3.70	41.00	3.77	40.00	3.85	39.00	3.93	38.00	4.00		
50	47	42.69	3.68	41.67	3.76	40.65	3.84	39.64	3.91	38.62	3.99		
59	50	44.74	3.65	43.68	3.73	42.61	3.80	41.55	3.88	40.48	3.95		
68	59	45.49	3.15	44.41	3.21	43.32	3.28	42.24	3.34	41.16	3.41		
75	65	48.02	3.13	46.88	3.20	45.74	3.26	44.59	3.33	43.45	3.39		

Outdoor temperature		Indoor temperature											
		°CDB		15.6		18.3		21.2		23.9		25.6	
		°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
				kW		kW		kW		kW		kW	
-15.0	-16.1	7.45	3.66	7.27	3.74	7.09	3.82	6.91	3.89	6.74	3.97		
-10.0	-11.1	9.06	3.72	8.85	3.79	8.63	3.87	8.42	3.95	8.20	4.03		
-5.0	-7.2	10.46	3.77	10.21	3.85	9.96	3.93	9.71	4.01	9.46	4.08		
0.0	-2.2	11.12	3.55	10.86	3.63	10.59	3.70	10.33	3.78	10.06	3.85		
5.0	2.8	11.66	3.52	11.38	3.59	11.10	3.66	10.83	3.74	10.55	3.81		
8.3	6.1	12.31	3.70	12.02	3.77	11.72	3.85	11.43	3.93	11.14	4.00		
10.0	8.3	12.51	3.68	12.21	3.76	11.91	3.84	11.62	3.91	11.32	3.99		
15.0	10.0	13.11	3.65	12.80	3.73	12.49	3.80	12.18	3.88	11.86	3.95		
20.0	15.0	13.33	3.15	13.01	3.21	12.70	3.28	12.38	3.34	12.06	3.41		
23.9	18.3	14.07	3.13	13.74	3.20	13.40	3.26	13.07	3.33	12.73	3.39		

OUTDOOR UNIT UOMH36AFXJ

# 7. Capacity compensation rate for pipe length and height difference

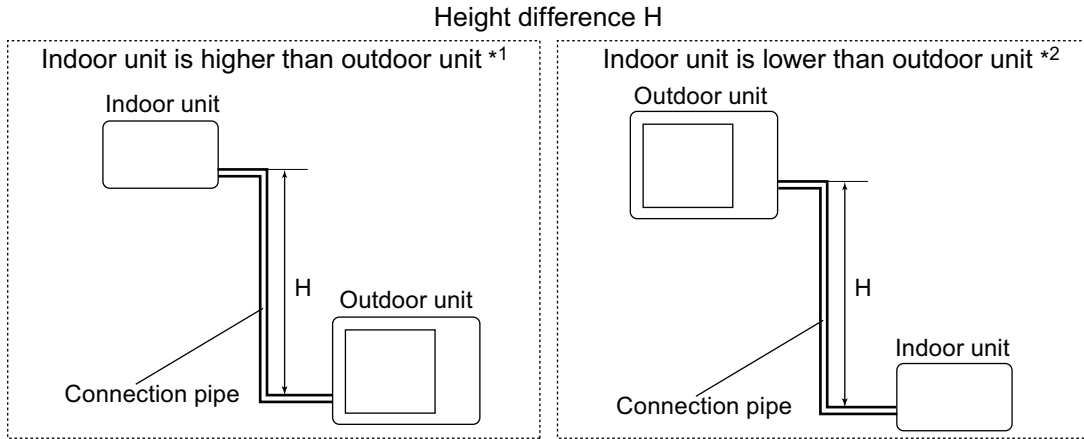

## 7-1. Model: UOMH36AFXZJ

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

### ■ Indoor unit: 7,000 Btu

COOLING		Pipe length							
		m	ft	5	7.5	10	15	20	25
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.955	0.941	0.927
		10	33	-	-	0.976	0.962	0.949	0.935
		7.5	25	-	0.988	0.980	0.966	0.952	0.939
		5	16	0.995	0.992	0.984	0.970	0.956	0.942
		0	0	1.003	1.000	0.992	0.978	0.964	0.950
	Indoor unit is lower than outdoor unit *2	-5	-16	1.003	1.000	0.992	0.978	0.964	0.950
		-7.5	-25	-	1.000	0.992	0.978	0.964	0.950
		-10	-33	-	-	0.992	0.978	0.964	0.950
		-15	-49	-	-	-	0.978	0.964	0.950

HEATING		Pipe length							
		m	ft	5	7.5	10	15	20	25
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.976	0.957	0.938
		10	33	-	-	0.991	0.976	0.957	0.938
		7.5	25	-	1.000	0.991	0.976	0.957	0.938
		5	16	0.990	1.000	0.991	0.976	0.957	0.938
		0	0	0.990	1.000	0.991	0.976	0.957	0.938
	Indoor unit is lower than outdoor unit *2	-5	-16	0.985	0.995	0.986	0.971	0.952	0.933
		-7.5	-25	-	0.993	0.984	0.969	0.950	0.931
		-10	-33	-	-	0.981	0.966	0.947	0.929
		-15	-49	-	-	-	0.961	0.943	0.924

## ■ Indoor unit: 9,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.956	0.942	0.928
		10	33	-	-	0.977	0.963	0.950	0.936
		7.5	25	-	0.988	0.981	0.967	0.954	0.940
		5	16	0.999	0.992	0.985	0.971	0.957	0.943
	Indoor unit is lower than outdoor unit *2	0	0	1.007	1.000	0.993	0.979	0.965	0.951
		-5	-16	1.007	1.000	0.993	0.979	0.965	0.951
		-7.5	-25	-	1.000	0.993	0.979	0.965	0.951
		-10	-33	-	-	0.993	0.979	0.965	0.951
		-15	-49	-	-	-	0.979	0.965	0.951

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.977	0.958	0.939
		10	33	-	-	0.993	0.977	0.958	0.939
		7.5	25	-	1.000	0.993	0.977	0.958	0.939
		5	16	0.993	1.000	0.993	0.977	0.958	0.939
	Indoor unit is lower than outdoor unit *2	0	0	0.993	1.000	0.993	0.977	0.958	0.939
		-5	-16	0.988	0.995	0.988	0.972	0.954	0.934
		-7.5	-25	-	0.993	0.986	0.970	0.952	0.932
		-10	-33	-	-	0.983	0.967	0.949	0.930
		-15	-49	-	-	-	0.962	0.944	0.925

## ■ Indoor unit: 12,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.937	0.912	0.888
		10	33	-	-	0.970	0.944	0.919	0.896
		7.5	25	-	0.988	0.974	0.948	0.923	0.899
		5	16	1.006	0.992	0.978	0.952	0.927	0.903
	Indoor unit is lower than outdoor unit *2	0	0	1.014	1.000	0.986	0.960	0.934	0.910
		-5	-16	1.014	1.000	0.986	0.960	0.934	0.910
		-7.5	-25	-	1.000	0.986	0.960	0.934	0.910
		-10	-33	-	-	0.986	0.960	0.934	0.910
		-15	-49	-	-	-	0.960	0.934	0.910

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.977	0.958	0.938
		10	33	-	-	0.993	0.977	0.958	0.938
		7.5	25	-	1.000	0.993	0.977	0.958	0.938
		5	16	0.995	1.000	0.993	0.977	0.958	0.938
	Indoor unit is lower than outdoor unit *2	0	0	0.995	1.000	0.993	0.977	0.958	0.938
		-5	-16	0.990	0.995	0.988	0.972	0.953	0.933
		-7.5	-25	-	0.993	0.986	0.970	0.952	0.932
		-10	-33	-	-	0.983	0.967	0.949	0.929
		-15	-49	-	-	-	0.962	0.944	0.924

## ■ Indoor unit: 14,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.955	0.937	0.922
		10	33	-	-	0.974	0.962	0.945	0.930
		7.5	25	-	0.988	0.978	0.966	0.948	0.934
		5	16	0.997	0.992	0.982	0.970	0.952	0.937
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	1.005	1.000	0.990	0.978	0.960	0.945
		-5	-16	1.005	1.000	0.990	0.978	0.960	0.945
		-7.5	-25	-	1.000	0.990	0.978	0.960	0.945
		-10	-33	-	-	0.990	0.978	0.960	0.945
		-15	-49	-	-	-	0.978	0.960	0.945

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.972	0.945	0.919
		10	33	-	-	0.992	0.972	0.945	0.919
		7.5	25	-	1.000	0.992	0.972	0.945	0.919
		5	16	1.000	1.000	0.992	0.972	0.945	0.919
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	1.000	1.000	0.992	0.972	0.945	0.919
		-5	-16	0.995	0.995	0.987	0.967	0.940	0.914
		-7.5	-25	-	0.993	0.985	0.965	0.938	0.912
		-10	-33	-	-	0.982	0.962	0.935	0.910
		-15	-49	-	-	-	0.957	0.930	0.905

## ■ Indoor unit: 18,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.968	0.961	0.954
		10	33	-	-	0.982	0.976	0.969	0.962
		7.5	25	-	0.988	0.986	0.980	0.973	0.966
		5	16	0.994	0.992	0.990	0.984	0.977	0.970
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	1.002	1.000	0.998	0.992	0.985	0.978
		-5	-16	1.002	1.000	0.998	0.992	0.985	0.978
		-7.5	-25	-	1.000	0.998	0.992	0.985	0.978
		-10	-33	-	-	0.998	0.992	0.985	0.978
		-15	-49	-	-	-	0.992	0.985	0.978

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.967	0.943	0.917
		10	33	-	-	0.990	0.967	0.943	0.917
		7.5	25	-	1.000	0.990	0.967	0.943	0.917
		5	16	1.010	1.000	0.990	0.967	0.943	0.917
Height difference H (m)	Indoor unit is lower than outdoor unit *2	0	0	1.010	1.000	0.990	0.967	0.943	0.917
		-5	-16	1.005	0.995	0.985	0.962	0.938	0.912
		-7.5	-25	-	0.993	0.983	0.960	0.936	0.910
		-10	-33	-	-	0.980	0.958	0.933	0.908
		-15	-49	-	-	-	0.953	0.929	0.903

## ■ Indoor unit: 24,000 Btu

COOLING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.978	0.969	0.953
		10	33	-	-	0.986	0.986	0.977	0.961
		7.5	25	-	0.988	0.990	0.990	0.981	0.965
		5	16	0.989	0.992	0.994	0.994	0.984	0.968
	0	0	0.997	1.000	1.002	1.002	0.992	0.976	
Indoor unit is lower than outdoor unit *2	-5	-16	0.997	1.000	1.002	1.002	0.992	0.976	
	-7.5	-25	-	1.000	1.002	1.002	0.992	0.976	
	-10	-33	-	-	1.002	1.002	0.992	0.976	
	-15	-49	-	-	-	1.002	0.992	0.976	

HEATING		Pipe length							
			m	5	7.5	10	15	20	25
		m	ft	16	25	33	49	66	82
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.964	0.939	0.913
		10	33	-	-	0.988	0.964	0.939	0.913
		7.5	25	-	1.000	0.988	0.964	0.939	0.913
		5	16	1.008	1.000	0.988	0.964	0.939	0.913
	0	0	1.008	1.000	0.988	0.964	0.939	0.913	
Indoor unit is lower than outdoor unit *2	-5	-16	1.003	0.995	0.983	0.959	0.934	0.909	
	-7.5	-25	-	0.993	0.981	0.957	0.932	0.907	
	-10	-33	-	-	0.978	0.954	0.929	0.904	
	-15	-49	-	-	-	0.949	0.925	0.899	

OUTDOOR UNIT  
 UOMH36AFXZJ



## 8. Additional charge calculation

### 8-1. Model: UOMH36AFXZJ

Refrigerant type		R410A
Refrigerant amount	lb oz	7 lb 1 oz
	g	3,200

#### ■ Refrigerant charge

- **3 or 4 indoor units are connected:**

Total pipe length	ft	164 or less	197	230 (Max.)	0.22 oz/ft (20 g/m)
	m	50 or less	60	70 (Max.)	
Additional charge	lb oz	0	7.1 oz	14.1 oz	
	g	0	200	400	

- **2 indoor units are connected (with optional kit RXK9FZ1818):**

Total pipe length	ft	65 or less	98	131 (Max.)	0.27 oz/ft (25 g/m)
	m	20 or less	30	40 (Max.)	
Additional charge	lb oz	0	8.9 oz	1 lb 1.8 oz	
	g	0	250	500	

---

## 9. Airflow

---

### 9-1. Model: UOMH36AFXZJ

#### ● Cooling

m <sup>3</sup> /h	3,600
l/s	1,000
CFM	2,119

#### ● Heating


m <sup>3</sup> /h	3,800
l/s	1,056
CFM	2,237

# 10. Operation noise (sound pressure)


## 10-1. Noise level curve

■ Model: UOMH36AFXZJ


● Cooling

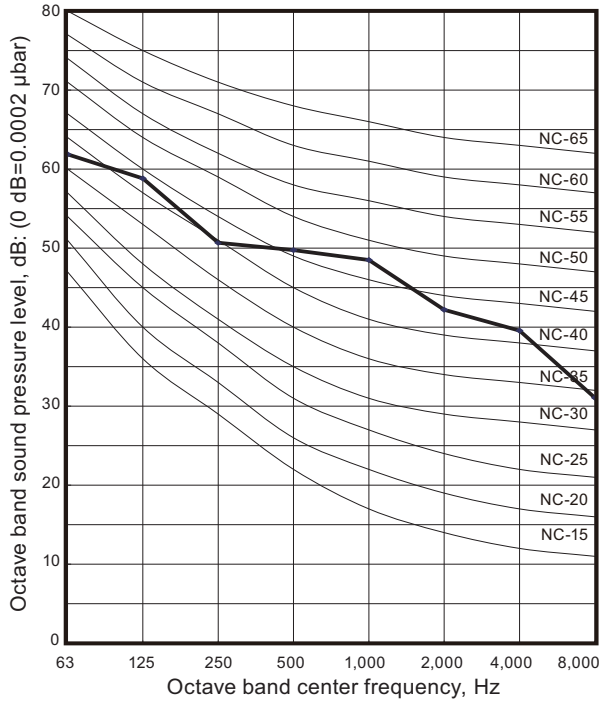

● Heating

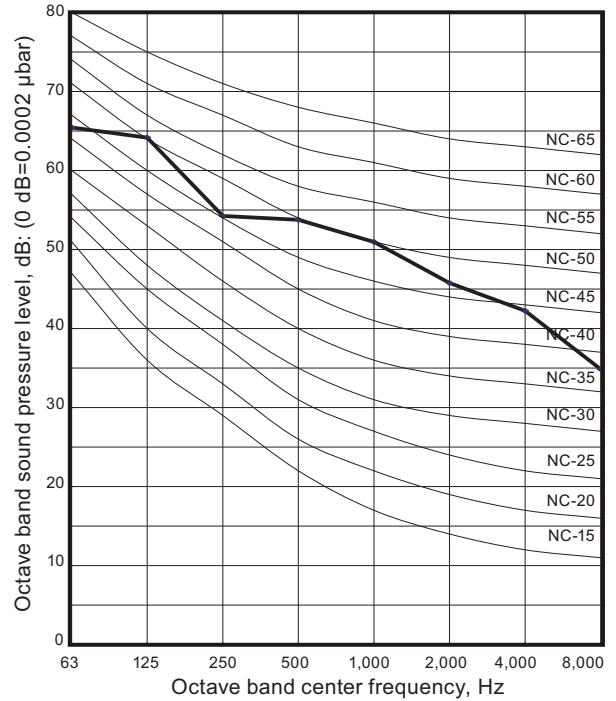

## 10-2. Sound level check point

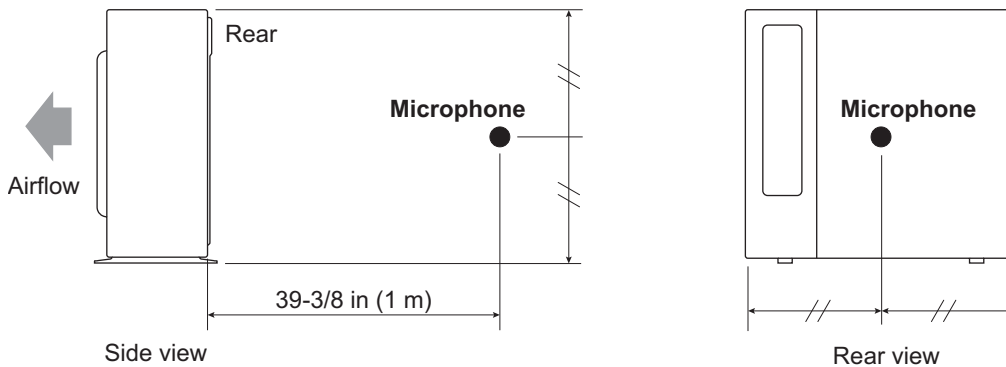

**NOTE:** Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.

OUTDOOR UNIT  
UOMH36AFXZJ

## 11. Electrical characteristics

Model name			UOMH36AFXZJ
Power supply	Voltage	V	208/230 ~
	Frequency	Hz	60
MCA *1		A	24.6
Starting current		A	17.1
Wiring spec. *2	MAX. CKT. BKR *3	A	30
	Power cable	AWG	10

\*1: Minimum Circuit Ampacity (Calculation based on UL1995)

\*2: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005.  
As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.






\*3: Maximum Circuit Breaker

## 12. Safety devices


Type of protection	Protection form		Model
			UOMH36AFXZJ
Circuit protection	Current fuse (Main PCB)		250 V, 5 A 250 V, 3.15 A
	Current fuse (Near the terminal)		250 V, 10 A
Fan motor protection	Temperature thermistor	Activate	251 ±16 °F (122 ±9 °C) Fan motor stop
		Reset	240 <sup>+18</sup> <sub>-16</sub> °F (116 <sup>+10</sup> <sub>-9</sub> °C) Fan motor restart
Compressor protection	Temperature thermistor	Activate	226 ±4 °F (108 ±2 °C) Compressor stop
		Reset	176 ±4 °F (80 ±2 °C) Compressor restart
Refrigerant circuit protection	Pressure switch 1	Activate	609 ±15 PSI (4.2 ±0.1 MPa)
		Reset	464 ±22 PSI (3.2 ±0.15 MPa)

\*Pressure switch 2: For control device. (Refer to the wiring diagram.)

## 13. Accessories

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Adapter assembly, 1/2 (12.7)→3/8 (9.52) [in (mm)]		1
Drain cap		5	Adapter assembly, 1/2 (12.7)→5/8 (15.88) [in (mm)]		1
Drain pipe		1			


## 14. Optional parts

Exterior	Part name	Model name	Summary
 <p>x 4                      x 1</p>	Adapter kit	RXK9FZ1818	<p><b>For 2 rooms combination system</b></p> <p>It can exchange liquid pipe size <math>\text{Ø}1/4</math> in (<math>\text{Ø}6.35</math> mm) for <math>\text{Ø}3/8</math> in (<math>\text{Ø}9.52</math> mm), and <math>\text{Ø}3/8</math> in (<math>\text{Ø}9.52</math> mm) for <math>\text{Ø}1/2</math> in (<math>\text{Ø}12.70</math> mm).</p> <p>If you choose 2-indoor-units system "18,000 Btu + 18,000 Btu", then you need this kit.</p>


### 14-1. 2 rooms combination (with optional part RXK9FZ1818)

: Note that the hatching items are different from those of 3 or 4 rooms combination.

#### ■ Size of piping

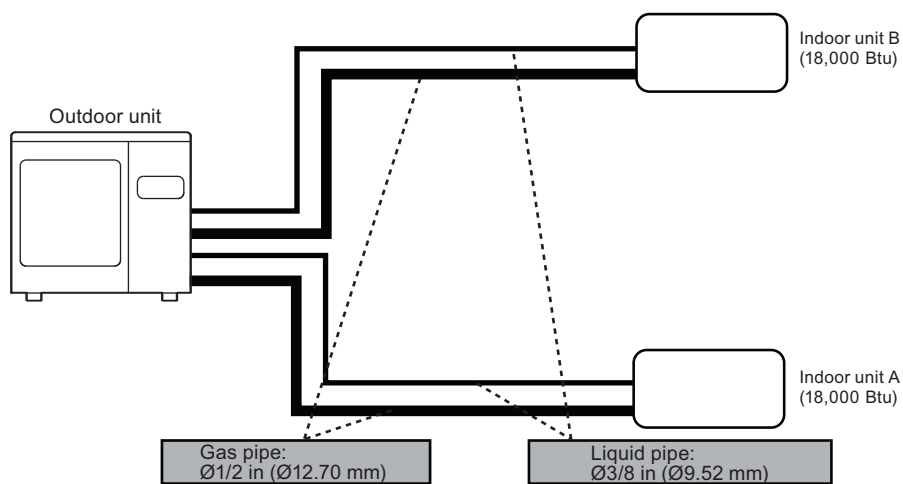

## ■ How to use the adapter (optional part RXK9FZ1818)

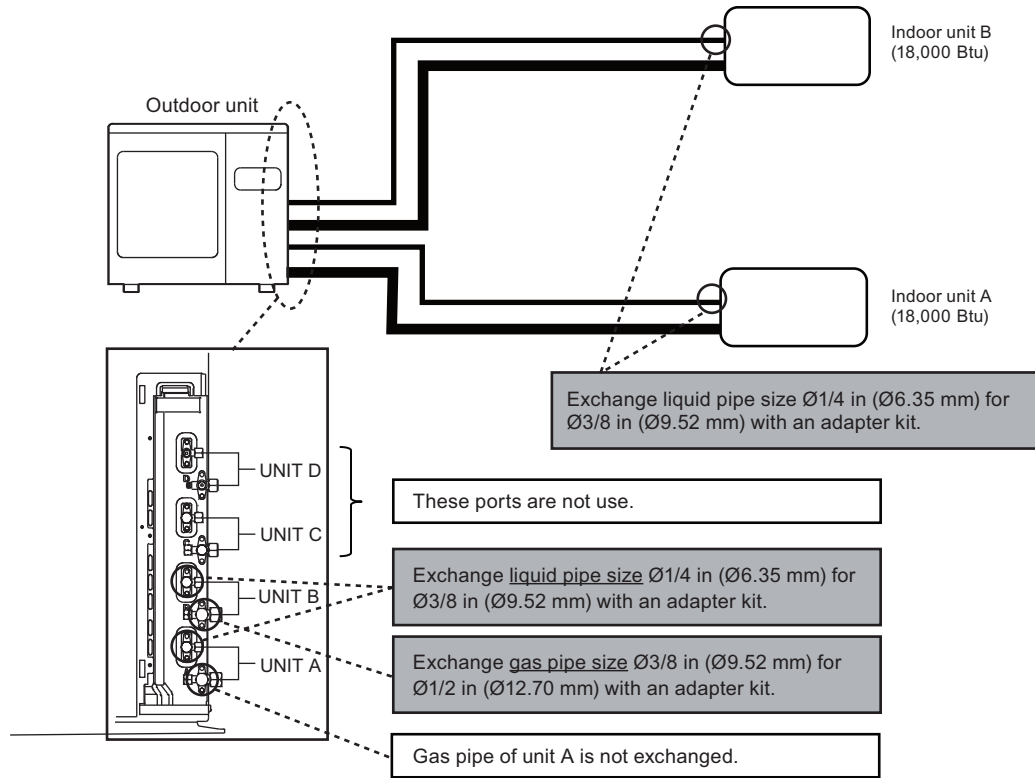

OUTDOOR UNIT  
UOMH36AFXZJ

## ■ Connection pipe length

Max.	Total	ft (m)	131 (40)
	Each unit		82 (25)
Min.	Total		49 (15)
	Each unit		25 (7.5)

## ■ Refrigerant charge

Pipe length (Total)	ft	65 or less	98	131 (Max.)	0.27 oz/ft 25 g/m
	m	20 or less	30	40 (Max.)	
Additional charge	lb oz	0	8.9 oz	1 lb 1.8 oz	
	g	0	250	500	



## 15. Outdoor unit installation precautions

**NOTE:** The information listed below are general precautions.  
Some models also include items that do not apply.

### 15-1. Place where prohibited for use

- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places not affected by heat radiation from other heat sources.
- Places where the air is not stagnant.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are product.

### 15-2. Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the outdoor unit.
- To allow maintenance after refrigerant piping, drain piping, and electric wiring connection and installation, provide an installation service space.  
\*Installation service space is shown in "[Installation space](#)" on page 152.
- Be careful when installing the set at the following places.

Condition	Contents	Countermeasures (Reference)
When installed near adjacent houses.	Perform installation work so that operating sound does not disturb the neighbors.	<ol style="list-style-type: none"> <li>1. Install a soundproof barrier.</li> <li>2. Change the installation site.</li> </ol>
When there is the possibility of strong wind.	<ul style="list-style-type: none"> <li>• If the outdoor unit is exposed to strong wind, capacity may drop, frost may form during heating, and operation may be stopped by high pressure rise. In addition, when a very strong wind blows, the fan may be damaged.</li> <li>• When a very strong wind blows, there is the possibility of the outdoor unit being toppled over if held only by foundation bolts.</li> </ul>	<ol style="list-style-type: none"> <li>1. Install the outdoor unit with keeping a sufficient distance between the outlet side of the unit and a facing wall or fence.</li> <li>2. Make the outlet direction and wind direction perpendicular.</li> <li>3. Fasten the outdoor unit using toppling prevention hardware (purchased locally).</li> </ol>
When snow accumulates.	If the outdoor unit is covered by accumulated snow, it may not be able to operate.	<ol style="list-style-type: none"> <li>1. Make the foundation as high as possible.</li> <li>2. Perform snow prevention work.</li> </ol>
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.